

FUNCTIONAL SERVICING REPORT

HILLSBURGH HEIGHTS INC

PROPOSED RESIDENTIAL SUBDIVISION

**5916 Trafalgar Road
Hillsburgh Urban Area**

Town of Erin

County of Wellington

August 3, 2022 (2nd submission)



CANDEVCON LIMITED
CONSULTING ENGINEERS & PLANNERS

TEL (905) 794-0600

FAX (905) 794-0611



PROJECT NO. W21081

Contents

1. INTRODUCTION	3
2. BACKGROUND TECHNICAL STUDIES	4
2.1 Town of Erin Servicing and Settlement Master Plan	4
2.3 Town of Erin Urban Centre Water Servicing Schedule B Class Environmental Assessment	2
2.4 5916 Trafalgar Road North, Environmental Impact Assessment	2
3. EXISTING CONDITIONS	2
3.1 General.....	2
3.2 Topography, Drainage and Natural Features	2
3.3 Physiography and Geotechnical Conditions.....	3
4. SANITARY AND WATER SERVICING	4
4.1 Sanitary.....	4
4.1.1 Existing Sanitary Sewers	4
4.1.2 Proposed Sanitary Sewer System.....	4
4.2 Water	5
4.2.1 Existing and Planned Watermains.....	5
4.2.2 Proposed Watermain System	5
5. STORM DRAINAGE AND STORMWATER MANAGEMENT	6
5.1 General.....	6
5.2 Storm Drainage System.....	6
5.2.1 Design Criteria.....	6
5.2.2 Proposed Storm Sewer System.....	6
5.3 Stormwater Management.....	6
5.3.2 Minor System Design.....	7
5.3.3 Grading.....	8
5.3.4 Existing Drainage	8
5.3.5 Requirements for Design of Stormwater Management Facilities	9
5.4 Water Balance	14
6 WELL HEAD PROTECTION	14
7. EROSION AND SEDIMENT CONTROL	16

FIGURES

- FIGURE 1 Location Plan
FIGURE 2 Well Head Protection

DRAWINGS

Subdivision Draft Plan (Candevcon Limited.)

DRAWING PS-1	Preliminary Servicing Plan
DRAWING ST-1	Storm Drainage Plan
DRAWING SA-1	Sanitary Drainage Plan
DRAWING WM-1	Watermain Plan
DRAWING EX-DR-1	Pre Development Drainage Areas
DRAWING SWM-1	Pond Details
DRAWING GR-1	Preliminary Grading Plan
DRAWING ESC-1	Erosion and Sediment Control Plan
DRAWING ESC-1A	Erosion and Sediment Control Details

APPENDICES

APPENDIX "A"	Sanitary Sewer Design Sheet
APPENDIX "B"	Storm Sewer Design Sheets
APPENDIX "C"	Preliminary Geotechnical Investigation Report
APPENDIX "D"	Hydrogeological Report
APPENDIX "E"	Storm Water Management Calculations
APPENDIX "F"	Stittmater SWM Report

1. INTRODUCTION


This Study has been prepared as a technical document in support of the Draft Plan application for Hillsburg Heights Inc and addresses sanitary, storm and water servicing and stormwater management.

The proposed subdivision is located at 5916 Trafalgar Road North in the former Village of Hillsburg, Town of Erin, as shown on Figure 1.

The subdivision, as illustrated on the Draft Plan (copy attached) comprises an area of 40.4 ha and includes:

- One Hundred Ninety Five (195) Single Detached Residential Units;
- One Hundred Seventy Four (174) Residential Townhouse Units;
- One (1) School Block;
- Two (2) SWM Pond Blocks;
- One (1) Park Block;
- One (1) Future Residential Block
- One (1) Future Commercial Block
- One (1) Vista Block
- One (1) Walkway Block
- One (1) Heritage House Block

The report describes the existing site conditions, and the proposed sanitary, storm and water systems, as well as the stormwater management infrastructure. The report includes preliminary grading information and outlines the required Erosion and Sediment Control Measures.

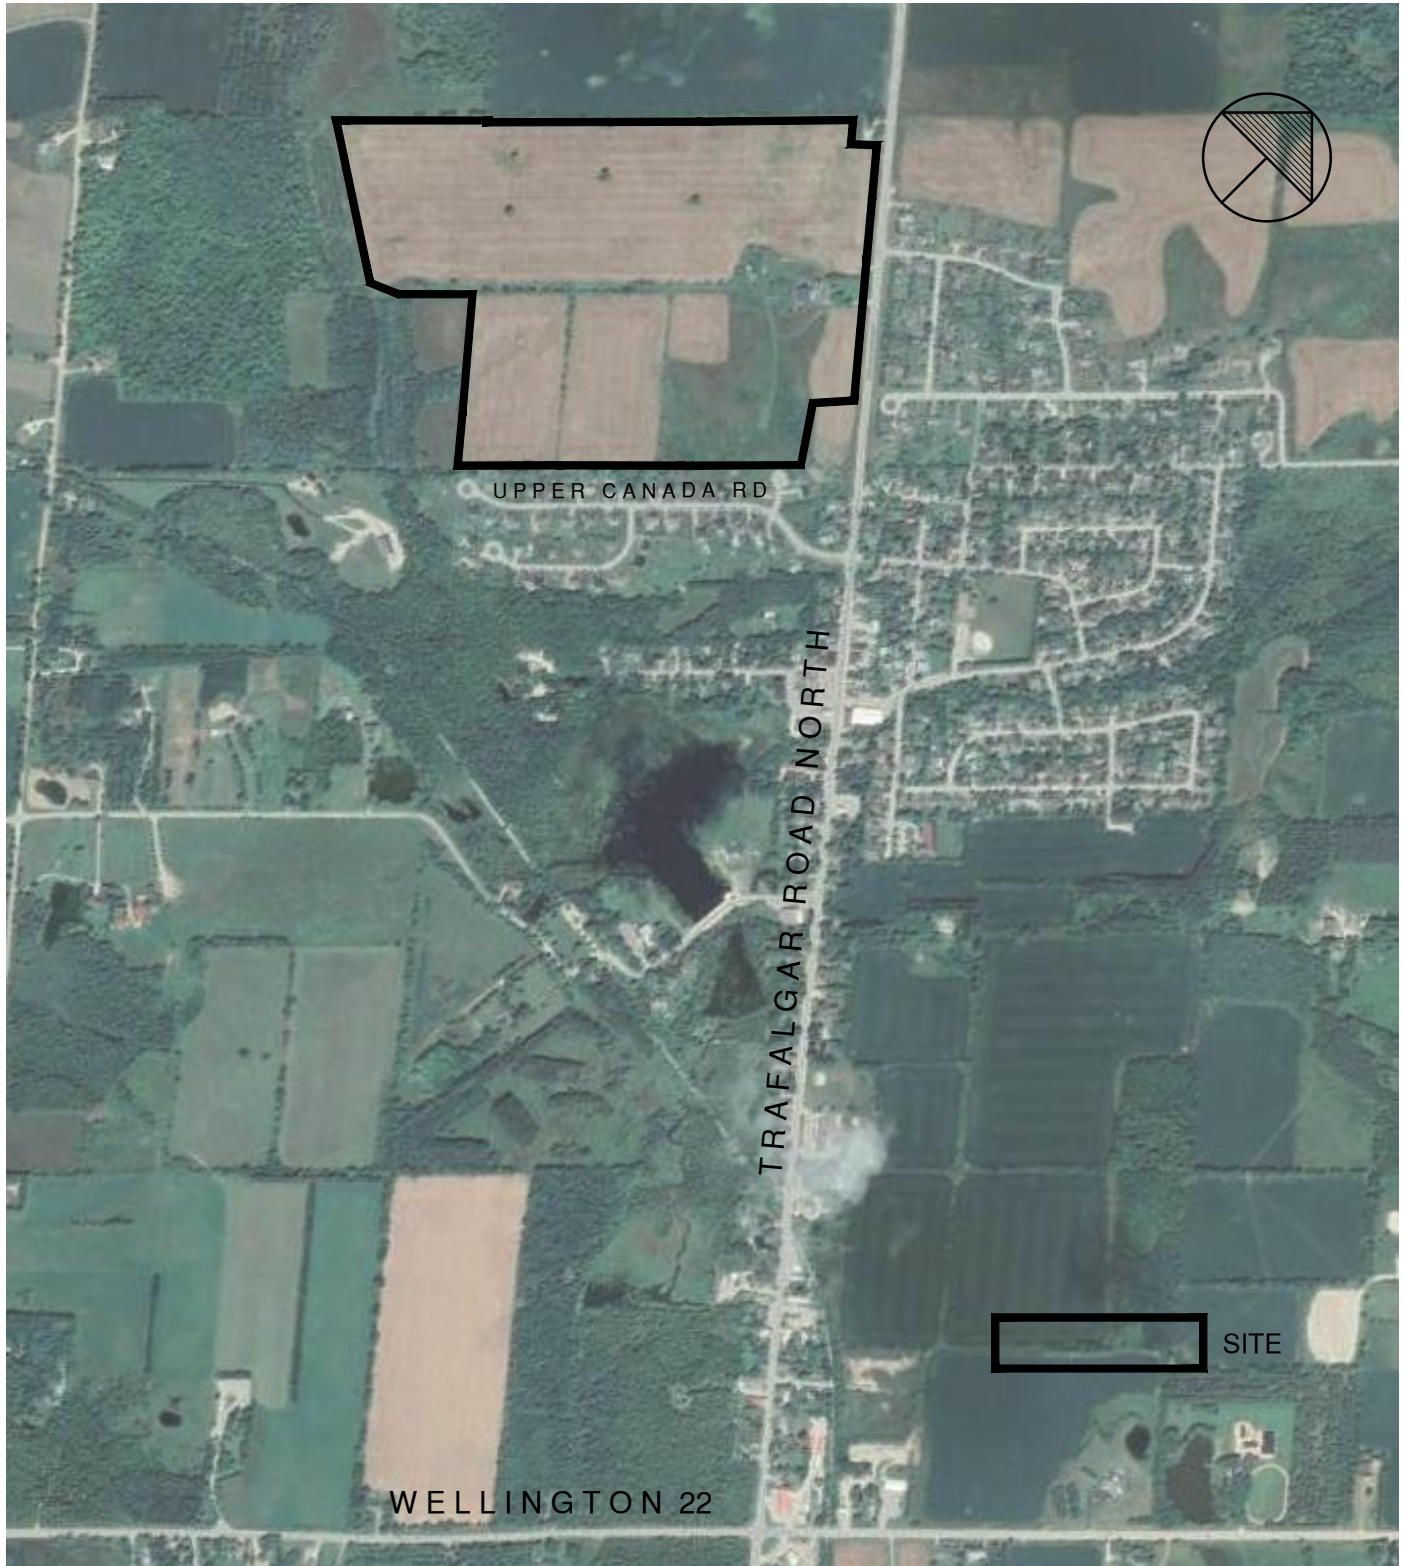

HILLSBURGH HEIGHTS INC.
RESIDENTIAL SUBDIVISION
5616 TRAFALGAR ROAD NORTH
PART 1 OF PLAN 61R-9590
PART OF LOT 26, CONCESSION 7
HILLSBURGH URBAN AREA
TOWN OF ERIN
LOCATION PLAN


CANDEVCON LIMITED
 CONSULTING ENGINEERS AND PLANNERS

TEL. (905) 794-FRANC(905) 794-0611

DATE	OCT. 1st, 2021	JOB No	W21081
DRAWN	E.A.M	SKETCH No.	1.0
SCALE	N.T.S		

2. BACKGROUND TECHNICAL STUDIES

The subject subdivision is located in the former Village of Hillsburgh in the Town of Erin. In the past seven years the Town has conducted a number of studies to review sanitary and water servicing within the Town, and the recommendations of the studies are outlined below.

2.1 Town of Erin Servicing and Settlement Master Plan¹

The Town of Erin commissioned a Servicing and Settlement Master Plan (SSMP) that was completed by B. M. Ross in 2014. The study reviewed both water and sanitary servicing requirements to meet future population forecasts to the year 2035. The key recommendations of the Master Plan were:

- The Town of Erin move forward with the remaining phases of the Class EA process to develop an undertaking to provide a sanitary sewage collection system for the settlement areas of Hillsburgh and Erin based on the servicing scenarios reviewed in the report.
- That the Town of Erin initiates the process of seeking out senior government funding assistance for this undertaking. The SSMP can be used as a supporting document to build a case that this undertaking would provide considerable economic, health, and environmental benefits to the Town. It is necessary to be ready to take advantage of any new funding programs that are introduced by the government.
- That the Town undertakes water servicing upgrades as defined in this report, so that appropriate facilities are in place when required to service future growth.
- That the Town review and amend its Official Plan as needed to implement the SSMP and allocate growth within its urban boundaries. Similarly, the County of Wellington should revise its Official Plan to reflect the Town's capacity to provide wastewater service, and adjust population forecasts accordingly.
- That the Town should apply stormwater management policies, as discussed in this report, to manage new growth areas and to address deficiencies with

¹ Town of Erin Servicing and Settlement Master Plan Final Report, B. M. Ross, August 12, 2014,

existing stormwater management.

2.2 **Town of Erin, Urban Centre Wastewater Servicing Class Environmental Assessment²**

The town of Erin commissioned a Class Environmental Assessment to review sanitary sewer servicing options by Ainley and Associates which was approved by the MECP in August, 2019. The recommendations of the report were:

- construct a sanitary collection system within the Villages of Hillsburg and Erin
- construct a sanitary treatment plant with tertiary treatment to treat effluent from both Hillsburg and Erin.

The town has initiated the design of the sewage treatment plant and collection system with the goal of having the infrastructure in place by 2023.

2.3 **Town of Erin Urban Centre Water Servicing Schedule B Class Environmental Assessment³**

The Town of Erin commissioned a Class Environmental Assessment by Triton Engineering to review water supply options completed in 2020. The study was approved by the MECP on August 31, 2020. The Class EA study reviewed both current and future water needs and recommended the following:

- install two additional supply wells
- construct watermains to interconnect both Erin and Hillsburgh

² Town of Erin, Urban Centre Wastewater Servicing Class Environmental Assessment, Ainley, October 2019

³ Town of Erin Urban Centre Water Servicing Schedule B Class Environmental Assessment, triton Engineering Services Limited, February 28, 2020

2.4 5916 Trafalgar Road North, Environmental Impact Assessment⁴

A part of the planning process an Environmental Impact Assessment Study was conducted for the site. The Study did not identify any environmentally sensitive land uses on the site.

The recommendations can be summarized as follows

- all works shall be contained within the property boundaries
- Sediment and erosion controls be in place prior to any earth works

⁴ 5916 Trafalgar Road North Environmental Impact Study, Birks Natural heritage Consultants, File 02-016-2021, November 1, 2021

3. EXISTING CONDITIONS

3.1 General

As part of the Planning process for the subject subdivision the following Studies were completed:

- Preliminary Geotechnical Investigation⁵
- Preliminary Hydrogeological Investigation⁶

3.2 Topography, Drainage and Natural Features

The terrain of the subject subdivision is rolling. The west half of the site drains to an existing low area to the west. The east half drains south to an existing storm sewer system and SWM pond located on McMurchy Lane. The west side drains to an existing wet land to the west.

⁵ Report to Cedar City Developments, Preliminary Geotechnical Investigation for Proposed Residential Development, 5916 Trafalgar Road North, Town of Erin (Hillsburgh), October 2020, Soil Engineers Limited, Reference Number 2009-S020

⁶ Hydrogeological Investigation, Proposed Briarwood Hillsburgh Development, 5916 Trafalgar Road North, town of Erin, Ontario, November 17 2021, 2021, HLV2K Engineering Limited, Project Number 2100428AH

3.3 Physiography and Geotechnical Conditions

The preliminary Geotechnical Investigation (copy of report including in Appendix “C”) indicated that the surficial soils beneath the of 250-300mm thick topsoil layer consists of Sandy Silt/Silty Sand till ranging in depths of 2 to 6m over a sand layer to the extent of the borehole depths.

The Hydrogeological Investigation (copy of report included in Appendix “D”) indicated groundwater levels are in excess of 7.8m below grade.

4. **SANITARY AND WATER SERVICING**

4.1 **Sanitary**

4.1.1 **Existing Sanitary Sewers**

The village of Hillsburgh is presently served with septic systems to treat sewage. There is no municipal sewage collection system

4.1.2 **Proposed Sanitary Sewer System**

As noted in section 2.2, the Town is proposing to install a sanitary collection system in the Village of Hillsburgh. The sanitary sewers will be designed in accordance with the Town of Erin Municipal Servicing Standards, April 2007

The town intends to extend a sanitary sewer on Trafalgar Road to the intersection of Upper Canada Drive. It is proposed to outlet the proposed sanitary sewers servicing the subdivision via a sanitary sewer to be constructed within McMurchy Lane and Upper Canada Drive to connect to the proposed sanitary sewer at the intersection of Trafalgar Road and Upper Canada Drive. The sewers within Upper Canada Drive shall be sized to accommodate the lands upstream on Upper Canada Drive .

The preliminary design of the sanitary sewer is shown on Drawing SA-1 and the Sanitary Sewer Design Sheets are included in Appendix "A".

4.2 Water

4.2.1 Existing and Planned Watermains

The existing watermain system in the vicinity of the subject subdivision is shown on Drawing PS-1 and comprises a 150mm watermain on Upper Canada Drive and a 150mm watermain located at the intersection of Upper Canada Drive and Trafalgar Road North

4.2.2 Proposed Watermain System

The proposed watermain system is shown on Drawing PS-1 and Drawing WM-1 and comprises of a 150 and 200mm watermain throughout the subdivision and the extension of the existing 150mm watermain at Upper Canada Drive and Trafalgar North on Trafalgar Road north to Street A.

Connection points to the Town system will be at the intersection of Streets E and A with Trafalgar Road North and at the western limit of Upper Canada Drive.

5. STORM DRAINAGE AND STORMWATER MANAGEMENT

5.1 General

As shown on drawing PS-1 storm water will drain to two SWM ponds located within the proposed subdivision.

5.2 Storm Drainage System

5.2.1 Design Criteria

The proposed storm system design will comply with the Town of Erin Standards which is described as follows:

Minor system; 1/5 year local sewers
 1/10 high value commercial development, downtown and
 Trunk collectors

Based on the above storm sewers within the subdivision will be designed to the 1/5 year storm

5.2.2 Proposed Storm Sewer System

The proposed storm sewer system is shown on Drawing PS-1 and STM-1. as outlines in Section 5.1 the storm sewers will outlet to SWM Ponds 1 and 2. Overland flow will be conveyed within the road rights of way (subject to a maximum ponding depth of 0.3m).

5.3 Stormwater Management

The subject site is located within the watershed of the Credit River. The stormwater management criteria for this development have been set based on requirements and discussion with the Town of Erin and Credit Valley Conservation. The requirements include:

- Stormwater quantity controls are required for the site to control post-development flows from the site to the pre-development conditions for the 5-year to the 100-year storm.
- Stormwater quality control is to be provided for the developing area for an Enhanced Protection level.

As outlined in Section 5.3.2, storm drainage from the subject subdivision will drain to ponds 1 and 2. This report outlines the preliminary design of those ponds.

5.3.2 Minor System Design

As per the Town's engineering design criteria, the proposed development is to be serviced with a minor storm sewer system designed to convey a 5-year storm event with provision of overland flow to accommodate the 100-Year storm event. The rainfall intensity value, I, are calculated in accordance with the 2010 IDF data for Malton, which was obtained from the MTO IDF Lookup tool. Based on this data, the rainfall intensity for the 5 and 100-year rainfall events is provided as follows :

Return period	<u>2-Yr</u>	<u>5- Yr</u>	<u>10- Yr</u>	<u>25- Yr</u>	<u>50- Yr</u>	<u>100- Yr</u>
A	21.7	28.6	33.1	38.9	43.1	47.3
B	-0.699	-0.699	-0.699	-0.699	-0.699	-0.699

The peak flows are calculated using the following formula :

$$Q = 2.778 \text{ ACI} / 1000$$

WHERE:

Q = 5-Year Peak Flows (m³/s)

A= Area in hectares (ha)

C= Runoff Coefficient

I= Rainfall Intensity (mm/hr)

The IDF curve data and storm sewer design sheet is included in Appendix "E." A preliminary design of the minor system is illustrated on Drawing PS-1 and the areas are depicted on Storm Drainage Plan (ST-1).

5.3.3 Grading

Preliminary grading (roads) is also illustrated on Drawing G-1 and PS-1, as well as overland flow routes. The proposed grading is based on providing cover to the sewer system according to Town of Erin Standards and providing an overland flow route to the SWM ponds.

5.3.4 Existing Drainage

Based on the topographic survey, the existing site land use is primarily agriculture with some grassed uncultivated areas. The Pre-development Drainage Area plan (EX-DR-1) provides an overview of the subject site's existing drainage conditions, catchment boundaries of the subject site and contributing external areas.

The existing storm sewers located on McMurchy Lane south were designed to capture external flows from the subject site draining through of the Strittmatter Subdivision. Excerpts from the stormwater management report⁹ for the Strittmatter subdivision are provided in Appendix "F."

The existing drainage area parameters are summarized in Table I below and based on the CVC standard parameters.

TABLE I
Existing Drainage Parameters

Catchment ID	Discharge Point	Catchment Area (Ha)	Land Type
Area-1, 2, 3 & External from North	Existing low points west of proposed development	30.14	Farm/Grassed
Area-4 & External from North	Existing 450mm sewers on McMurchy Lane	22.96	Farm/Grassed

⁹ Stormwater Management Report and Design Drawings, Proposed Striimatter Subdivision, Village of Hillsburgh, Town of Erin, July 2000, Prepared by Burnside Development Services, R.J. Burnside & Associates Limited, RJB File : S-405.

5.3.5 Requirements for Design of Stormwater Management Facilities

- **Stormwater Management Pond No. 1**

The proposed stormwater management pond 1 is located in the southeast corner of the property. It will accommodate post-development drainage from an area of 21.68 ha. The pond will outlet to an existing 450mm dia storm sewer located on McMurchy Lane. The flows from the pond will be controlled to the discharge targets established in the Strittmatter SWM Report.

TABLE II
Release Rate Targets for SWM Pond 1 (East)

Storm Event	Allowable Release Rate (m ³ /s)
5-year	0.06
100-Year	0.16

Based on the drainage area and release rates identified in Table II, an iterative process was used to calculate the pond's effective stage-storage-discharge relationship, determining the control structure sizing. The ponds have been adequately sized for 5 and 100-year events. Table III below provides an overview of the stage-discharge-storage relationship of the stormwater management facility. Related outflow calculations are included in Appendix "E."

TABLE III
SWM POND 1 RATING CURVE

Pond No.	Pond Area (ha)	Permanent Pool Volume Provided (m ³)	Pond Stage-Storage-Discharge Relationship								
			Extended Detention for Erosion Control						Flood Control		
			25mm Erosion Control			5-Year Control			100-Year Control		
			Release Rate (L/s)	Pond W.L (m)	Storage Volume (m ³)	Release Rate (L/s)	Pond W.L (m)	Storage Volume (m ³)	Release Rate (L/s)	Pond W.L (m)	Storage Volume (m ³)
1	21.68	4,950	17	452.65	4,194	60	453.18	8,536	79	454.20	19,069

The VO model was used to determine storm flow calculations and required stormwater quantity control volumes based on required release rates. Table IV below provides an overview of the modelling results for the pond operation for 5 and 100-year storm events.

**TABLE IV
STORMWATER MANAGEMENT POND 1 (East)
SUMMARY OF VO MODEL RESULTS**

Pond 1		
Total Drainage Area to SWM Pond =	21.68 Ha	
Permanent Pool Storage Required for Enhanced Protection Level (80% TSS Removal)	4,950 m ³	
Permanent Pool Storage Provided	7,777 m ³	
Description	Design Storm*	
	5-Year	100-Year
Peak Flow (m³/s)	4.111	7.830
Outflow (m³/s)	0.058	0.078
Pond W.L. (m)	453.18	454.20
Max. Storage Used (m³)	8,281	17,856
Storage at Pond W.L (m³)	8,536	19,069

** Based on VO Results appended in Appendix "E."*

** The design storm used is similar to the Strittmatter SWM Report, Three-hour duration Chicago Storm for below-mentioned IDF Curves ;*

IDF curve parameters (5-Year):

$$A = 1439.371$$

$$B = 13.688$$

$$C = 0.846 \text{ used in: } INTENSITY = A / (t + B)^C$$

IDF curve parameters (100-Year):

$$A = 3113.230$$

$$B = 21.416$$

$$C = 0.857 \text{ used in: } INTENSITY = A / (t + B)^C$$

- **Stormwater Management Pond 2**

The proposed stormwater management pond 2 is located at the existing low area of the western limit of the property and will outlet overland the existing wooded area to the west and ultimately to an existing wetland located to the south. The SWM Pond will accommodate drainage from approximately 26.26 ha. The SWM pond design criteria is to control post-development peak flows to the pre-development levels.

The pre-development flows were modelled using Visual Otthymo for Malton IDF data for the Credit River. A newly developed tool by MTO is available online (http://www.mto.gov.on.ca/IDF_Curves/results_out.shtml?coords=43.72362,-79.64363) was used to find the IDF values and total rainfall for different storm events at coordinates 43° 43' 15" N, 79° 38' 45" W (43.720833,-79.645833). The values obtained were used to generate SCS Type II Distribution Hyetograph for storm events 2 to 100 years.

**TABLE V
PRE-DEVELOPMENT FLOWS**

Drainage Area =	30.14 Ha	DESIGN STORM				
Storm Event	2-Year (L/s)	5-Year (L/s)	10-Year (L/s)	25-Year (L/s)	50-Year (L/s)	100-Year (L/s)
Target Flows*	881	1477	1963	2600	3169	3645

**Refer to Pre-Development Release Rate in Appendix E.*

Based on the drainage area and release rate targets identified in Table V, an iterative process was used to calculate the pond's effective stage-storage-discharge relationship, determining the control structure sizing. The ponds have been adequately sized for all storms up to and including 100-year events. Table VI below provides an overview of the stage-discharge-storage relationship of the stormwater management facility. Related outflow calculations are included in Appendix "E."

TABLE VI
SWM POND 2 (West) RATING CURVE

Total Drainage Area to SWM Pond			26.26 Ha
Permanent Pool Storage Required for Enhanced Protection Level (80% TSS Removal)			5,234 m ³
Permanent Pool Storage Provided			10,225 m ³
Storm Event	Release Rate from Control Structure (m³/s)	Pond Elevation (m)	Storage (m³)
25mm	0.022	458.85	4,390
2-Year	0.187	459.10	6,751
5-Year	0.506	459.26	8,381
10-Year	0.782	459.37	9,953
25-Year	1.158	459.50	10,970
50-Year	1.547	459.62	12,310
100-Year	2.151	459.70	13,219

The VO model was used to determine storm flow calculations and required stormwater quantity control volumes based on required release rates. Table VII below provides an overview of the modelling results for the pond operation for 2 to 100-year storm events (SCS Type II, 24Hour, 15mins).

TABLE VII
STORMWATER MANAGEMENT POND 2 (West)
SUMMARY OF VO MODEL RESULTS

Description	Design Storm*					
	2-Year	5-Year	10-Year	25-Year	50-Year	100-Year
Target Flow (m³/s)	<i>0.881</i>	<i>1.477</i>	<i>1.963</i>	<i>2.600</i>	<i>3.169</i>	<i>3.645</i>
VO Peak Flow (m³/s)	2.910	4.00	4.784	5.839	7.126	7.856
Outflow (m³/s)	0.183	0.489	0.709	1.141	1.485	1.992
Pond W.L. (m)	459.10	459.26	459.37	459.50	459.62	459.70
Max. Storage Used (m³)	6,612	8,312	9,547	10,948	12,162	12,983
Storage at Pond W.L (m³)	6,751	8,381	9,953	10,970	12,310	13,219

** Based on VO Results appended in Appendix "E."*

The related control structure and outflow calculations are included in Appendix "E." For Ponds 1 and 2, an orifice plate will be used to provide Erosion Control, and rectangular broad crested weir/orifice controls are proposed to achieve 2-year up to 100-year flow targets.

The following summarizes the outlet controls:

- **SWM Pond No. 1 (East)**
 - 25mm Erosion Control: 100mm diameter orifice plate.
 - 2 to 100 Year Release: a combination of 100mm diameter orifice plate and 0.15m wide x 0.10m high weir.
 - A 26m wide emergency spillway is sized to safely convey the uncontrolled 100-year peak flow (7.830m³/s). The crest elevation of the emergency spillway is set at an elevation of 454.20m.

- **SWM Pond No. 2 (West)**
 - 25mm Erosion Control: 120mm diameter orifice plate.
 - 2 to 100 Year Release: a combination of 120mm diameter orifice plate and 1.65m wide x 0.75m high weir.
 - A 27m wide emergency spillway is sized to safely convey the uncontrolled 100-year peak flow (7.856m³/s). The crest elevation of the emergency spillway is set at an elevation of 459.70m.

Preliminary design details of the proposed Stormwater Management Pond No. 1 and 2 are illustrated on Drawing ST-1 (Storm Drainage Area Plan), considering the proposed sewer inverts and preliminary grading. It is noted that the configurations of the ponds and related structures will be finalized as part of the final Engineering Design of the facilities.

5.4 Water Balance

The hydrogeological review indicates that post development the site will have a total infiltration deficient 38,200 cm.

To supplement the anticipate loss of infiltration it is proposed to provide infiltration galleries within the rear of the lots the proposed school and the proposed commercial block will have their own on-site infiltration galleries.

It is proposed that infiltration enhancements will consist of topsoil of up to 0.3m deep and infiltration galleries in rear yards. As shown on drawing PS-1. Preliminary layout of the proposed infiltration galleries indicates that the total length of galleries that could be provided in both the proposed and the potential future development areas is approximately 3200lm. Assuming the trench is 1.5 x 1.5 meters square with a porosity of 40% the total storage available within the galleries is 2880 cm

Assuming that the infiltration galleries infiltrate 10mm of rainfall over the impervious areas of the development the total volume of water needed to infiltrate is as follows assuming a 60% overall impervious value:

- Area of road/lots: 34.96ha (exclusive of SWM ponds and park)
 - Volume to be retained: $34.96 \text{ ha} \times 10\text{mm} \times 0.60 = 2097\text{m}^3$
 - Length of infiltration trench required: $2097 \div 1.35^* = 1768$
- * 1.5m x 1.5m infiltration trenches proposed with assumed 40% void ratio.*

Based o the above there is sufficient volume available to provide the required infiltration storage


For the school and commercial blocks block, infiltration galleries will be designed at site plan approval.

6 WELL HEAD PROTECTION

There is an existing well located on the east side of Trafalgar Road near the intersection of Trafalgar Road and Street A. The CTC Source Protection District has prepared an Approved Source Protection Plan and have identified a well head protection area for the well as shown on map 1.6 (copy attached as figure 3) from the above noted Plan.

The closest proposed Storm Water Management facility and sanitary sewers are show on the attached plan. Based on the plan the closest Storm Water Management facility is not located within the zone of influence for the well and no further protective measures are required. It is also noted that the proposed sanitary sewers are also outside the zone of influence.

Therefore no special construction methods will be required o construct the ponds or the sanitary sewers.

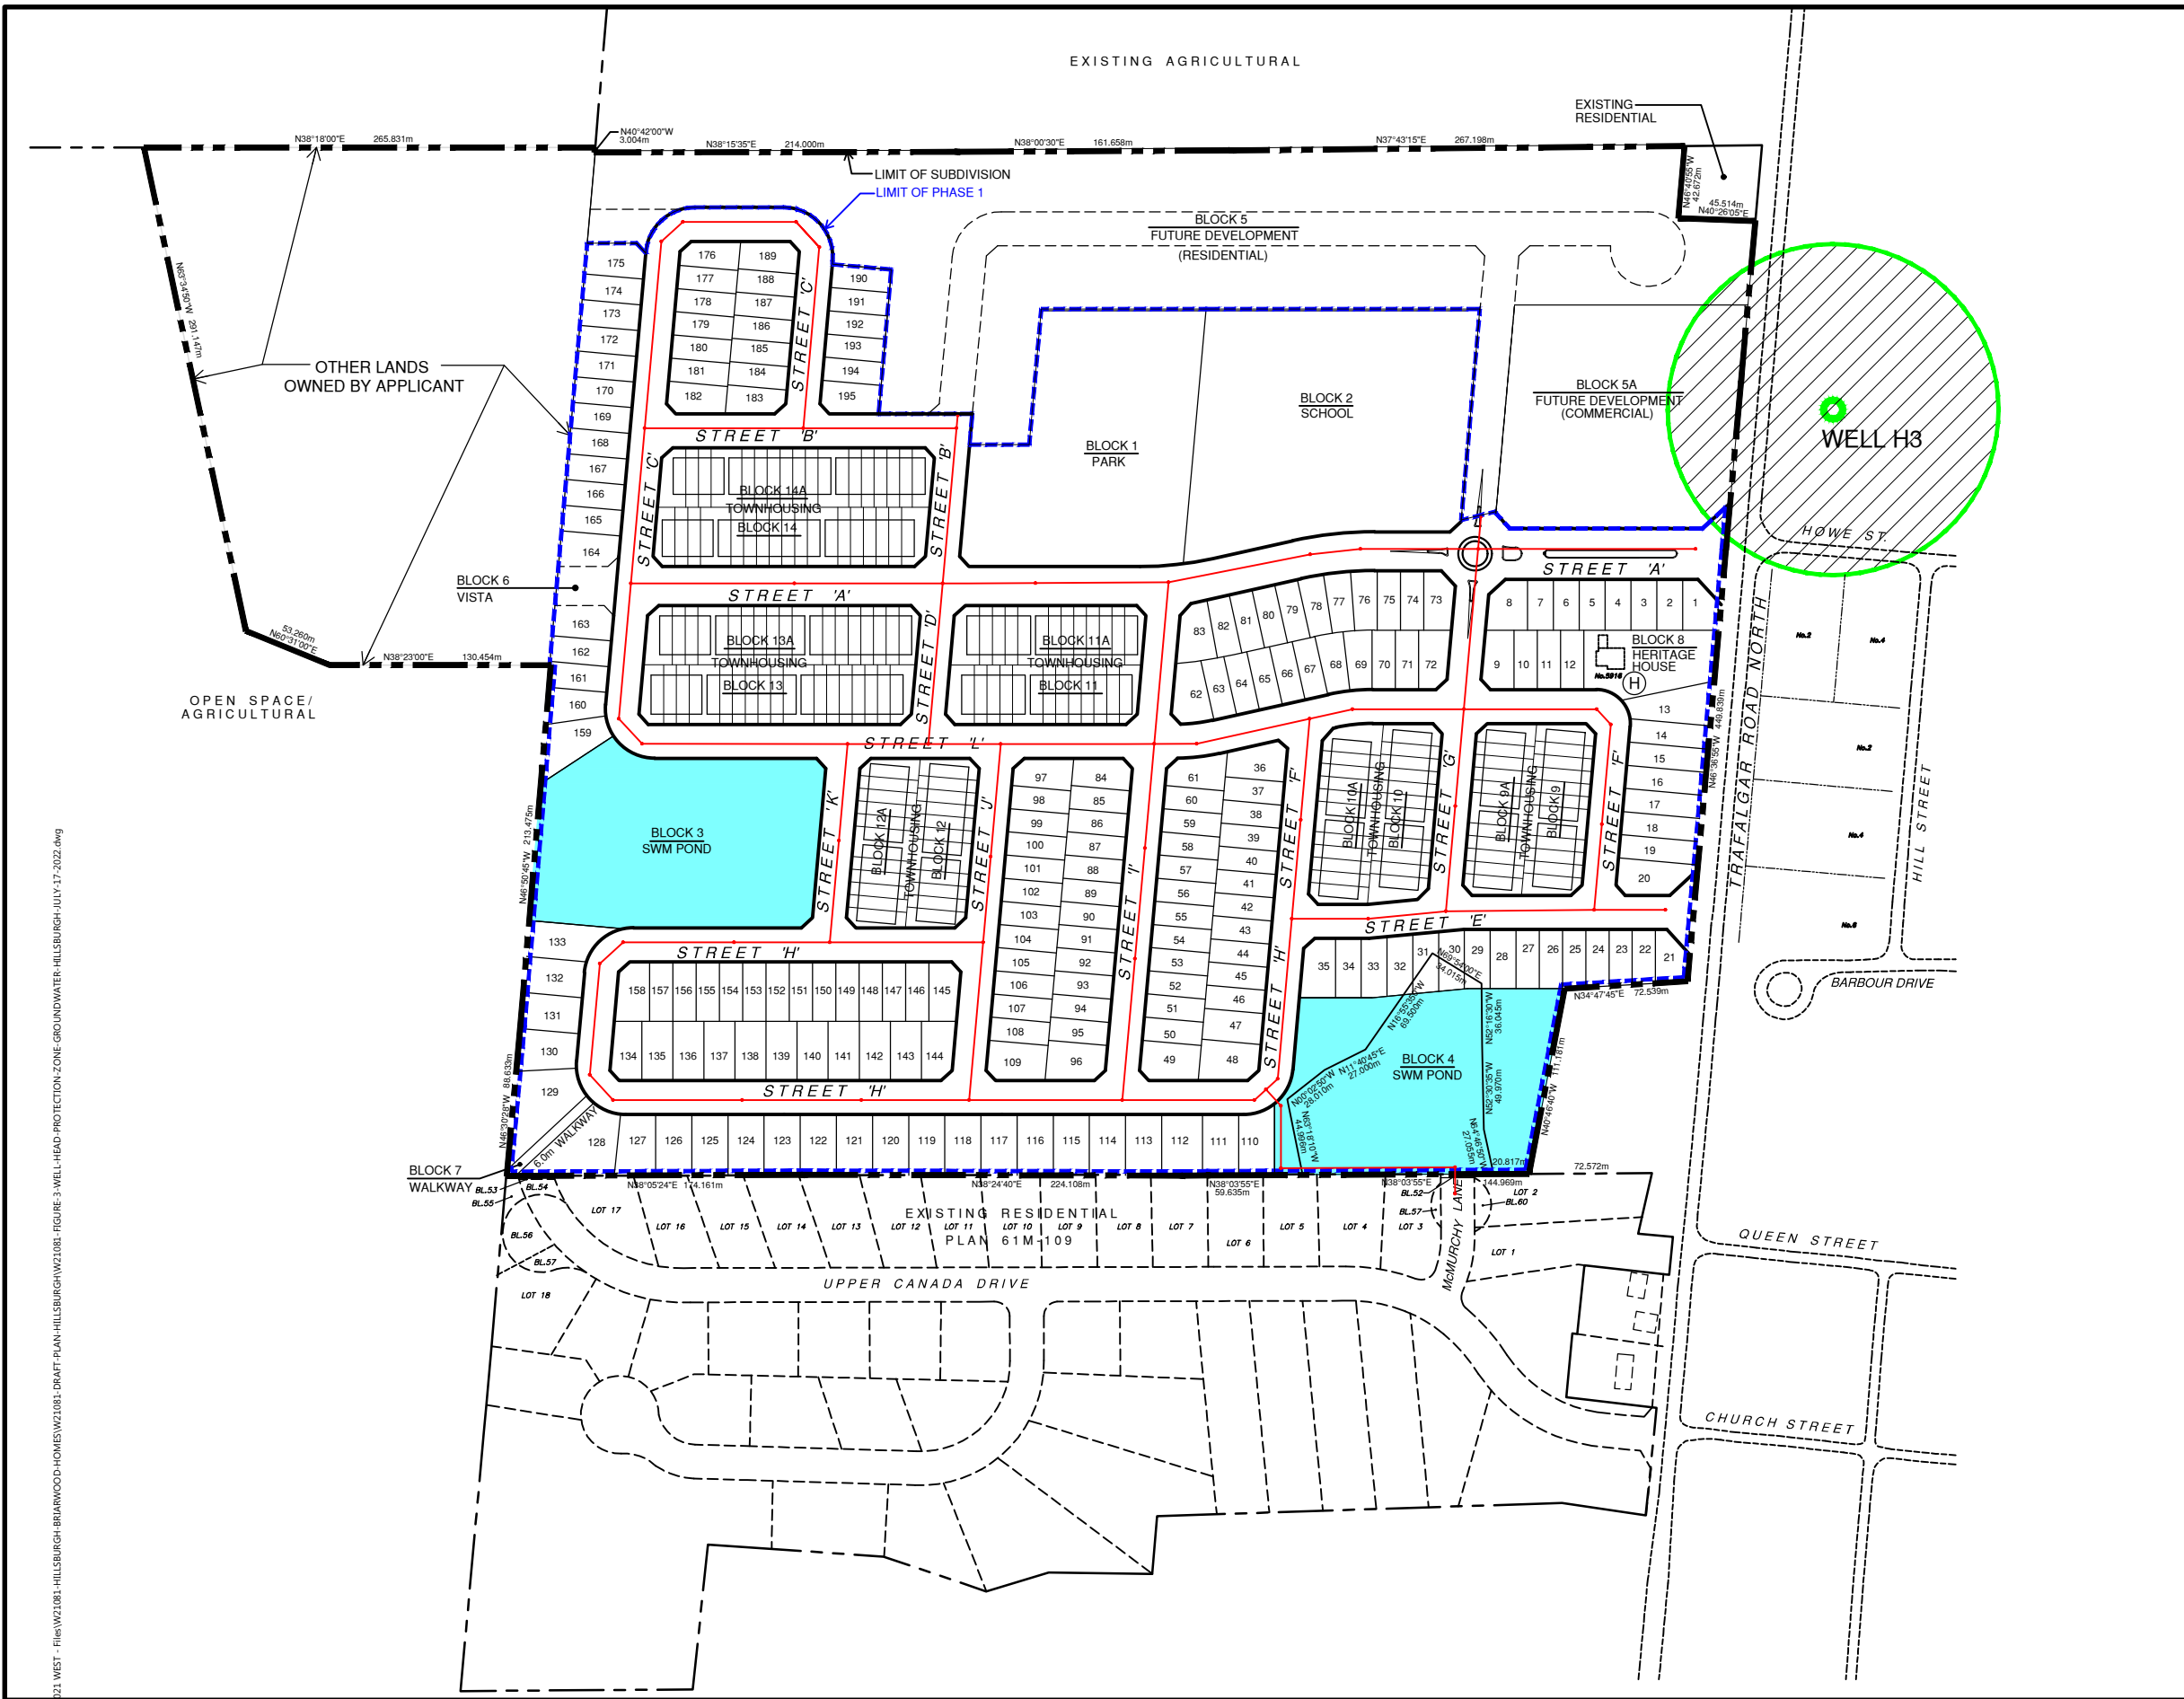

- LEGEND:**
- PROPOSED STORMWATER MANAGEMENT POND
 - PROPOSED SANITARY SEWER
 - HILLSBURGH WELL H3
(MAP 1.6: HILLSBURGH - SIGNIFICANT GROUNDWATER QUALITY THREAT AREAS)
 - WELL HEAD PROTECTION AREA LEVEL A

HILLSBURGH HEIGHTS INC.
(BRIARWOOD DEVELOPMENTS GROUP)
WELL HEAD PROTECTION ZONE
 5916 TRAFALGAR ROAD NORTH
 (PLAN 61R-9590)
 PART OF LOT 26, CONCESSION 7
 TOWN OF ERIN
 COUNTY OF WELLINGTON

CANDEVCON LIMITED
 CONSULTING ENGINEERS AND PLANNERS
 TEL. (905) 794-0600 FAX (905) 794-0611

DATE	JULY 27th 2022	JOB No	W21081
DRAWN	S.G.K.	FIGURE No.	
SCALE	1:4000	FIGURE 2	

J:\CD\2021 WEST - Files\W21081-HILLSBURGH-BRIARWOOD-HOMES\W21081-DRAFT-PLAN-HILLSBURGH-GROUNDWATER-HILLSBURGH-JULY-17-2022.dwg

7. EROSION AND SEDIMENT CONTROL

Erosion and sedimentation are naturally occurring processes that involve particle detachment, sediment transport and deposition of soil particles. Construction activities commonly alter the landscapes where they are located, exacerbating these natural processes. One of the most significant alterations encountered during construction is the removal of the vegetation that stabilizes the subsoil. In the absence of the vegetation, the underlying soils are fully or partially exposed to various natural forces such as rain, flowing water, wind, and gravity⁶.

The discharge of high sediment loads to natural watercourses has significant impacts on receiving waters and aquatic habitat. Some specific examples include:

- Degradation of water quality;
- Damage or destruction of fish habitat;
- Increased flooding.

In consideration of the above, it is necessary as part of the Final Design and implementation of infrastructure and development servicing to incorporate a comprehensive Erosion and Sediment Control Plan. The objectives are:

- (i) Minimize wherever possible the extent of vegetation removal;
- (ii) Provide appropriate sediment control measures to minimize the off-site transport of sediment;
- (iii) Minimize the extent of time that sites are devoid of stabilizing vegetation;
- (iv) Provide interim erosion control measures where permanent restoration is not feasible.
- (v) Provide permanent restoration to eliminate future erosion.

⁶ *Erosion and Sediment Control Guidelines for Urban Construction*, December 2006, Greater Horseshoe Conservation Authorities.

The Erosion and Sediment Control Plan should consider the specific characteristics of each development site and address the requirements relating to the following typical construction stages:

- Topsoil Stripping and Site Pre-Grading
- Infrastructure Servicing
- Building Construction

A “treatment train” approach is recommended in the development of an appropriate Erosion and Sediment Control Plan in compliance with the *Erosion and Sediment Control Guidelines for Urban Construction*. Typical sediment control measures include:

- Installation of double silt fencing along the boundary of work areas adjacent to the NHS;
- Construction of vegetated cut off swales including sediment traps and rock check dams;
- Stabilization of temporary sediment traps and provision of vegetated filter strips adjacent to the NHS;
- Provision of catch basin sediment controls.

Inherent in the Erosion and Sediment Control Plan is a monitoring program with an Action Plan to implement remedial measures in a timely manner where required.

As part of the final engineering design, the Sediment and Erosion Control Plan will be prepared including sizing of temporary sedimentation ponds and sediment traps.

APPENDIX "A"

Sanitary Sewer Design Sheets



Subdivision:	Hillsburgh Heights	Town of Hillsburgh	Project No.: W21081
File No.:		SANITARY DRAINAGE	Date: 2022-08-04
Consultant:	Candevcon Limited		Prepared By: SDL
Drainage Area Plan:	SA-1		Checked By: JSL

Town of Erin DESIGN CRITERIA

equivalent populations	population	Average Day Flow:	450 Lpcd
Residential/unit	3	Peaking Factor:	1+14/(4+(P)^0.5) P = Pop. in 1000's
School/ha	60	Infiltration:	0.00015 m³/s/ha
commercial/ha	100	Manning's Co-eff.:	0.013
		max flow (m/s)	3
		min flow (m/s)	0.6

LOCATION										POPULATION								FLOWS				
STREET	AREA ID	MAINTANANCE HOLES		RESIDENTIAL			commercial (ha)	school (ha)	TOTAL POP	ACCUM. POP.	PEAK FACTOR	AREA (ha)	ACCUM. AREA (ha)	PK. DAY FLOW (m³/s)	INFILT. (m³/s)	TOTAL FLOW (m³/s)	SIZE (mm)	SLOPE (%)	CAPACITY (m³/s)	VELOCITY		DESIGN FLOW / FULL FLOW %
		upstream	downstream	single family area	town house units	area														units	FULL FLOW (m/s)	
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21		
	1	MH1A	MH2A	0.29	4			12	12	3.41	0.29	0.29	0.000	0.000	0.000	200	3.10%	0.058	1.84	0.10	1	
	2	MH2A	MH3A	0.33	3			9	21	3.38	0.33	0.62	0.000	0.000	0.000	200	3.10%	0.058	1.84	0.10	1	
	3	MH3A	MH6A	1.00	14			42	63	3.29	1.00	1.62	0.001	0.000	0.001	200	3.10%	0.058	1.84	0.31	3	
	4	MH1A	MH4A	0.34	3			9	9	3.42	0.34	0.34	0.000	0.000	0.000	200	3.10%	0.058	1.84	0.10	1	
	5	MH4A	MH5A	0.90	13			39	48	3.32	0.90	1.24	0.001	0.000	0.001	200	3.10%	0.058	1.84	0.21	2	
	6	MH5A	MH6A			0.47	10	30	78	3.27	0.47	1.71	0.001	0.000	0.002	200	3.10%	0.058	1.84	0.31	3	
	7	MH6A	MH8A	0.44	5			15	156	3.19	0.44	3.77	0.003	0.001	0.003	200	3.10%	0.058	1.84	0.56	6	
	8	MH7A	MH8A			0.80	20	60	60	3.30	0.80	0.80	0.001	0.000	0.001	200	3.10%	0.058	1.84	0.21	2	
	9	MH8A	MH9A	0.38	4			12	228	3.13	0.38	4.95	0.004	0.001	0.004	200	3.10%	0.058	1.84	0.66	8	
	10	MH9A	MH10A	0.11	1			3	231	3.12	0.11	5.06	0.004	0.001	0.005	200	3.10%	0.058	1.84	0.66	8	
	11	MH10A	MH18A			0.68	15	45	276	3.09	0.68	5.74	0.004	0.001	0.005	200	3.10%	0.058	1.84	0.76	10	
	12	MH5A	MH11A			0.42	9	27	303	3.08	0.42	6.16	0.005	0.001	0.006	200	3.10%	0.058	1.84	0.76	10	
	EXT1	EXT1	MH11A	2.41	38			114	114	3.23	2.41	2.41	0.002	0.000	0.002	200	3.10%	0.058	1.84	0.41	4	
	13	MH11A	MH14A					0	417	3.01	0.00	8.57	0.007	0.001	0.008	200	3.10%	0.058	1.84	0.90	14	
	14	MH12A	MH13A			0.40	8	24	24	3.37	0.40	0.40	0.000	0.000	0.000	200	3.10%	0.058	1.84	0.10	1	
	15	MH13A	MH14A			0.29	5	15	39	3.34	0.29	0.69	0.001	0.000	0.001	200	3.10%	0.058	1.84	0.21	2	
	16	MH7A	MH14A			0.73	18	54	54	3.31	0.73	0.73	0.001	0.000	0.001	200	3.10%	0.058	1.84	0.21	2	
	17	MH14A	MH17A					0	510	2.97	0.00	9.99	0.008	0.001	0.009	200	3.10%	0.058	1.84	1.03	17	
	18	MH15A	MH16A			0.45	10	30	540	2.96	0.45	10.44	0.008	0.002	0.010	200	3.10%	0.058	1.84	1.07	18	
	19	MH16A	MH17A			0.18	3	9	549	2.95	0.18	10.62	0.008	0.002	0.010	200	3.10%	0.058	1.84	1.07	18	
	20	MH17A	MH18A			0.21	4	12	837	2.85	0.21	16.57	0.012	0.002	0.015	200	3.10%	0.058	1.84	1.34	26	
	21	MH18A	MH19A			0.29	6	18	855	2.84	0.29	16.86	0.013	0.003	0.015	200	3.10%	0.058	1.84	1.37	27	
	22	MH19A	MH20A			0.29	6	18	873	2.84	0.29	17.15	0.013	0.003	0.015	200	3.10%	0.058	1.84	1.37	27	
	23	MH29A	MH20A	0.42	5			15	15	3.40	0.42	0.42	0.000	0.000	0.000	200	3.10%	0.058	1.84	0.10	1	
	24	MH20A	MH21A	0.36	5			15	903	2.83	0.36	17.93	0.013	0.003	0.016	200	3.10%	0.058	1.84	1.41	28	
	25	MH21A	MH22A	0.33	4			12	915	2.82	0.33	18.26	0.013	0.003	0.016	200	3.10%	0.058	1.84	1.44	29	
	26	MH22A	MH23A	0.13	1			3	918	2.82	0.13	18.39	0.014	0.003	0.016	200	3.10%	0.058	1.84	1.44	29	
	27	MH23A	MH24A	0.36	3			9	927	2.82	0.36	18.75	0.014	0.003	0.016	200	3.10%	0.058	1.84	1.44	29	
	28	MH24A	MH25A	0.39	2			6	933	2.82	0.39	19.14	0.014	0.003	0.017	200	3.10%	0.058	1.84	1.44	29	
	29	MH25A	MH26A	0.63	7			21	954	2.81	0.63	19.77	0.014	0.003	0.017	200	3.10%	0.058	1.84	1.47	30	
	30	MH26A	MH27A	0.71	8			24	978	2.81	0.71	20.48	0.014	0.003	0.017	200	3.10%	0.058	1.84	1.50	31	
	31	MH27A	MH30A	0.55	6			18	996	2.80	0.55	21.03	0.015	0.003	0.018	200	3.10%	0.058	1.84	1.50	31	
	32	MH16A	MH28A	0.27	4	0.27	7	33	33	3.35	0.54	0.54	0.001	0.000	0.001	200	3.10%	0.058	1.84	0.21	2	
	33	MH28A	MH29A	0.22	4	0.22	5	27	60	3.30	0.44	0.98	0.001	0.000	0.001	200	3.10%	0.058	1.84	0.31	3	
	34	MH29A	MH30A	0.43	5			15	75	3.28	0.43	1.41	0.001	0.000	0.001	200	3.10%	0.058	1.84	0.31	3	
	35	MH30A	MH33A	0.47	4			12	1083	2.78	0.47	22.91	0.016	0.003	0.019	200	3.10%	0.058	1.84	1.56	34	
	36	MH15A	MH31A	0.54	8			24	1107	2.77	0.54	23.45	0.016	0.004	0.019	200	3.10%	0.058	1.84	1.56	34	
	37	MH31A	MH32A	0.50	8			24	24	3.37	0.50	0.50	0.000	0.000	0.000	200	3.10%	0.058	1.84	0.10	1	
	38	MH32A	MH33A	0.71	10			30	54	3.31	0.71	1.21	0.001	0.000	0.001	200	3.10%	0.058	1.84	0.21	2	
	39	MH33A	MH55A	0.48	4			12	1149	2.76	0.48	24.60	0.017	0.004	0.020	200	3.10%	0.058	1.84	1.58	35	
	40	MH12A	MH35A	0.51	6			18	18	3.39	0.51	0.51	0.000	0.000	0.000	200	3.10%	0.058	1.84	0.10	1	
	41	MH35A	MH36A	0.17	2			6	24	3.37	0.17	0.68	0.000	0.000	0.001	200	3.10%	0.058	1.84	0.10	1	
	42	MH36A	MH39A	0.32	3				164	3.18	2.51	3.19	0.003	0.000	0.003	200	3.10%	0.058	1.84	0.56	6	
	43	MH37A	MH38A	0.44	5			15	15	3.40	0.44	0.44	0.000	0.000	0.000	200	3.10%	0.058	1.84	0.10	1	
	44	MH38A	MH39A	0.35	3			9	24	3.37	0.35	0.79	0.000	0.000	0.001	200	3.10%	0.058	1.84	0.10	1	
	EXT2	EXT2	MH39A	3.10	37		1.70	281	281	3.09	4.80	4.80	0.005	0.001	0.005	200	3.10%	0.058	1.84	0.76	10	
	45	MH39A	MH44A					0	469	2.99	0.00	8.78	0.007	0.001	0.009	200	3.10%	0.058	1.84	0.94	15	

APPENDIX "B"

Storm Sewer Design Sheets



CANDEVCON LIMITED
CONSULTING ENGINEERS AND PLANNERS

9358 GOREWAY DRIVE TEL (905) 794-0600
BRAMPTON ON. L6P-0M7 FAX (905) 794-0611

Subdivision: **HILLSBURGH HEIGHTS**
File No.:
Consultant: **Candevcon Limited**
Drainage Area Plan: **STM 1**

TOWN OF HILLSBURGH
STORM DRAINAGE

FILE NUMBER **W21081**
DATE **July 20, 2022**
PREPARED BY **SDL**

GORE ROAD TRIBUTARY

Park	0.25
Single/semi	0.50
Multiple/inst	0.75
Industrial	0.90
Roads	0.90

For 5-yr storm I₅ = 28.6*((t/60)^(-.699))
For 10-yr storm I₁₀ = 33.1*((t/60)^(-.699))
For 100-yr storm I₁₀₀ = 47.3*((t/60)^(-.699))

Core System	Area No.	Up-stream	Down-stream	Contributing Area (ha)		Breakdown of Areas				Area x Storm Coef.				C	Total	Cummulative	Time (min)		I ₅	I ₁₀	FLOW Q= 2.78AC	PIPE													
				In Area	Control	0.25	0.50	0.75	0.90	0.25	0.50	0.75	0.90				A x C	AxC				In Area	Total	Q _{Design}	Length (m)	Size (mm)	Grade (%)	Capacity (m ³ /sec)	Velocity (m/s)	Time (min)	% Full				
POND 1	SP1-1	MH12	MH34	0.52	0	0.52					0	0.26	0.00	0.00	0.50								88.8	300	2										
	SP1-2	MH34	MH35	0.11	0.52	0.63					0	0.06	0.00	0.00	0.50	0.06	0.06	10	10.25	113.80	0.017	29.5	300	2.00	0.137	1.93	0.25	13							
	SP1-3	MH35	MH38	2.55	0.63	3.18			2.55		0	0.00	1.91	0.00	0.75	1.91	1.97	10.25	10.61	111.10	0.608	66	600	2.00	0.868	3.07	0.36	70							
	SP1-4	MH36	MH37	0.51	0.00	0.51			0.51		0	0.26	0.00	0.00	0.50	0.26	0.26	10.00	10.59	111.27	0.079	64.9	300	1.80	0.130	1.84	0.59	61							
	SP1-5	MH37	MH38	0.38	0.51	0.89			0.38		0	0.19	0.00	0.00	0.50	0.19	0.45	10.59	11.13	107.49	0.133	68.5	375	1.8	0.235	2.13	0.54	57							
	EXT4	EXT4	MH38	6.95	0.00	6.95	1.97	1.81	1.1	2.07	0.493	0.91	0.83	1.86	0.59	4.09	4.09	12.00	12.00																
	SP1-6	MH36	MH41	0.14	11.02	11.16				0.14	0	0.00	0.00	0.13	0.90	0.13	6.62	12.00	12.26	100.42	1.849	88.9	750	5	2.488	5.64	0.26	74							
	SP1-7	MH39	MH41	0.33	0.00	0.33					0	0.17	0.00	0.00	0.50	0.17	0.17	10.00	11.09	107.74	0.049	63.2	300	0.5	0.068	0.97	1.09	72							
	SP1-8	MH40	MH41	0.64	0.00	0.64					0	0.32	0.00	0.00	0.50	0.32	0.32	10.00	11.22	106.84	0.095	82.4	375	0.5	0.124	1.12	1.22	77							
	SP1-9	MH41	MH42	0.47	12.13	12.60			0.47		0	0.00	0.35	0.00	0.75	0.35	7.46	12.26	12.45	99.38	2.061	62.6	750	5	2.488	5.64	0.19	83							
	SP1-10	MH42	MH47	0.49	12.60	13.09			0.49		0	0.00	0.37	0.00	0.75	0.37	7.83	12.45	12.62	98.41	2.142	63.4	825	5	3.208	6.00	0.18	67							
	SP1-11	MH40	MH43	0.12	0.00	0.12					0	0.06	0.00	0.00	0.50	0.06	0.06	10.00	10.09	115.06	0.019	14.8	300	3.7	0.186	2.63	0.09	10							
	SP1-12	MH43	MH44	0.57	0.12	0.69			0.28	0.29	0	0.14	0.22	0.00	0.63	0.36	0.42	10.09	10.46	112.21	0.130	58.2	300	3.7	0.186	2.63	0.37	70							
	SP1-13	MH44	MH46	0.47	0.69	1.16			0.27	0.2	0	0.14	0.15	0.00	0.61	0.29	0.70	10.46	10.73	110.26	0.215	55.5	375	4.8	0.384	3.48	0.27	56							
	SP1-14	MH45	MH46	0.26	0.00	0.26					0	0.13	0.00	0.00	0.50	0.13	0.13	10.00	10.27	113.69	0.041	40	300	3.3	0.176	2.49	0.27	23							
	SP1-15	MH46	MH47	0.46	1.42	1.88			0.46		0	0.23	0.00	0.00	0.50	0.23	1.06	10.73	11.51	104.95	0.310	93.5	525	1	0.430	1.99	0.78	72							
	SP1-16	MH47	MH48	0.20	14.97	15.17			0.2		0	0.10	0.00	0.00	0.50	0.10	8.99	12.45	12.57	98.73	2.468	42.5	900	4.5	3.839	6.04	0.12	64							
	SP1-17	MH48	MH53	0.18	15.17	15.35			0.18		0	0.09	0.00	0.00	0.50	0.09	9.08	12.57	12.71	97.95	2.473	52	900	4.5	3.839	6.04	0.14	64							
	SP1-18	MH15	MH51	0.43	0.00	0.43			0.43		0	0.22	0.00	0.00	0.50	0.22	0.22	10.00	10.58	111.32	0.067	93.2	300	3.8	0.188	2.67	0.58	35							
	SP1-19	MH39	MH51	0.15	0.00	0.15			0.15		0	0.08	0.00	0.00	0.50	0.08	0.08	10.00	10.18	114.40	0.024	28.4	300	3.8	0.188	2.67	0.18	13							
	SP1-20	MH51	MH52	0.48	0.58	1.06			0.24	0.24	0	0.12	0.18	0.00	0.63	0.30	0.59	10.58	10.93	108.86	0.179	63.9	375	3.8	0.342	3.09	0.34	52							
	SP1-21	MH52	MH53	0.48	1.06	1.54			0.24	0.24	0	0.12	0.18	0.00	0.63	0.30	0.89	10.93	11.25	106.69	0.264	66.9	450	3.8	0.556	3.49	0.32	48							
	SP1-22	MH53	MH58	0.50	16.89	17.39			0.5		0	0.25	0.00	0.00	0.50	0.25	10.22	12.71	12.97	96.56	2.744	81.5	1050	2.7	4.485	5.18	0.26	61							
	SP1-23	MH15	MH54	0.49	0.00	0.49			0.49		0	0.25	0.00	0.00	0.50	0.25	0.25	10.00	10.67	110.67	0.075	67.5	300	1.5	0.118	1.68	0.67	64							
	SP1-24	MH54	MH55	0.56	0.49	1.05			0.56		0	0.28	0.00	0.00	0.50	0.28	0.53	10.67	11.23	106.80	0.156	65	375	1.5	0.215	1.94	0.56	73							
	SP1-25	MH55	MH56	0.71	1.05	1.76			0.71		0	0.36	0.00	0.00	0.50	0.36	1.13	11.23	11.86	102.79	0.321	83.4	450	1.5	0.349	2.20	0.63	92							
	SP1-26	MH20	MH56	0.23	1.76	1.99			0.23		0	0.12	0.00	0.00	0.50	0.12	0.12	10.00	10.20	114.24	0.037	42.9	300	7	0.256	3.62	0.20	14							
	SP1-27	MH56	MH57	0.38	1.99	2.37			0.38		0	0.19	0.00	0.00	0.50	0.19	1.43	11.86	12.14	101.13	0.402	79.4	450	7	0.754	4.74	0.28	53							
SP1-28	MH57	MH58	0.23	2.37	2.60			0.23		0	0.12	0.00	0.00	0.50	0.12	1.55	12.14	12.20	100.77	0.433	17.6	450	7	0.754	4.74	0.06	57								
	MH58	OUT		19.99						0	0.00	0.00	0.00			11.77	12.20	12.27	100.38	3.284	24.4	1050	3.6	5.179	5.98	0.07	63								



CANDEVCON LIMITED
CONSULTING ENGINEERS AND PLANNERS

9358 GOREWAY DRIVE TEL (905) 794-0600
BRAMPTON ON. L6P-0M7 FAX (905) 794-0611

Subdivision: **HILLSBURGH HEIGHTS**
File No.:
Consultant: **Candevcon Limited**
Drainage Area Plan: **STM 1**

TOWN OF HILLSBURGH
STORM DRAINAGE

FILE NUMBER **W21081**
DATE **July 20, 2022**
PREPARED BY **SDL**

GORE ROAD TRIBUTARY

Park	0.25
Single/semi	0.50
Multiple/inst	0.75
Industrial	0.90
Roads	0.90

For 5-yr storm I₅ = 28.6*((t/60)^(-.699))
For 10-yr storm I₁₀ = 33.1*((t/60)^(-.699))
For 100-yr storm I₁₀₀ = 47.3*((t/60)^(-.699))

Core System	Area No.	Up-stream	Down-stream	Contributing Area (ha)		Breakdown of Areas				Area x Storm Coef.				C	Total	Cummulative	Time (min)		I ₅	I ₁₀	FLOW Q= 2.78AC	PIPE							
				In Area	Control	0.25	0.50	0.75	0.90	0.25	0.50	0.75	0.90				A x C	AxC				In Area	Total	Q _{Design}	Length (m)	Size (mm)	Grade (%)	Capacity (m ³ /sec)	Velocity (m/s)
	SP2-26	MH27	MH28	0.38	2.99	3.37		0.38			0	0.19	0	0	0.5	0.19	1.69	12.63	13.29	94.94		0.445	62.7	750	0.4	0.704	1.59	0.66	63
	SP2-27	MH27	MH31	0.29	3.37	3.66		0.29			0	0.145	0	0	0.5	0.15	1.83	13.29	13.86	92.18		0.469	54.7	750	0.4	0.704	1.59	0.57	67
	SP2-28	MH16	MH29	0.55	0.00	0.55		0.25	0.3		0	0.125	0.225	0	0.6	0.35	0.35	13.86	14.36	89.91		0.087	71.6	300	3	0.167	2.37	0.50	52
	SP2-29	MH29	MH30	0.44	0.55	0.99		0.2	0.24		0	0.1	0.18	0	0.6	0.28	0.63	14.36	14.68	88.56		0.155	51.9	375	3	0.304	2.75	0.31	51
	SP2-30	MH21	MH30	0.44	0.00	0.44			0.44		0	0	0.33	0	0.8	0.33	0.33	14.68	15.65	84.68		0.078	87.3	300	1.2	0.106	1.50	0.97	73
	SP2-31	MH30	MH31	0.41	1.43	1.84			0.41		0	0	0.308	0	0.8	0.31	1.27	15.65	16.07	83.11		0.293	90.4	375	5	0.392	3.55	0.42	75
	SP2-32	MH31	MH33	0.36	5.50	5.86			0.36		0	0	0.27	0	0.8	0.27	3.37	16.07	16.61	81.22		0.760	65.2	900	0.5	1.280	2.01	0.54	59
		MH33	OUT	0.13	9.52	9.65			0.13		0	0	0.098	0	0.8	0.10	13.11	16.61	17.06	79.73		2.907	65.2	1200	0.5	2.756	2.44	0.45	105

APPENDIX “C”

Preliminary Geotechnical Investigation Report



Soil Engineers Ltd.

CONSULTING ENGINEERS

GEOTECHNICAL • ENVIRONMENTAL • HYDROGEOLOGICAL • BUILDING SCIENCE

90 WEST BEAVER CREEK ROAD, SUITE 100, RICHMOND HILL, ONTARIO L4B 1E7 · TEL: (416) 754-8515 · FAX: (905) 881-8335

BARRIE
TEL: (705) 721-7863
FAX: (705) 721-7864

MISSISSAUGA
TEL: (905) 542-7605
FAX: (905) 542-2769

OSHAWA
TEL: (905) 440-2040
FAX: (905) 725-1315

NEWMARKET
TEL: (905) 853-0647
FAX: (905) 881-8335

GRAVENHURST
TEL: (705) 684-4242
FAX: (705) 684-8522

HAMILTON
TEL: (905) 777-7956
FAX: (905) 542-2769

**A REPORT TO
CEDAR CITY DEVELOPMENTS**

**PRELIMINARY GEOTECHNICAL INVESTIGATION FOR
PROPOSED DEVELOPMENT**

**5916 TRAFALGAR ROAD NORTH
TOWN OF ERIN (HILLSBURGH)**

REFERENCE NO. 2009-S020

OCTOBER 2020

DISTRIBUTION

3 Copies - Cedar City Developments
1 Copy - Soil Engineers Ltd. (Mississauga)
1 Copy - Soil Engineers Ltd. (Richmond Hill)



TABLE OF CONTENTS

1.0 INTRODUCTION 1
2.0 SITE AND PROJECT DESCRIPTION 1
3.0 FIELD WORK..... 1
4.0 SUBSURFACE CONDITIONS 2
 4.1 Topsoil 2
 4.2 Earth Fill and Topsoil Fill..... 2
 4.3 Silty Sand Till and Sandy Silt Till 3
 4.4 Sand..... 4
 4.5 Silt..... 5
 4.6 Compaction Characteristics of the Revealed Soils 5
5.0 GROUNDWATER CONDITIONS 7
6.0 DISCUSSION AND RECOMMENDATIONS 7
 6.1 Site Preparation..... 8
 6.2 Foundation10
 6.3 Basement Structures.....10
 6.4 Underground Services.....11
 6.5 Backfilling in Trenches and Excavated Areas12
 6.6 Slab-On-Grade, Garages and Driveways13
 6.7 Pavement Design13
 6.8 Soil Parameters14
 6.9 Excavation.....15
7.0 LIMITATIONS OF REPORT16

TABLES

Table 1 - Estimated Water Content for Compaction of On-Site Material..... 6
Table 2 - Pavement Design..... 14
Table 3 - Soil Parameters..... 15
Table 4 - Classification of Soils for Excavation..... 15

ENCLOSURES

Borehole Logs..... Figures 1 to 12
Grain Size Distribution Graphs Figures 13 to 15
Borehole and Monitoring Well Location Plan Drawing No. 1
Cross-Sections and Subsurface Profiles Drawing Nos. 2 and 3
Details of Perimeter Drainage System..... Drawing No. 4



1.0 **INTRODUCTION**

In accordance with an email authorization dated September 2, 2020, from Mr. Steven Silverberg, President of Cedar City Developments, a geotechnical investigation was carried out at 5916 Trafalgar Road North in the Town of Erin (Hillsburgh).

The purpose of the investigation was to reveal the subsurface conditions and determine the engineering properties of the disclosed soils for a future development. Detailed design of the development is not available; the geotechnical findings and preliminary recommendations for development are presented in this report.

2.0 **SITE AND PROJECT DESCRIPTION**

The Town of Erin is located in a physiographical region known as Hillsburgh Sandhills where the topography is rough with flat-bottomed swampy valleys running through sandy knolls. Lacustrine sands, silts and clays, reworked till, and glaciolacustrine sediments were deposited on drift and ground moraines which had been partly eroded by the past glaciation.

The subject property at 5916 Trafalgar Road North in the Town of Erin (Hillsburgh) is approximately 47 hectares in area. It is located on the west side of Trafalgar Road North, approximately 650 m south of Sideroad 27. At the time of the investigation, the property was mostly a farm field, with farm buildings fronting Trafalgar Road North. The existing site gradient is undulating, having a difference in elevation of more than 20 m across the property.

Detailed design of the proposed development is not available at the time of report preparation. It is understood that it will likely be a mixed use residential subdivision development with municipal services and roadways.

3.0 **FIELD WORK**

The field work, consisting of twelve (12) sampled boreholes extending to depths ranging from 6.2 to 6.6 m from the prevailing ground surface, was performed on September 22 and 23, 2020, at the locations shown on the Borehole Location Plan, Drawing No. 1.

The boreholes were advanced at intervals to the sampling depths by a track-mounted, continuous-flight power-auger machine equipped for soil sampling. Standard Penetration Tests, using the procedures described on the enclosed “List of Abbreviations and Terms”, were performed at the sampling depths. The test results are recorded as the Standard Penetration



Resistance (or 'N' values) of the subsoil. The relative density of the non-cohesive strata and the consistency of the cohesive strata are inferred from the 'N' values. Split-spoon samples were recovered for soil classification and laboratory testing.

The ground elevation at each borehole location was obtained using a hand-held Global Navigation Satellite System (GNSS) equipment.

4.0 **SUBSURFACE CONDITIONS**

The investigation has disclosed that beneath a topsoil veneer, with a layer of earth fill and topsoil fill at one location, the site is generally underlain by strata of sandy silt till, silty sand till and sand. In place, a localized deposit of silt was also encountered.

Detailed descriptions of the subsurface conditions are presented on the Borehole Logs, comprising Figures 1 to 12, inclusive. The revealed stratigraphy is plotted in the Subsurface Profiles, Drawing Nos. 2 and 3. The engineering properties of the disclosed soils are discussed herein.

4.1 **Topsoil** (All Boreholes)

Boreholes were drilled in the farm field or open areas. The revealed topsoil ranges from 25 to 33 cm in thickness. Due to active farming activities, thicker topsoil layers can be anticipated in places, especially in low-lying areas. Diligent control of the stripping operation will be required to prevent overstripping for the development.

The topsoil is dark brown in colour, with appreciable amounts of roots and humus. It is considered to be void of engineering value and must be removed for development.

Due to its humus content, the topsoil will produce volatile gases and may generate an offensive odour under anaerobic conditions. It must not be buried within the building envelope or deeper than 1.2 m below the finished grade so it will not have an adverse impact on the environmental well-being of the developed area.

4.2 **Earth Fill and Topsoil Fill** (Borehole 6)

A layer of earth fill and topsoil fill was contacted in Borehole 6, extending to a depth of 3.0 m from grade. The earth fill consists of silty sand with organic inclusions while the topsoil fill is sandy in texture, with appreciable topsoil content.



The water content values of the earth fill samples are 9% and 12%; while the water content values for the topsoil fill are 11%, 13% and 19%, indicating damp to very moist conditions. The high water content value of 19% indicates the presence of topsoil in the fill.

The obtained 'N' values range from 4 to 11 blows per 30 cm of penetration. This indicates that the fill was non uniform in compaction.

The existing earth fill is not suitable for supporting structures. It must be subexcavated, sorted free of organics and deleterious material, inspected, and properly compacted. If it is impractical to sort the fill, then it must be wasted. The topsoil fill encountered on site should be further assessed to determine its suitability for reuse.

One must be aware that the samples retrieved from boreholes may not be truly representative of the geotechnical and environmental quality of the fill, and do not indicate whether the topsoil beneath the earth fill was completely stripped. This should be further assessed by laboratory testing and/or test pits.

4.3 **Sandy Silt Till and Silty Sand Till** (All Boreholes, except Boreholes 6 and 7)

The sandy silt till and silty sand till predominate the soil stratigraphy at the site. They consist of a random mixture of particle sizes ranging from clay to gravel, with either sand or silt being the dominant fractions. Hard resistance to augering was encountered occasionally, inferring the occurrence of cobbles and boulders in the till mantle. Grain size analyses were performed on 4 representative samples and the results are plotted on Figures 13 and 14.

The natural water content values of the till samples were determined; the results are plotted on the Borehole Logs. The obtained values range from 3% to 15%, with a median of 7%. This indicates that the tills are in a dry to very moist condition.

The obtained 'N' values range from 3 to more than 100, with a median of 39 blows per 30 cm of penetration. These values show that the relative density is very loose to very dense, being generally dense. The loose tills generally occur in the weathered zone near the ground surface, extending to a depth of 0.8 to 1.8 m from grade.

The engineering properties of the till deposit are listed below:

- High frost susceptibility and moderately low water erodibility.
- Relatively low to low permeability, with an estimated coefficient of permeability of 10^{-5} to 10^{-6} cm/sec, an estimated percolation rate of 30 to 50 min/cm and runoff coefficients of:



Slope	
0% - 2%	0.11 to 0.15
2% - 6%	0.16 to 0.20
6% +	0.23 to 0.28

- The shear strength is primarily derived from internal friction and is augmented by cementation.
- The till deposit will generally be stable in relatively steep cuts; however, under prolonged exposure, localized sheet collapse may occur.
- Fair pavement-supportive material, with an estimated California Bearing Ratio (CBR) value of 8%.
- Moderately low corrosivity to buried metal, with an estimated electrical resistivity of 5000 ohm·cm.

4.4 **Sand** (All Boreholes, except Borehole 1)

The sand deposit was interstratified with the till deposit in 11 of the 12 boreholes. It is fine to medium grained, with a variable amount of silt. The sand is laminated with silt seams, showing a lacustrine deposit. Grain size analyses were performed on 3 representative samples and the results are plotted on Figure 15.

The obtained 'N' values range from 2 to over 100, with a median of 35 blows per 30 cm of penetration, indicating the sand is very loose to very dense, being generally dense in relative density. The natural water content of the sand samples was determined to range from 1% to 17%, with a median of 4%., indicating a dry to wet, generally damp condition.

The deduced engineering properties of the sand deposit are given below:

- Moderate to low frost susceptibility.
- High water erodibility.
- Pervious, with an estimated coefficient of permeability of 10^{-2} to 10^{-3} cm/sec, a percolation rate of 5 to 10 min/cm, and runoff coefficients of:

Slope	
0% - 2%	0.04
2% - 6%	0.09
2% - 6%	0.13

- The shear strength is derived from internal friction and is directly dependent on soil density.
- In excavation, the sand will slough in a relatively steep slope. It will run with water seepage and boil under a piezometric head of 0.3 m.



- A fair pavement-supportive structure, with an estimated CBR value of 10%.
- Low corrosivity to buried metal, with an estimated electrical resistivity of 6500 ohm·cm.

4.5 **Silt** (Boreholes 1 and 2)

The silt stratum was contacted beneath the topsoil in the southwest sector of the property. It is very fine grained, with sand and clay seams and layers.

The natural water content of the soil samples was determined; the values range from 8% to 16%, with a median of 13%, indicating moist to very moist conditions.

The obtained ‘N’ values range from 6 to 27, with a median of 8 blows per 30 cm of penetration, indicating the deposit is loose to compact, being generally loose in relative density. The loose silt is the result of weathering near the ground surface, which extends up to a depth of 1.8 m from grade.

The engineering properties relating to the project are given below:

- High frost susceptibility, with high soil-adfreezing potential.
- High water erodibility; it is susceptible to migration through small openings under seepage pressure.
- Relatively low permeability, with an estimated coefficient of permeability of 10^{-5} cm/sec, a percolation rate of 30 to 40 min/cm and the runoff coefficients of:

Slope	
0% - 2%	0.11
2% - 6%	0.16
6% +	0.23

- The shear strength is derived from internal friction, which is density dependent.
- In excavation, the silt will slough and run slowly with seepage bleeding from the cut face. It will boil with a piezometric head of 0.4 m.
- Poor pavement-supportive material, with an estimated CBR value of 3%.
- Moderate corrosivity to buried metal, with an estimated electrical resistivity of 4500 ohm·cm.

4.6 **Compaction Characteristics of the Revealed Soils**

The obtainable degree of compaction is primarily dependent on the soil moisture and, to a lesser extent, on the type of compactor used and the effort applied. As a general guide, the



typical water content values of the revealed soils for Standard Proctor compaction are presented in Table 1.

Table 1 - Estimated Water Content for Compaction of On-Site Material

Soil Type	Determined Natural Water Content (%)	Water Content (%) for Standard Proctor Compaction	
		100% (optimum)	Range for 95% or +
Existing Earth Fill	9 and 12	12 to 15	8 to 18
Silt/Sand	1 to 17 (median 4 and 13)	11 and 12	6 to 15
Silt Till/Sand Till	3 to 15 (median 7)	12	8 to 15

The above values show that part of the in situ soils are either too dry or too wet and will require aeration or wetting for a 95% or + Standard Proctor compaction. The wet materials must be aerated by spreading them thinly on the ground in dry and warm weather, prior to structural compaction. Alternatively, the wet sand and silt can be mixed with the drier tills.

Weathered soils and earth fill should be screened, segregated the organics and deleterious material before reuse as structural backfill. The earth fill must be sorted free of topsoil and deleterious materials prior to reuse as structural fill. If it is impractical to sort the fill, then it must be wasted. The topsoil fill must be further assessed to determine its suitability for reuse.

When compacting the very dense till on the dry side of the optimum, the compactive energy will frequently bridge over the chunks in the soils and be transmitted laterally into the soil mantle. Therefore, the lifts of these soils must be limited to 20 cm or less (before compaction). The presence of boulders will prevent transmission of the compactive energy into the underlying material to be compacted. If an appreciable amount of boulders is mixed with the material, it must either be sorted or must not be used for structural backfill.

If the compaction of the soils is carried out with the water content within the range for 95% Standard Proctor dry density but on the wet side of the optimum, the surface of the compacted soil mantle will roll under the dynamic compactive load. This is unsuitable for road construction since each component of the pavement structure is to be placed under dynamic conditions which will induce the rolling action of the subgrade surface and cause structural failure of the new pavement. The foundations or bedding of the sewer and slab-on-grade, on the other hand, will be placed on a subgrade which will not be subjected to impact loads. Therefore, the structurally compacted soil mantle with the water content on



the wet side or dry side of the optimum will provide an adequate subgrade for the construction.

One should be aware that 90%± Standard Proctor compaction of the wet organic sand and silt is achievable. Further densification is prevented by the pore pressure induced by the compactive effort; however, large random voids will have been expelled, and with time the pore pressure will dissipate and the percentage of compaction will increase. There are many cases on record where after a few weeks to months of rest, the density of the compacted mantle has increased to over 95% of its maximum Standard Proctor dry density.

5.0 **GROUNDWATER CONDITIONS**

All boreholes remained dry and open upon completion of drilling. Minor seepage was encountered in the sand deposit in Borehole 9 at a depth of 6.0 m from grade. The groundwater level will fluctuate with seasons.

In excavation, where groundwater seepage is encountered, the yield is expected to be small to some in the till and appreciable and maybe persistent in the sand and silt.

6.0 **DISCUSSION AND RECOMMENDATIONS**

This investigation has disclosed that beneath a topsoil veneer, with a layer of earth fill and topsoil fill at Borehole 6, the site is underlain by strata of sandy silt till, silty sand till and sand, very loose to very dense, generally dense in relative density. A localized deposit of loose to compact silt was contacted near the ground surface. The very loose to loose condition in the revealed soil stratigraphy is the result of weathering near the ground surface, which extends up to a depth of 0.8 to 1.8 m from grade.

All boreholes remained dry and open upon completion of the borehole drilling. Minor seepage was contacted in Borehole 9 at a depth of 6.0 m from grade. The groundwater level will fluctuate with the seasons.

The future development at the property will likely be a mixed use residential subdivision development with municipal services and roadways. The geotechnical findings warranting special consideration for the proposed project are presented below:

1. The existing site gradient is undulating. The site will have to be regraded for the proposed development. Prior to site grading with cut and fill, the topsoil veneer



- should be completely removed. The earth fill and topsoil fill should be excavated, examined, sorted free of topsoil and deleterious material before reuse for filling. If it is impractical to sort the fill, then it must be wasted.
2. After demolition of the existing structures and foundations, the debris must be removed and disposed off-site.
 3. In areas where earth fill is required to raise the site, it is generally more economical to place an engineered fill for normal footing, underground services and pavement construction.
 4. The proposed structures can be constructed on conventional footings founded in the engineered fill or sound natural soils.
 5. The footing subgrade must be inspected by either a geotechnical engineer, or a geotechnical technician under the supervision of a geotechnical engineer to assess its suitability for bearing the foundations.
 6. Additional boreholes may be required to elaborate the subsoil and groundwater conditions once the design for the proposed development is finalized.

The recommendations appropriate for the design of the development are presented herein. One must be aware that the subsurface conditions may vary between boreholes. Should subsurface variances become apparent during construction, a geotechnical engineer must be consulted.

6.1 **Site Preparation**

The existing site gradient is undulating. The site will have to be regraded for the proposed development.

Prior to site grading with cut and fill, the existing topsoil should be completely removed. The earth fill and topsoil fill should be excavated, examined, sorted free of topsoil and deleterious material before reuse for filling, otherwise they have to be removed.

The existing structures and foundations must be demolished and the debris must be removed and disposed off-site. The backfill must be free of topsoil or deleterious material, placed and compacted to engineered fill specifications.

The existing earth fill, topsoil fill, disturbed soils and weathered soils must be sub-excavated, sorted free of topsoil and organics or further assessed for suitability of engineered fill uses.

The requirements for the engineered fill are presented below:



1. After removal of topsoil, earth fill, topsoil fill and unsuitable material, the native soil subgrade must be inspected and proof-rolled prior to any fill placement.
2. Inorganic soils must be used for the fill, and they must be uniformly compacted in lifts 20 cm thick to 98% or + of the maximum Standard Proctor dry density up to the proposed finished grade. The soil moisture must be properly controlled near the optimum. If the foundations are to be built soon after the fill placement, the densification process for the engineered fill must be increased to 100% of the maximum Standard Proctor compaction.
3. If the engineered fill is compacted with the moisture content on the wet side of the optimum, the underground services and pavement construction should not begin until the pore pressure within the fill mantle has completely dissipated. This must be further assessed at the time of the engineered fill construction.
4. If imported fill is to be used, it should be inorganic soils, free of any deleterious material with environmental issue (contamination). Any potential imported earth fill from off-site must be reviewed for geotechnical and environmental quality by the appropriate personnel as authorized by the developer or agency, before it is hauled to the site.
5. The engineered fill must not be placed during the period from late November to early April when freezing ambient temperatures occur either persistently or intermittently. This is to ensure that the fill is free of frozen soils, ice and snow.
6. The fill operation must be fully supervised and monitored by a technician under the direction of a geotechnical engineer.
7. If the engineered fill is to be left over the winter months, adequate earth cover, or equivalent, must be provided for protection against frost action.
8. The engineered fill envelope and finished elevations must be clearly and accurately defined in the field, and they must be precisely documented.
9. Foundations founded on engineered fill must be reinforced by at least two 15-mm steel reinforcing bars in the footings and in the upper section of the foundation walls, or be designed by a structural engineer, to properly distribute the stress induced by the abrupt differential settlement (about 15 mm) between the natural soil and engineered fill.
10. Any excavation carried out in certified engineered fill must be reported to the geotechnical consultant who supervised the fill placement in order to document the locations of excavation and/or to supervise reinstatement of the excavated areas to engineered fill status. If construction on the engineered fill does not commence within a period of 2 years from the date of certification, the condition of the engineered fill must be assessed for re-certification.
11. The footing and underground services subgrade must be inspected by the geotechnical consulting firm that supervised the engineered fill placement. This is to ensure that the



foundations and service pipes are placed within the engineered fill envelope, and the integrity of the fill has not been compromised by interim construction, environmental degradation and/or disturbance by the footing excavation.

6.2 **Foundation**

The proposed structures can be supported on conventional spread and strip footings, founded on the undisturbed native soil or engineered fill. The recommended soil bearing pressures for the design of conventional footings are provided below:

- Maximum Soil Bearing Pressure at Serviceability Limit State (SLS) = 150 kPa
- Factored Ultimate Bearing Pressure at Ultimate Limit State (ULS) = 240 kPa

The total and differential settlements of structures designing for the bearing pressure at SLS are estimated within 25 mm and 20 mm, respectively.

Foundations exposed to weathering or in unheated areas should have at least 1.5 m of earth cover for protection against frost action. In heated areas, the earth cover can be reduced to 1.2 m.

During construction, the subgrade soils of foundations should be inspected by the geotechnical engineer to ensure that the conditions are compatible with the design of the foundations.

If water seepage is encountered in excavation, the foundation must be poured immediately after subgrade inspection or the subgrade should be protected by a concrete mud-slab immediately after exposure. This will prevent construction disturbance and costly rectification of the bearing subsoil.

The building foundation should meet the requirements specified in the latest Ontario Building Code and the structures should be designed to resist an earthquake force using Site Classification 'D' (stiff soil).

6.3 **Basement Structures**

All boreholes remained dry upon completion of the fieldwork. In conventional basement construction, the basement structures should be provided with perimeter drainage system (Drawing No. 4), connecting into a positive outlet or sewer system. The subdrains should be encased in a fabric filter to protect them against blockage by silting. If the basement



structure is within 1.0 m above the high groundwater regime, underfloor subdrain should be placed in the slab bedding, with a 6 mil vapour barrier above the obvert of the subdrain to prevent upfiltrating moisture from dampening the floor slab.

Both the perimeter and underfloor subdrain systems should be drained into the municipal storm sewer system by gravity or into a sump pit where the water can be removed by pumping. In addition, the external grading should be designed to drain the surface runoff away from the building structures.

The soil parameters stated in Section 6.8 can be used to evaluate the earth pressure on the foundation walls. The exterior must be graded to direct runoff away from the structures.

The basement floor slab should be constructed on a granular base, 20 cm thick, consisting of 20-mm clear limestone, or equivalent. The subgrade for the slab-on-grade floor should consist of sound natural soils or properly compacted inorganic earth fill, compacted to 98% of the maximum Standard Proctor dry density.

A Modulus of Subgrade Reaction of 35 MPa/m can be used for the design of the floor slab.

6.4 **Underground Services**

The underground services should be founded on sound natural soil or properly compacted inorganic earth fill. Where incompetent or weathered soil is encountered, it should be subexcavated and replaced with the bedding material, compacted to at least 95% Standard Proctor dry density.

A Class 'B' bedding is recommended for the underground services construction. It should consist of compacted 20-mm Crusher-Run Limestone, or equivalent, as approved by a geotechnical engineer. Where the subgrade consists of saturated soil, with continuous seepage of groundwater, a Class 'A' concrete bedding is recommended.

The sewer joints into the manholes and catch basins must be leak-proof to prevent the migration of fines through the joints. Openings to subdrains and catch basins should be shielded with a fabric filter to prevent blockage by silting.

In order to prevent pipe floatation when the sewer trench is deluged with water derived from infiltrated precipitation, a soil cover of at least two times the diameter of the pipe should be in place at all times after completion of the pipe installation.



The subgrade of the underground services may consist of soils which are considered to have moderately high electrical corrosivity to ductile iron pipes and metal fittings; therefore, the underground services should be protected against soil corrosion. For estimation for the anode weight requirements, the electrical resistivities of the disclosed soils can be used. The proposed anode weight must meet the minimum requirements as specified by the Town of Erin and/or Wellington County Standard.

6.5 **Backfilling in Trenches and Excavated Areas**

The backfill in service trenches should be compacted to at least 95% of its maximum Standard Proctor Dry Density (SPDD). Below concrete floor subgrade and in the zone within 1.0 m below the pavement, the material should be compacted with the water content 2% to 3% drier than the optimum; compacted to 98% of the respective SPDD.

Selected on site inorganic soils are suitable for use as trench backfill. The till should be sorted free of large cobbles and boulders (over 15 cm in size). In addition, some of the in situ soils are either too wet or too dry for 95% or + Standard Proctor compaction and will require aeration, wetting or proper mixing prior to its use as structural backfill.

In normal construction practice, the problem areas of pavement settlement largely occur adjacent to manholes, catch basins, services crossings, foundation walls and columns, it is recommended that a sand backfill should be used.

The narrow trenches for services crossings should be cut at 1 vertical:2 horizontal so that the backfill in the trenches can be effectively compacted. Otherwise, soil arching in the trenches will prevent achievement of the proper compaction. In confined areas where the desired slope cannot be achieved or the operation of a proper kneading-type roller cannot be facilitated, imported sand fill, which can be appropriately compacted by using a smaller vibratory compactor, must be used. The interface of the native soils and the sand backfill will have to be flooded for a period of several days.

One must be aware of the possible consequences during trench backfilling and exercise caution as described below:

- To backfill a deep trench, one must be aware that future settlement is to be expected, unless the sides is flattened to 1 vertical:2 horizontal, and the lifts of the fill and its moisture content are stringently controlled; i.e., lifts should be no more than 20 cm (or less if the backfilling conditions dictate) and uniformly compacted to achieve at least 95% SPDD, with the moisture content on the wet side of the optimum.



- It is often difficult to achieve uniform compaction of the backfill in the lower vertical section of a trench which is an open cut or is stabilized by a trench box, particularly in the sector close to the trench walls or the sides of the box. These sectors must be backfilled with sand and the compaction must be carried out diligently prior to the placement of the backfill above this sector, i.e., in the upper sloped trench section. This measure is necessary in order to prevent consolidation of inadvertent voids and loose backfill which will compromise the compaction of the backfill in the upper section.
- In areas where groundwater movement is expected in the pipe bedding or trench backfill mantle, anti-seepage collars (OPSS 802.095) should be provided.
- When construction is carried out in freezing weather, frozen soil layers may inadvertently be mixed with the structural trench backfill. Should the in situ soils have a water content on the dry side of the optimum, it would be impossible to wet the soils due to the freezing condition, rendering difficulties in obtaining uniform and proper compaction. Furthermore, the freezing condition will prevent wetting of the backfill or when it is required, such as when the trench box is removed. The above will invariably cause backfill settlement in the next few years.
- In areas where the underground services construction is carried out during winter months, prolonged exposure of the trench walls will result in frost heave within the soil mantle of the walls. This may result in some settlement as the frost recedes, and repair costs will be incurred prior to final surfacing of the new pavement.

6.6 **Slab-On-Grade, Garages and Driveways**

The on-site soils are mostly frost susceptible and the ground will be subject to frost heaving during cold weather. The pavement and sidewalk in open areas, thus, should be designed to tolerate the ground movement.

In areas where ground movement due to frost heave cannot be tolerated, the slab-on-grade, pavement, barrier free ramps and/or sidewalk can be constructed on a free-draining granular base of 0.3 to 1.2 m thick, depending on the degree of tolerance for settlement. These measures, with proper drainage, will prevent water from accumulating in the granular base.

Alternatively, they can be insulated with 50-mm Styrofoam, or its thermal equivalent.

The slab-on-grade in open areas should be designed to tolerate frost heave, and the grading around the slab-on-grade must be such that it directs runoff away from the surface.

6.7 **Pavement Design**



The pavement design for local and collector roads is presented in Table 2.

Table 2 - Pavement Design

Course	Thickness (mm)	OPS Specifications
Asphalt Surface	40	HL-3
Asphalt Binder		HL-8
Local Road	50	
Collector Road	65	
Granular Base	150	OPSS Granular 'A' or equivalent
Granular Sub-base		OPSS Granular 'B' or equivalent
Local Road	300	
Collector Road	400	

In preparation of pavement subgrade, all topsoil and compressible material should be removed. The final subgrade must be proof-rolled using a heavy roller or loaded dump truck. Any soft spot as identified must be rectified by subexcavation and replacing with selected dry inorganic material. The subgrade within 1.0 m below the underside of the granular sub-base must be compacted to at least 98% SPDD, with the water content at 2% to 3% drier than its optimum.

All the granular bases should be compacted in 150 to 200 mm lifts to 100% SPDD.

The pavement subgrade will suffer a strength regression if water is allowed to saturate the mantle. The following measures should, therefore, be incorporated in the construction procedures and road design:

- The subgrade should be properly crowned and smooth-rolled to allow interim precipitation to be properly drained.
- Lot areas adjacent to the roads should be properly graded to prevent ponding of large amounts of water. Otherwise, the water will seep into the subgrade mantle and induce a regression of the subgrade strength, with costly consequences for the pavement construction.
- Fabric filter-encased curb subdrains connecting to a positive outlet of catch basin, will be required on both sides of the roadway.

6.8 Soil Parameters



The recommended soil parameters for the project design are given in Table 3.

Table 3 - Soil Parameters

<u>Unit Weight and Bulk Factor</u>	Unit Weight γ (kN/m³)		Estimated Bulk Factor	
	Bulk	Submerged	Loose	Compacted
Sandy Silt Till and Silty Sand Till	22.5	12.5	1.30	1.05
Earth Fill, Weathered Soil, Silt and Sand	20.5	11.5	1.25	0.98
<u>Lateral Earth Pressure Coefficients</u>	Active K_a		At Rest K_o	Passive K_p
Compacted Earth Fill	0.40		0.55	2.50
Native Till, Sand or Silt	0.30		0.45	3.30
<u>Coefficients of Friction</u>				
Between Concrete and Granular Base				0.50
Between Concrete and Sound Natural Soils				0.35
<u>Maximum Allowable Soil Pressure (SLS) For Thrust Block Design</u>				
Engineered Fill and Sound Natural Soils				75 kPa

6.9 **Excavation**

Excavation should be carried out in accordance with Ontario Regulation 213/91. The types of soils are classified in Table 4.

Table 4 - Classification of Soils for Excavation

Material	Type
Sound Till	1 to 2
Earth Fill, Weathered Soils, Sand or Silt in drained condition	3
Saturated Soils	4

Groundwater derived from infiltrated surface water or precipitation may be encountered in excavation. Any groundwater seepage in shallow excavation can be controlled by normal pumping from sumps. In excavation extending into the saturated silt or sand, if encountered, the possibility of flowing sides and bottom boiling dictates that the ground be pre-drained or depressurized by pumping from closely spaced sump-wells or well points.



7.0 **LIMITATIONS OF REPORT**

This report was prepared by Soil Engineers Ltd. for the account of Cedar City Developments and for review by the designated consultants, contractors, financial institutions, and government agencies. The material in the report reflects the judgment of Kelvin Hung, P.Eng., and Bernard Lee, P.Eng., in light of the information available to it at the time of preparation.

Prospective contractors may be asked to assess the subsurface conditions for soil cuts and dewatering by digging test pits to the intended depth of trench excavation. These test pits should be allowed to remain open for a period of at least 4 hours to assess the trenching conditions and to assess the proper dewatering scheme for the planned excavations.

SOIL ENGINEERS LTD.

Kelvin Hung, P.Eng.
KH/BL:dd



Bernard Lee, P.Eng.



LIST OF ABBREVIATIONS AND DESCRIPTION OF TERMS

The abbreviations and terms commonly employed on the borehole logs and figures, and in the text of the report, are as follows:

SAMPLE TYPES

AS	Auger sample
CS	Chunk sample
DO	Drive open (split spoon)
DS	Denison type sample
FS	Foil sample
RC	Rock core (with size and percentage recovery)
ST	Slotted tube
TO	Thin-walled, open
TP	Thin-walled, piston
WS	Wash sample

SOIL DESCRIPTION

Cohesionless Soils:

<u>'N'</u> (blows/ft)	<u>Relative Density</u>
0 to 4	very loose
4 to 10	loose
10 to 30	compact
30 to 50	dense
over 50	very dense

Cohesive Soils:

PENETRATION RESISTANCE

Dynamic Cone Penetration Resistance:

A continuous profile showing the number of blows for each foot of penetration of a 2-inch diameter, 90° point cone driven by a 140-pound hammer falling 30 inches.

Plotted as '—●—'

Undrained Shear Strength (ksf)

less than 0.25
0.25 to 0.50
0.50 to 1.0
1.0 to 2.0
2.0 to 4.0
over 4.0

'N' (blows/ft)

0 to 2
2 to 4
4 to 8
8 to 16
16 to 32
over 32

Consistency

very soft
soft
firm
stiff
very stiff
hard

Standard Penetration Resistance or 'N' Value:

The number of blows of a 140-pound hammer falling 30 inches required to advance a 2-inch O.D. drive open sampler one foot into undisturbed soil.

Plotted as '○'

Method of Determination of Undrained Shear Strength of Cohesive Soils:

x 0.0 Field vane test in borehole; the number denotes the sensitivity to remoulding

△ Laboratory vane test

□ Compression test in laboratory

For a saturated cohesive soil, the undrained shear strength is taken as one half of the undrained compressive strength

WH	Sampler advanced by static weight
PH	Sampler advanced by hydraulic pressure
PM	Sampler advanced by manual pressure
NP	No penetration

METRIC CONVERSION FACTORS

1 ft = 0.3048 metres
11b = 0.454 kg

1 inch = 25.4 mm
1ksf = 47.88 kPa



Soil Engineers Ltd.

CONSULTING ENGINEERS


GEOTECHNICAL • ENVIRONMENTAL • HYDROGEOLOGICAL • BUILDING SCIENCE

PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 23, 2020

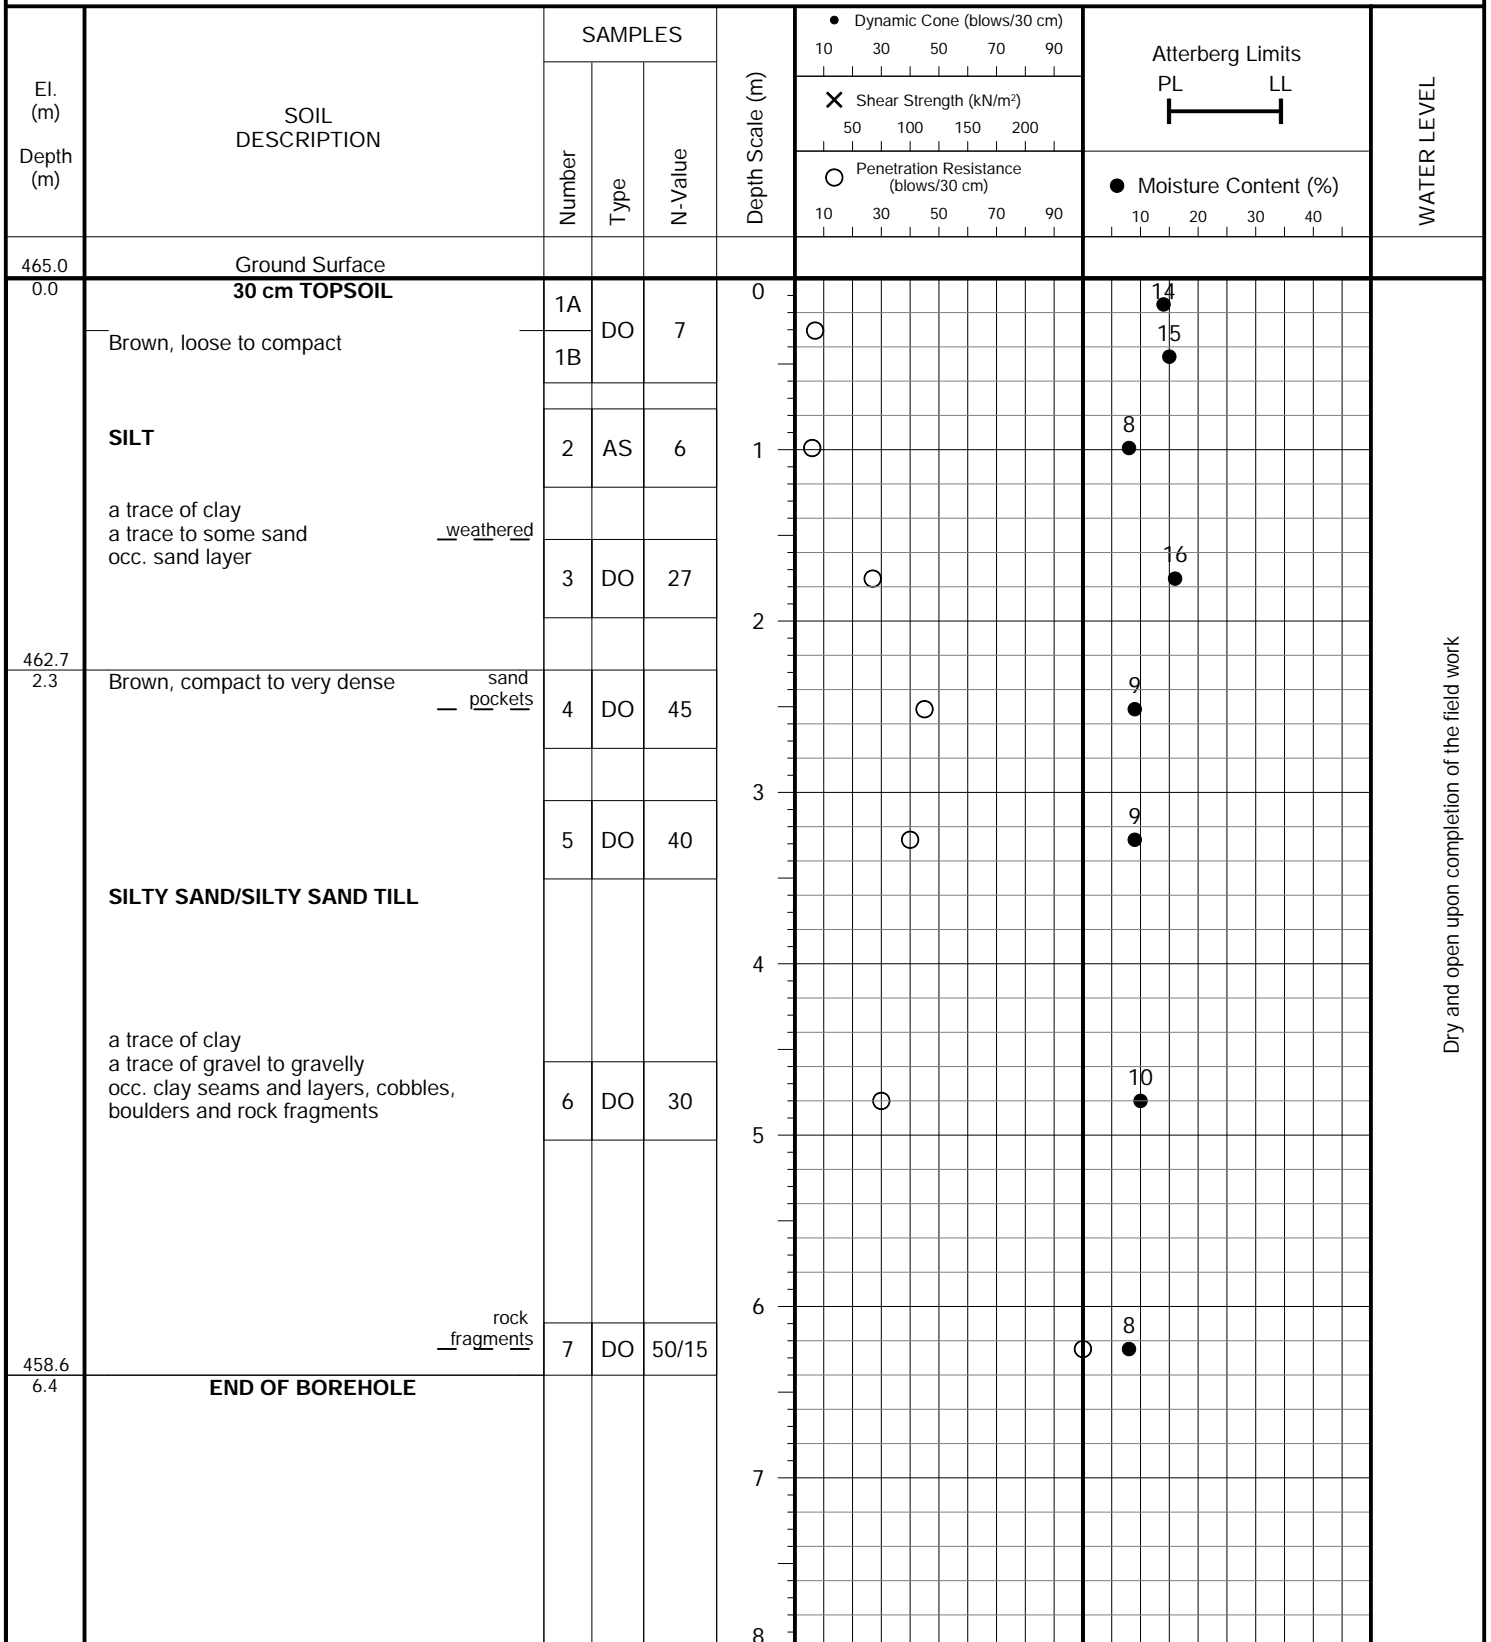


PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 23, 2020

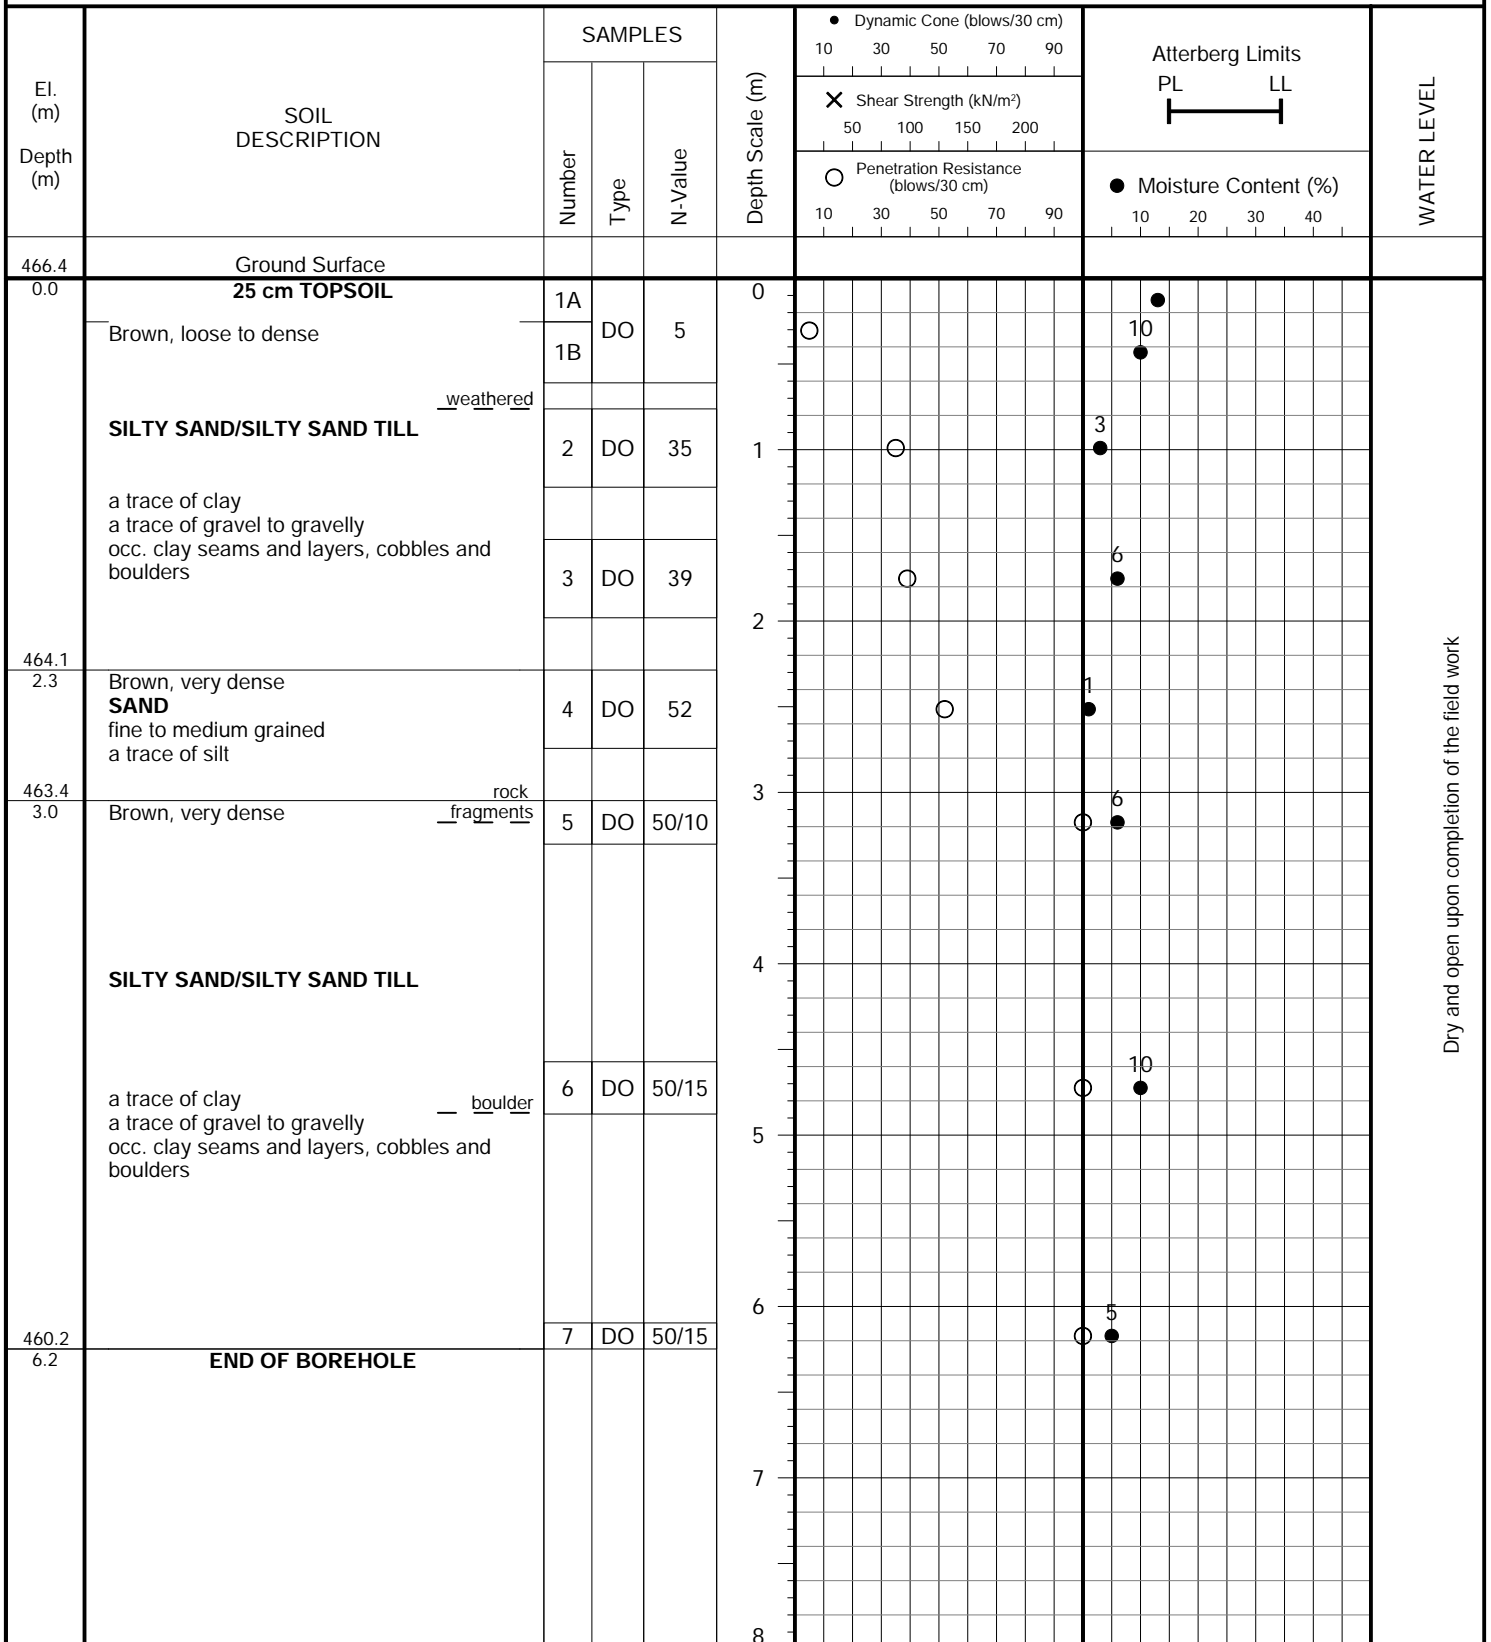

Dry and open upon completion of the field work




PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 23, 2020

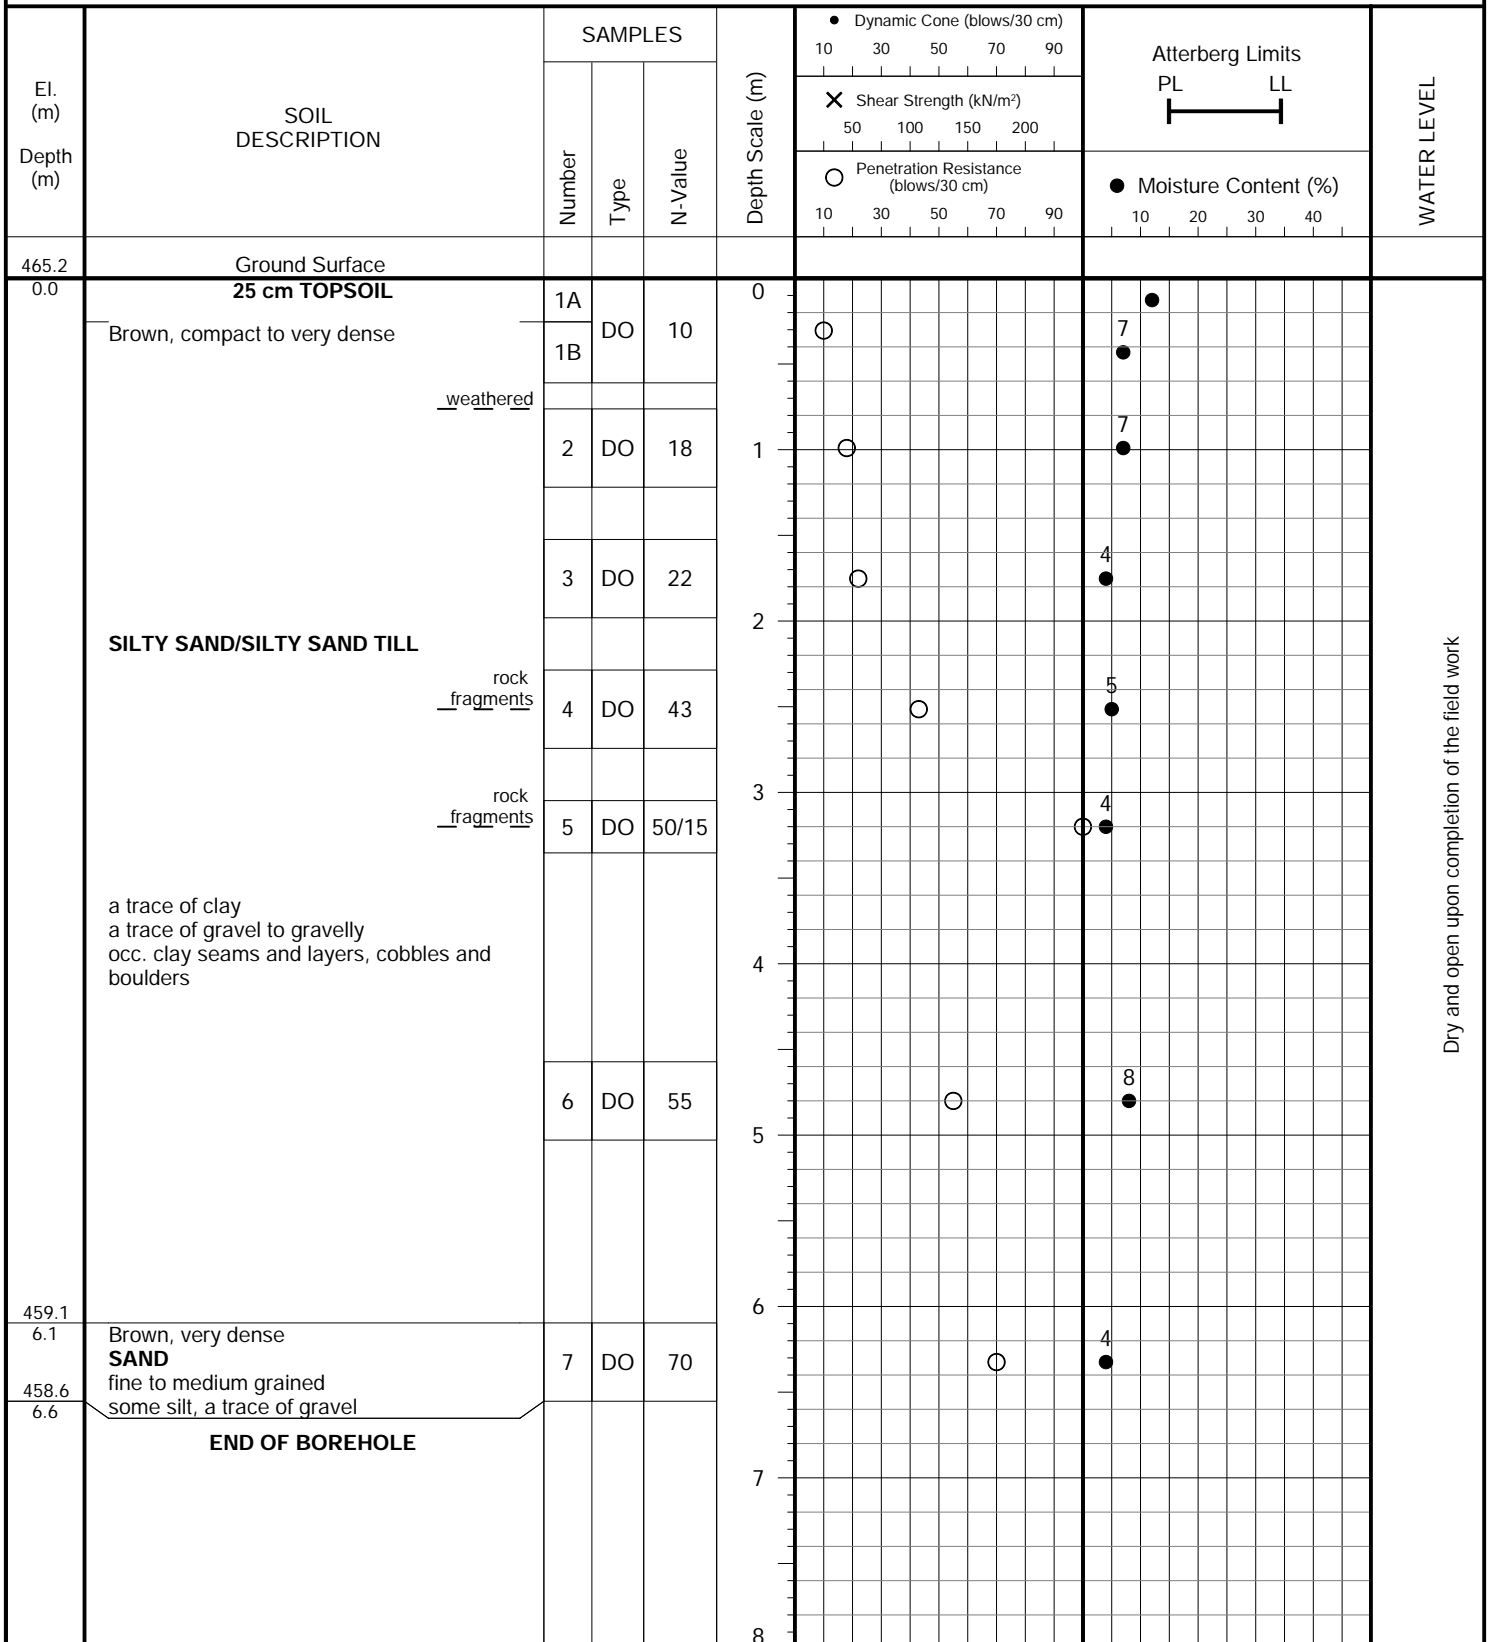


PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 23, 2020

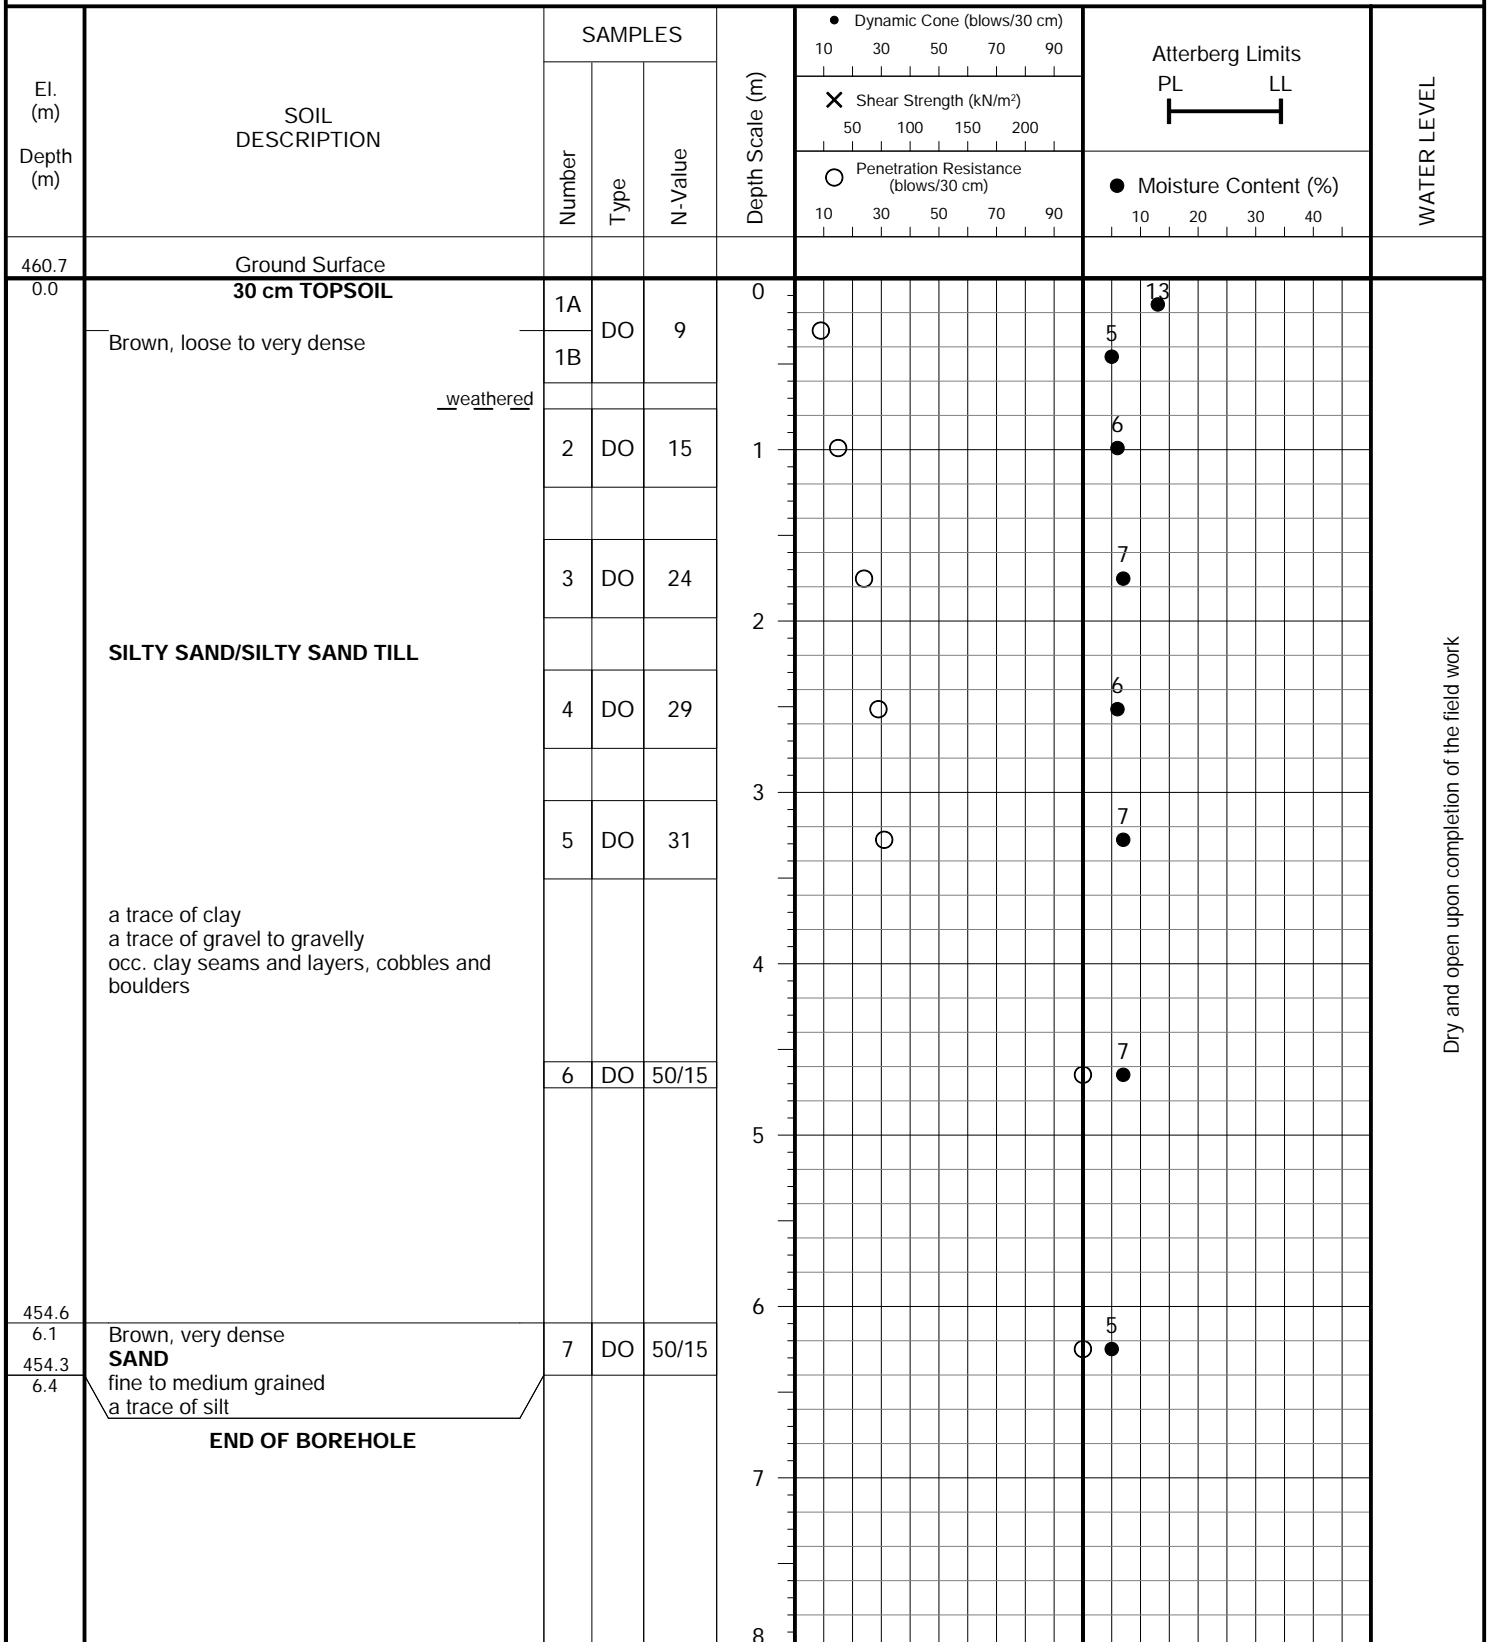

Dry and open upon completion of the field work




PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 23, 2020

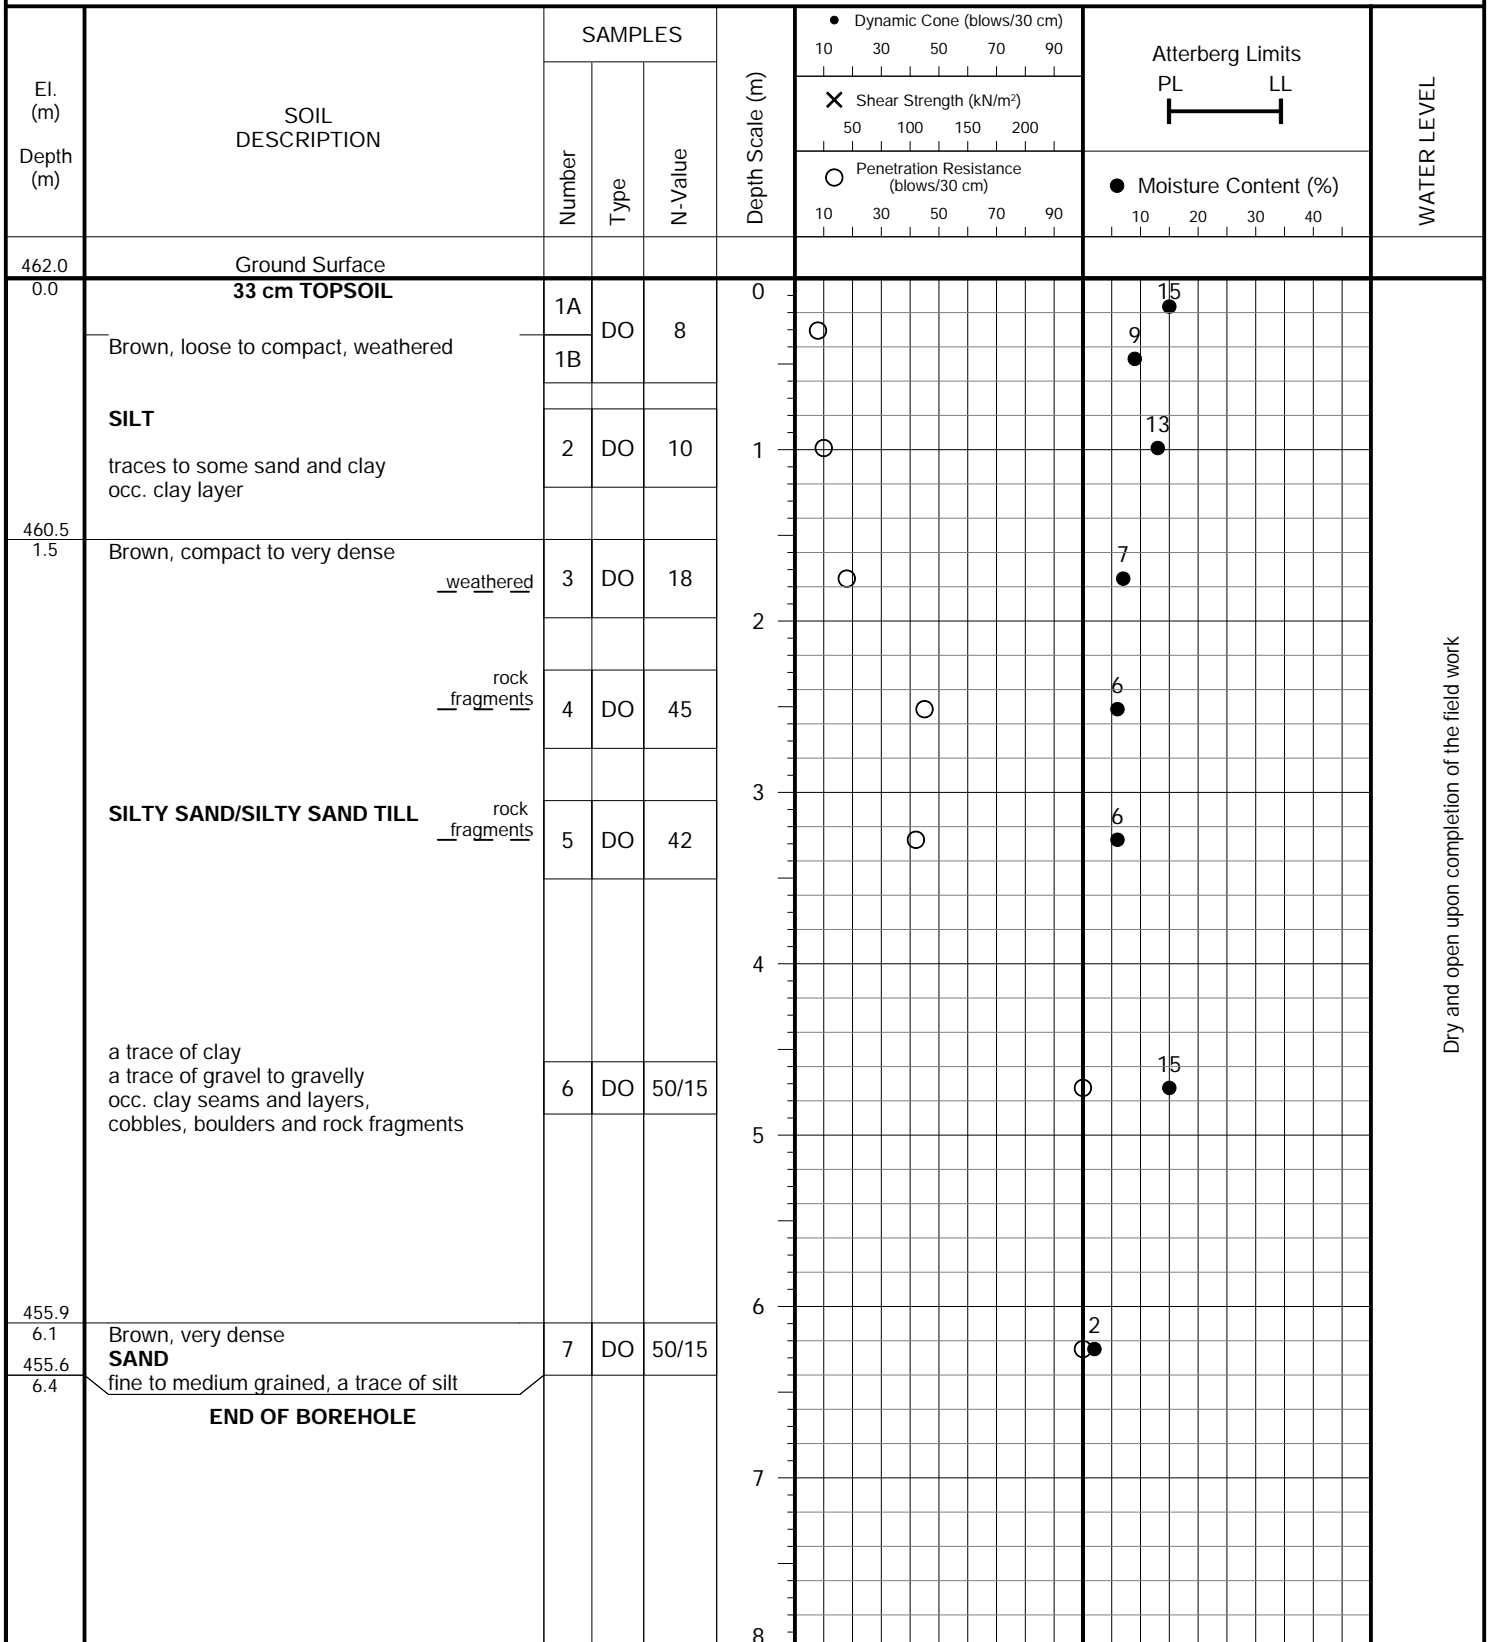

Dry and open upon completion of the field work




PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 22, 2020

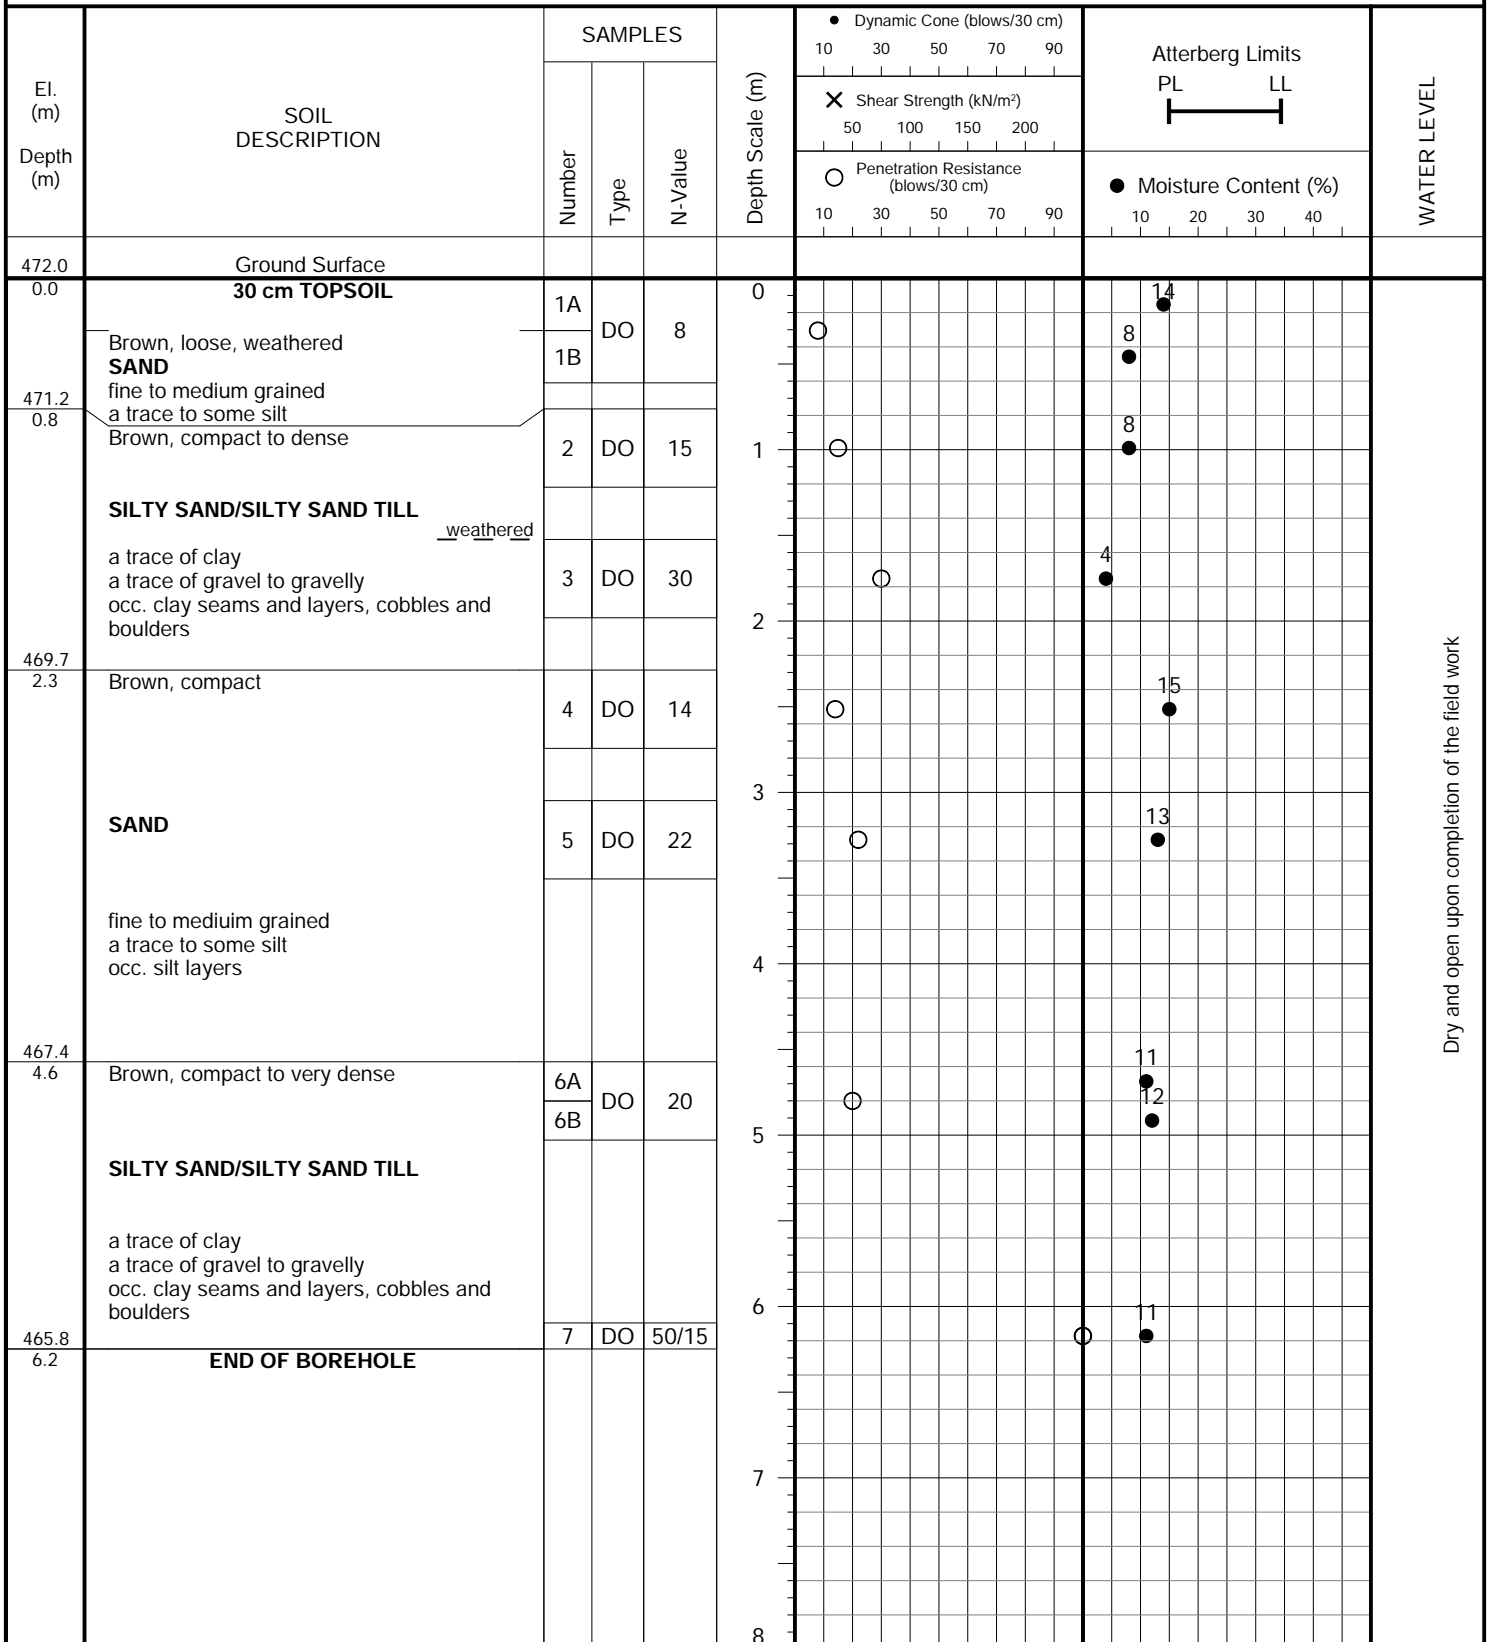

Dry and open upon completion of the field work




PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 22, 2020

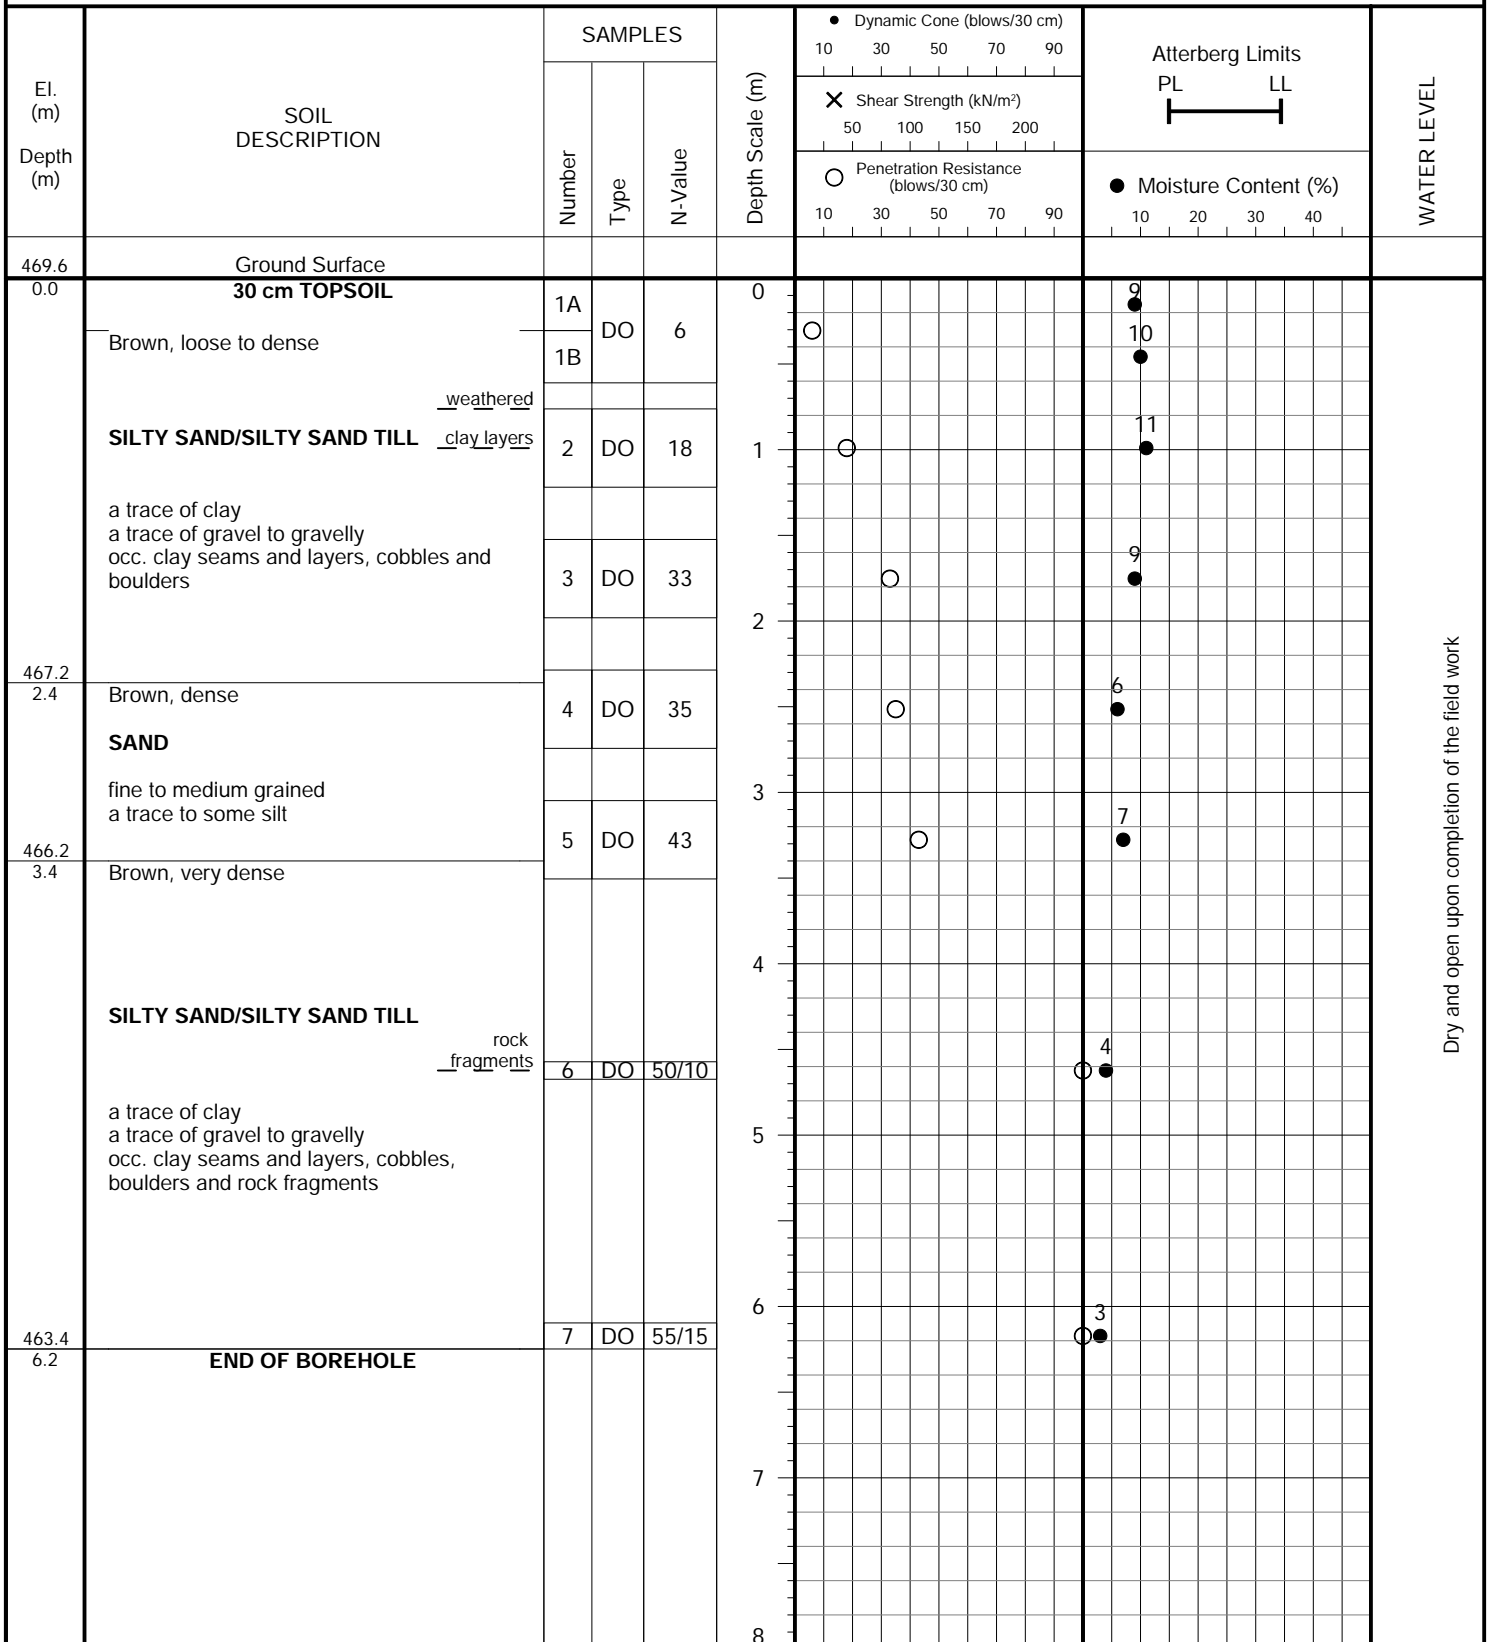

Dry and open upon completion of the field work




PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 22, 2020

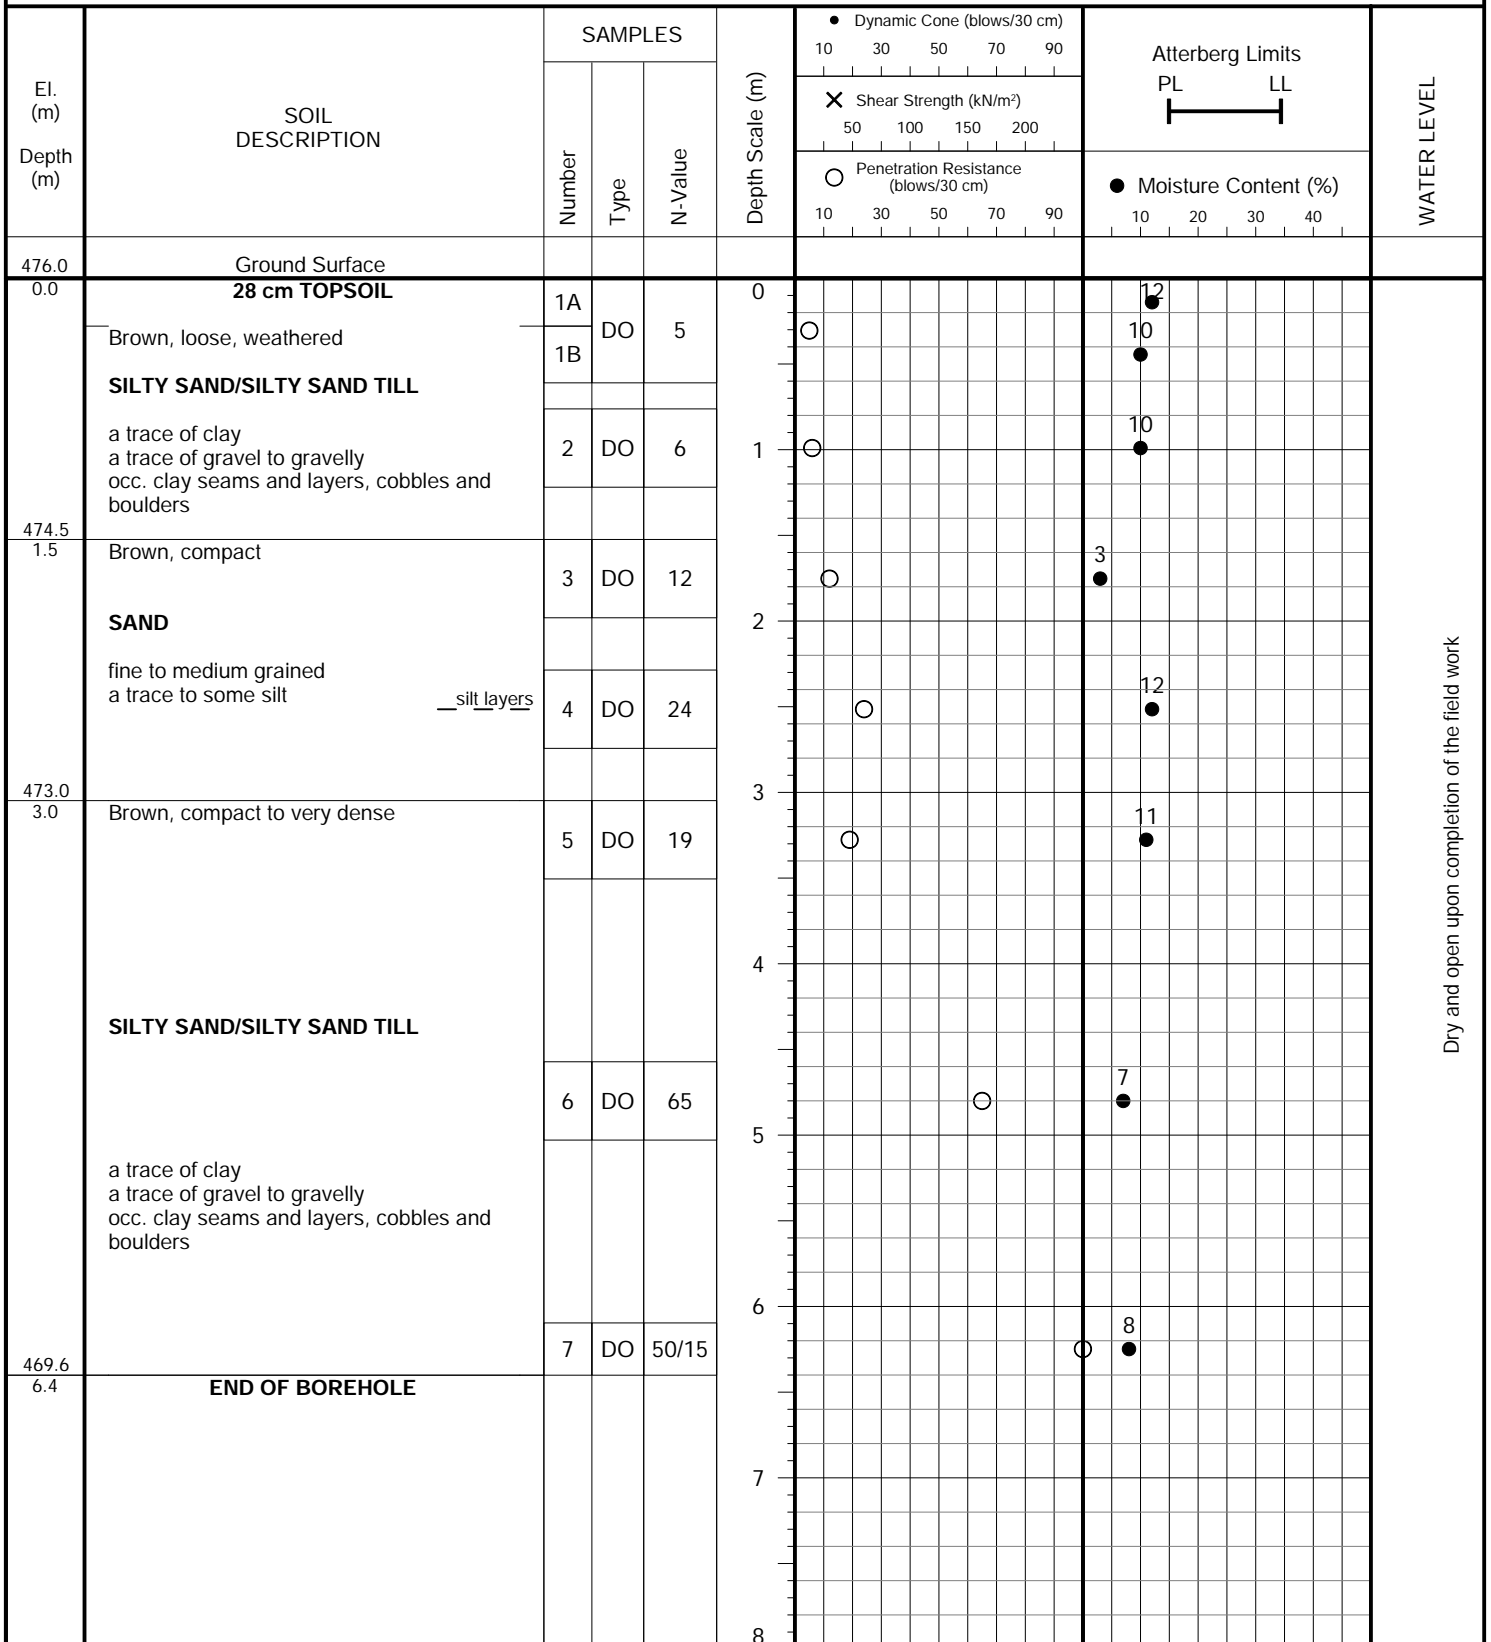

Dry and open upon completion of the field work




PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 22, 2020

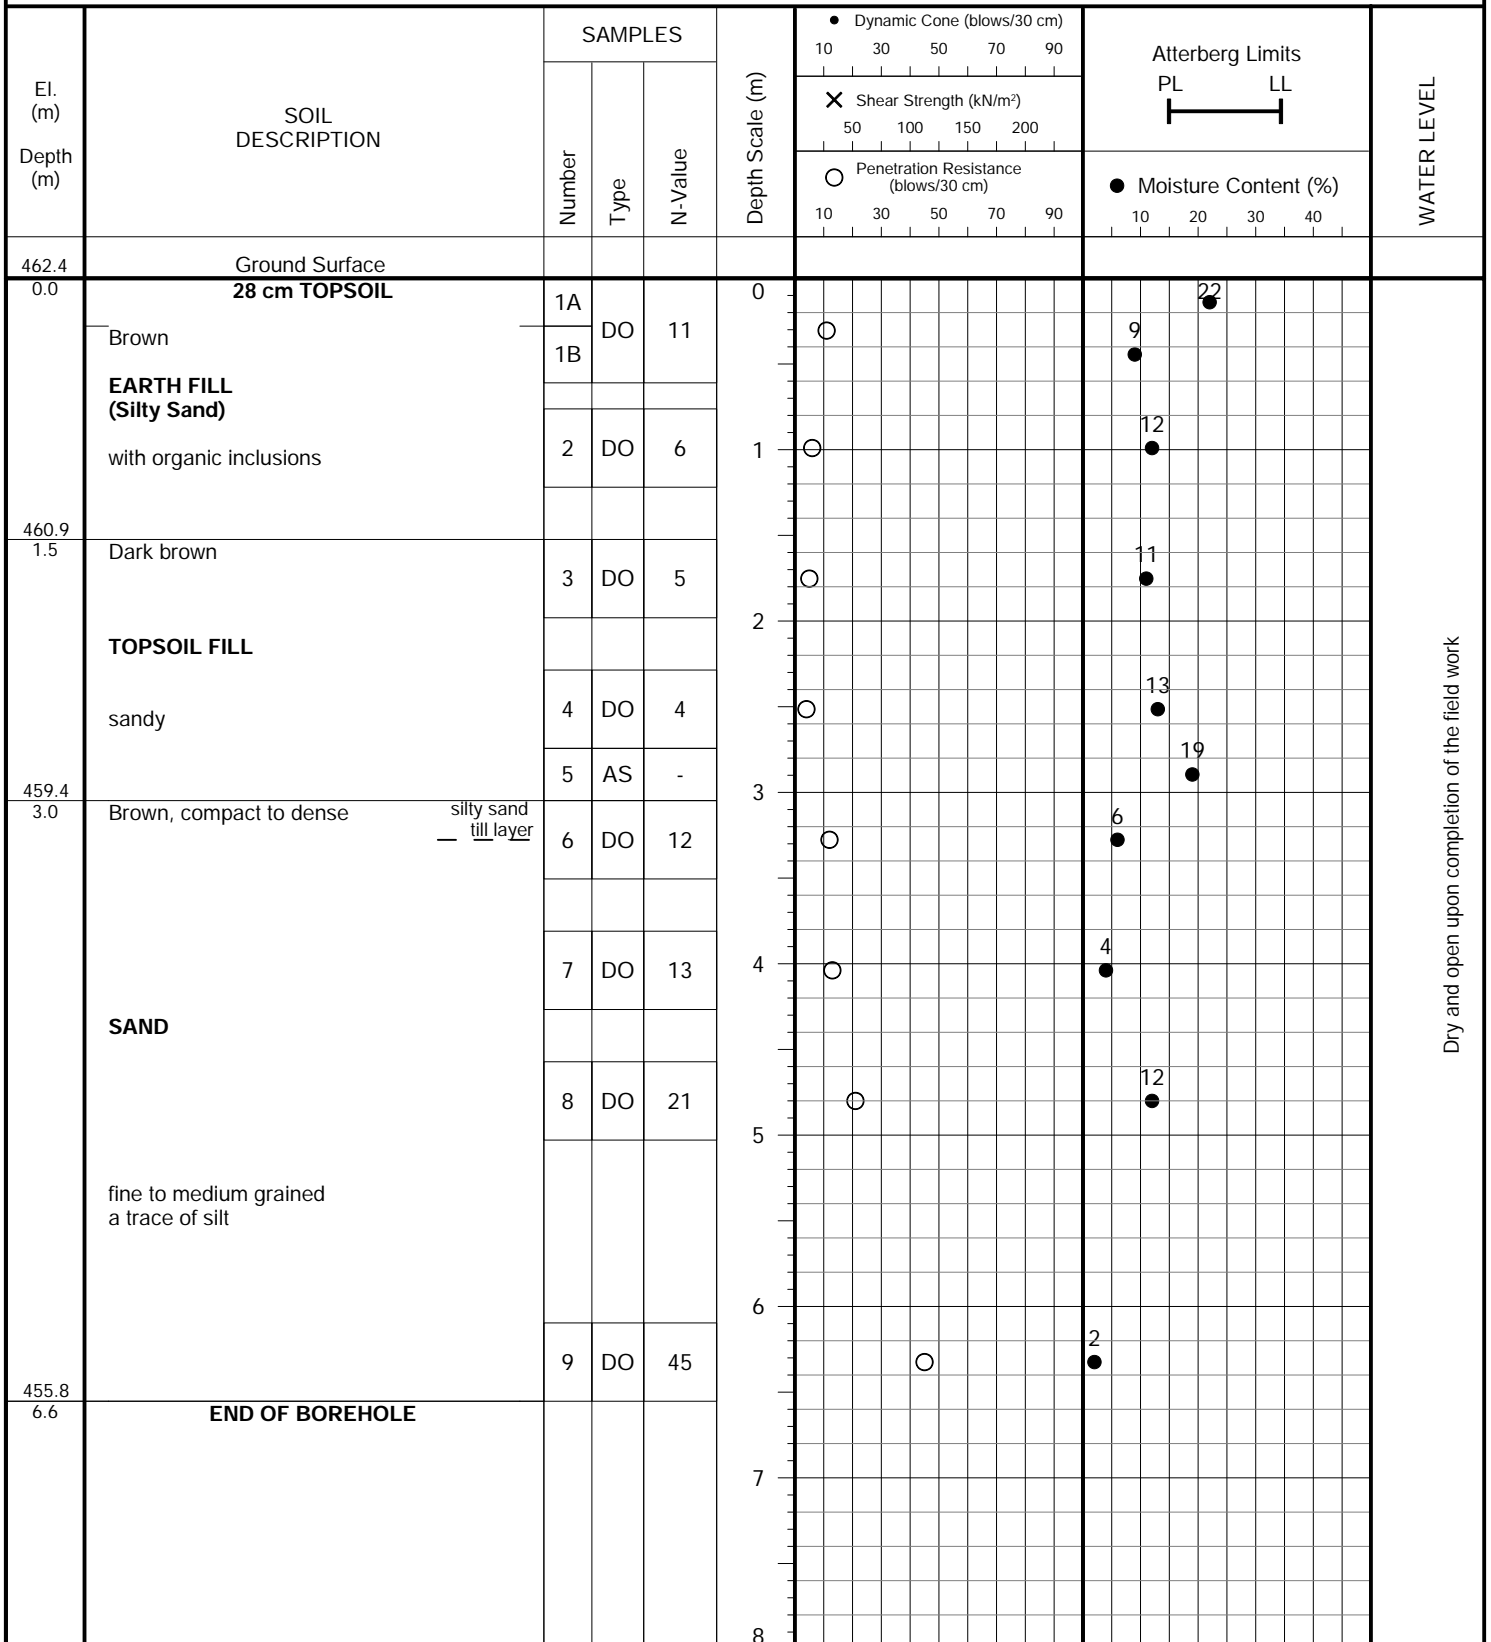

Dry and open upon completion of the field work




PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 22, 2020

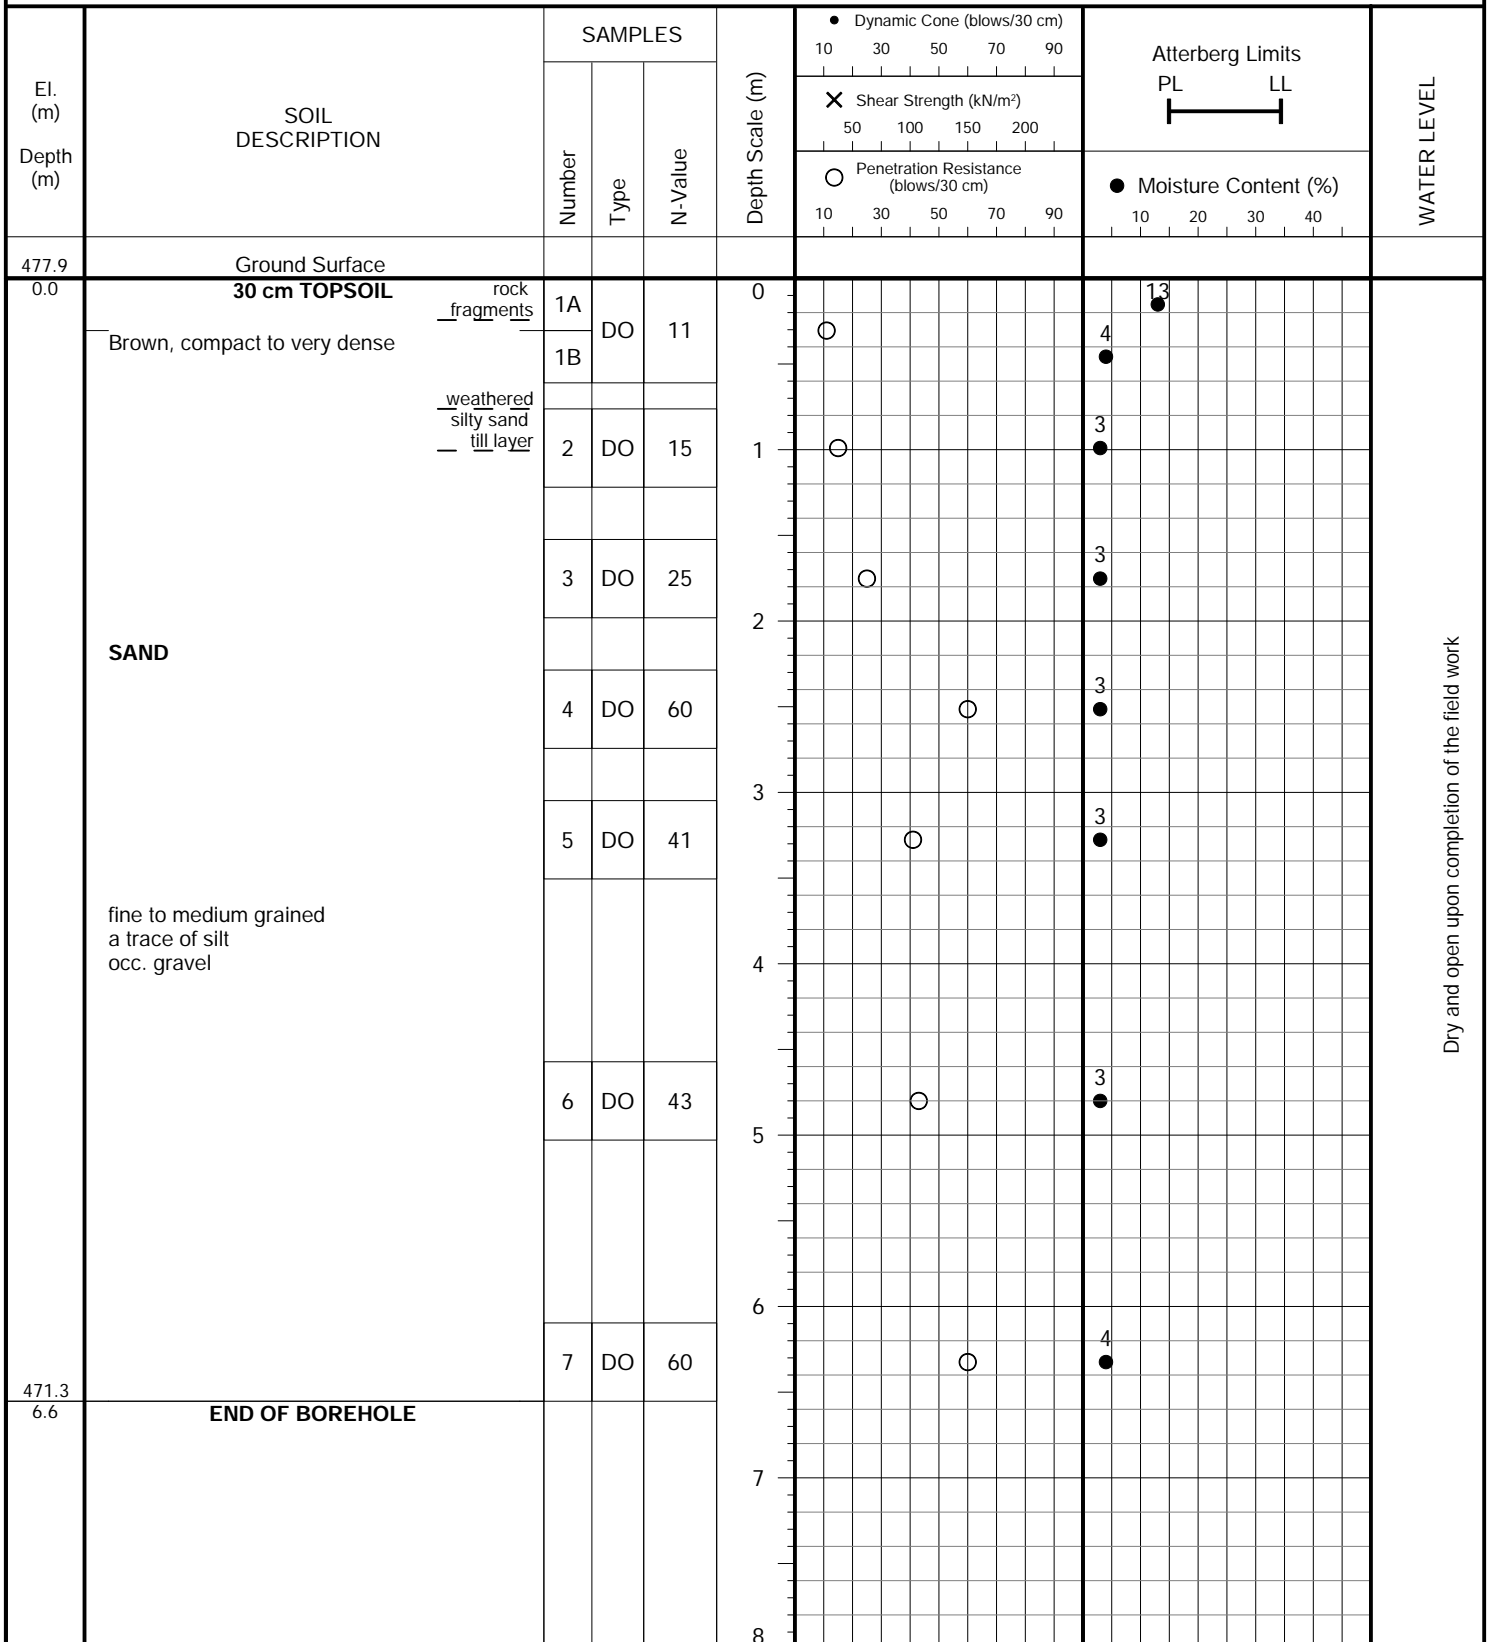


PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 22, 2020

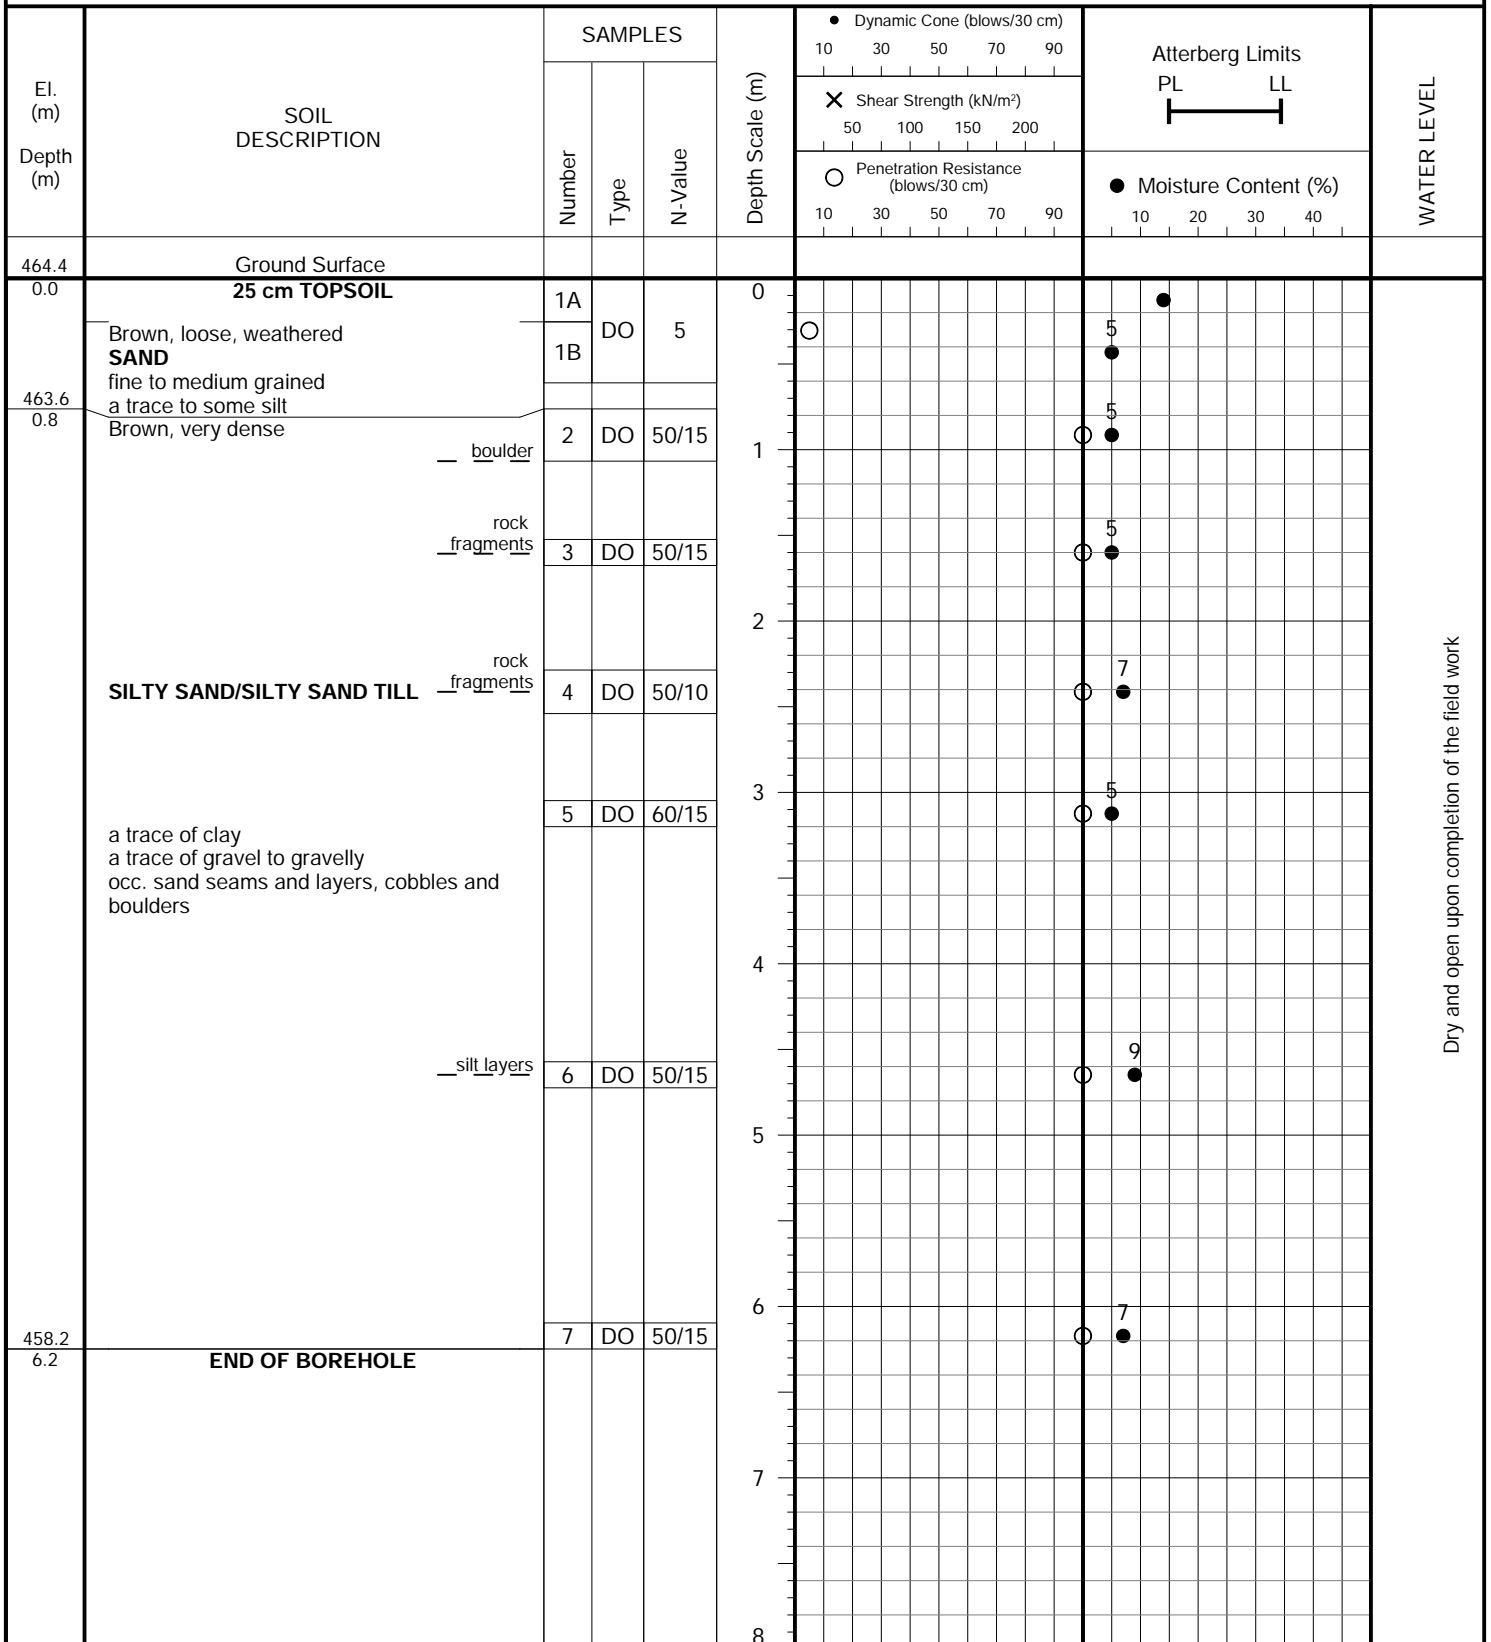

Dry and open upon completion of the field work




PROJECT DESCRIPTION: Proposed Development

METHOD OF BORING: Solid Stem Augers

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

DRILLING DATE: September 23, 2020

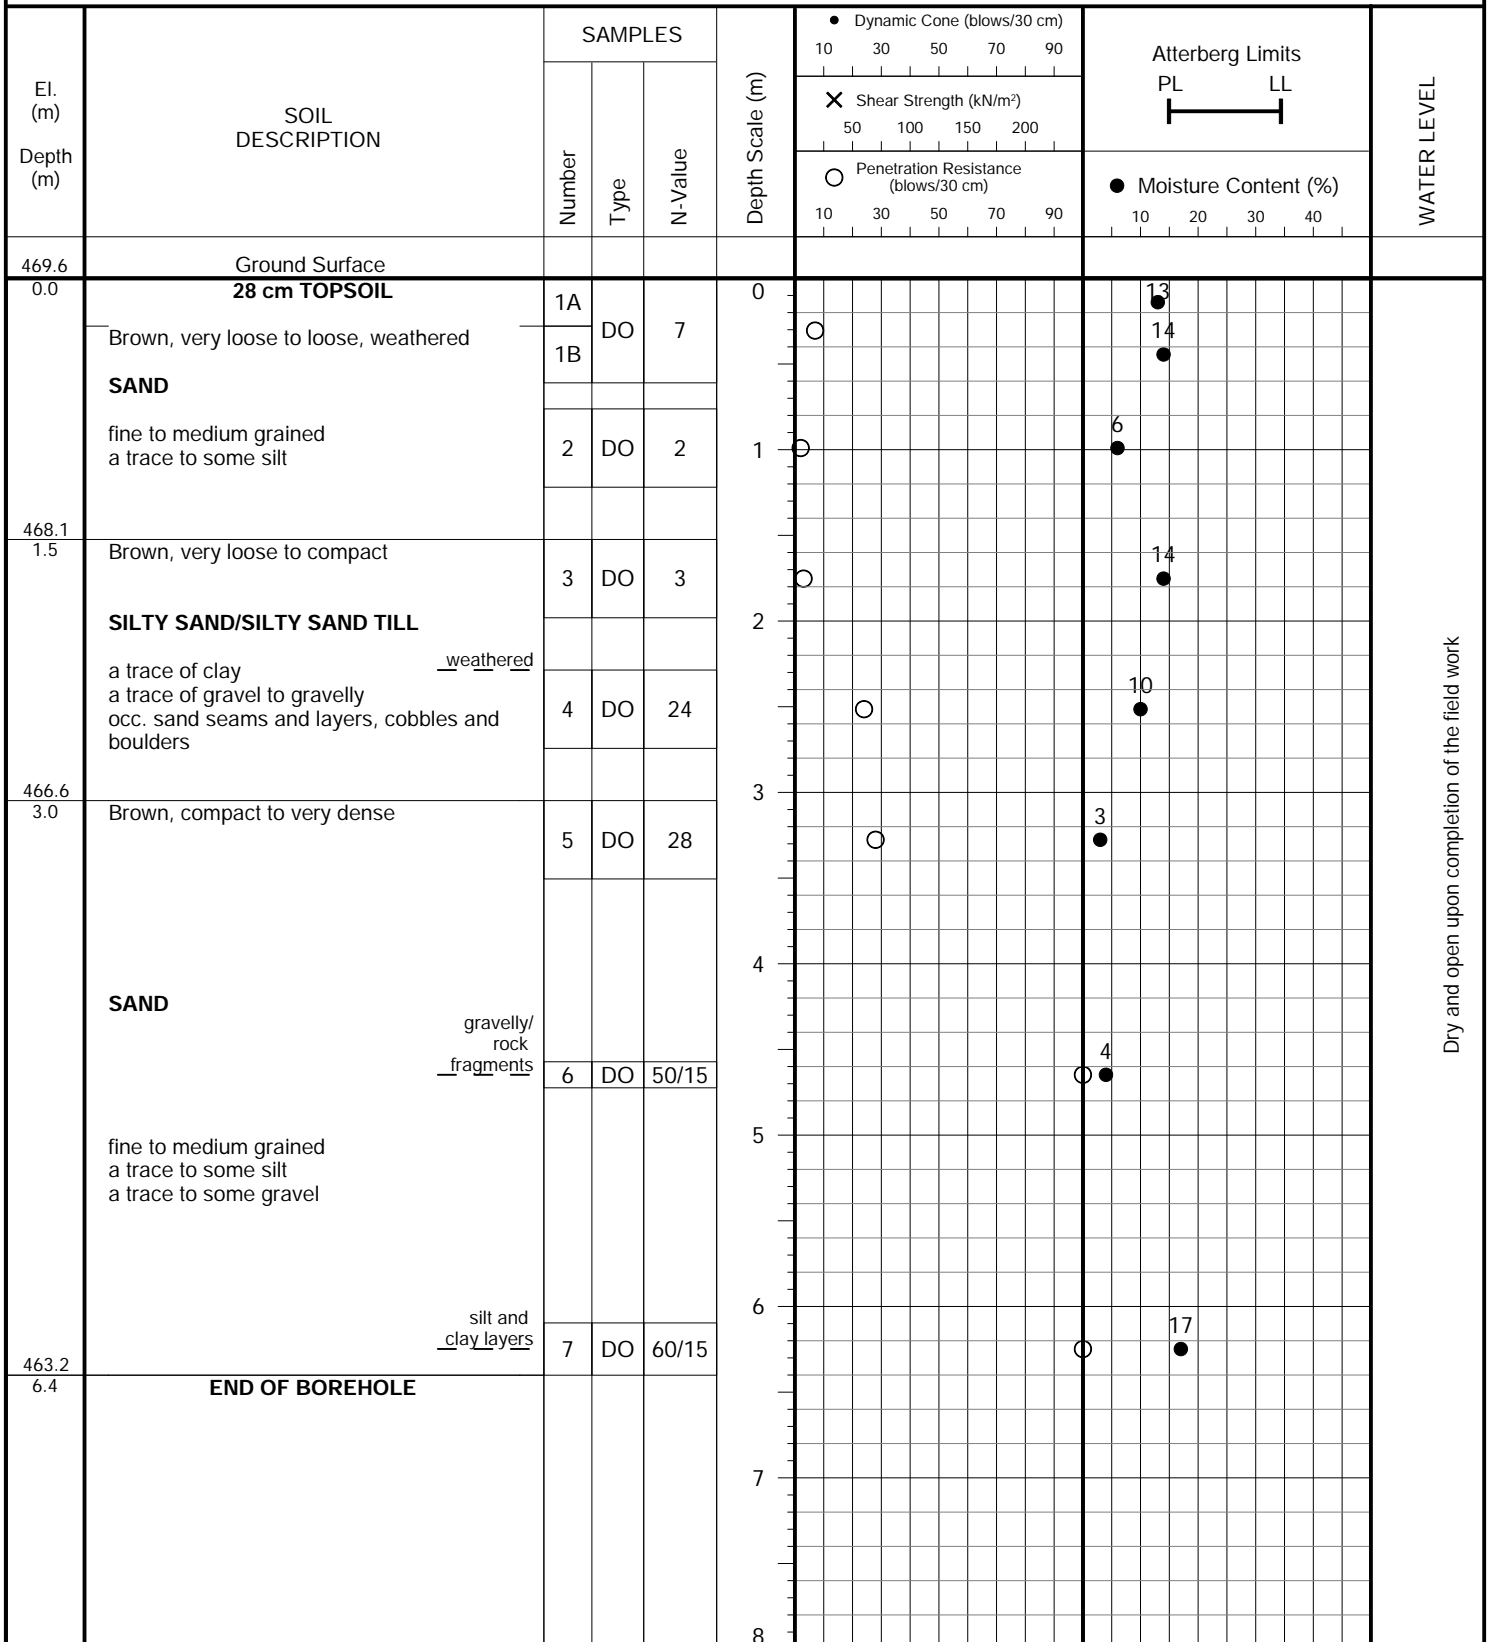

Dry and open upon completion of the field work






U.S. BUREAU OF SOILS CLASSIFICATION

GRAVEL				SAND				SILT	CLAY
COARSE		FINE	COARSE	MEDIUM	FINE	V. FINE			

UNIFIED SOIL CLASSIFICATION

GRAVEL		SAND				SILT & CLAY
COARSE	FINE	COARSE	MEDIUM	FINE		

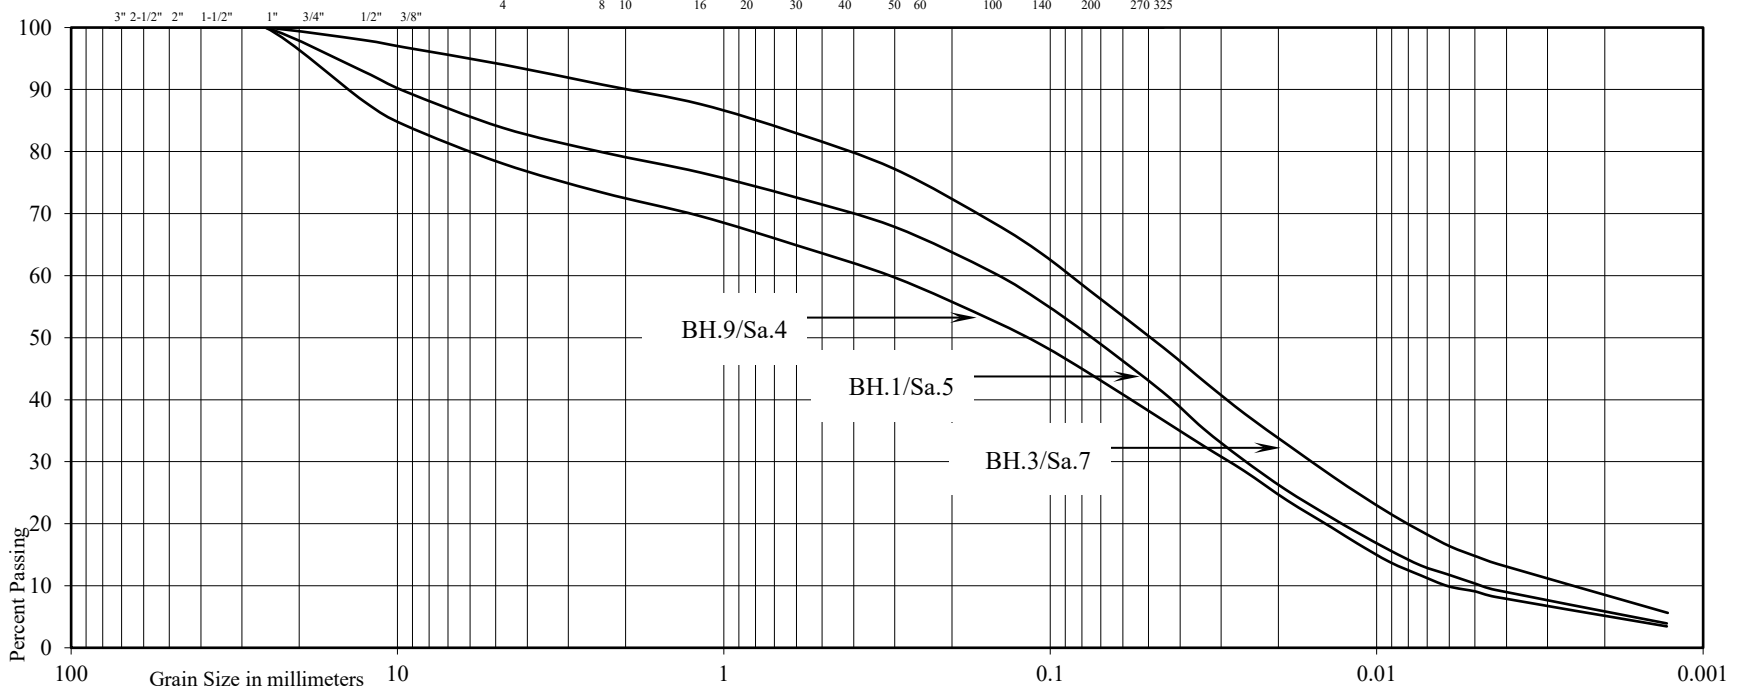

Project: Proposed Development
 Location: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

Borehole No:	1	3	9
Sample No:	5	7	4
Depth (m):	3.3	6.2	2.5
Elevation (m):	461.7	465.8	467.1

BH./Sa.	1/5	3/7	9/4
Liquid Limit (%) =	-	-	-
Plastic Limit (%) =	-	-	-
Plasticity Index (%) =	-	-	-
Moisture Content (%) =	9	11	10
Estimated Permeability (cm./sec.) =	10 ⁻⁶	10 ⁻⁶	10 ⁻⁵

Classification of Sample [& Group Symbol]: SANDY SILT TILL, a trace to some gravel to gravelly, a trace of clay


Figure: 13

U.S. BUREAU OF SOILS CLASSIFICATION

GRAVEL			SAND				SILT	CLAY
COARSE	FINE		COARSE	MEDIUM	FINE	V. FINE		

UNIFIED SOIL CLASSIFICATION

GRAVEL		SAND			SILT & CLAY
COARSE	FINE	COARSE	MEDIUM	FINE	


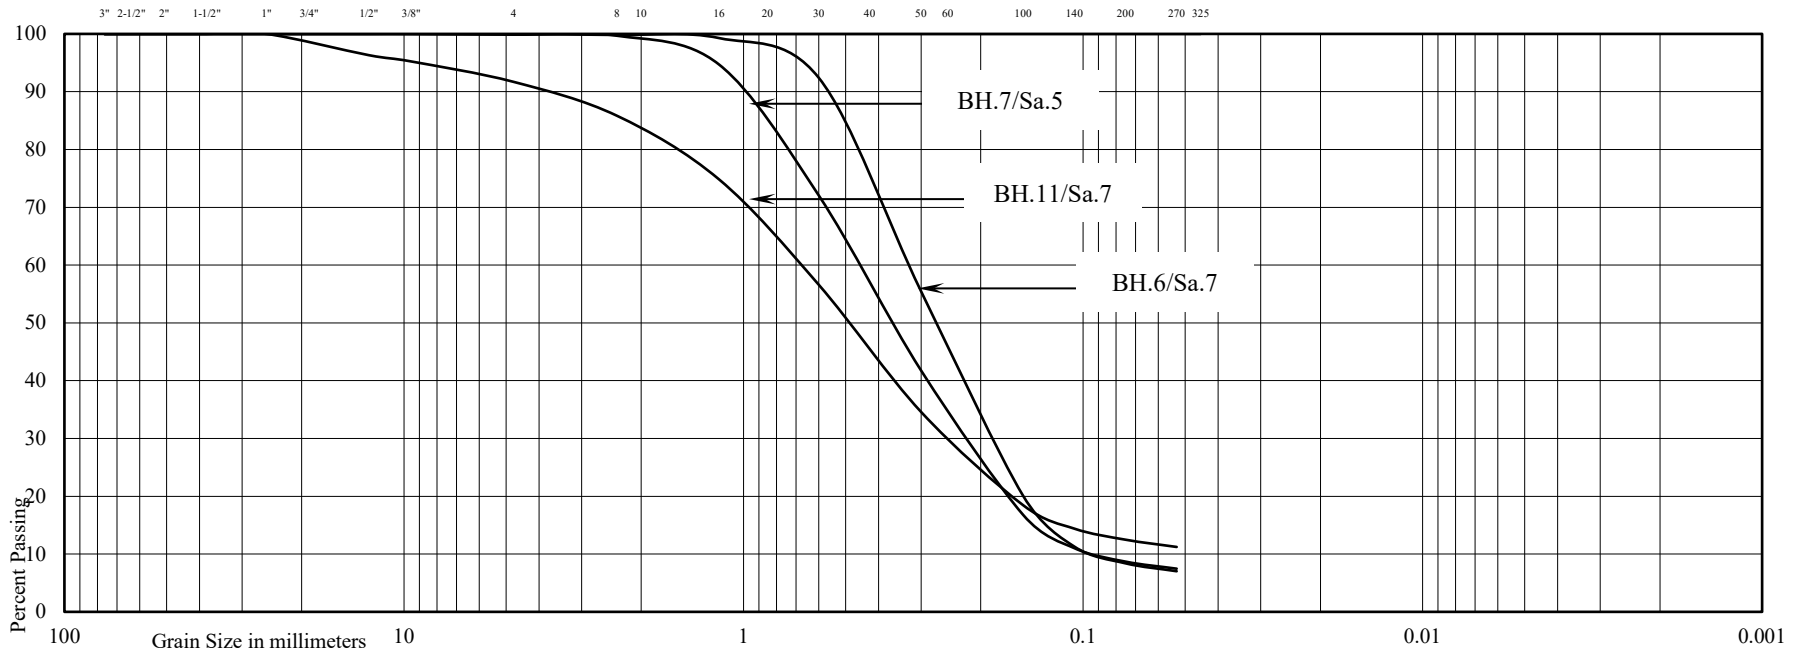


Project: Proposed Development
 Location: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

Borehole No:	6	7	11
Sample No:	7	5	7
Depth (m):	4.0	1.8	6.3
Elevation (m):	458.4	476.1	458.9

BH./Sa.	6/7	7/5	11/7
Liquid Limit (%) =	-	-	-
Plastic Limit (%) =	-	-	-
Plasticity Index (%) =	-	-	-
Moisture Content (%) =	4	3	4
Estimated Permeability (cm./sec.) =	10 ⁻²	10 ⁻²	10 ⁻³

Classification of Sample [& Group Symbol]: FINE TO MEDIUM SAND, a trace to some silt, traces of coarse sand and gravel

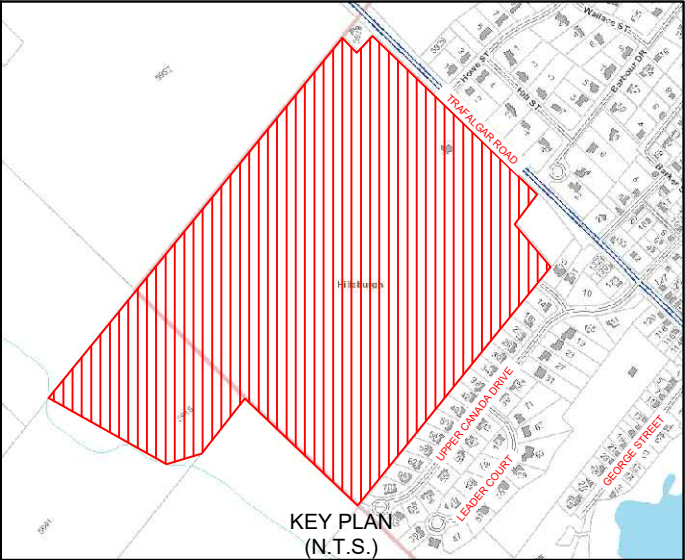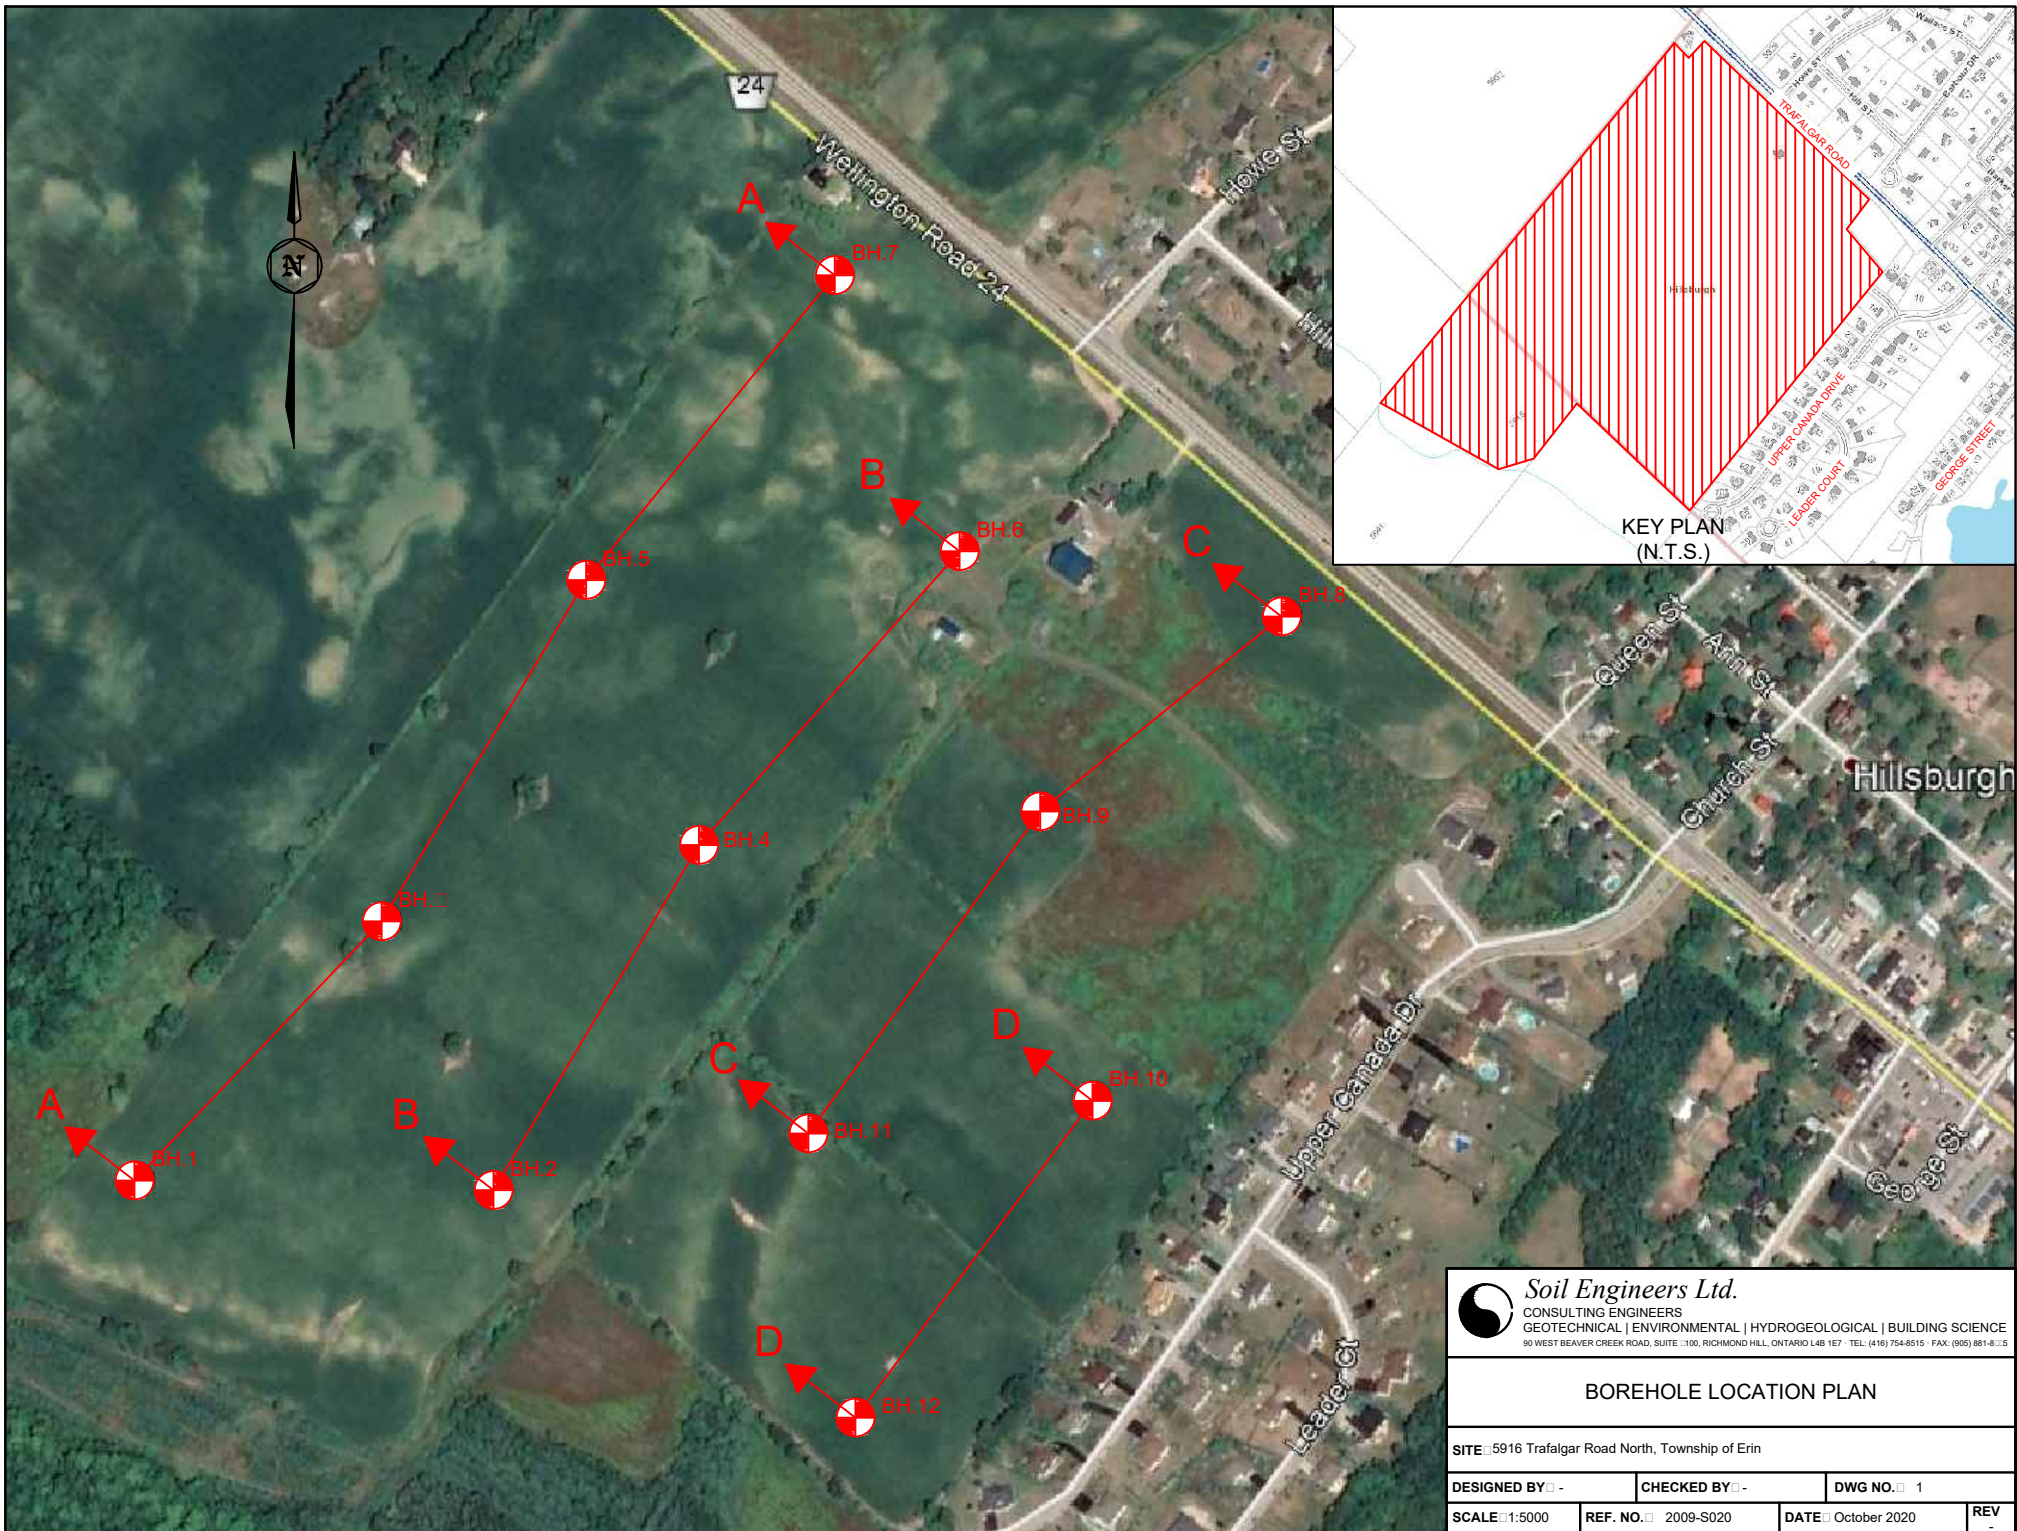


Soil Engineers Ltd.
 CONSULTING ENGINEERS
 GEOTECHNICAL | ENVIRONMENTAL | HYDROGEOLOGICAL | BUILDING SCIENCE
 90 WEST BEAVER CREEK ROAD, SUITE 100, RICHMOND HILL, ONTARIO L4B 1E7 TEL: (416) 754-8515 FAX: (905) 881-8115

BOREHOLE LOCATION PLAN

SITE: 5916 Trafalgar Road North, Township of Erin

DESIGNED BY	CHECKED BY	DWG NO. 1
SCALE 1:5000	REF. NO. 2009-S020	DATE October 2020
		REV



Soil Engineers Ltd.

CONSULTING ENGINEERS

GEOTECHNICAL | ENVIRONMENTAL | HYDROGEOLOGICAL | BUILDING SCIENCE

SUBSURFACE PROFILE

DRAWING NO. 2

SCALE: AS SHOWN


JOB NO.: 2009-S020
REPORT DATE: October 2020
PROJECT DESCRIPTION: Proposed Development

PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

LEGEND



BH No.:	1	3	5	7	12	10	8
El. (m):	465.0	472.0	476.0	477.9	460.7	466.4	464.4

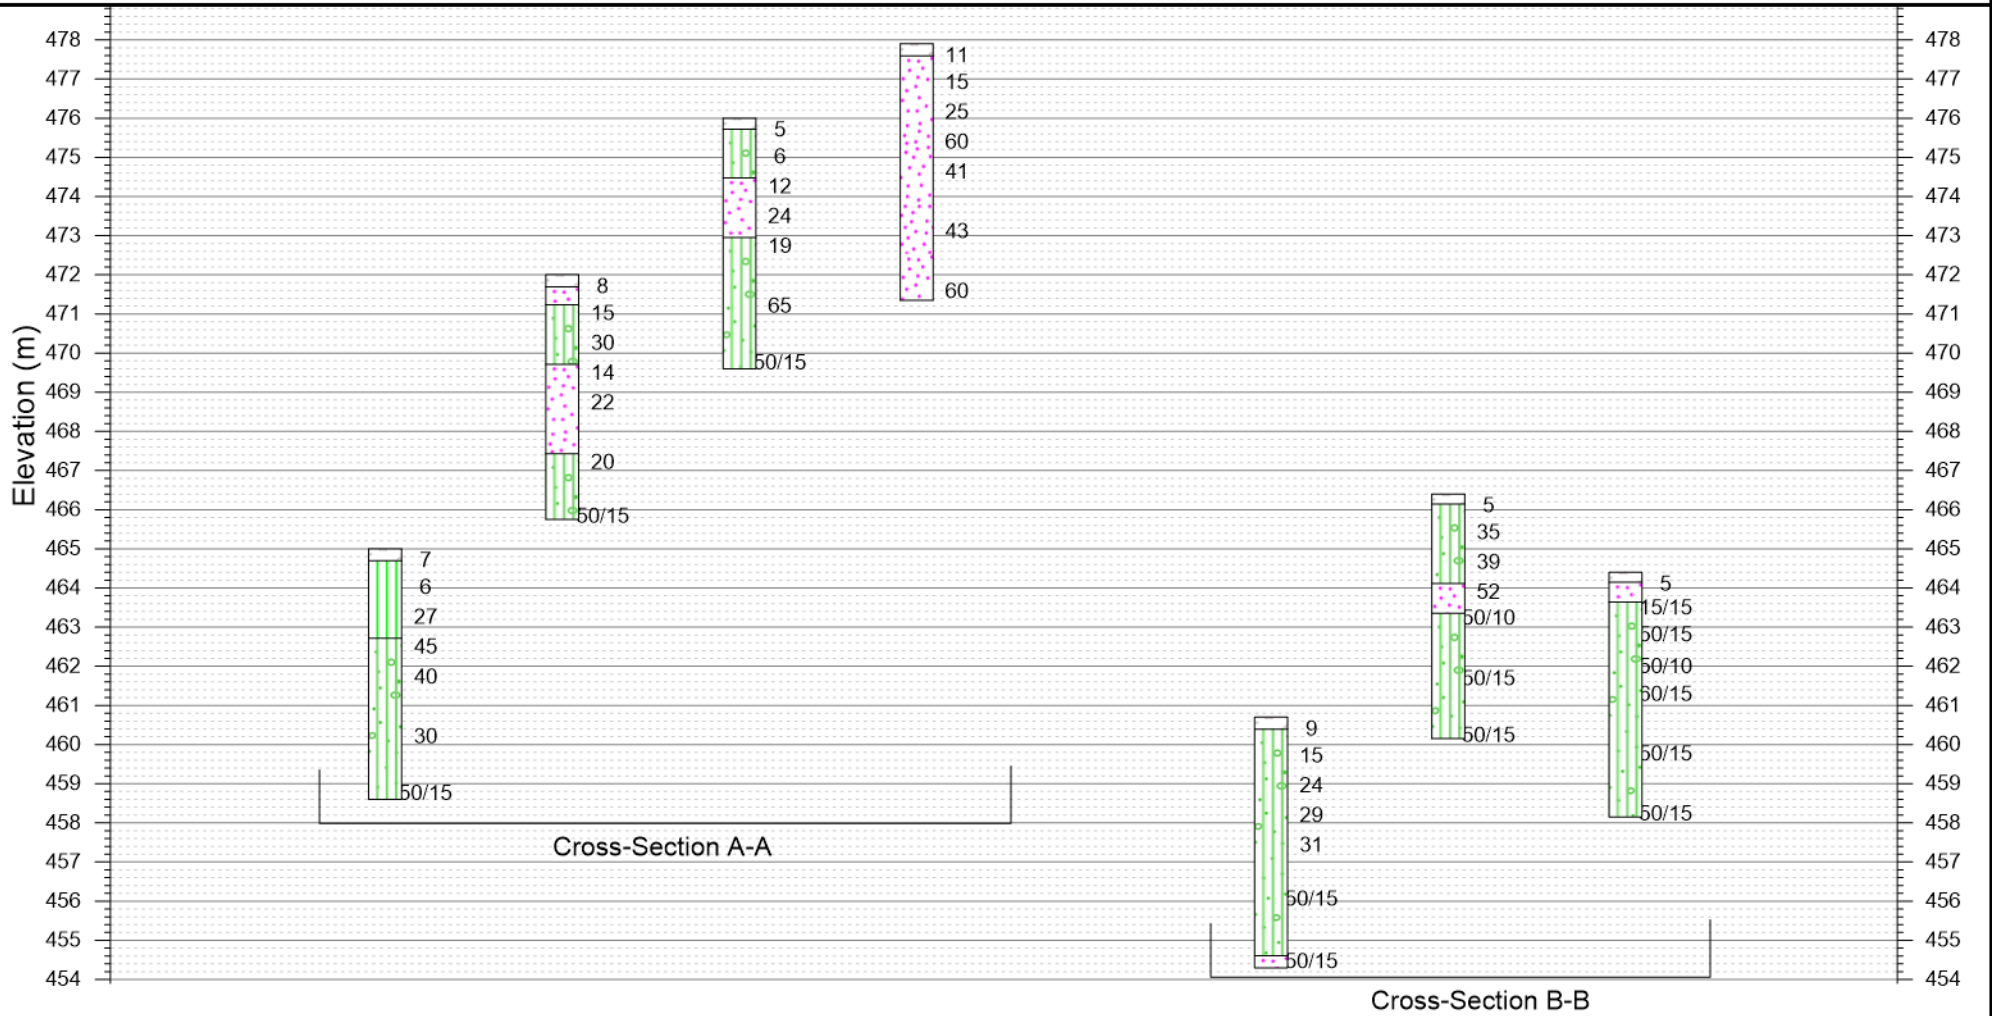



Soil Engineers Ltd.

CONSULTING ENGINEERS

GEOTECHNICAL | ENVIRONMENTAL | HYDROGEOLOGICAL | BUILDING SCIENCE

SUBSURFACE PROFILE

DRAWING NO. 3

SCALE: AS SHOWN


JOB NO.: 2009-S020
REPORT DATE: October 2020
PROJECT DESCRIPTION: Proposed Development


PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin (Hillsburgh)

LEGEND

 TOPSOIL  SAND  SANDY SILT/SILTY SAND TILL

BH No.:	11	9	8	12	10
El. (m):	465.2	469.6	464.4	460.7	466.4

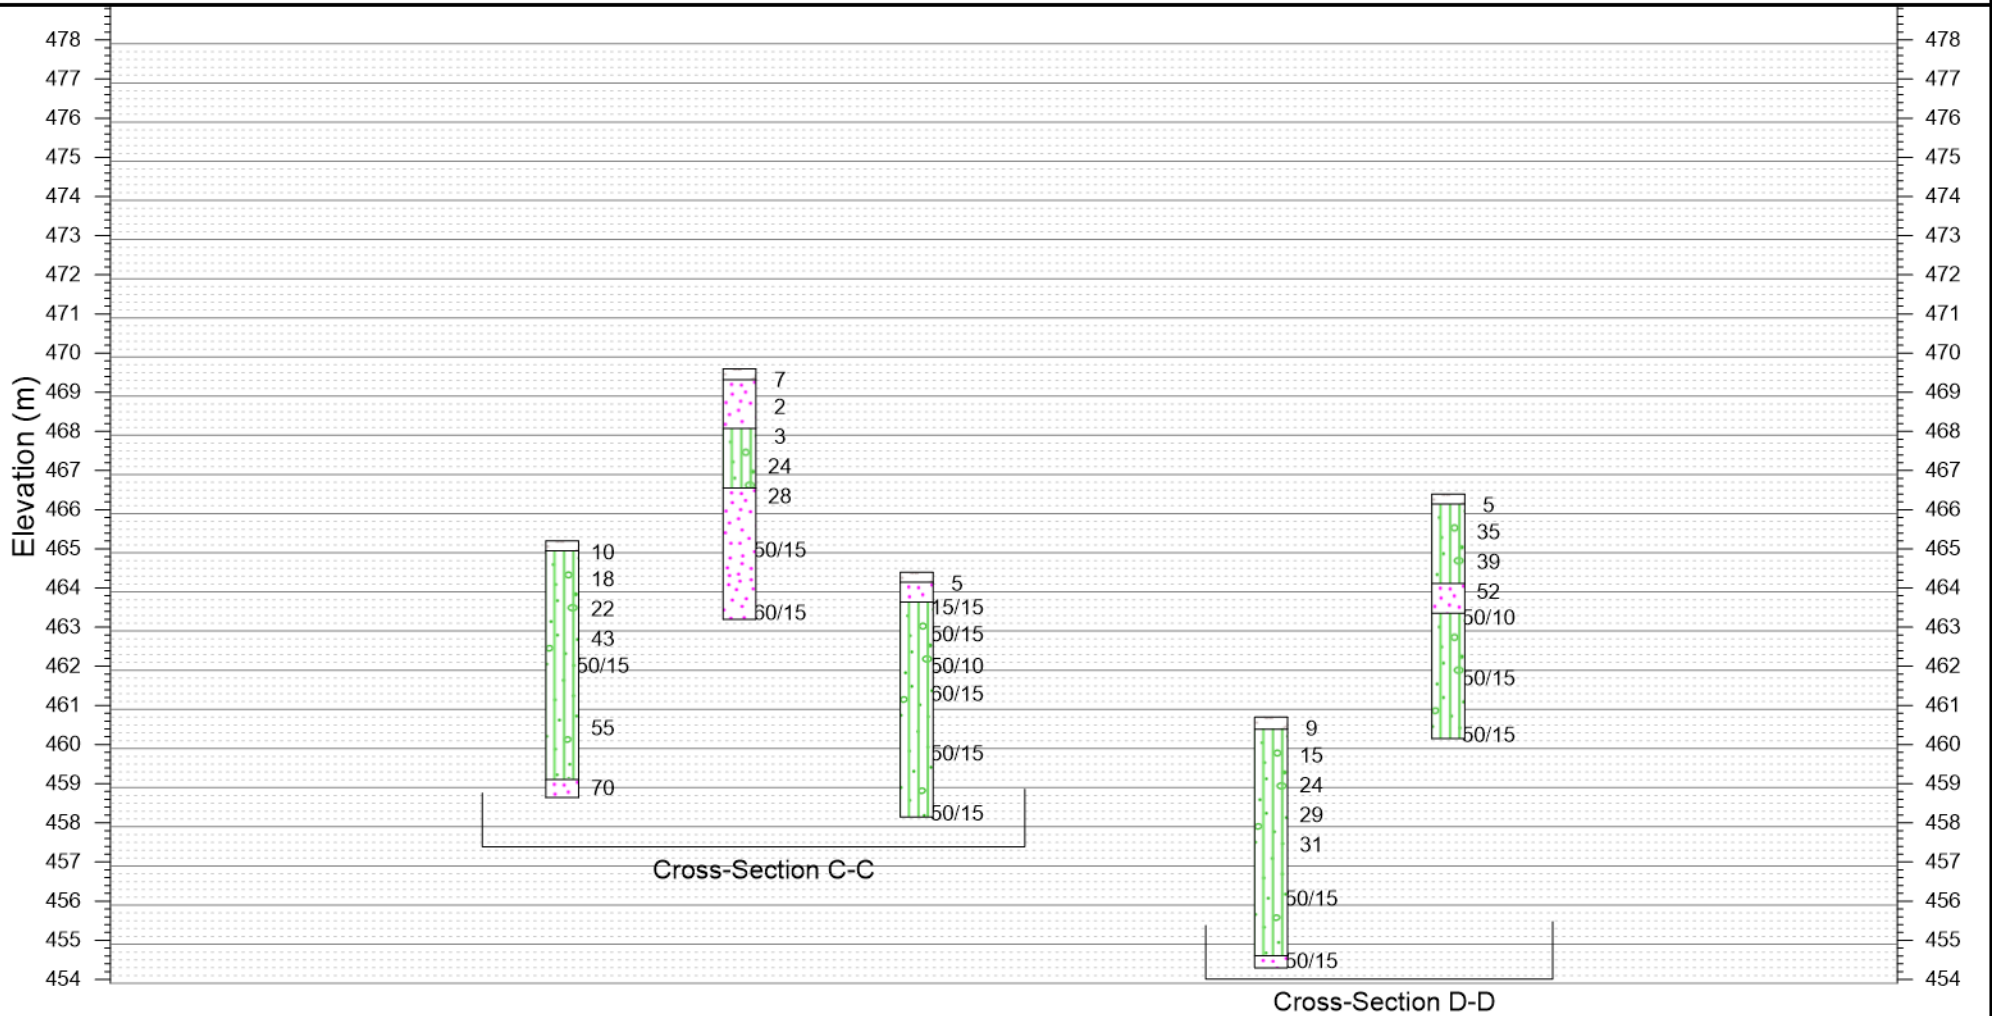

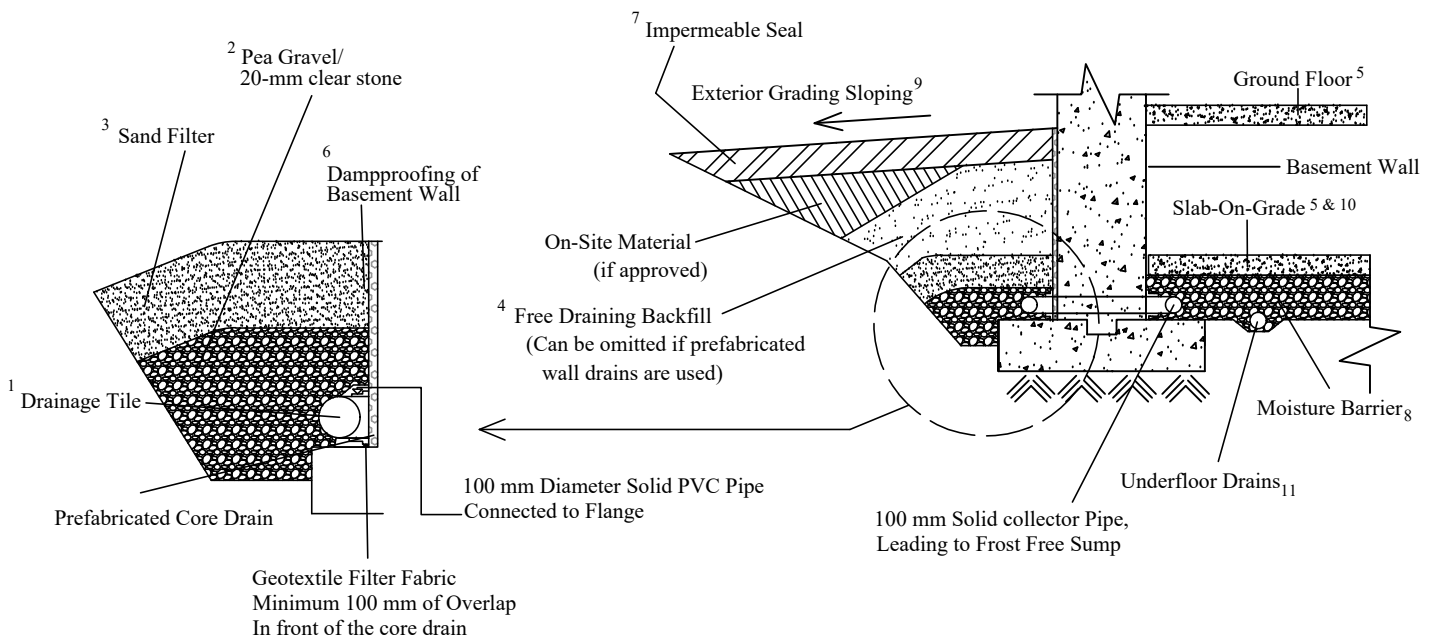

NOTES:

1. **Drainage tile:** consists of 100 mm (4") diameter weeping tile or equivalent perforated pipe leading to a positive sump or outlet. Invert to be at minimum of 150 mm (6") below underside of basement floor slab.
2. **Pea gravel:** at 150 mm (6") on the top and sides of drain. If drain is not placed on concrete footing, provide 100 mm (4") of pea gravel below drain. The pea gravel may be replaced by 20 mm clear stone provided that the drain is covered by a porous geotextile membrane of Terrafix 270R or equivalent.
3. **Filter material:** consists of C.S.A. fine concrete aggregate. A minimum of 300 mm (12") on the top and sides of gravel. This may be replaced by an approved porous geotextile membrane of Terrafix 270R or equivalent.
4. **Free-draining backfill:** OPSS Granular 'B' or equivalent, compacted to 95% to 98% (maximum) Standard Proctor dry density. Do not compact closer than 1.8 m (6') from wall with heavy equipment. This may be replaced by on-site material if prefabricated wall drains (Miradrain) extending from the finished grade to the bottom of the basement wall are used.
5. **Do not backfill** until the wall is supported by the basement floor slab and ground floor framing, or adequate bracing.
6. **Dampproofing** of the basement wall is required before backfilling
7. **Impermeable backfill seal** of compacted clay, clayey silt or equivalent. If the original soil in the vicinity is a free-draining sand, the seal may be omitted.
8. **Moisture barrier:** 20-mm clear stone or compacted OPSS Granular 'A', or equivalent. The thickness of this layer should be 150 mm (6") minimum.
9. **Exterior Grade:** slope away from basement wall on all the sides of the building.
10. **Slab-On-Grade** should not be structurally connected to walls or foundations.
11. **Underfloor drains*** should be placed in parallel rows at 6 to 8 m (20'-25') centre, on 100 mm (4") of pea gravel with 150 mm (6") of pea gravel on top and sides. The invert should be at least 300 mm (12") below the underside of the floor slab. The drains should be connected to positive sumps or outlets. Do not connect the underfloor drains to the perimeter drains.

* Underfloor drains can be deleted where not required.



Soil Engineers Ltd.

CONSULTING ENGINEERS
 GEOTECHNICAL | ENVIRONMENTAL | HYDROGEOLOGICAL | BUILDING SCIENCE
 90 WEST BEAVER CREEK, SUITE 100, RICHMOND HILL, ONTARIO · TEL: (416) 754-8515 · FAX: (416) 754-8516

Details of Perimeter Drainage System

SITE 5916 Trafalgar Road North, Township of Erin

DESIGNED BY K.L.	CHECKED BY B.S.	DWG NO. 4
SCALE N.T.S.	REF. NO. 2009-S020	DATE October 2020
		REV -

APPENDIX “D”

Hydrogeological Investigation Report

**HYDROGEOLOGICAL INVESTIGATION
PROPOSED BRIARWOOD HILLSBURGH DEVELOPMENT
5916 Trafalgar Road North, Town of Erin, Ontario**

Prepared for:

Hillsburgh Heights Inc.

636 Edward Avenue, Suite 14
Richmond Hill, Ontario L4C 0V4

Prepared by:



2179 Dunwin Drive, Unit 4
Mississauga, ON L5L 1X2

Project No. 2100428AH

August 02, 2022

August 02, 2022

Project No. 2100428AH

Hillsburgh Heights Inc.
636 Edward Avenue, Suite 14
Richmond Hill, Ontario L4C 0V4

Email: Fausto@briarwoodhomes.ca

Attention: Mr. Fausto Saponara

Dear Mr. Saponara

**RE: Hydrogeological Investigation for Proposed Briarwood Hillsburgh Development
5916 Trafalgar Road North, Town of Erin, Ontario**

HLV2K Engineering Limited (HLV2K) is pleased to provide the hydrogeological investigation report for the above mentioned project. The report presents HLV2K's understanding of the hydrogeological setting of the study area based on exploratory drilling, data collection, analyses, and review.

We trust that this information meets your present requirements. If we can be of additional assistance in this regard, please contact this office.

For and on behalf of HLV2K Engineering Limited,

k. Mohamadi

Kourosh Mohammadi, Ph.D., P.Eng.

President & Principal Engineer

TABLE OF CONTENT

1 INTRODUCTION..... 1

1.1 General 1

1.2 Purpose 1

2 METHOD OF INVESTIGATION 2

2.1 General 2

2.2 Boreholes and Monitoring Wells 2

2.3 Groundwater Monitoring 3

2.4 In-Situ Hydraulic Conductivity Testing 3

2.5 In-Situ Percolation Test 3

3 SITE CONDITIONS 4

3.1 Physical Setting 4

3.2 Climatic Conditions 4

3.3 Physiography and Drainage 4

3.4 Geological Mapping 5

3.5 Subsurface Soil Conditions 5

4 GROUNDWATER CONDITIONS 6

4.1 Regional Groundwater Recharge 6

4.2 Groundwater Level Fluctuations 6

4.3 Percolation Test Results 9

4.4 Groundwater Use in the Study Area 9

5 GROUNDWATER DEWATERING ESTIMATES 10

6 WELLHEAD PROTECTION AREA 10

7 WATER BALANCE ANALYSIS 10

7.1 Thornthwaite Monthly Water-Balance Model 11

7.2 Pre-Construction Water Balance 11

7.3 Post-Construction Water Balance without LID 12

7.4 Post-Construction Water Balance with LID 14

7.5 Impact Assessment 16

8 PREDICTED EFFECTS 17

8.1 Groundwater Use 17

8.2 Surface Water Resources 17

8.3 Potential for Dewatering-Related Consolidation Settlement 17

9 SUMMARY AND CONCLUSION 18

10 STATEMENT OF LIMITATIONS 19

11 CLOSURE 19

REFERENCES 20

FIGURES

Figure 1	Site Location
Figure 2	Borehole Location Plan
Figure 3	Physiographic Map
Figure 4	Surficial Geology
Figure 5	Bedrock Geology
Figure 6	Water Well Use Map
Figure 7	Wellhead Protection Area Close to Site
Figure 8	Location of the Wetland

TABLES

Table 1: Information on Boreholes and Groundwater Monitoring Wells	3
Table 2: Climate Data Summary (1981 – 2010) – Fergus Shand Dam Station (ID 6142400)	4
Table 3: Summary of Groundwater Level Observations in Monitoring Wells	7
Table 4: Summary of Infiltration Test Results	9
Table 5: Post-Construction (Proposed) Land Statistics	13
Table 6: Post -Construction Water Balance Summary.....	15

APPENDICES

Appendix A	Borehole Logs and Grain Size Analysis
Appendix B	Infiltration Tests Field Measurements and Calculations
Appendix C	Information on Water Well Records Received from MECP
Appendix D	Water Balance Analysis Tables
Appendix E	Drawings Provided by the Client

LIST OF ACRONYMS AND DEFINITIONS

BH	Borehole
EASR	Environmental Activity and Sector Registry
K	Hydraulic Conductivity
GPM	Gallon per Minute
mbgs	Metres Below Ground Surface
MECP	Ontario Ministry of the Environment, Conservation and Parks
O.Reg.903	Ontario's Wells Regulation
PTTW	Permit To Take Water

1 INTRODUCTION

1.1 General

HLV2K Engineering Limited (HLV2K) was retained by Hillsburgh Heights Inc. (the Client) with a proposal to conduct the hydrogeological investigations for the proposed Briarwood Hillsburgh Development located at 5916 Trafalgar Road North, Town of Erin, Ontario (the Site). The Site is situated in a mixed rural, residential, and agricultural area. It is on the west side of Trafalgar Road, between Sideroad 27 to the north and Upper Canada Drive to the south. The Site is surrounded by residential housing, agricultural fields, and forested area.

At the time of investigation, the Site was vacant and covered by grass. There are two residential houses within the property. The total area of the Site is approximately 46.9 hectares (ha).

Based on the information provided by the client, the proposed development will consist of 195 single family residential lots, 174 townhouse units, one (1) school block, one (1) heritage house, two (2) storm water management (SWM) facilities, one (1) park block, and new private roads with total area of 40.4 ha. The subdivision will be fully connected to municipal services (municipal water and sanitary sewers). The location of the Site is shown on **Figure 1**.

1.2 Purpose

The purpose of the hydrogeological investigation was to characterize the existing hydrogeological conditions at and in the vicinity of the Site, assess the need for, and options for, groundwater control in association with the proposed construction, evaluate potential impacts to the local groundwater regime resulting from the proposed construction, and identify appropriate mitigative measures, as warranted.

This hydrogeological study may be utilized in support for an application for a Permit to Take Water (PTTW) for dewatering purposes during construction or registering in Environmental Activity and Sector Registry (EASR), if necessary. The purpose of completing the PTTW / EASR application is to conduct the work in compliance with Ontario Regulation 387/04 (as amended) and the Ontario Water Resources Act (OWRA). The water taking EASR is for construction projects that require more than 50,000 liters per day (L/day) of water and less than 400,000 L/day under normal conditions. A PTTW is required for any surface water or groundwater taking during construction in excess of 400 cubic metres per day (m³/day).

2 METHOD OF INVESTIGATION

2.1 General

This hydrogeological study began with a review of previously completed geotechnical and environmental reports and published information for the study area, including previously published regional physiographic and geologic mapping and watershed planning reports. Many of these documents are referred to throughout various sections of this report and the relevant details can be found in the References section following the text of the report.

In particular, the work completed in association with this hydrogeological study consisted of the following tasks:

- Reviewing and interpreting available reports and published data;
- Developing Health & Safety and Sampling and Analysis Plans for work at the Site;
- Assessing the current Site conditions, and areas of interest;
- Installing five (5) monitoring wells;
- Reviewing water well records available from the Ministry of the Environment, Conservation and Parks (MECP);
- Developing the groundwater monitoring wells installed on the Site by removing at least three well volumes of groundwater or two times to dry;
- Performing in-situ hydraulic conductivity testing (slug tests) to assess the aquifer permeability;
- Measuring groundwater levels in each of the monitoring wells located at the Site;
- Evaluating proposed construction dewatering requirements; and
- Prepare a final report on the findings of this investigation.

2.2 Boreholes and Monitoring Wells

HLV2K drilled five (5) boreholes on September 1 and 7, 2021 and installed five (5) monitoring wells (MW1 to MW5) for groundwater monitoring and sampling. One monitoring well (MW1) was installed at approximate depth of 10 m below ground surface (mbgs) and others were installed at approximately 6.2 mbgs. Borehole logs for all boreholes are provided in **Appendix A**. One piezometer to approximate depth of 1 mbgs was installed close to the wetland to monitor the shallow water level close to the wetland. In addition, HLV2K drilled 4 test holes to approximate depth of 2.4 mbgs for percolation tests.

The well survey was conducted using a GPS unit (Sokkia GCX3 with SHC500 controller). The monitoring well, test holes, and piezometer locations are shown in **Figure 2**. The details of construction of the monitoring wells are summarized in **Table 1**.

It should be noted that the ground surface elevations noted on the appended borehole logs are approximate and were used for the purpose of relating borehole soil stratigraphy and should not be used or relied on for other purposes.

Table 1: Information on Boreholes and Groundwater Monitoring Wells

MW ID	Estimated Ground Surface Elevation (m)	Borehole Bottom		Well Screen Interval Depth (mbgs)		Well Screen Interval Elevation (m)	
		Depth (mbgs)	Elevation (m)	from	to	from	to
MW1	473.50	9.8	463.70	6.65	9.7	466.85	463.80
MW2	469.37	6.2	463.17	3.05	6.1	466.32	463.27
MW3	471.00	6.3	464.70	3.15	6.2	467.85	464.80
MW4	458.48	6.7	451.78	3.55	6.6	454.93	451.88
MW5	454.05	6.5	447.55	3.35	6.4	450.70	447.65
Piezometer	448.19	0.9	447.29	0.3	0.9	447.89	447.29

2.3 Groundwater Monitoring

As part of this investigation, HLV2K visited the site on September 17th and 30th to measure the groundwater levels in the monitoring wells. Groundwater was encountered only in MW5 and the rest of the wells were found dry.

2.4 In-Situ Hydraulic Conductivity Testing

Monitoring wells were dry except MW5. The depth of the water in MW5 was not enough to conduct hydraulic conductivity test. Wells will be revisited in spring when the high groundwater level is expected. If enough water is encountered in any of the wells, the hydraulic conductivity test will be conducted.

2.5 In-Situ Percolation Test

HLV2K's staff visited the Site on September 1st and 7th, 2021. After receiving utility locates, four (4) 150-mm borehole was drilled to approximate depth of 2.4 m below ground surface (mbgs). All loose material was removed from the sides and bottom of the hole. **Figure 2** shows the location of the test holes. Groundwater level was measured in the monitoring well in vicinity of the test hole.

The installed monitoring wells were used to measure the groundwater levels at the time of percolation tests. The borehole logs are provided in **Appendix A**.

The bottom of the hole was covered with 10 cm of sand and then the hole was filled with the water to a depth close to the surface (15 cm to 30 cm below ground surface). The water levels versus time were recorded. Field test measurements are provided in **Appendix B**.

3 SITE CONDITIONS

3.1 Physical Setting

The Site is situated in a mixed rural, residential, and agricultural area. It is on the west side of Trafalgar Road, between Sideroad 27 to the north and Upper Canada Drive to the south. The Site is surrounded by residential housing, agricultural fields, and forested area. According to the Oak Ridges Moraine Atlas which is available online at (<http://www.mah.gov.on.ca/page334.aspx>) and the Niagara Escarpment Plan (NEP) Maps available online at (<http://www.escarpment.org/landplanning>), the Site is not located within an area where either the Oak Ridges Moraine Conservation Plan or the Niagara Escarpment Plan would be applicable.

3.2 Climatic Conditions

Average monthly climate data from an Environment Canada climate station located at the Fergus Shand Dam (Station ID 6142400), approximately 14 km west of the Site, for the period between 1981 and 2010 is provided in **Table 2**, below (Environment Canada, 2021). The data indicates that the climate in the study area is typical continental with cold winters and warm summers and precipitation records showing local seasonal variation. As shown in **Table 2**, below, the mean annual precipitation is 945.7 mm/year, with annual mean rainfall of 797.8 mm/year (84% of total precipitation). Average monthly precipitation ranged from 55.9 mm in February to 96.6 mm in August. The mean annual daily temperature is 6.7 degrees Celsius (°C), ranging from -7.4 °C in January to 20.0 °C in July.

Table 2: Climate Data Summary (1981 – 2010) – Fergus Shand Dam Station (ID 6142400)

MONTH	Daily Average Temperature (°C)	Average Rainfall (mm)	Average Snow (cm)	Average Precipitation (mm)
January	-7.4	27.8	40.1	67.9
February	-6.3	25.3	30.6	55.9
March	-1.9	36.7	22.9	59.6
April	5.7	67.9	6.2	74.1
May	12.2	86.8	0.1	86.9
June	17.5	83.8	0.0	83.8
July	20.0	89.2	0.0	89.2
August	19.0	96.6	0.0	96.6
September	14.9	93.1	0.0	93.1
October	8.3	75.6	1.6	77.2
November	2.1	80.5	12.5	93.0
December	-3.9	34.7	33.9	68.6
Year	6.7	797.8	147.8	945.7

NOTE: Data was obtained from Environment Canada website (Environment Canada 2021).

3.3 Physiography and Drainage

A review of the topographic map provided online by Natural Resources Canada (Toporama) depicts the Site as located within an area that is generally high relief at an approximate elevation of 450 m to 470 m. The project is located in the Little Credit River Watershed within the Credit Valley River Conservation

Authority (CVCA) jurisdiction. The watershed is approximately 1,000 square kilometers (km²). The main branch of the Credit River originates north of Orangeville and flows southerly to Lake Ontario at Port Credit, Mississauga, ON (CVC, 2011).

According to the physiographic regions of Ontario identified by Chapman and Putnam (2007), the Site is located in Hillsburgh Sandhills (**Figure 3**). The Hillsburgh Sandhills physiographic region is found in the northwestern portion of the watershed and consists of coarse-grained sediments. It is an area of high relief with thick deposits of glacial outwash (sandy materials) overlying glacial tills and bedrock (CVC, 2011)

3.4 Geological Mapping

The geology of the Credit River watershed generally consists of ice-contact stratified drift (CVC, 2011). A regional description of the Quaternary geology for the area of the Site can be found on the Ontario Geological Survey Digital Map - Surficial geology of southern Ontario (OGS, 2010). A section of this map showing the surficial geology in the vicinity of the Site is presented on **Figure 4**.

As shown on **Figure 4**, the surficial deposits in the immediate vicinity of the Site are mapped as Orangeville Moraine with materials consisted of sand and gravel including some till or silt. The western side of the Site is modern alluvial deposits.

Bedrock is comprised of upper Silurian to lower Devonian of Guelph Formation. The bedrock surface is expected to be approximately 60 mbgs. None of the boreholes drilled for this investigation reached the bedrock. **Figure 5** shows the bedrock at the Site and its vicinity.

3.5 Subsurface Soil Conditions

The subsurface soil conditions encountered during boreholes advanced at the Site are shown on the borehole logs in **Appendix A**. A summary of the soil conditions is provided below.

Topsoil with approximate thickness of 200 to 300 mm was encountered in all boreholes. Below the topsoil, a layer of sandy silt to silty sand was encountered at all borehole locations and extended in general to approximately from 1.5 to 3.1 m below the existing ground surface. Organic matter, rootlets, gravel and cobbles were found in this layer. Below this layer, a layer of sand and gravel was encountered in all boreholes and extended to maximum explored depth of 9.8 m.

4 GROUNDWATER CONDITIONS

4.1 Regional Groundwater Recharge

Recharge is the process by which groundwater is replenished and involves the vertical infiltration of water through the subsoil deposits and geologic materials to the saturated zone. The major sources of recharge in the study area are a result of precipitation and freshet. The amount of groundwater recharge in a particular area depends on surficial geology, topography, and the extent of land development in that area. Generally, regional groundwater recharge is irregularly distributed temporally and spatially as interpreted from specific climatic conditions, local geology, and land development status.

The Site is a vacant land and is used for agriculture. Therefore, the groundwater recharge occurs under natural condition. A water balance analysis was completed for the site to estimate the change in water recharge pre and post development and will be presented in the following sections.

4.2 Groundwater Level Fluctuations

The groundwater level data collected from the monitoring wells are provided in **Table 3**, below. The screen elevations of these monitoring wells are shown in **Table 1** above and on the borehole logs provided in **Appendix A**.

Groundwater level monitoring rounds were completed from September 2021 to July 2022. As shown in **Table 3** below, the groundwater has found only in MW5 at approximate elevation of 449.5 m. The rest of the monitoring wells were dry.

Regional groundwater flow in the area typically reflects the local topography and generally occurs from topographic highs to topographic lows. The dominant regional groundwater flow direction is southerly, toward Lake Ontario.

It should be noted that groundwater conditions vary depending on factors such as temperature, season, precipitation, construction activity and other situations, which may be different from those encountered at the time of the monitoring. The possibility of groundwater level fluctuations at the Site should be considered when designing and developing the construction plans for the project.

Table 3: Summary of Groundwater Level Observations in Monitoring Wells

BH ID	MW1		MW2		MW3		MW4		MW5		P1	
Ground Elevation (m)	473.50		469.37		471.00		458.48		454.05		448.19	
Borehole Depth (m)	9.80		6.20		6.30		6.70		6.50		0.90	
	Depth (mbgs)	Elevation (m)	Depth (mbgs)	Elevation (m)	Depth (mbgs)	Elevation (m)	Depth (mbgs)	Elevation (m)	Depth (mbgs)	Elevation (m)	Depth (mbgs)	Elevation (m)
1&7-Sep-21 (at completion)	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry
17-Sep-21	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.64	449.41	Dry	Dry
30-Sep-21	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.70	449.35	Dry	Dry
05-Oct-21	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.64	449.41	Dry	Dry
15-Oct-21	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.65	449.40	Dry	Dry
30-Oct-21	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.69	449.36	Dry	Dry
16-Nov-21	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.67	449.38	Dry	Dry
30-Nov-21	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.65	449.40	Dry	Dry
15-Dec-21	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.66	449.39	Dry	Dry
04-Jan-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.67	449.38	Dry	Dry
17-Jan-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.68	449.37	Dry	Dry
31-Jan-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.68	449.37	Dry	Dry
14-Feb-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.65	449.40	Dry	Dry

Hydrogeological Investigation for Proposed Briarwood Hillsburgh Development
 5916 Trafalgar Road North, Town of Erin, Ontario

BH ID	MW1		MW2		MW3		MW4		MW5		P1	
Ground Elevation (m)	473.50		469.37		471.00		458.48		454.05		448.19	
Borehole Depth (m)	9.80		6.20		6.30		6.70		6.50		0.90	
28-Feb-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.63	449.42	Dry	Dry
15-Mar-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.55	449.50	Dry	Dry
31-Mar-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.51	449.54	Dry	Dry
12-Apr-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.42	449.63	Dry	Dry
27-Apr-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.35	449.70	Dry	Dry
18-May-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.30	449.75	Dry	Dry
01-Jun-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.28	449.77	Dry	Dry
16-Jun-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.28	449.77	Dry	Dry
30-Jun-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.30	449.75	Dry	Dry
15-Jul-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.34	449.71	Dry	Dry
27-Jul-22	Dry	Dry	Dry	Dry	Dry	Dry	Dry	Dry	4.36	449.69	Dry	Dry

4.3 Percolation Test Results

Table 4 below is the summary of the percolation test results. The selected value for the test presented in the table is the average of final three percolation rates during each test which is closer to the steady-state infiltration rate. Detailed calculations are provided in **Appendix B**.

Table 4: Summary of Infiltration Test Results

Test ID	Hole Depth (mbgs)	Hole Bottom Elevation (m)	Groundwater Depth (mbgs)	Infiltration Rate (mm/hr)	Percolation Time (min/cm)
TP1	2.4	466.3	<9.8 (MW1)	600	1
TP2	2.4	466.7	<6.2 (MW2)	120	5
TP3	1.85	460.5	<6.7 (MW4)	1200	0.5
TP4	2.2	452.8	4.8 (MW5)	300	2

4.4 Groundwater Use in the Study Area

A search of the MECP Water Well Information System (WWIS) database to identify active wells near the Site were conducted. The database search was requested for the area located within 500 m from the Site. The database search identified records for 90 wells.

Figure 5 presents the locations of the identified wells as well as the associated water use categories within 500 m around the Site. A detailed table showing water well record (WRR) information for these wells is provided in **Appendix C**. The classification of these wells is as follows:

- 4 monitoring/observation wells and test hole;
- 16 wells identified as abandoned; and
- 2 wells were not stated;
- 68 wells as water supply wells.

The monitoring wells/test holes identified in the database search are typically interpreted as geotechnical/geological boreholes and normally no water would be obtained or used from these boreholes. The search revealed the presence of 68 domestic water wells or other water supply wells potentially in use in the area of the Site. If groundwater use or dewatering is required for the Site, a door-to-door well survey is recommended.

5 GROUNDWATER DEWATERING ESTIMATES

Details of construction was not provided to HLV2K at the time of this investigation; however, it is our understanding that one level of basement is considered for the houses in this development. The water level monitored during the investigation shows that dewatering would not be required during the construction to control the groundwater. The monitoring well depths are 6.5 to 9.8 mbgs and no groundwater encountered within this depth except in MW5 at 4.8 mbgs or elevation of 449.3 m. Perch water may be present during the construction and the contractor should be ready to control that water, if encountered.

During the excavation for foundation or underground utilities, rainwater may need to be pumped from the trenches. According to MTO IDF Curve Lookup website¹, 24-hour rainfall with a 2-year return period in Erin area is 56.5 mm. The volume of the water depends on the area of excavation at the time.

6 WELLHEAD PROTECTION AREA

A small portion of the Site (approximately 0.6 ha) in the northeast is located within the Well Head Protection Area A (WHPA-A) which represents a 100 m circle around a municipality water supply well as shown in **Figure 7**. It is also located within the Significant Groundwater Recharge Area (SGRA). A water balance analysis was conducted to estimate the recharge rate in pre and post construction. The results are provided in the following section.

7 WATER BALANCE ANALYSIS

When precipitation (P) occurs, it can either run off (R) through the surface water system, infiltrate (I) to the water table, or evapotranspire (ET) from the earth's surface and vegetation. The sum of R and I is defined as the water surplus (S). When long-term averages of P, R, I, and ET are used, there is no net change in groundwater storage (ST). On a yearly basis, however, there is a potential for small changes in ST.

The annual water budget can be stated as,

$$P = ET + R + I + ST$$

The monthly averages of P and temperature (T) were collected from Environment Canada data. Based on the physiographic setting and proximity to weather stations, the Fergus Shand Dam Station (ID 6142400) located approximately 14 km west of the Site chosen as the most representative precipitation and temperature data

Climate Normals are arithmetic calculations of observed climate values over a specified time period and are used to describe the climatic characteristics of a location. Real-time values, such as daily temperature, may be compared to the "climate normal" to compare departures from the "average". The Canadian Climate Normals are calculated based on World Meteorological Organization (WMO) Standards. The WMO

¹ http://www.mto.gov.on.ca/IDF_Curves

considers 30 years sufficient to eliminate year-to-year variations. The most recently published 30-year period from Environment Canada is January 1981 to December 2010.

In addition, the WMO established that normals should be arithmetic means calculated for each month of the year from daily data. To qualify, temperature data, soil temperatures and evaporation must fit the following rule: "If more than 3 consecutive daily values are missing or more than 5 daily values in total in a given month are missing, the monthly mean should not be computed and the year-month mean should be considered missing." This is referred to as the "3/5" rule. For total precipitation, degree-days, and "days with" calculations, no missing days are allowed.

7.1 Thornthwaite Monthly Water-Balance Model

The Thornthwaite water balance (Thornthwaite, 1948; Mather, 1978; 1979) uses an accounting type procedure to analyze the allocation of water among various components of the hydrologic cycle. Inputs to the model are monthly temperature, precipitation and the site latitude. Outputs include monthly potential and actual evapotranspiration, soil moisture storage, soil moisture storage change, surplus, and runoff. For ease of calculation, an Excel spreadsheet was developed. This water balance was prepared according to the "Hydrogeological Assessment Submissions: Conservation Authority Guidelines to Support Development Application (2013).

7.2 Pre-Construction Water Balance

To predict water balance elements the 30-year average weather data was used. The detailed calculations are presented in below sections.

Precipitation (P)

Based on the 30-year average (1981-2010) for the Fergus Shand Dam meteorological station, the average precipitation is about 945.9 mm/year. The monthly precipitation distribution is presented in **Table D.1 of Appendix D**.

Storage (ST)

Long-term annual change in storage is 0, although there is some variation on a monthly basis. It should be noted that for the topography, soil conditions (silty sand till to sandy silt till) and vegetative cover (moderate to deep rooted crops), the maximum soil moisture storage was estimated at about 250 mm according to Table 3.1 of MECP Stormwater Management Planning and Design Manual (2003).

Evapotranspiration

Calculated potential evapotranspiration (PET) based on the Thornthwaite monthly water balance model is about 573 mm/year, or about 61% of the total precipitation. The actual evapotranspiration is calculated based on a potential evapotranspiration (PET) and soil-moisture-storage withdrawal (SMW). PET is estimated from monthly temperature and is defined as a water loss from a homogeneous, vegetation covered area that never lacks water (Thornthwaite, 1948; Mather, 1978). In Thornthwaite water balance, PET is calculated using Thornthwaite Method (Ponce, 1989). The method is based on an annual temperature efficiency index J, defined as the sum of 12 monthly values of heat index I. Each index I is a function of the mean monthly temperature T, in degrees Celsius, as follows:

$$I = \left(\frac{T}{5}\right)^{1.514}$$

Evapotranspiration is calculated by the following formula:

$$PET(0) = 1.6 \left(\frac{10T}{J} \right)^c$$

in which PET(0) is the potential evapotranspiration at 0° latitude in centimeters per month; and c is an exponent to be evaluated as follows:

$$c = 0.000000675J^3 - 0.0000771J^2 + 0.01792J + 0.49239$$

At the latitude other than 0° potential evapotranspiration is calculated by

$$PET = K PET(0)$$

in which K is a constant for each month of the year, varying as a function of latitude. The latitude for Fergus Shand Dam station is 43° 44' and values of K are provided in **Table D.2** in **Appendix D**.

Water Surplus

The overall pre-construction water surplus for study area is estimated at 373 mm/year. Water surplus (S) has two components in Thornthwaite model: a runoff component, which is the overland flow component that occurs when soil moisture capacity is exceeded; and, an infiltration component. Using the MECP SWM manual (MECP, 2003) for guidance, it is estimated that about 50% of the water surplus (186.5 mm/year) infiltrates and the remaining 50% (186.5 mm/year) runs off either directly or as interflow. The details calculation is presented in **Table D.2** in **Appendix D**.

Annual Water Balance

The summary of annual water balance assessment for the pre-construction condition is provided in **Table D.3** in **Appendix D**.

7.3 Post-Construction Water Balance without LID

Based on the proposed Draft Plan provided by the Client (**Appendix E**), **Table 5** below shows a summary of post (proposed) construction land statistics.

Table 5: Post-Construction (Proposed) Land Statistics

Item	Area (m ²)
Total Area	404,000
Paved roadways/walkway/Vista	83,200
Residential (total area)	167,800
Residential (Impervious area– 55% of lot area)	92,290
School block	21,900
School (Impervious area)	4,500
Park Block	17,100
Park (Impervious area – 20% of lot area)	4,060
Soft landscaped lot lawns, Boulevards, 80% of Park, 45% of residentials, Open space (excluding SWM Pond)	106,590
SWM Pond	33,000
Future Development	81,000

It was estimated that 55% of the residential lots, 20% of the park, and 4,500 m² of the school to be covered with impervious surfaces. The future development (81,000 m²) was not considered in this assessment, and it was considered to remain vacant, however, its contribution to recharge was not counted in water balance analysis.

To predict water balance elements, the 30-year average weather data was used. Based on the provided development information, it is our understanding that about 46% of the post construction surface will be considered impervious (excluding future development). Additionally, the Conservation Authority guidelines suggest infiltration will be lowered by 10% (a factor of 0.1) because of site grading and compaction of the soil due to construction work. However, the soil compaction issue might be resolved by increasing the topsoil depth to 300 mm. **Table D.4** in **Appendix D** presents the components of post construction water balance.

Precipitation (P)

Precipitation remains the same, the 30-year average (1981-2010) for the Fergus Shand Dam Station meteorological station (945.9 mm/year) was used.

Storage (ST)

Long-term change in storage is 0. It should be noted that compared to pre-construction, there is a change in the distribution and magnitude of monthly soil moisture storage. It is assumed that development of the land will result in reduced grades that, with the same soil conditions (clayey silt to sandy silt till) and changed vegetative cover (shallow rooted lawns and gardens), will reduce the maximum soil moisture storage to 125 mm.

Evapotranspiration

In post construction, it was assumed that the increased impervious area would result in an additional 20% in potential evaporation from the areas covered with hard surfaces. The total water lost to evaporation increases, but the PET for pervious areas, calculated at 573 mm/year, remains about the same.

Water Surplus

The post-construction water surplus for the entire Site is calculated to be about 1,130 mm/year. Of this, about 621 mm/year will be converted to runoff on impervious areas and 508 mm/year will be available for infiltration or runoff on pervious areas in post-development condition. This exceeds the infiltration potential for the surficial soils; thus a component of the available infiltration water will also run off.

The results of the post construction water balance calculation suggest that there is enough water to maintain recharge, as there is a positive surplus (S) in the post construction scenario.

Annual Water Balance without LID

The major change between the pre- and post-construction water balance is that in the pre-construction setting, most of the water surplus is carried off the site as interflow and infiltration, whereas in the post construction setting, there is more interflow and overland flow. **Table D.5 in Appendix D** shows that the volume of runoff will be increased from 75,937 m³/year in pre-development to 181,658 m³/year. The post-development infiltration volume is approximately 21,873 m³/year which is almost 30% of the pre-development, if no mitigation measure is implemented and 46% of the site surface is converted to impervious surface.

7.4 Post-Construction Water Balance with LID

To assess the potential impacts of the proposed development on groundwater resources, the draft development plan (**Appendix E**) was reviewed.

Table D.6 in Appendix D presents the overall post construction water balance with mitigation measures.

Post development infiltration and runoff rates will be affected by the presence of impervious surfaces (i.e. building/garage rooftops, asphalt driveways and road), which based on the proposed development plan will comprise approximately 58% of the development property. The results of the post-construction water balance assessment without LID measures (**Table D.5 in Appendix D**) show that there will be enough water to infiltrate in the pervious areas to increase the infiltration rate and reduce the runoff in post-construction development. Techniques to maximize the water availability in pervious areas such as designing grades to direct roof runoff towards lawns, side and rear yard swales, and other pervious areas throughout the development where possible can considerably increase the volume of infiltration in developed areas. Increasing the topsoil thickness by about two times the normal thickness is also considered as beneficial to enhance storage of water in the topsoil and increase the potential for infiltration. Other mitigation techniques that can be considered to mitigate increases in runoff and reductions in infiltration include such measures as subsurface infiltration trenches, permeable pavements, rain gardens,

bioswales, galleries and pervious pipe systems. Surface methods should only be considered in areas where there is sufficient depth to water table to accommodate the systems within the unsaturated zone and sufficient soil hydraulic conductivity to function effectively. The MECP manual recommends that subsurface galleries or trenches should be about 1 m above the high water table.

The proposed LID measures for the Site would be the disconnected roof leaders to convey the rainwater from roofs to the permeable areas around the residential houses and increase the chance of infiltration. In addition, infiltration gallery will be installed to increase the recharge rate. The infiltration trenches will be designed by others. According to the information provided by the Client, the followings were considered in water balance analysis in post-development conditions with LID

- 80% of the residential lots are contributing to the infiltration trenches (185,280 m²).
- 50% of the park is contributing to the infiltration trenches (10,150 m²).
- 4500 m² of the school area is contributing to the infiltration trenches.

It was considered that LID measures would be designed to infiltrate the 25 mm storm event or less which accounts for approximately 90% of precipitation. The estimated infiltration rate for the trenches, then, calculated based on the followings:

- 20% of the rainfall on impervious surface was assumed to be evaporated. It means there is 80% or 757 mm surplus.
- 90% of the rainfall event is 25 mm or less. Only 90% of the surplus was considered for infiltration (681 mm).
- The estimated infiltration rate for the infiltration galleries is expected to be 65% or more in post-construction condition. The total infiltration rate in infiltration galleries would be 443 mm or 47% of the precipitation.

Natural infiltration that occurs on pervious surfaces along with the proposed mitigative measures exceed the pre-development infiltration volume by approximately 2,234 m³/year. The runoff volume also exceeds the pre-development runoff volume by approximately 68,240 m³/year.

In this condition, the total infiltration volume will be 77,414 m³/year and total runoff volume in the post-construction will be changed to 144,176 m³/year. **Table 6** below summarizes the post-construction water balance for reducing the runoff and increasing infiltration using LID measures.

Table 6: Post -Construction Water Balance Summary

Parameter	Value
Average Annual Rainfall (mm)	946
Pre- Development Infiltration (m ³ /year)	75,180
Post-Development Infiltration without Mitigation (m ³ /year)	21,873
Post-Development Infiltration with Mitigation (m ³ /year)	77,414
Pre- and Post-Development Infiltration Differential (%)	+3%

7.5 Impact Assessment

To assess the potential impacts of the proposed development on groundwater resources, the draft development plan was reviewed. From a hydrogeological perspective, the following changes will occur as a result of the proposed development.

- The subject site is characteristically homogeneous with respect to soil types at ground surface. It is mainly silty sand over sand and gravel.
- The development will create new hard surfaces over a portion of the site, increasing the impervious area. The amount of impervious areas is estimated to be about 46%.
- As a result of the increase in impervious area, the overall infiltration will decrease and the amount of overland flow runoff will increase, particularly during storm events. Runoff will be managed using conventional storm water management techniques or Low Impact Development (LID) that include storm water management (SWM) facilities.
- With the inevitable changes in impervious areas and potential changes to groundwater quality and quantity, best management practices (BMPs) that promote groundwater infiltration/recharge for the purpose of trying to establish post-development infiltration at pre-development levels makes a significant contribution to mitigate the effects of development. Some of the recommended practices includes:
 - Disconnected roof leaders to convey the rainwater from roofs to the permeable areas and infiltration trenches around the residential houses and increase the chance of infiltration. Using the roof-tops rainwater can also preserve the groundwater quality. The location of these facilities and the function/operation are addressed by others.
- Although, the increase in impervious area can potentially result in a slight lowering of shallow groundwater levels, maintaining infiltration at levels similar to existing conditions will result water levels within the current range of seasonal fluctuations. No change in the overall flow direction is expected.
- The contribution of groundwater can be an important factor in the overall health of aquatic systems. Implementing mitigation measures to reduce the infiltration deficit will assist in maintaining the current level of groundwater contribution to the surface water features. As such, no negative impact is expected if LID measures are implemented to maintain the groundwater recharge similar to the existing conditions.

8 PREDICTED EFFECTS

Based on the hydrogeological information and data analysis in this report, the potential impacts to surface water and groundwater resources in the vicinity of the Site due to excavation dewatering for construction of the proposed houses at the Site are described below.

8.1 Groundwater Use

As indicated in Section 4.3, the search of the MECP water well records indicated 68 water supply wells within approximately 500 m of the Site. The area of the Site is currently serviced with a municipal water supply. The groundwater depth at the site is expected to be below basement floor and foundation. However, if groundwater dewatering and/or use is considered for this development, a door-to-door survey is recommended.

8.2 Surface Water Resources

The only surface water feature in the vicinity of the Site is the wetland at the southwest side of the Site (**Figure 8**). Since no groundwater use/dewatering is expected for this development, the impact on surface water is not anticipated. The change in the infiltration rate or runoff due to the development is considered in the water balance analysis.

8.3 Potential for Dewatering-Related Consolidation Settlement

Based on the investigation completed, temporary dewatering (i.e. during construction) is not expected. No settlement due to dewatering is expected for this Site.

9 SUMMARY AND CONCLUSION

Based on the results of the subsurface investigation, hydrogeological assessment, and analysis of hydraulic conductivity testing and groundwater level monitoring data, the following summary of conclusions and recommendations is provided:

- The groundwater was not encountered in any of the monitoring wells within the depth of expected excavation and PTTW/EASR is not required for dewatering during construction. Perched water and rainfall might be present during excavation and the contractor should be ready to deal with the water, if encountered.
- The Site is located within the Significant Groundwater Recharge Area (SGRA). Based on water balance analysis, implementing mitigation measures to reduce the infiltration deficit will assist in maintaining the current level of groundwater contribution to the surface water features. As such, no negative impact is expected if LID measures are implemented to maintain the groundwater recharge similar to the existing conditions.
- A small portion of Site (approximately 0.6 ha) is within the Wellhead Protection Area A (WHPA-A), which represent a 100 m distance from one municipal supply well. The sanitary sewer and stormwater management facility should be designed as per policy SWG-13 and SWG-14 to protect the groundwater quality.
- HLV2K recommends the decommissioning of existing groundwater monitoring wells after completion of the construction of the project. In conformance with Ontario's Wells Regulation (O.Reg.903) of the Ontario Water Resources Act, the installation and eventual decommissioning of groundwater wells must be carried out by a licensed well contractor. If a well is damaged/destroyed during the construction activities, then the well should be properly decommissioned in advance of that work.

10 STATEMENT OF LIMITATIONS

The contents of this report are subject to the attached 'Statement of Limitation' sheet. The reader's attention is specifically drawn to these conditions as it is considered essential that they be followed for proper use and interpretation of this report. The Statement of Limitations is not intended to reduce the level of responsibility accepted by HLV2K, but rather to ensure that all parties who have been given reliance for this report are aware of the responsibilities each assumes in so doing.

This report was prepared by HLV2K exclusively for the account of Hillsburgh Heights Inc. (the CLIENT). Other than by the CLIENT, copying or distribution of this report or use of or reliance on the information contained herein, in whole or in part, is not permitted without the express written permission of HLV2K. Any use, reliance on or decision made by any person other than CLIENT based on this report is the sole responsibility of such other person. The CLIENT and HLV2K make no representation or warranty to any other person with regard to this report and the work referred to in this report and the CLIENT and HLV2K accept no duty of care to any other person or any liability or responsibility whatsoever for any losses, expenses, damages, fines, penalties or other harm that may be suffered or incurred by any other person as a result of the use of, reliance on, any decision made or any action taken based on this report or the work referred to in this report.

11 CLOSURE

We trust that this information is satisfactory for your present requirements. Should you have any questions or require additional information, please do not hesitate to contact this office.

For and Behalf of HLV2K Engineering Limited

K. Mohammadi

Kourosh Mohammadi, PhD, P.Eng.

Principal Hydrogeological Engineer



REFERENCES

- Chapman, L.J., and Putnam, D.F. (2007). The Physiography of Southern Ontario, Ontario Geological Survey, Miscellaneous Release—Data 228.
- CVC (2011). Credit River Watershed and Region of Peel: Natural Areas Inventory – Volume 1, Credit River Conservation, September 2011.
- Environment Canada (2021). Canadian National Climate Archive, Canadian Climate Norms and Averages (1981 – 2010), Fergus Shand Dam – Station ID 6142400– Website:
https://climate.weather.gc.ca/climate_normals/results_1981_2010_e.html?searchType=stnName&txtStationName=fergus+shand+dam&searchMethod=contains&txtCentralLatMin=0&txtCentralLatSec=0&txtCentralLongMin=0&txtCentralLongSec=0&stnID=4760&dispBack=1
- OGS (2010). Surficial geology of southern Ontario; Ontario Geological Survey, Miscellaneous Release—Data 128 – Revised
- OGS (2011). 1:250 000 scale bedrock geology of Ontario; Ontario Geological Survey, Miscellaneous Release---Data 126-Revision 1.

HLV2K Engineering Limited

STATEMENT OF LIMITATIONS

Your report has been developed based on your unique project specific requirements as understood by HLV2K Engineering Limited (HLV2K) and applies only to the site investigated. Project criteria typically include the general nature of the project; its size and configuration; the location of any structures on the site; other site improvements; the presence of underground utilities; and the additional risk imposed by scope-of-service limitations imposed by the client. Your report should not be used if there are any changes to the project without first asking HLV2K to assess how factors that changed subsequent to the date of the report affect the report's recommendations. HLV2K cannot accept responsibility for problems that may occur due to changed factors if they are not consulted.

Subsurface conditions are created by natural processes and the activity of man. For example, water levels can vary with time, fill may be placed on a site and pollutants may migrate with time. Because a report is based on conditions, which existed at the time of subsurface exploration, decisions should not be based on a report whose adequacy may have been affected by time. Consult HLV2K to be advised how time may have impacted on the project.

The findings derived from this investigation were based on information collected and/or provided by the Client. It may become apparent that soil and groundwater conditions differ between and beyond the testing locations examined during future investigations or other work that could not be detected or anticipated at the time of this study. As such, HLV2K cannot be held liable for environmental conditions that were not apparent from the available information. The conclusions presented represent the best judgment of the assessors based on limited investigations.

Site assessment identifies actual subsurface conditions only at those points where samples are taken and when they are taken. Data derived from literature, external data source review, sampling, and subsequent laboratory testing are interpreted by geologists, engineers or scientists to provide an opinion about overall site conditions, their likely impact on the proposed development and recommended actions. Actual conditions may differ from those inferred to exist, because no professional, no matter how qualified, can reveal what is hidden by earth, rock and time. The actual interface between materials may be far more gradual or abrupt than assumed based on the facts obtained. Nothing can be done to change the actual site conditions, which exist, but steps can be taken to reduce the impact of unexpected conditions. For this reason, owners should retain the services of HLV2K through the development stage, to identify variances, conduct additional tests if required, and recommend solutions to problems encountered on site.

Your report is based on the assumption that the site conditions as revealed through selective point sampling are indicative of actual conditions throughout an area. This assumption cannot be substantiated until project implementation has commenced and therefore your report recommendations can only be regarded as preliminary. Only HLV2K, who prepared the report, is fully familiar with the background information needed to assess whether or not the report's recommendations are valid and whether or not changes should be considered as the project develops. If another party undertakes the implementation of the recommendations of this report there is a risk that the report will be misinterpreted and HLV2K cannot be held responsible for such misinterpretation.

To avoid misuse of the information contained in your report it is recommended that you confer with HLV2K before passing your report on to another party who may not be familiar with the background and the purpose of the report. Your report should not be applied to any project other than that originally specified at the time the report was issued.

HLV2K Engineering Limited

Costly problems can occur when other design professionals develop their plans based on misinterpretations of a report. To help avoid misinterpretations, retain HLV2K to work with other project design professionals who are affected by the report. Have HLV2K explain the report implications to design professionals affected by them and then review plans and specifications produced to see how they incorporate the report findings.

The report as a whole presents the findings of the site assessment and the report should not be copied in part or altered in any way.

Logs, figures, drawings, etc. are customarily included in our reports and are developed by scientists, engineers or geologists based on their interpretation of field logs (assembled by field personnel) and laboratory evaluation of field samples. These logs etc. should not under any circumstances be redrawn for inclusion in other documents or separated from the report in any way.

Your report is not likely to relate any findings, conclusions, or recommendations about the potential for hazardous materials existing at the site unless specifically required to do so by the client. Specialist equipment, techniques, and personnel are used to perform a geoenvironmental assessment.

Contamination can create major health, safety and environmental risks. If you have no information about the potential for your site to be contaminated or create an environmental hazard, you are advised to contact HLV2K for information relating to geoenvironmental issues.

HLV2K is familiar with a variety of techniques and approaches that can be used to help reduce risks for all parties to a project, from design to construction. It is common that not all approaches will be necessarily dealt with in your site assessment report due to concepts proposed at that time. As the project progresses through design towards construction, speak with HLV2K to develop alternative approaches to problems that may be of genuine benefit both in time and in cost.


Reporting relies on interpretation of factual information based on judgement and opinion and has a level of uncertainty attached to it, which is far less exact than the design disciplines. This has often resulted in claims being lodged against consultants, which are unfounded. To help prevent this problem, a number of clauses have been developed for use in contracts, reports and other documents. Responsibility clauses do not transfer appropriate liabilities from HLV2K to other parties but are included to identify where HLV2K's responsibilities begin and end. Their use is intended to help all parties involved to recognise their individual responsibilities. Read all documents from HLV2K closely and do not hesitate to ask any questions you may have.

Third party information reviewed and used to formulate this report is assumed to be complete and correct. HLV2K used this information in good faith and will not accept any responsibility for deficiencies, misinterpretation or incompleteness of the information contained in documents prepared by third parties.

Nothing in this report is intended to constitute or provide a legal opinion.


Should additional information become available, HLV2K requests that this information be brought to our attention so that we may re-assess the conclusions presented herein.

FIGURES

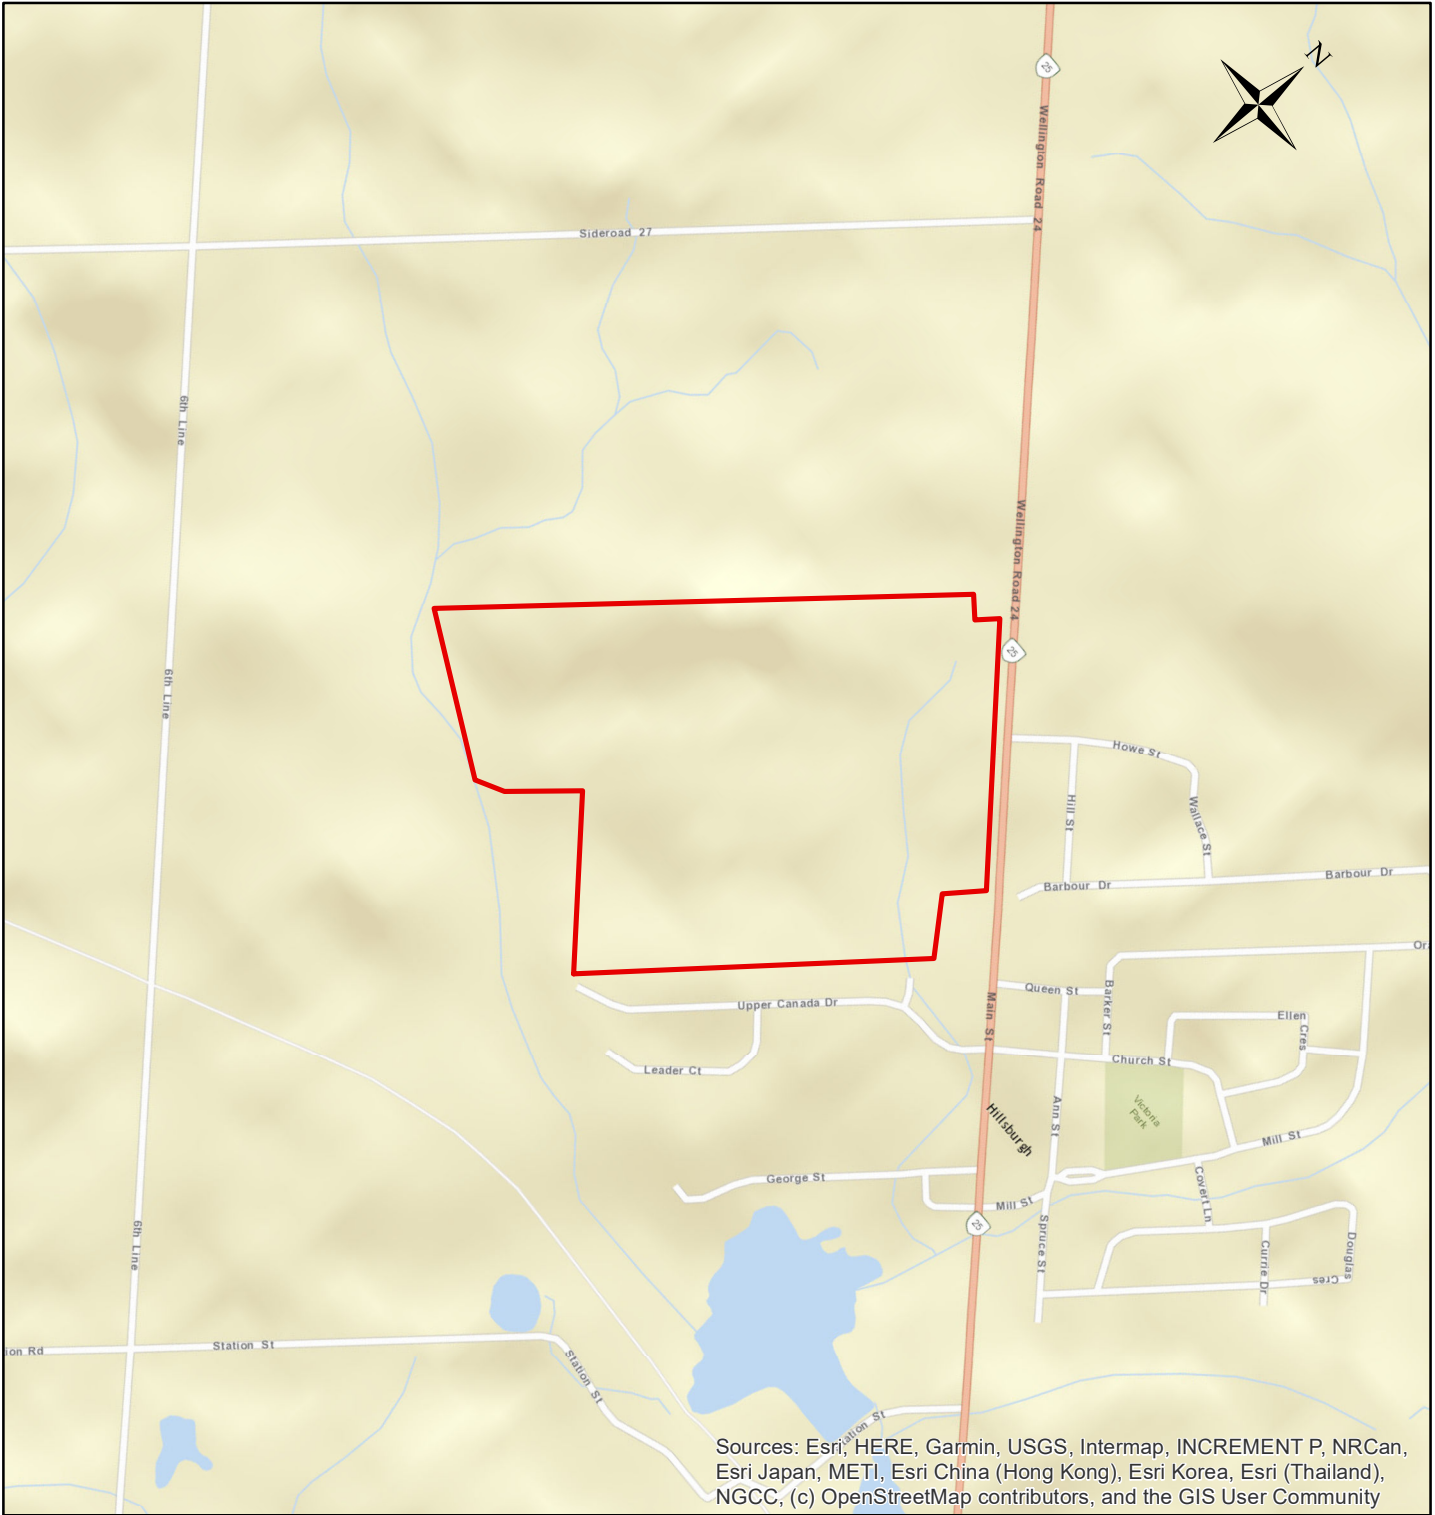





Legend


 Site Boundary


Drawn: MM	Title SITE LOCATION PLAN	
Approved: KM	Project	
Date: SEP. 2021	HYDROGEOLOGICAL INVESTIGATION	
Project No.: 2100428AH	5916 Trafalgar Road North, Town of Erin, Ontario	
	Client Hillsburgh Heights Inc.	
	0 105 210 420 Meters	FIGURE 1




Legend


-  Monitoring Wells/Boreholes
-  Piezometer Percolation Test
-  Site Boundary
- 


Drawn: MM	Title BOREHOLES LOCATION PLAN	
Approved: KM	Project	
Date: SEP. 2021	HYDROGEOLOGICAL INVESTIGATION 5916 Trafalgar Road North, Town of Erin, Ontario	
Project No.: 2100428AH		
	Client Hillsburgh Heights Inc.	
	0 40 80 160 Meters	FIGURE 2

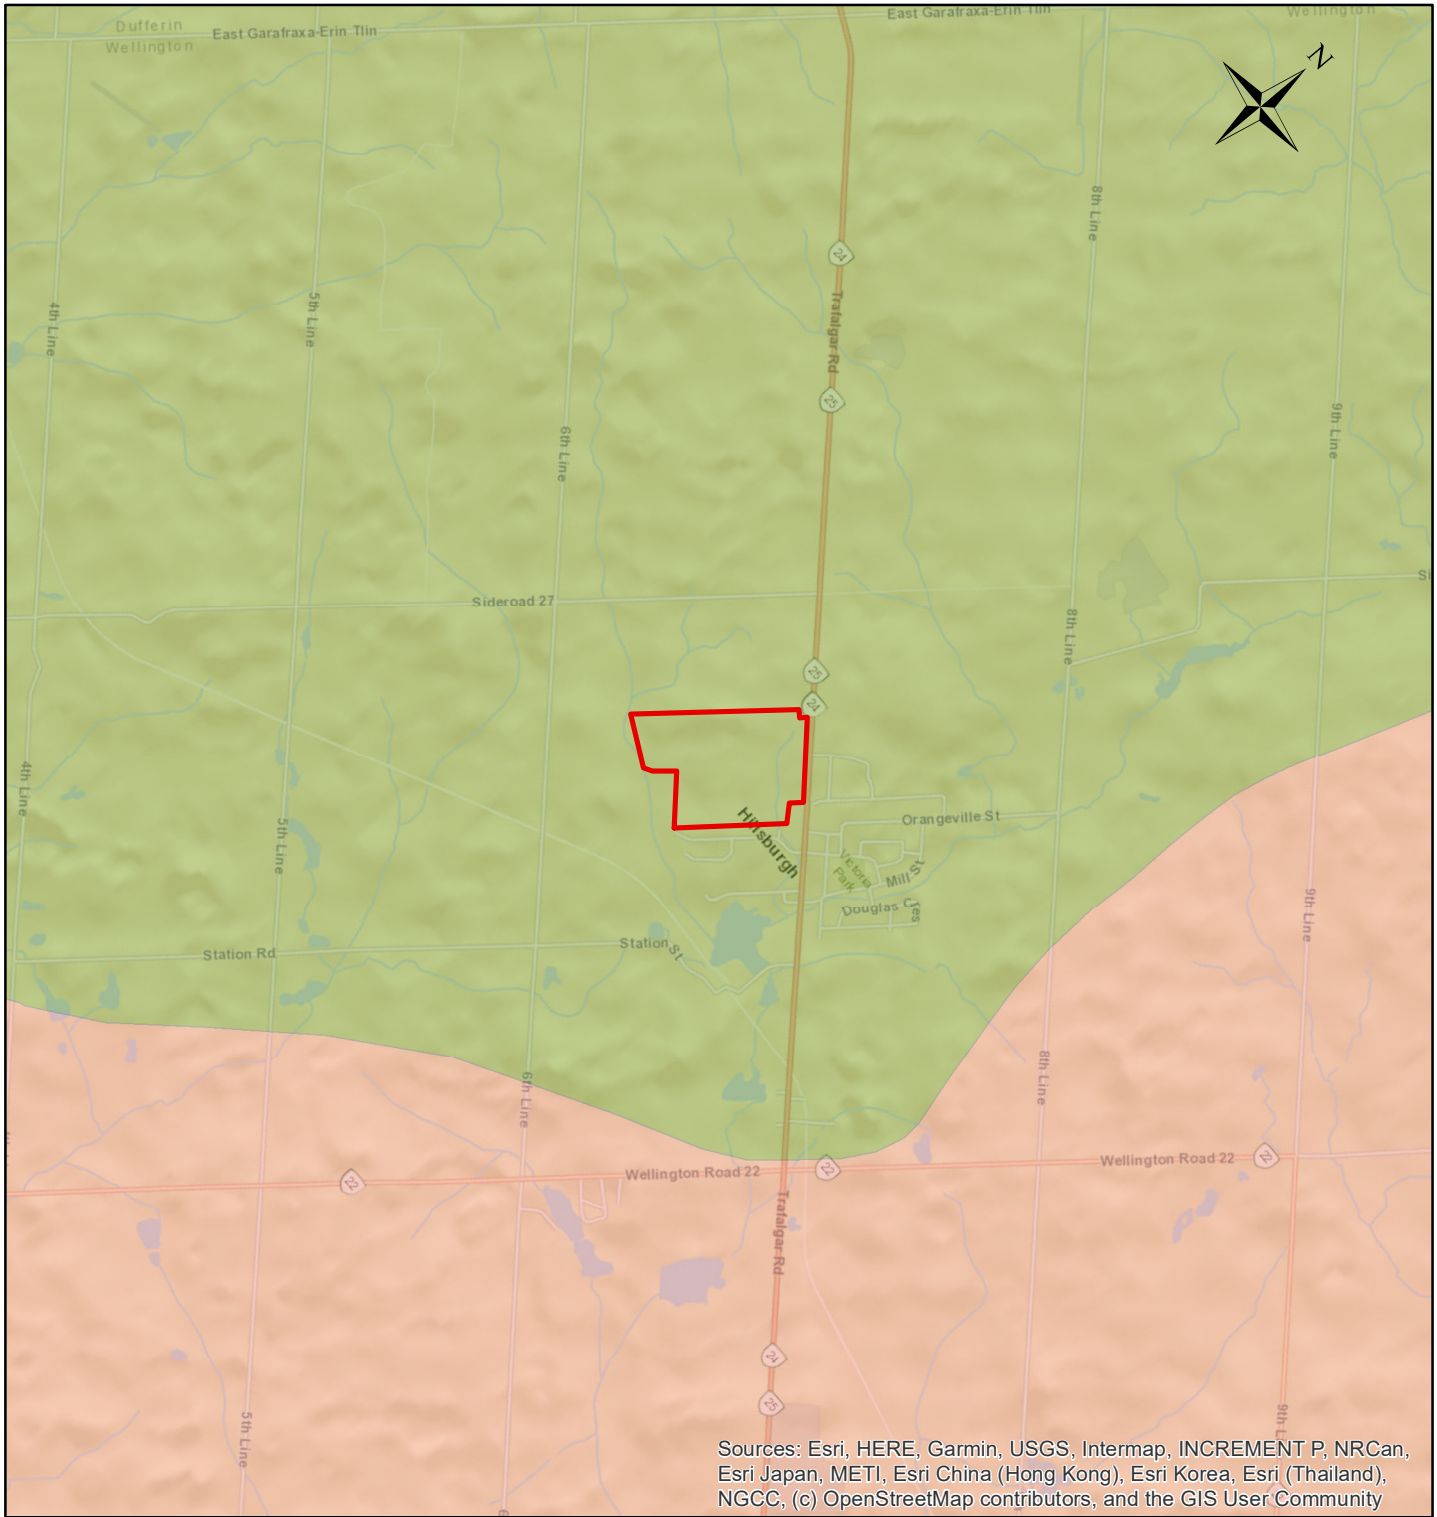

Legend



-  Site Boundary
-  9, Hillsburgh Sandhills
-  11, Guelph Drumlin Field


Drawn: MM	Title PHYSIOGRAPHIC MAP	
Approved: KM	Project	
Date: SEP. 2021	HYDROGEOLOGICAL INVESTIGATION 5916 Trafalgar Road North, Town of Erin, Ontario	
Project No.: 2100428AH	Client Hillsburgh Heights Inc.	
	0 337.5 675 1,350 Meters	FIGURE 3

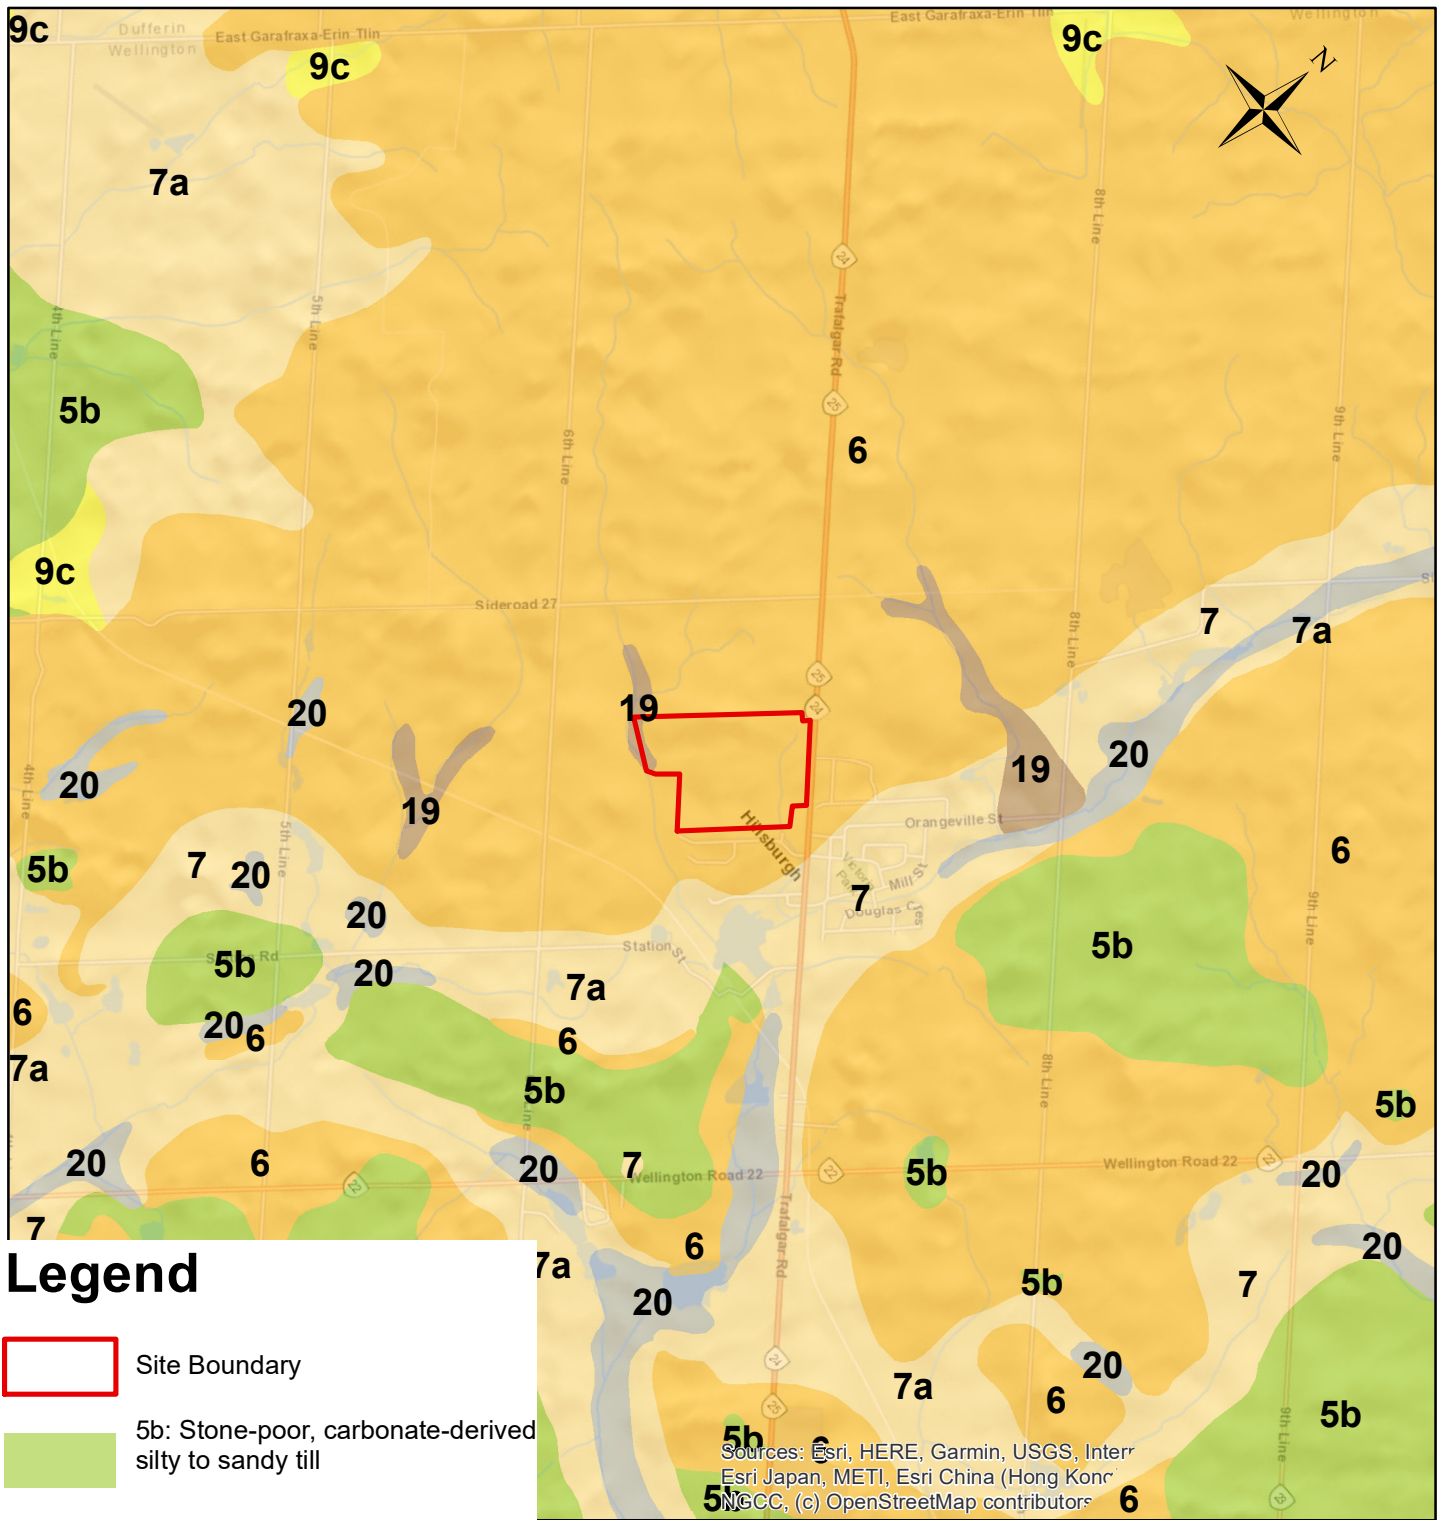

Legend

- Site Boundary
- 5b: Stone-poor, carbonate-derived silty to sandy till
- 6: Ice-contact stratified deposits
- 7: Glaciofluvial deposits
- 7a: Sandy deposits
- 9c: Foreshore-basinal deposits
- 19: Modern alluvial deposits
- 20: Organic deposits

Drawn:	MM	Title	SURFICIAL GEOLOGY
Approved:	KM	Project	HYDROGEOLOGICAL INVESTIGATION 5916 Trafalgar Road North, Town of Erin, Ontario
Date:	SEP. 2021		
Project No.:	2100428AH		
		Client	Hillsburgh Heights Inc.
			FIGURE 4

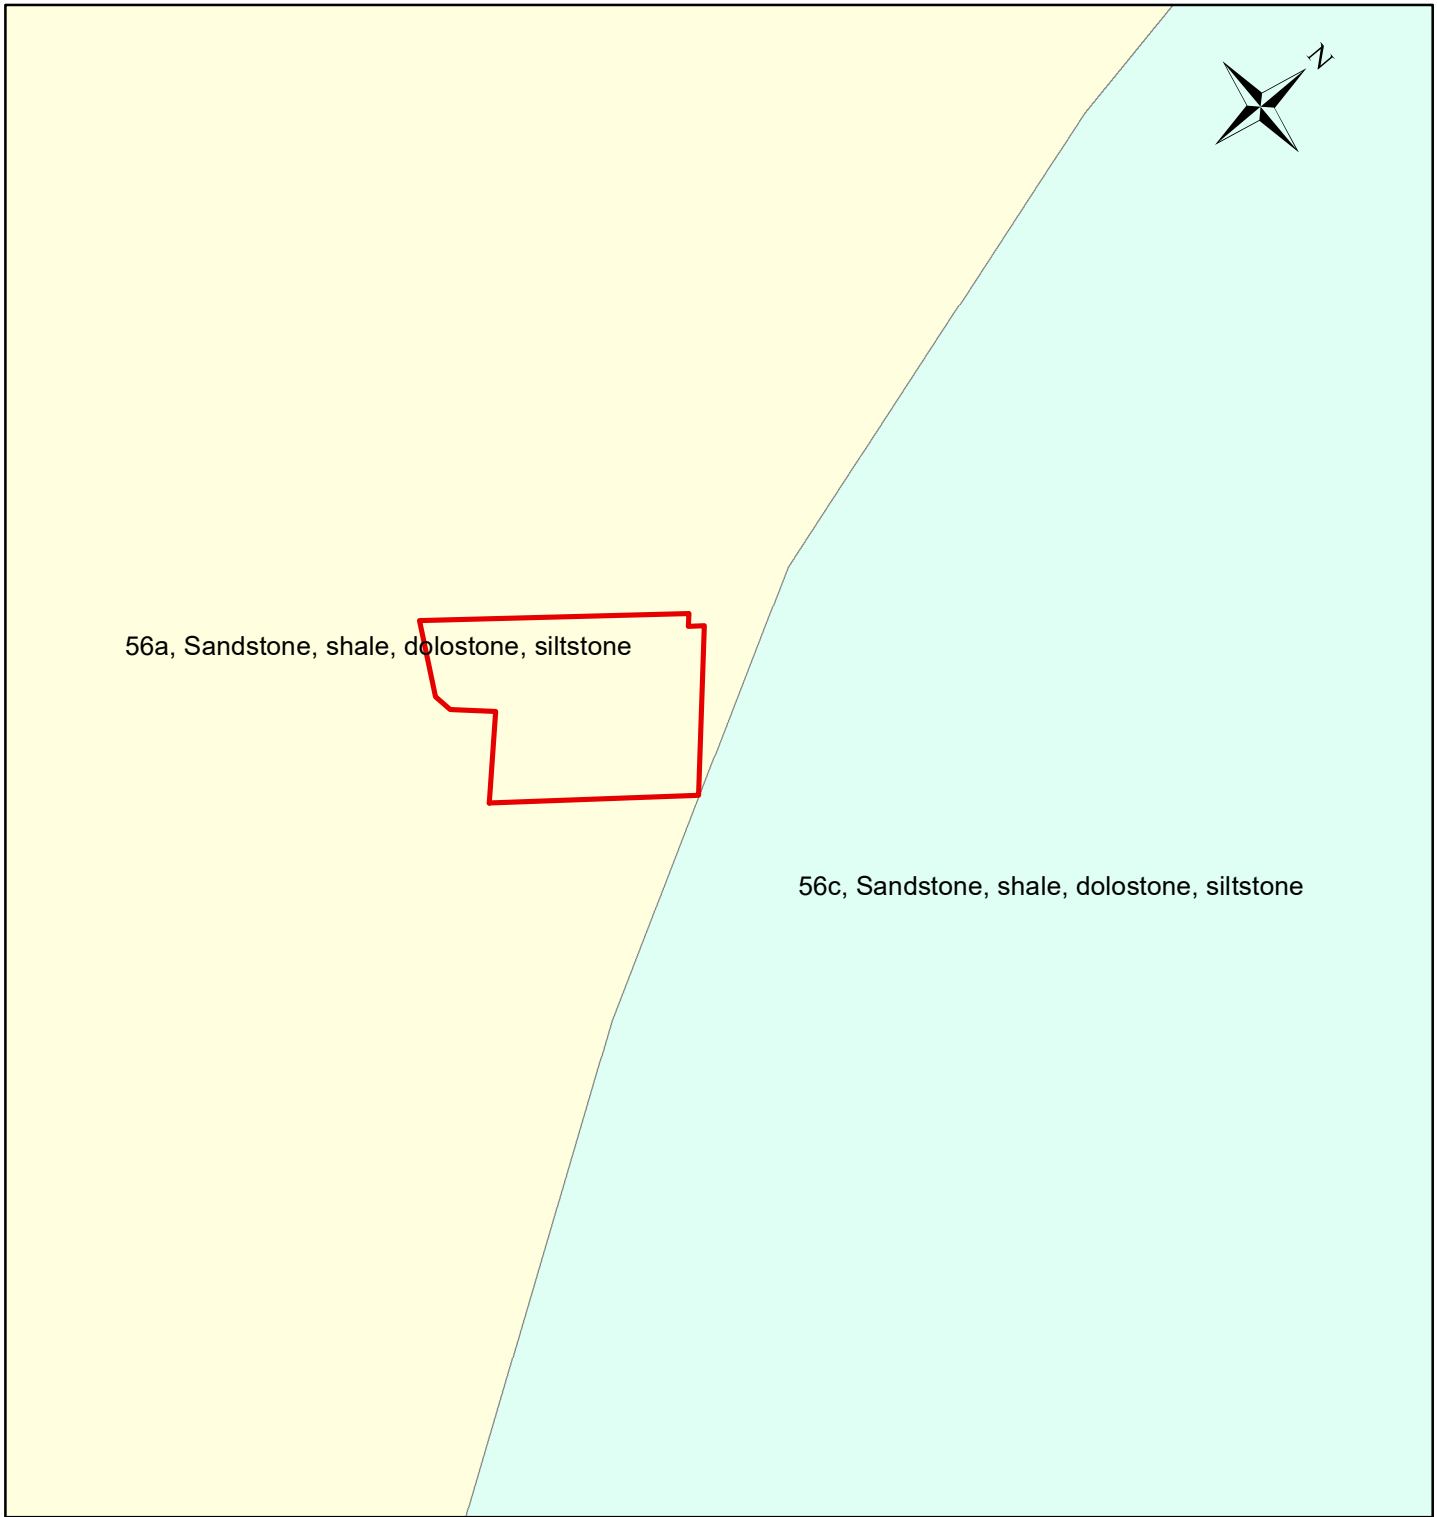


Legend


 Site Boundary

Bedrock Formation

 56a, Guelph Formation

 56c, Armabel Formation

Drawn: MM	Title BEDROCK GEOLOGY	
Approved: KM	Project	
Date: SEP. 2021	HYDROGEOLOGICAL INVESTIGATION 5916 Trafalgar Road North, Town of Erin, Ontario	
Project No.: 2100428AH		
	Client Hillsburgh Heights Inc.	
	0 210 420 840 Meters	FIGURE 5

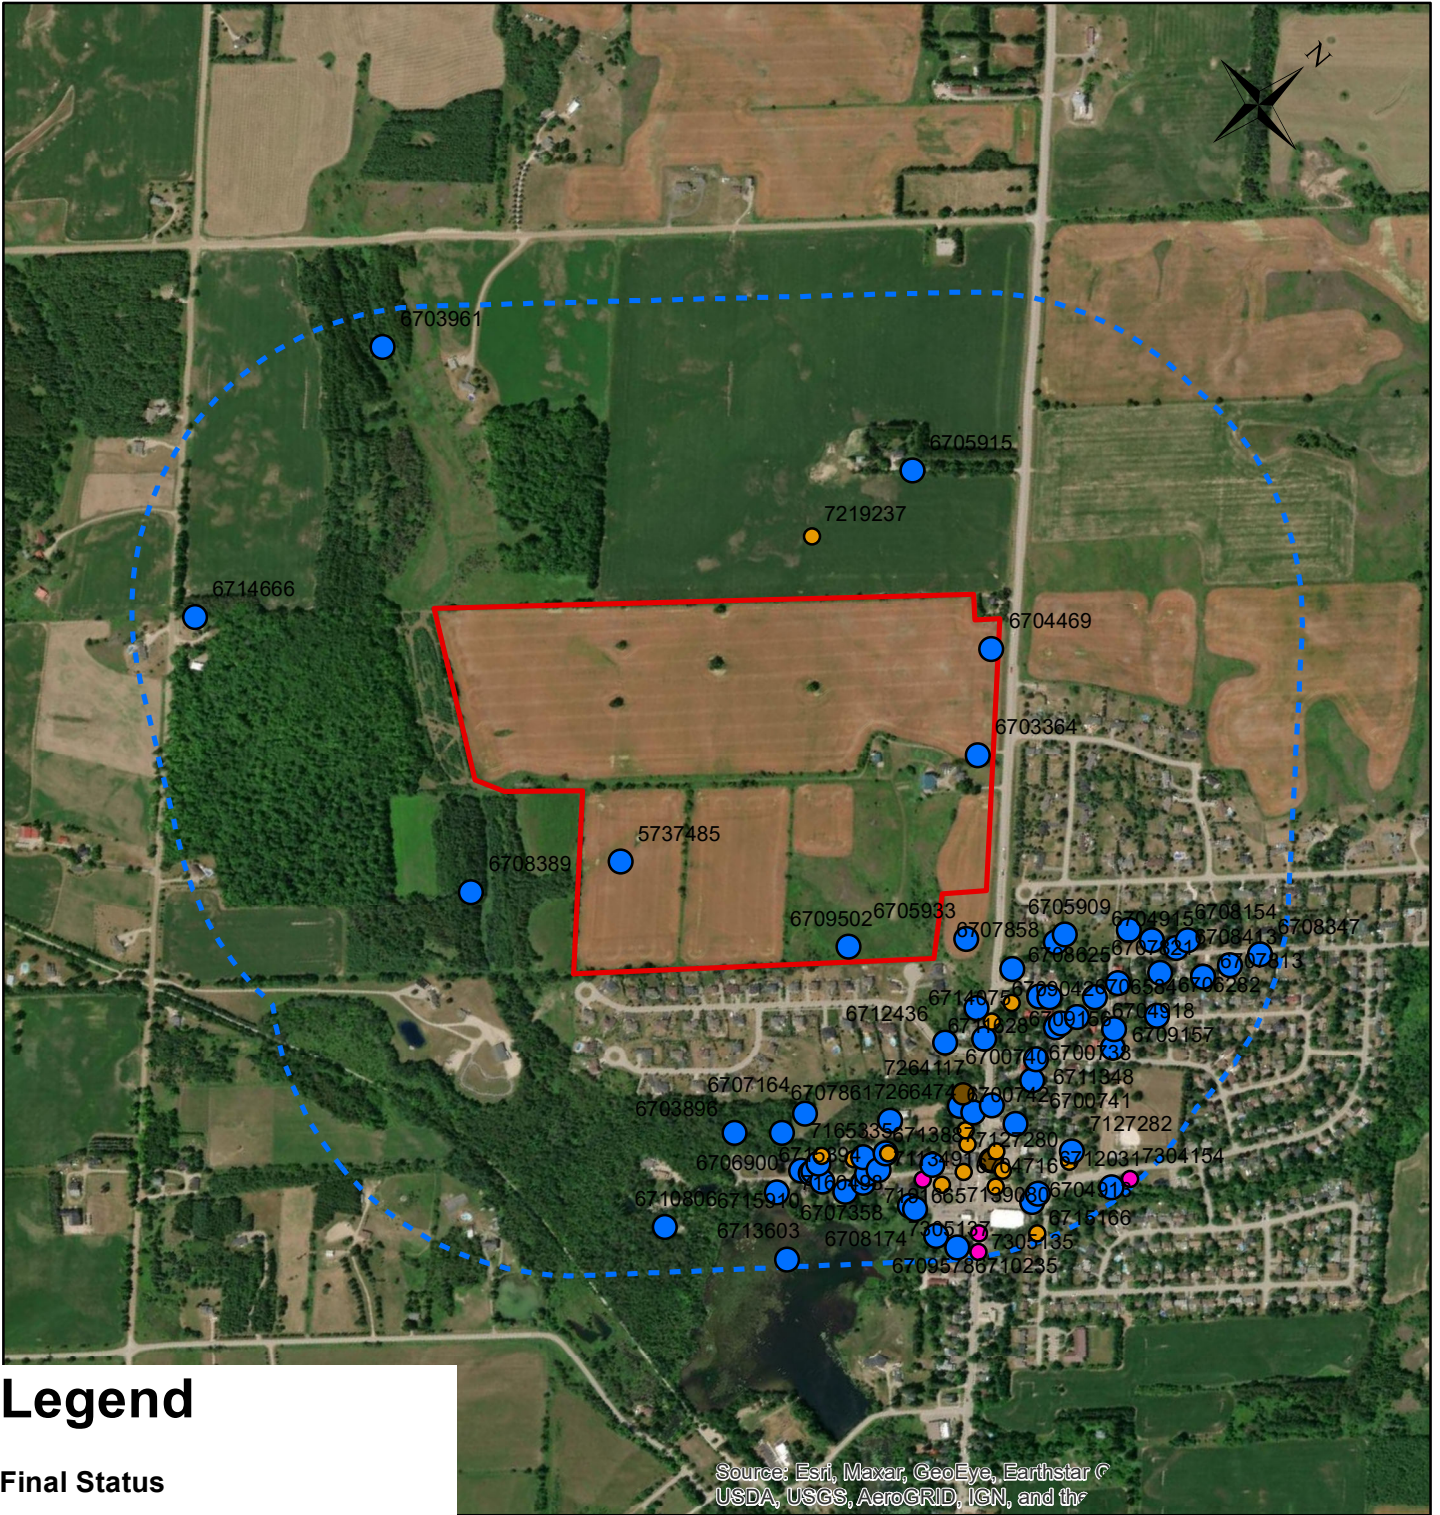


Source: Esri, Maxar, GeoEye, Earthstar ©
 USDA, USGS, AeroGRID, IGN, and the

Legend






Final Status


- Abandoned
- Monitoring and Test Hole
- Not Stated
- Water Supply
- 500m Buffer
- Site Boundary

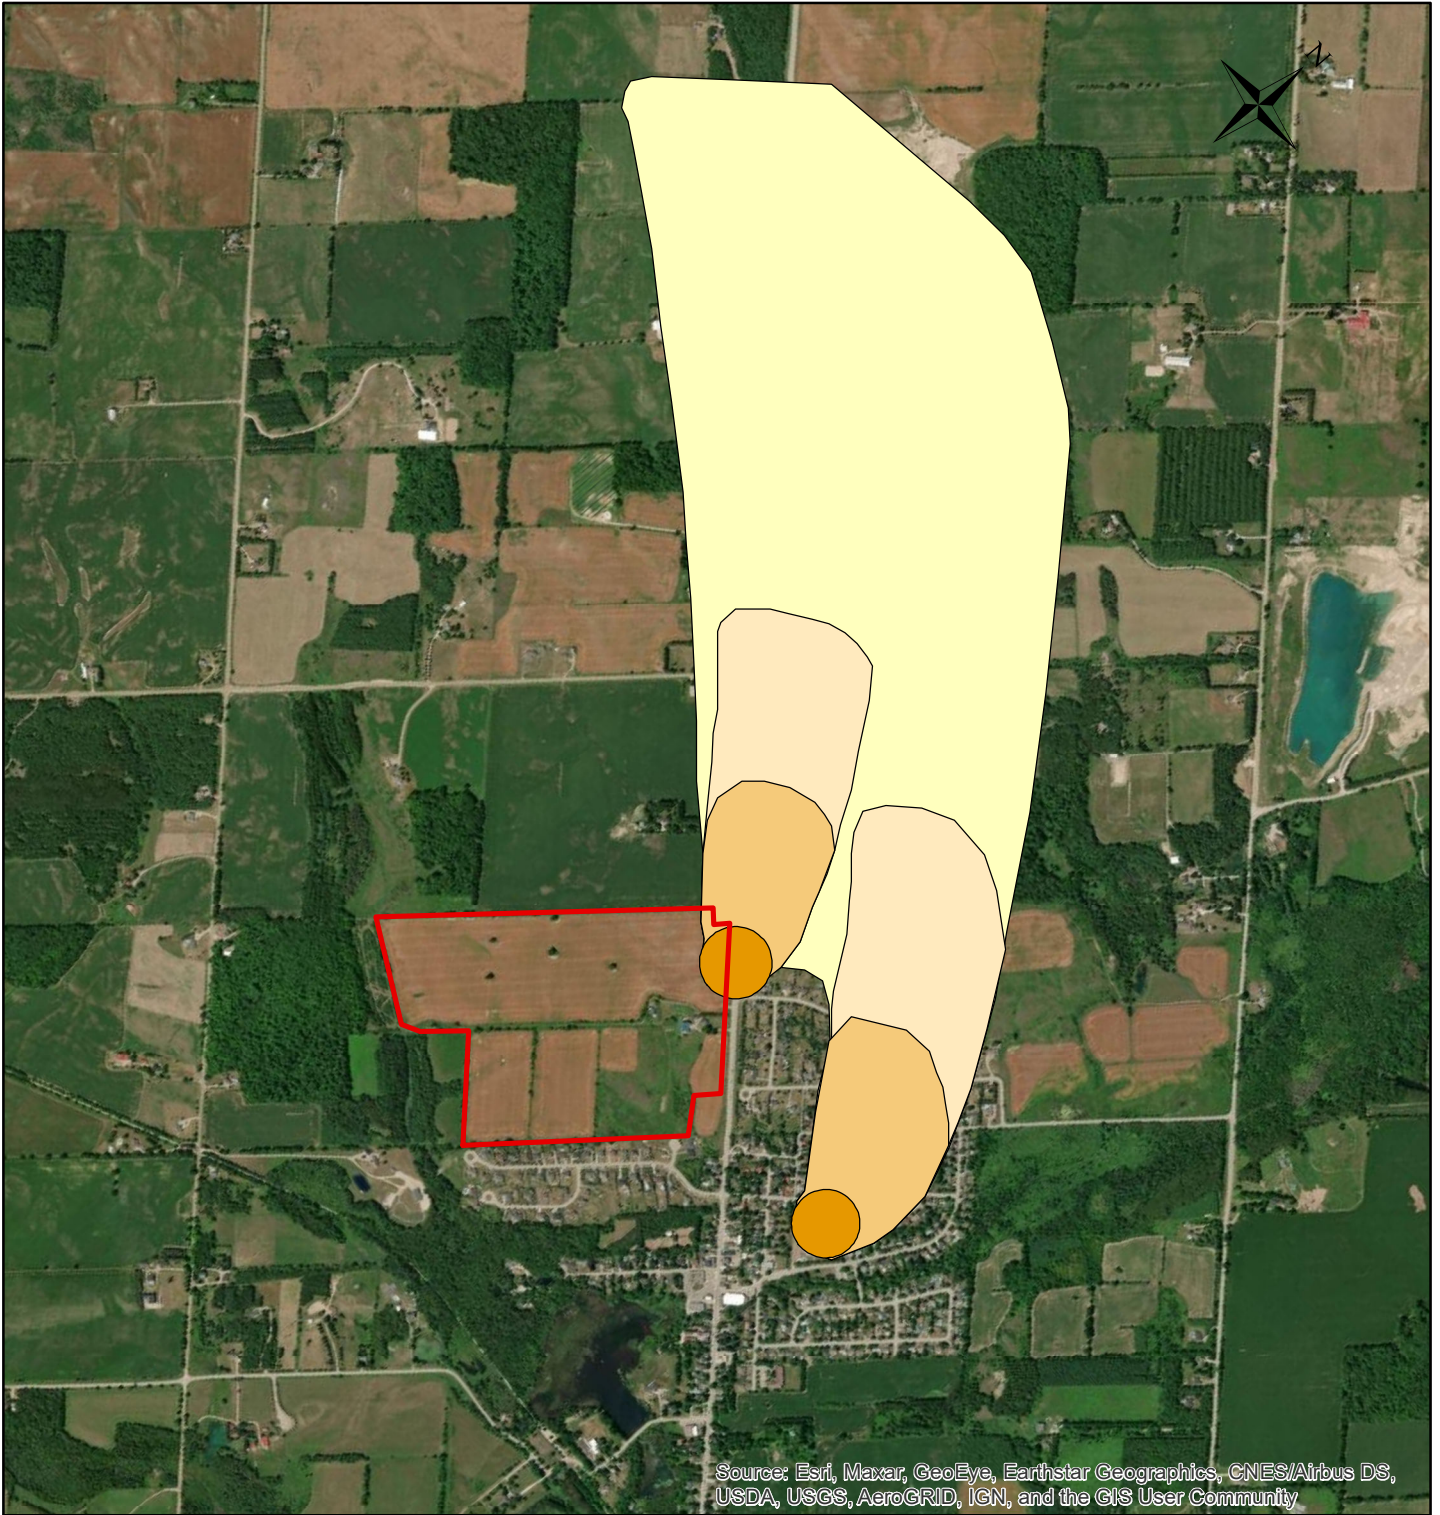Drawn: MM	Title WATER WELL USE MAP	
Approved: KM	Project	
Date: SEP. 2021	HYDROGEOLOGICAL INVESTIGATION	
Project No.: 2100428AH	5916 Trafalgar Road North, Town of Erin, Ontario	
	Client Hillsburgh Heights Inc.	
	0 105 210 420 Meters	FIGURE 6



Legend

-  Site Boundary
-  WHPA-A
-  WHPA-B
-  WHPA-C
-  WHPA-D

Drawn: MM	Title WELLHEAD PROTECTION AREA CLOSE TO SITE	
Approved: KM	Project	
Date: NOV. 2021	HYDROGEOLOGICAL INVESTIGATION 5916 Trafalgar Road North, Town of Erin, Ontario	
Project No.: 2100428AH	Client Hillsburgh Heights Inc.	
	0 170 340 680 Meters	FIGURE 7

APPENDIX A

BOREHOLE LOGS AND GRAIN SIZE ANALYSIS


PROJECT: Briarwood Hillsburgh Development
 CLIENT: Briarwood Homes
 PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin, Ontario
 DATUM: Geodetic
 BH LOCATION: See Borehole Location Plan N 4849474.973 E 568214.5891

DRILLING DATA
 Method: Hollow Stem Auger
 Diameter: 150mm
 Date: Sep-07-2021
 REF. NO.: 2100428AH
 DRAWING NO.: 2

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W _p	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W _L	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m ³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%)						
(m) ELEV DEPTH	DESCRIPTION	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80							100	20	40	60	80	100
0.0 473.3	Topsoil: 200mm																					
0.2	Sandy Silt: trace gravel/cobbles, trace clay, trace rootlets, oxidized, greyish brown, moist, loose to compact	1	SS	4																		
1		2	SS	12																		
2		3	SS	23																		
4		4	SS	23																		
3 470.4	Sand and gravel: trace silt, trace clay, brown, moist, loose to very dense	5	SS	39																		
4		6	SS	50/150																		
5		7	SS	67																		
6																						
7																						

Continued Next Page

GROUNDWATER ELEVATIONS



GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity

○ = 3% Strain at Failure

PROJECT: Briarwood Hillsburgh Development
 CLIENT: Briarwood Homes
 PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin, Ontario
 DATUM: Geodetic
 BH LOCATION: See Borehole Location Plan N 484974.973 E 568214.5891

DRILLING DATA
 Method: Hollow Stem Auger
 Diameter: 150mm
 Date: Sep-07-2021
 REF. NO.: 2100428AH
 DRAWING NO.: 2

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT	NATURAL MOISTURE CONTENT	LIQUID LIMIT	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m ³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)									
8	Sand and gravel: trace silt, trace clay, brown, moist, loose to very dense(Continued)		8	SS	13	Screen											
9																	
463.7			9	SS	6												
9.8	End of Borehole: borehole terminated at 9.8m 1) 50 mm diameter monitoring well installed upon completion. Upon completion: open & dry																

GROUNDWATER ELEVATIONS
 Measurement

GRAPH NOTES +³, ×³: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

PROJECT: Briarwood Hillsburgh Development
 CLIENT: Briarwood Homes
 PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin, Ontario
 DATUM: Geodetic
 BH LOCATION: See Borehole Location Plan N 4849079.566 E 567864.1193

DRILLING DATA
 Method: Hollow Stem Auger
 Diameter: 150mm
 Date: Sep-07-2021
 REF. NO.: 2100428AH
 DRAWING NO.: 3

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W _p	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W _L	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m ³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60							80
469.4	0.0	Topsoil:300mm															
469.1	0.3	Silty sand to sandy silt till: trace clay, trace gravel/cobble, trace rootlets, brown, moist, loose to compact	1	SS	6												
			2	SS	23												
467.9	1.5	Sandy silt till: trace gravel, brown, moist, dense to very dense	3	SS	52												
				4	SS	44											
				5	SS	39											
				6	SS50/125mm												
				7	SS50/75mm												
463.2	6.2	End of Borehole:borehole terminated at 6.2m 1) 50 mm diameter monitoring well installed upon completion. Upon completion: open & dry															

GROUNDWATER ELEVATIONS
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3 , × 3 : Numbers refer to Sensitivity ○ ●=3% Strain at Failure

PROJECT: Briarwood Hillsburgh Development
 CLIENT: Briarwood Homes
 PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin, Ontario
 DATUM: Geodetic
 BH LOCATION: See Borehole Location Plan N 4849170.944 E 568075.1217

DRILLING DATA
 Method: Hollow Stem Auger
 Diameter: 150mm
 Date: Sep-07-2021
 REF. NO.: 2100428AH
 DRAWING NO.: 4

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m ³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%)			
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80	100				PLASTIC LIMIT W _p	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W _L
471.0	0.0	Topsoil:300mm																
470.7	0.3	Silty sand: trace gravel, trace rootlets, greyish brown, moist, loose	1	SS	8						○							
			2	SS	9						○							
469.5	1.5	Sand and gravel: trace silt, some cobbles, brown, moist, dense to very dense	3	SS	36						○							
			4	SS	37						○							
			5	SS	39						○							
			6	SS50/130mm							○							
			7	SS50/75mm							○							
464.7	6.3	End of Borehole:borehole terminated at 6.3m 1) 50 mm diameter monitoring well installed upon completion. Upon completion: open & dry																

GROUNDWATER ELEVATIONS
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3, x 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

PROJECT: Briarwood Hillsburgh Development
 CLIENT: Briarwood Homes
 PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin, Ontario
 DATUM: Geodetic
 BH LOCATION: See Borehole Location Plan N 4848881.638 E 568028.4108

DRILLING DATA
 Method: Hollow Stem Auger
 Diameter: 150mm
 Date: Sep-07-2021
 REF. NO.: 2100428AH
 DRAWING NO.: 5

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W _p	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W _L	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m ³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)								
458.5 0.0	Topsoil: 250mm															
458.2 0.3	Sand and gravel: trace silt, trace clay, trace rootlets, some cobbles, brown, moist, loose to compact		1	SS	4											
			2	SS	17											
457.0 1.5	Silty clay: trace sand, trace gravel, brown, moist, hard		3	SS50/75mm												
456.2 2.3	Sand and gravel: trace silt, trace clay, some cobbles, brown, moist, compact to very dense		4	SS50/130mm												
			5	SS	18											
			6	SS	30											
			7	SS50/100mm												
451.8 6.7	End of Borehole: borehole terminated at 6.7m 1) 50 mm diameter monitoring well installed upon completion. Upon completion: open & dry															

GROUNDWATER ELEVATIONS
 Measurement 1st 2nd 3rd 4th


GRAPH NOTES + 3, x 3: Numbers refer to Sensitivity ○ = 3% Strain at Failure

PROJECT: Briarwood Hillsburgh Development
 CLIENT: Briarwood Homes
 PROJECT LOCATION: 5916 Trafalgar Road North, Town of Erin, Ontario
 DATUM: Geodetic
 BH LOCATION: See Borehole Location Plan N 4849136.503 E 568418.3089

DRILLING DATA
 Method: Hollow Stem Auger
 Diameter: 150mm
 Date: Sep-07-2021
 REF. NO.: 2100428AH
 DRAWING NO.: 6

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W _p	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W _L	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m ³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%)		
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)									WATER CONTENT (%)	
454.0	0.0	Topsoil: 250mm																
453.8	0.3	Silty sand: trace clay, trace gravel, trace rootlets, brown, moist, loose	1	SS	5													
	1		2	SS	5													
	2		3	SS	7													7 47 39 7
451.7	2.3	Sand: some gravel, some silt, trace clay, brown, moist, compact to very dense	4	SS	12													
	3		5	SS50/130mm														
	4																	
	5		6	SS	69													
	6																	
447.6	6.5	End of Borehole: borehole terminated at 6.5m 1) 50 mm diameter monitoring well installed upon completion. 2) Water Level Readings: Date: Sept 07, 2021 Water Level(mbgf): 4.8	7	SS50/75mm														

GROUNDWATER ELEVATIONS




GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity
 ○ ●=3% Strain at Failure

UNIFIED SOIL CLASSIFICATION SYSTEM

LS 702/D 422

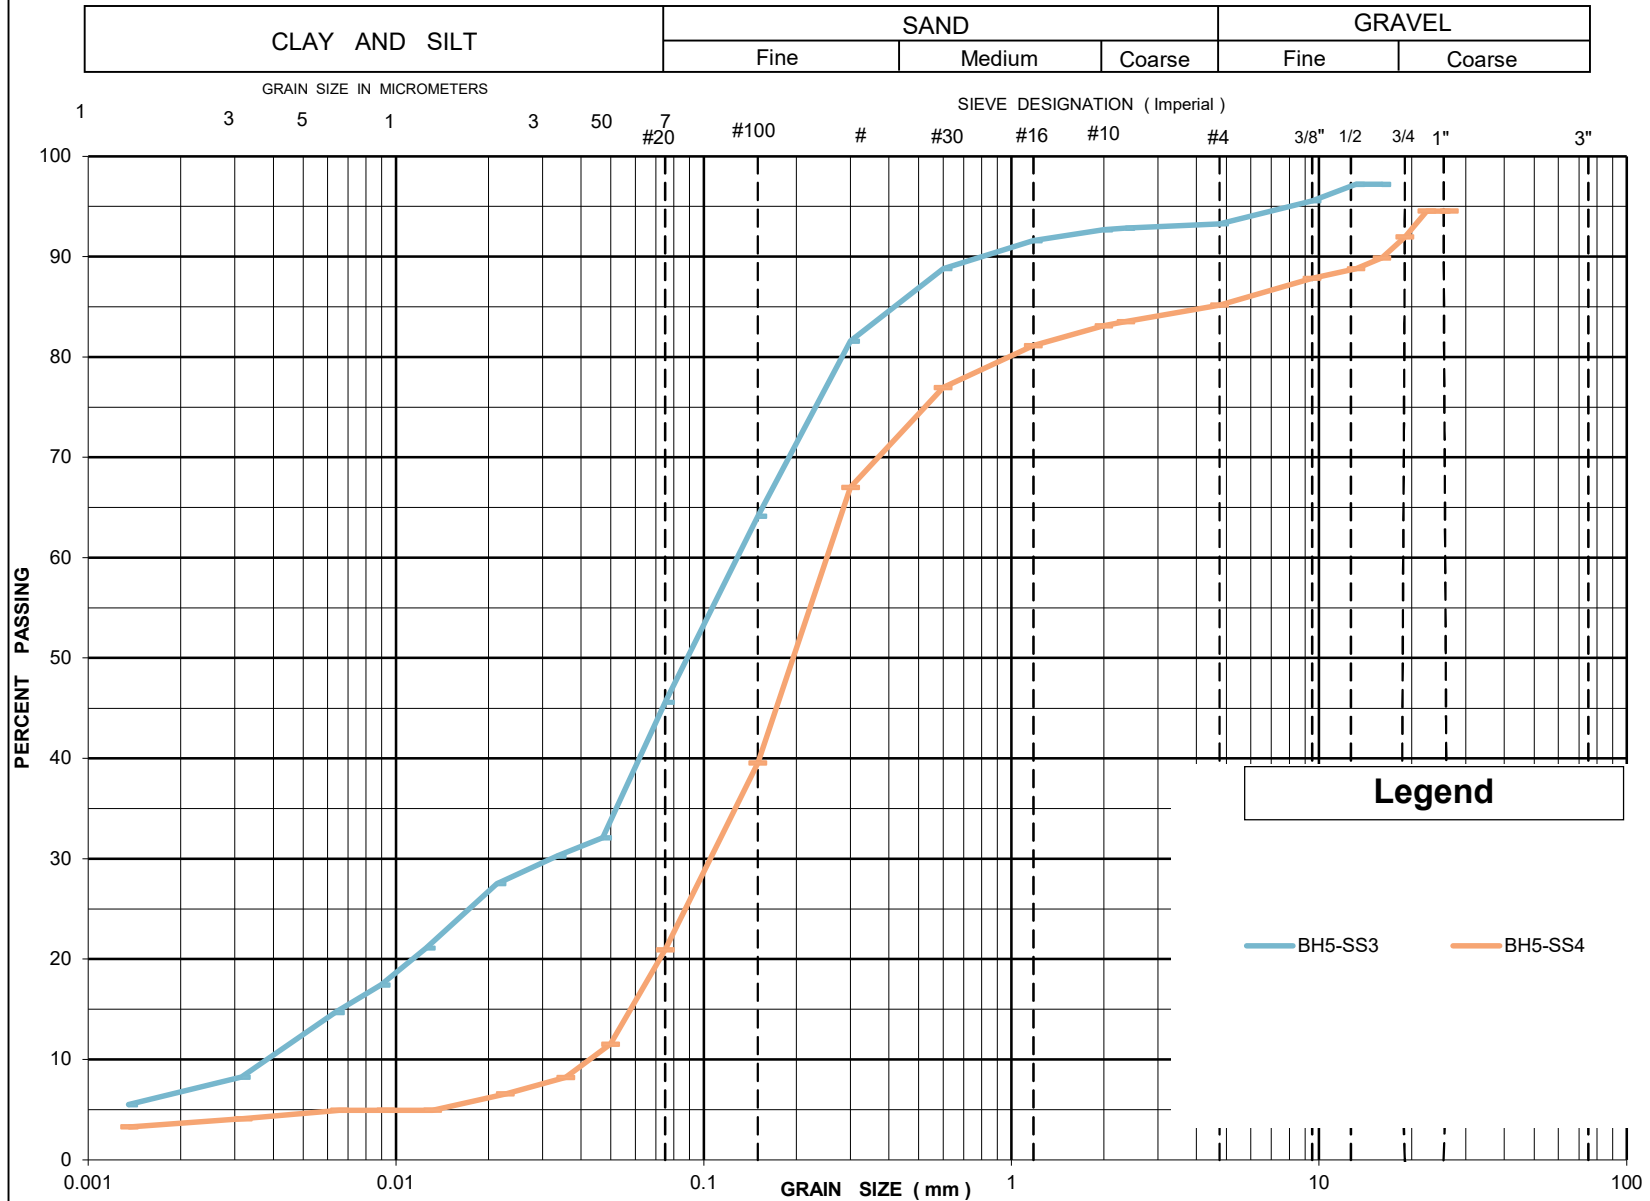

GRAIN SIZE DISTRIBUTION

Drawing No : 2
 PROJECT # : 2100428AH
 DATE : Sept 23, 2021

APPENDIX B

INFILTRATION TESTS

FIELD MEASUREMENTS AND CALCULATIONS

Test Hole:	TP4
Tested By:	Bruce Kashani

Date:	07-Sep-21
Weather:	Cloud & windy
Depth to Water (m):	>6.5
Diameter (cm):	15

Project No.:	2100428AH
Depth to bedrock (m):	N/A
Depth (cm):	220

Horizon (m)	Soil Texture	Soil color	Comments
0.0 - 0.25	Topsoil	Brown, black	
0.25 - 2.20	Sandy silt	Brown	

Time (min)	Water Depth (cm)
0	15.00
2	30.00
5	38.00
12	42.00
20	53.00
30	58.00
40	63.00
50	68.00

Δt (min)	Δh (cm)	Inf. Rate (cm/min)	Inf. Rate (mm/hr)	Percolation time (min/cm)	Average (min/cm)
2	15.00	7.5	4500.0		
3	8.00	2.7	1600.0	0.38	
7	4.00	0.6	342.9	1.75	
8	11.00	1.4	825.0	0.73	
10	5.00	0.5	300.0	2.00	
10	5.00	0.5	300.0	2.00	
10	5.00	0.5	300.0	2.00	2.0

Test Hole:	TP1
Tested By:	Bruce Kashani

Date:	01-Sep-21
Weather:	Sunny
Depth to Water (m):	>6.5
Diameter (cm):	15

Project No.:	2100428AH
Depth to bedrock (m):	N/A
Depth (cm):	240

Horizon (m)	Soil Texture	Soil color	Comments
0.0 - 0.20	Topsoil	Brown, black	
0.20 - 2.40	Sandy silt to silty sand with gravel and cobbles	Brown	

Time (min)	Water Depth (cm)
0	30.00
2	60.00
5	75.00
10	83.00
20	105.00
30	115.00
40	125.00
50	135.00

Δt (min)	Δh (cm)	Inf. Rate (cm/min)	Inf. Rate (mm/hr)	Percolation time (min/cm)	Average (min/cm)
2	30.00	15.0	9000.0		
3	15.00	5.0	3000.0	0.20	
5	8.00	1.6	960.0	0.63	
10	22.00	2.2	1320.0	0.45	
10	10.00	1.0	600.0	1.00	
10	10.00	1.0	600.0	1.00	
10	10.00	1.0	600.0	1.00	1.0

Test Hole:	TP2
Tested By:	Bruce Kashani

Date:	07-Sep-21
Weather:	Cloud & windy
Depth to Water (m):	>6.5
Diameter (cm):	15

Project No.:	2100428AH
Depth to bedrock (m):	N/A
Depth (cm):	240

Horizon (m)	Soil Texture	Soil color	Comments
0.0 - 0.30	Topsoil	Brown, black	
0.30 - 1.50	Silty sand to sandy silt with gravel and cobbles	Brown	
1.50 - 2.40	Sandy silt till	Brown	

Time (min)	Water Depth (cm)
0	30
2	33
6	39
11	45
16	48
21	49
26	50
31	51
36	52

Δt (min)	Δh (cm)	Inf. Rate (cm/min)	Inf. Rate (mm/hr)	Percolation time (min/cm)	Average (min/cm)
2	3.00	1.5	900.0		
4	6.00	1.5	900.0	0.67	
5	6.00	1.2	720.0	0.83	
5	3.00	0.6	360.0	1.67	
5	1.00	0.2	120.0	5.00	
5	1.00	0.2	120.0	5.00	
5	1.00	0.2	120.0	5.00	
5	1.00	0.2	120.0	5.00	5.0

Test Hole:	TP3
Tested By:	Bruce Kashani

Date:	07-Sep-21
Weather:	Cloud & windy
Depth to Water (m):	>6.5
Diameter (cm):	15

Project No.:	2100428AH
Depth to bedrock (m):	N/A
Depth (cm):	185

Horizon (m)	Soil Texture	Soil color	Comments
0.0 - 0.25	Topsoil	Brown, black	
0.25 - 1.50	Sand and gravel	Brown	
1.50 - 2.30	Silty caly	Brown	
1.50 - 1.85	Sand and gravel	Brown	

Time (min)	Water Depth (cm)
0	18
2	36
6	55
9	62
12	68
15	74
18	80
21	86

Δt (min)	Δh (cm)	Inf. Rate (cm/min)	Inf. Rate (mm/hr)	Percolation time (min/cm)	Average (min/cm)
2	18.00	9.0	5400.0		
4	19.00	4.8	2850.0	0.21	
3	7.00	2.3	1400.0	0.43	
3	6.00	2.0	1200.0	0.50	
3	6.00	2.0	1200.0	0.50	
3	6.00	2.0	1200.0	0.50	
3	6.00	2.0	1200.0	0.50	0.5

APPENDIX C
**INFORMATION ON WATER WELL RECORDS
RECEIVED FROM MECP**

Water Well Record

WELL_ID	BOREHOLE ID	Easting	Northing	Well Depth (m)	Water Table Depth (m)	Date Completed	Final Status
5737485	10541210	568049	4848857	47.2	31.4	10-Dec-02	Water Supply
6700714	10464860	568613	4849152	33.5	19.8	19-Oct-57	Water Supply
6700738	10464884	568722	4849243	45.7	10.4	16-Feb-65	Water Supply
6700740	10464886	568722	4849233	42.7	12.2	04-Aug-58	Water Supply
6700741	10464887	568764	4849146	25.9	4.3	20-May-60	Water Supply
6700742	10464888	568801	4849079	29.9	6.1	21-Mar-61	Water Supply
6703364	10467506	568294	4849423	68.6	25.9	05-Feb-69	Water Supply
6703528	10467665	568634	4848703	54.9	7.6	05-Aug-69	Water Supply
6703896	10468025	568514	4848713	50.3	8.5	01-Apr-71	Water Supply
6703961	10468086	567144	4849103	41.8	15.2	14-Jun-71	Water Supply
6704469	10468577	568174	4849553	88.4	42.1	22-Sep-72	Water Supply
6704716	10468823	568914	4849033	45.7	2.4	11-May-73	Water Supply
6704913	10469017	568918	4849017	74.7	4.6	25-Oct-73	Water Supply
6704915	10469019	568749	4849470	47.2	13.7	20-Sep-73	Water Supply
6704918	10469022	568725	4849314	27.7	9.8	18-Sep-73	Water Supply
6705909	10469993	568614	4849343	46.6	9.8	08-Jul-75	Water Supply
6705915	10469999	567864	4849643	68.0	35.1	05-Jun-75	Water Supply
6705933	10470017	568514	4849213	35.1	12.5	30-May-75	Water Supply
6706282	10470362	568764	4849423	27.4	12.8	16-Oct-76	Water Supply
6706584	10470660	568814	4849373	53.0	0.9	20-May-77	Water Supply
6706900	10470970	568564	4848773	60.0	7.6	29-Apr-78	Water Supply
6707164	10471227	568564	4848823	29.0	6.4	09-Jan-79	Water Supply
6707358	10471410	568714	4848823	32.9	3.7	18-Apr-80	Water Supply
6707813	10471818	568814	4849473	32.0	12.2	29-Apr-83	Water Supply
6707821	10471826	568814	4849473	20.4	12.8	08-Jun-83	Water Supply
6707858	10471859	568614	4849323	36.6	14.9	06-Jul-83	Water Supply
6707861	10471862	568664	4848923	36.6	2.4	12-May-83	Water Supply
6708154	10472069	568752	4849492	19.2	12.2	29-Jun-84	Water Supply
6708174	10472089	568803	4848861	22.9	2.1	18-Apr-84	Water Supply
6708346	10472255	568642	4848787	35.4	4.3	24-Jul-85	Water Supply
6708347	10472256	568847	4849569	33.5	12.2	04-Dec-85	Water Supply
6708360	10472268	568714	4849447	33.5	14.3	18-Dec-85	Water Supply
6708365	10472273	568793	4848858	34.1	3.0	24-Dec-85	Water Supply
6708389	10472295	567929	4848635	41.1	6.4	09-May-85	Water Supply
6708413	10472319	568828	4849519	33.5	10.7	07-Apr-86	Water Supply
6708616	10472508	568719	4849027	29.6	8.8	01-Dec-86	Water Supply
6708625	10472517	568732	4849358	23.5	10.7	11-Aug-86	Water Supply
6708826	10472716	568676	4849428	15.2	6.7	13-Apr-87	Water Supply
6709042	10472915	568731	4849270	48.2	12.2	10-Dec-87	Water Supply
6709050	10472923	568646	4848767	57.0	5.5	30-Nov-87	Water Supply
6709156	10473026	568808	4849283	51.8	7.6	12-Jan-88	Water Supply
6709157	10473027	568786	4849305	30.2	7.6	09-Dec-87	Water Supply
6709502	10473351	568399	4849055	15.2	5.5	20-Dec-88	Water Supply
6709578	10473427	568859	4848859	49.7	7.0	15-Dec-88	Water Supply
6710235	10474082	568896	4848874	32.0	2.7	27-Jul-89	Water Supply
6710806	10474647	568559	4848525	25.6	3.0	24-Jul-91	Water Supply
6710809	10474650	568682	4848850	34.1	6.7	24-May-91	Water Supply
6711075	10474916	568765	4848930	57.0	4.3	30-Oct-92	Water Supply
6711348	10475182	568741	4849173	48.8	12.2	19-Oct-93	Water Supply
6711628	10475461	568665	4849244	44.2	16.8	27-Oct-94	Water Supply
6712031	10475864	568983	4849133	57.9	1.8	01-May-96	Water Supply
6712436	10476269	568623	4849076	39.6	9.8	30-Jul-97	Water Supply
6713318	10477151	568660	4849130	49.4	8.5	26-Jan-00	Water Supply
6713603	10477436	568730	4848645	29.6	3.0	22-Nov-00	Water Supply
6713631	10477464	568677	4849256	51.8	15.2	09-Jan-01	Water Supply
6713887	10523019	568753	4849068	29.0	8.5	04-Oct-01	Water Supply
6713900	10523032	568707	4848838	38.1	4.3	25-Oct-01	Water Supply
6714075	10528610	568602	4849240	38.4	17.4	18-Jun-02	Water Supply
6714666	10548217	567286	4848578	72.5	34.1	09-Oct-03	Water Supply
6715166	11179802	568963	4848990			10-Dec-04	Abandoned
6715250	11327036	568800	4848921	4.3		10-Feb-05	Abandoned
6715394	11327180	568714	4848856	30.5	5.2	04-Jul-05	Water Supply
6715503	11327289	568674	4848836			02-Sep-05	Abandoned
6715772	11558293	568669	4848773	30.5	6.1	15-Jun-06	Water Supply
6715910	11695692	568647	4848772	30.5	7.0	06-Sep-06	Water Supply
7050905	23050905	568707	4848791	30.5	5.2	01-Oct-07	Water Supply
7105350	1001599370	568636	4848799			05-May-08	Abandoned
7113491	1001839380	568822	4849009	27.7	3.4	07-May-08	Water Supply
7118031	1001955780	568633	4848757	44.8	7.0	25-Sep-08	Water Supply
7127280	1002637730	568907	4849107			02-Jun-09	Abandoned
7127282	1002637730	568897	4849121	25.0	2.7	09-Jun-09	Water Supply

Water Well Record

WELL_ID	BOREHOLE ID	Easting	Northing	Well Depth (m)	Water Table Depth (m)	Date Completed	Final Status
7139080	1002932280	568847	4849013			14-Aug-08	Abandoned
7139081	1002932280	568822	4849009			14-Aug-09	Not Stated
7160498	1003486390	568701	4848883	18.3	3.7	23-Feb-11	Water Supply
7165335	1003534010	568704	4848886			13-Jun-11	Abandoned
7174984	1003633140	568777	4848996			12-Nov-11	Abandoned
7191665	1004205580	568807	4848962			25-Sep-12	Abandoned
7194971	1004232460	568816	4849025			06-Nov-12	Abandoned
7197600	1004256250	568757	4849009			20-Dec-12	Abandoned
7201338	1004288380	568860	4848987			25-Apr-13	Abandoned
7201342	1004288390	568787	4848856			25-Apr-13	Abandoned
7219237	1004731810	567841	4849446			15-Sep-13	Abandoned
7249486	1005717520	568647	4849158			02-Sep-15	Abandoned
7264117	1006030530	568708	4849044			29-May-16	Not Stated
7266474	1006141900	568742	4849038	23.5	6.4	11-Apr-16	Water Supply
7278147	1006322440	568644	4849203			21-Dec-16	Abandoned
7304154	1006975720	568993	4849166	7.6		03-Nov-17	Monitoring and Test Hole
7305135	1006981980	568902	4848916	4.6		29-Nov-17	Monitoring and Test Hole
7305136	1006981980	568773	4848902	5.5		24-Nov-17	Monitoring and Test Hole
7305137	1006981980	568924	4848896	4.6		24-Nov-17	Monitoring and Test Hole

APPENDIX D

WATER BALANCE TABLES

TABLE D.1 - Climate Data

Fergus Shand Dam Station, Ontario

Latitude: 43°44' NLongitude: 80°19' WElevation: 417.6 m

Temperature: Temperature:	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
Daily Average (°C)	-7.4	-6.3	-1.9	5.7	12.2	17.5	20.0	19.0	14.9	8.3	2.1	-3.9	6.7
Rainfall (mm)	27.8	25.3	36.7	67.9	86.8	83.8	89.2	96.6	93.1	75.6	80.5	34.7	798
Snowfall (mm)	40.1	30.6	22.9	6.2	0.1	0.0	0.0	0.0	0.0	1.6	12.5	33.9	147.9
Precipitation (mm)	67.9	55.9	59.6	74.1	86.9	83.8	89.2	96.6	93.1	77.2	93.0	68.6	945.9

TABLE D.2

**Pre- and Post-Development Water Balance Components
Based on Thornthwaite's Soil Moisture Balance Approach**

Pre- and Post-Development Water Balance Components Based on Thornthwaite's Soil Moisture Balance Approach													
Potential Evapotranspiration Calculation	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	YEAR
Davily Average Temperature (°C)	-7	-6	-2	6	12	18	20	19	15	8	2	-4	7
Heat index: $i = (t/5)^{1.514}$	0.00	0.00	0.00	1.22	3.86	6.66	8.16	7.55	5.22	2.15	0.27	0.00	35.1
Unadjusted Daily Potential Evapotranspiration U (mm)	0.00	0.00	0.00	26.65	59.36	86.76	99.85	94.61	73.26	39.58	9.32	0.00	489
Adjusting Factor K for U (Latitude 43° 44' N)	0.77	0.87	0.99	1.11	1.23	1.29	1.27	1.17	1.05	0.92	0.80	0.74	
Adjusted Potential Evapotranspiration PET (mm)	0	0	0	30	73	112	127	111	77	36	7	0	573
PRE-DEVELOPMENT WATER BALANCE	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	YEAR
Precipitation (P)	68	56	60	74	87	84	89	97	93	77	93	69	946
Potential Evapotranspiration (PET)	0	0	0	30	73	112	127	111	77	36	7	0	573
P - PET	68	56	60	44	14	-28	-37	-14	16	41	86	69	373
Change in Soil Moisture Storage	0	0	0	0	0	-28	-37	-14	16	41	23	0	0
Soil Moisture Storage (Assume January Soil Moisture Storage = 100% SMS)	250	250	250	250	250	222	184	170	186	227	250	250	
Actual Evapotranspiration (AET)	0	0	0	30	73	112	127	111	77	36	7	0	573
Soil Moisture Deficit (in mm)	0	0	0	0	0	28	66	80	64	23	0	0	
Surplus - available for infiltration or runoff	68	56	60	44	14	0	0	0	0	0	63	69	373
Potential Infiltration (based on MOE methodology*; independent of temperature)	34.0	28.0	29.8	22.2	6.9	0.0	0.0	0.0	0.0	0.0	31.4	34.3	187
Potential Surface Water Runoff (independent of temperature)	34.0	28.0	29.8	22.2	6.9	0.0	0.0	0.0	0.0	0.0	31.4	34.3	187
POST- DEVELOPMENT WATER BALANCE ON IMPERVIOUS AREAS	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	YEAR
Precipitation (P)	68	56	60	74	87	84	89	97	93	77	93	69	946
Potential Evaporation (PE) from impervious areas (assume 20%)	13.6	11.2	11.9	14.8	17.4	16.8	17.8	19.3	18.6	15.4	18.6	13.7	189
P-PE (surplus available from impervious areas)	54	45	48	59	70	67	71	77	74	62	74	55	757
Water surplus change compared to pre-condition (for areas that change from vegetated open areas to impervious areas)	-14	-11	-12	15	56	67	71	77	74	62	12	-14	384

Soil Moisture Storage 250
PE from impervious areas % 20

*MOE SWM infiltration factor calculation	
topography - Rolling land (approximately 2.8 to 3.8m/km)	0.2
soils - relatively tight silty clay till materials	0.2
cover - predominantly cultivated land	0.1
Infiltration Factor	0.5

TABLE D.3 - Annual Pre-Construction Water Balance

	Pre-Construction		
	Unpaved Areas	Impervious Areas (building)	Totals
Area	403000	1000	404000
Pervious Area	403000	0	403000
Impervious Area	0	1000	1000
Infiltration Factors			
Topography Infiltration Factor	0.2	0.15	
Soil Infiltration Factor	0.2	0.1	
Land Cover Infiltration Factor	0.1	0	
MOE Infiltration Factor	0.5	0.25	
Actual Infiltration Factor	0.5	0	
Runoff Coefficient Pervious Surfaces	0.5	1	
Runoff from Impervious Surfaces	0	0.8	
Inputs (per Unit Area)			
Precipitation (mm/yr)	946	946	946
Run-On (mm/yr)	0	0	0
Other Inputs (mm/yr)	0	0	0
Total Inputs (mm/yr)	946	946	946
Outputs (per Unit Area)			
Precipitation Surplus (mm/yr)	373	757	374
Net Surplus (mm/yr)	373	757	374
Evapotranspiration (mm/yr)	573	189	572
Infiltration (mm/yr)	187	0	186
Rooftop Infiltration (mm/yr)	0	0	0
Total Infiltration (mm/yr)	187	0	186
Runoff Pervious Areas	187	0	186
Runoff Impervious Areas	0	757	2
Total Runoff (mm/yr)	187	757	188
Total Outputs (mm/yr)	946	946	946
Difference (Inputs - Outputs)	0	0	
Inputs (Volumes)			
Precipitation (m3/yr)	381198	946	382144
Run-On (m3/yr)	0	0	0
Other Inputs (m3/yr)	0	0	0
Total Inputs (m3/yr)	381198	945.9	382144
Outputs (Volumes)			
Precipitation Surplus (m3/yr)	150360	757	151117
Net Surplus (m3/yr)	150360	757	151117
Evapotranspiration (m3/yr)	230838	189	231027
Infiltration (m3/yr)	75180	0	75180
Rooftop Infiltration (m3/yr)	0	0	0
Total Infiltration (m3/yr)	75180	0	75180
Runoff Pervious Area (m3/yr)	75180	0	75180
Runoff Impervious Areas (m3/yr)	0	757	757
Total Runoff (m3/yr)	75180	757	75937
Total Outputs (m3/yr)	381198	946	382144
Difference (Inputs - Outputs)	0	0	0

* Evaporation from impervious areas was assumed to be 20% of precipitation

TABLE D.4 - WATER BALANCE COMPONENTS FOR CASE WHERE RUNOFF IS DIRECTED TO PVIOUS AREAS

POTENTIAL EVAPOTRANSPIRATION CALCULATION	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	YEAR
Average Temperature (° C)	-7.4	-6.3	-1.9	5.7	12.2	17.5	20.0	19.0	14.9	8.3	2.1	-3.9	6.7
Heat index: $i = (t/5)^{1.514}$	0.00	0.00	0.00	1.22	3.86	6.66	8.16	7.55	5.22	2.15	0.27	0.00	35.1
Unadjusted Daily Potential Evapotranspiration U (mm)	0.00	0.00	0.00	26.65	59.36	86.76	99.85	94.61	73.26	39.58	9.32	0.00	489
Adjusting Factor K for U (Latitude 43° 44' N)	0.77	0.87	0.99	1.11	1.23	1.29	1.27	1.17	1.05	0.92	0.80	0.74	
Adjusted Potential Evapotranspiration PET (mm)	0	0	0	30	73	112	127	111	77	36	7	0	573
POST-DEVELOPMENT WATER BALANCE	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	YEAR
Pervious areas will receive rainfall plus some runoff from impervious areas, so the following balance calculations use this total water supply to assess potential infiltration.													
Precipitation (P)	68	56	60	74	87	84	89	97	93	77	93	69	946
Potential Evaporation (PE) from impervious areas (assume 20% of P)	14	11	12	15	17	17	18	19	19	15	19	14	189
P-PE (surplus available for runoff from impervious areas)	54	45	48	59	70	67	71	77	74	62	74	55	757
WAT (Total water supply to pervious areas = rain plus impervious area runoff)	122	101	107	133	156	151	161	174	168	139	167	123	1703
Potential Evapotranspiration from pervious areas (PET)	0	0	0	30	73	112	127	111	77	36	7	0	573
WAT - PET	122	101	107	104	83	39	34	63	91	103	160	123	1130
Change in Soil Moisture (mm)	0	0	0	0	0	0	0	0	0	0	0	0	0
Soil Moisture Storage (mm)*	125	125	125	125	125	125	125	125	125	125	125	125	
Actual Evapotranspiration (AET)	0	0	0	30	73	112	127	111	77	36	7	0	573
Total surplus - available for infiltration or runoff on pervious areas	122	101	107	104	83	39	34	63	91	103	160	123	1130
Estimate of I and R (based on MOE infiltration factor)*													
Potential Infiltration* (based on soil conditions; independent of temperature)	55.0	45.3	48.3	46.6	37.5	17.5	15.3	28.3	40.9	46.2	72.0	55.6	508
Potential Surface Water Runoff (independent of temperature)	67.2	55.3	59.0	57.0	45.9	21.4	18.7	34.6	50.0	56.4	87.9	67.9	621
Estimate of I and R (based on MOE Factors and CA Guideline assumption of a 10% reduction in infiltration reduction related to soil compaction)													
Potential Infiltration (based on soil conditions; independent of temperature)	49.5	40.8	43.4	42.0	33.8	15.7	13.8	25.5	36.8	41.6	64.8	50.0	458
Potential Surface Water Runoff (independent of temperature)	72.7	59.9	63.8	61.7	49.6	23.1	20.2	37.5	54.1	61.0	95.1	73.5	672

Max SMS 125
PE from impervious areas % 20

*MOE SWM infiltration factor calculation	
topography - flat to rolling	0.2
soils - tight sandy to clayey silt till	0.2
cover - predominantly impervious paved surface	0.05
Infiltration Factor	0.45

TABLE D.5 - Annual Post-Construction Water Balance without LID

	Unpaved Areas	Impervious Areas (Paved/Buildings)	Water (Pond)	Totals
Area	106590	183410	33000	323000
Pervious Area	106590	0	0	106590
Impervious Area	0	183410	33000	216410
Infiltration Factors				
Topography Infiltration Factor	0.2	0	0	
Soil Infiltration Factor	0.2	0	0	
Land Cover Infiltration Factor	0.05	0	0	
MOE Infiltration Factor	0.45	0	0	
Actual Infiltration Factor	0.55	0	0	
Runoff Coefficient Pervious Surfaces	0.45	1	1	
Runoff from Impervious Surfaces	0	0.8	0.8	
Inputs (per Unit Area)				
Precipitation (mm/yr)	946	946	946	946
Run-On (mm/yr)	0	0	0	0
Other Inputs (mm/yr)	0	0	0	0
Total Inputs (mm/yr)	946	946	946	946
Outputs (per Unit Area)				
Precipitation Surplus (mm/yr)	373	757	757	630
Net Surplus (mm/yr)	373	757	757	630
Evapotranspiration (mm/yr)	573	189	189	316
Infiltration (mm/yr)	205	0	0	68
Rooftop Infiltration (mm/yr)	0	0	0	0
Total Infiltration (mm/yr)	205	0	0	68
Runoff Pervious Areas	168	0	0	55
Runoff Impervious Areas	0	757	757	507
Total Runoff (mm/yr)	168	757	757	562
Total Outputs (mm/yr)	946	946	946	946
Difference (Inputs - Outputs)	0	0	0	
Inputs (Volumes)				
Precipitation (m3/yr)	100823	173488	31215	305526
Run-On (m3/yr)	0	0	0	0
Other Inputs (m3/yr)	0	0	0	0
Total Inputs (m3/yr)	100823	173488	31215	305526
Outputs (Volumes)				
Precipitation Surplus (m3/yr)	39769	138790	24972	203531
Net Surplus (m3/yr)	39769	138790	24972	203531
Evapotranspiration (m3/yr)	61055	34698	6243	101995
Infiltration (m3/yr)	21873	0	0	21873
Rooftop Infiltration (m3/yr)	0	0	0	0
Total Infiltration (m3/yr)	21873	0	0	21873
Runoff Pervious Area (m3/yr)	17896	0	0	17896
Runoff Impervious Areas (m3/yr)	0	138790	24972	163762
Total Runoff (m3/yr)	17896	138790	24972	181658
Total Outputs (m3/yr)	100823	173488	31215	305526
Difference (Inputs - Outputs)	0	0	0	0

* Evaporation from impervious areas was assumed to be 20% of precipitation



TABLE D.6 - Annual Post-Construction Water Balance with LID

	Unpaved Areas (Landscape)	Impervious Areas (Roads/walkways)	LID (Infiltration Trenches)	Water	Totals
Area	59510	83200	147290	33000	323000
Pervious Area	59510	0	0	0	59510
Impervious Area	0	83200	147290	33000	263490
Infiltration Factors					
Topography Infiltration Factor	0.2	0	0	0	
Soil Infiltration Factor	0.2	0	0	0	
Land Cover Infiltration Factor	0.05	0	0	0	
MOE Infiltration Factor	0.45	0	0	0	
Actual Infiltration Factor	0.55	0	0	0	
Runoff Coefficient Pervious Surfaces	0.45	1	1	1	
Runoff from Impervious Surfaces	0	0.8	0.8	0.8	
Inputs (per Unit Area)					
Precipitation (mm/yr)	946	946	946	946	946
Run-On (mm/yr)	0	0	0	0	0
Other Inputs (mm/yr)	0	0	0	0	0
Total Inputs (mm/yr)	946	946	946	946	946
Outputs (per Unit Area)					
Precipitation Surplus (mm/yr)	373	757	757	757	686
Net Surplus (mm/yr)	373	757	757	757	686
Evapotranspiration (mm/yr)	573	189	189	189	260
Infiltration (mm/yr)	205	0	0	0	38
LID (mm/yr)	0	0	443	0	202
Total Infiltration (mm/yr)	205	0	443	0	240
Runoff Pervious Areas	168	0	0	0	31
Runoff Impervious Areas	0	757	314	757	415
Total Runoff (mm/yr)	168	757	314	757	446
Total Outputs (mm/yr)	946	946	946	946	946
Difference (Inputs - Outputs)	0	0	0		
Inputs (Volumes)					
Precipitation (m3/yr)	56291	78699	139322	31215	305526
Run-On (m3/yr)	0	0	0	0	0
Other Inputs (m3/yr)	0	0	0	0	0
Total Inputs (m3/yr)	56291	78699	139322	31215	305526
Outputs (Volumes)					
Precipitation Surplus (m3/yr)	22203	62959	111457	24972	221591
Net Surplus (m3/yr)	22203	62959	111457	24972	221591
Evapotranspiration (m3/yr)	34087	15740	27864	6243	83934
Infiltration (m3/yr)	12212	0	0	0	12212
Rooftop Infiltration/Other LID (m3/yr)	0	0	65203	0	65203
Total Infiltration (m3/yr)	12212	0	65203	0	77414
Runoff Pervious Area (m3/yr)	9991	0	0	0	9991
Runoff Impervious Areas (m3/yr)	0	62959	46255	24972	134186
Total Runoff (m3/yr)	9991	62959	46254	24971	144176
Total Outputs (m3/yr)	56291	78699	139321	31214	305525
Difference (Inputs - Outputs)	0	0	0	0	1

* Evaporation from impervious areas was assumed to be 20% of precipitation

APPENDIX E

DRAWINGS PROVIDED BY THE CLIENT

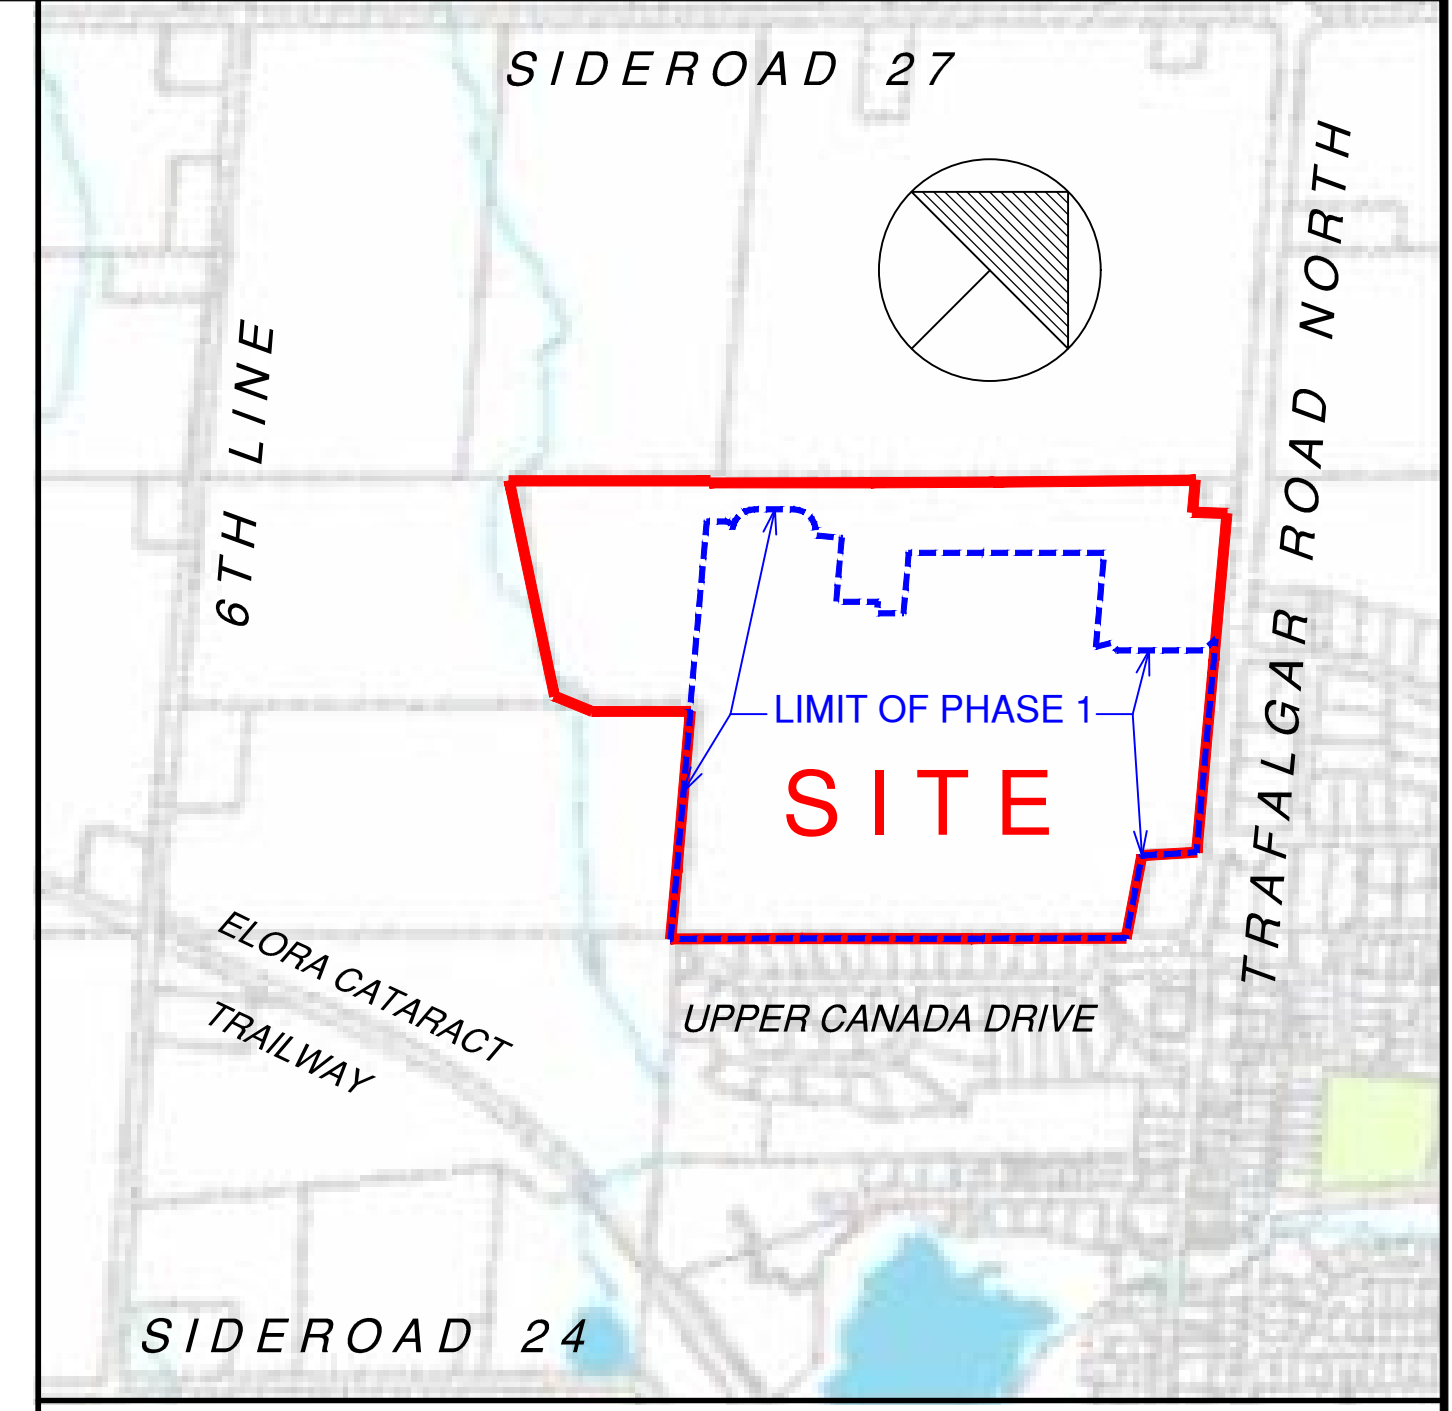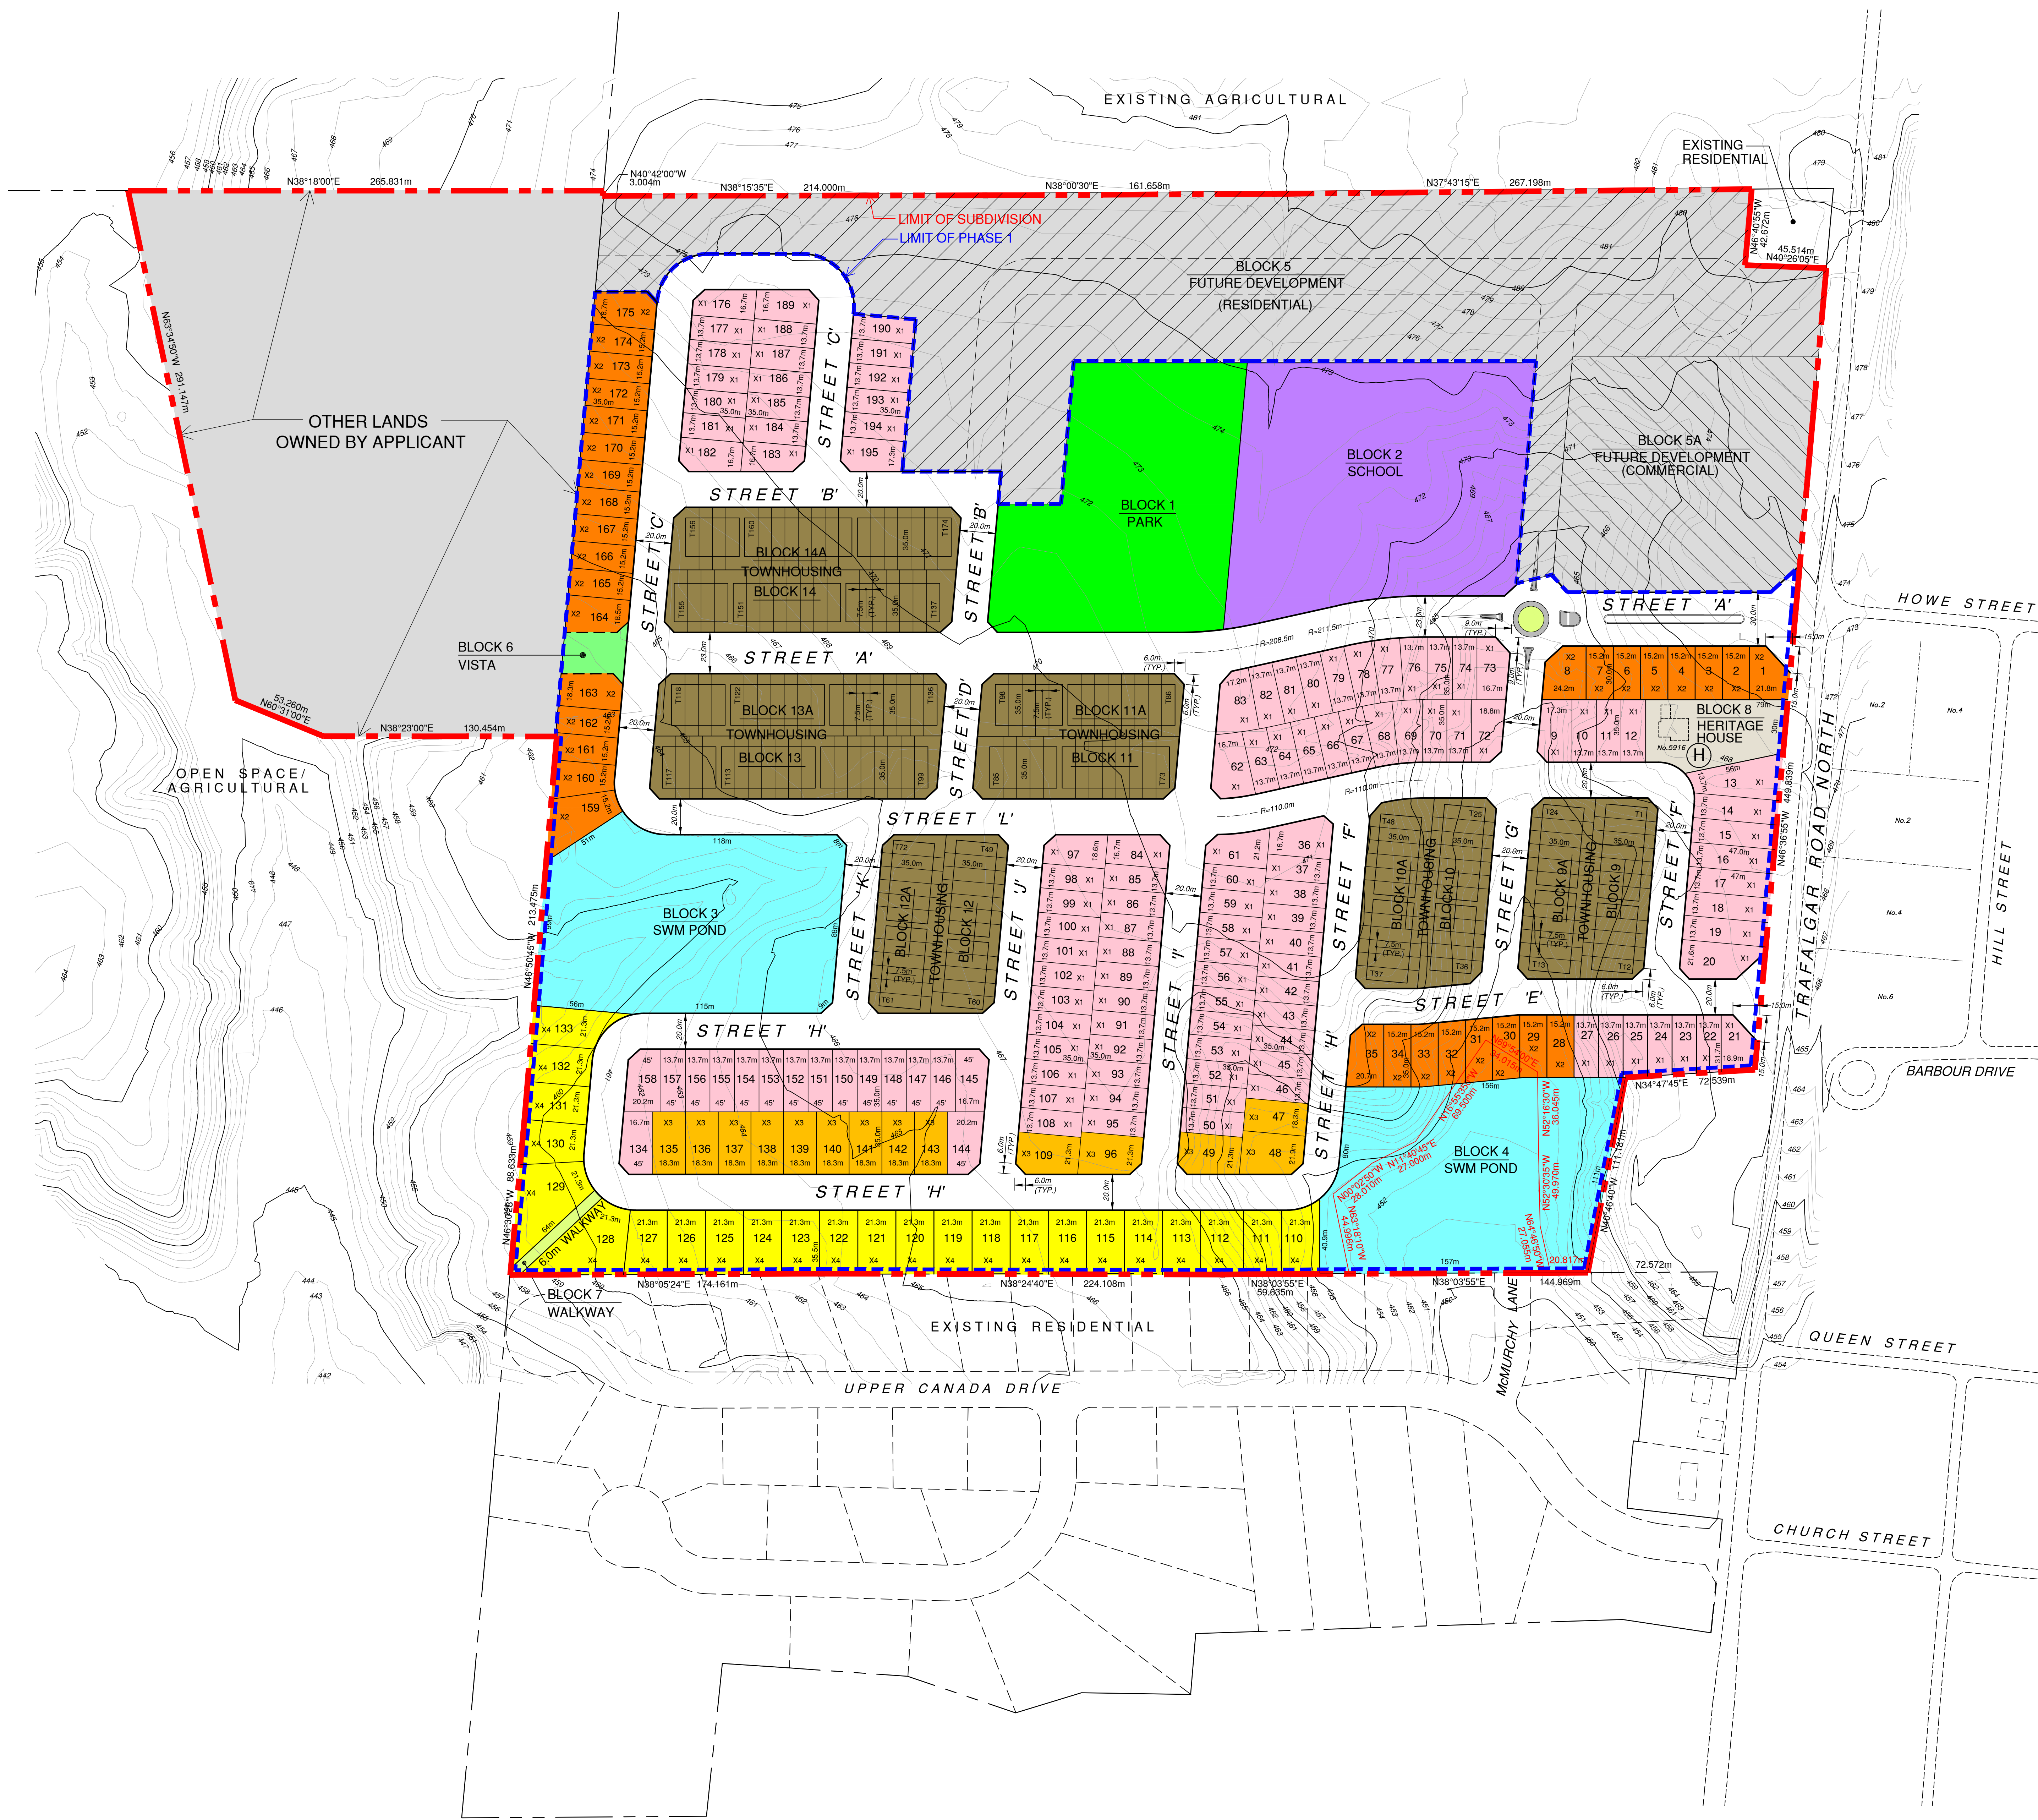

KEY PLAN
1:10,000

LOT SCHEDULE

DESCRIPTION	TYPE	MINIMUM FRONTAGE	MINIMUM DEPTH	NUMBER OF LOTS	NUMBER OF UNITS
SINGLE DETACHED	X1	13.7m (45.0')	35.0m (114.8')	124	124
SINGLE DETACHED	X2	15.2m (50.0')	35.0m (114.8')	33	33
SINGLE DETACHED	X3	18.3m (60.0')	35.0m (114.8')	14	14
SINGLE DETACHED	X4	21.3m (70.0')	35.0m (114.8')	24	24
TOWNHOUSE	T	7.5m (24.6')	35.0m (114.8')	-	174
TOTAL				195	369

LAND USE	BLOCK / LOT	AREA
RESIDENTIAL	LOTS 1-195	11.32 ha. (27.98 Ac.)
PARK	BLOCK 1	1.71 ha. (4.23 Ac.)
SCHOOL	BLOCK 2	2.19 ha. (5.41 Ac.)
SWM POND	BLOCKS 3-4	3.30 ha. (8.15 Ac.)
FUTURE DEVELOPMENT (RESIDENTIAL)	BLOCK 5	6.31 ha. (15.60 Ac.)
FUTURE DEVELOPMENT (COMMERCIAL)	BLOCK 5A	1.79 ha. (4.42 Ac.)
VISTA	BLOCK 6	0.08 ha. (0.19 Ac.)
ROADS	STREETS A-L	8.23 ha. (20.34 Ac.)
WALKWAY	BLOCK 7	0.01 ha. (0.02 Ac.)
HERITAGE HOUSE	BLOCK 8	0.29 ha. (0.72 Ac.)
TOWNHOUSING	BLOCKS 9-14A (170 UNITS)	5.17 ha. (12.77 Ac.)
TOTAL		40.40 ha. (99.83 Ac.)

NO.	DESCRIPTION	DATE	BY
1	REVISIONS AS PER TOWN AND COUNTY COMMENTS	12.07.2022	D.K.H.
2	LIMIT OF PHASE 1 ADDED WITH FUTURE DEVELOPMENT BLOCKS 5-5A; TOWNHOUSE BLOCKS 11-14A ADDED AND LOT WIDTHS REVISED; ST. A' R.O.W. INCREASED AND WALKWAY BLOCK 7 WIDTH INCREASED.	17.06.2022	D.K.H.
3	DIMENSIONS ADDED TO STREETS AND BLOCKS.	04.02.2022	D.K.H.
4	BEARINGS AND DISTANCES ADDED AS PER BSRD LAND SURVEYORS PLAN REF. No. 21-14-619-00, DATED JAN., 7th 2022	07.01.2022	D.K.H.

ADDITIONAL INFORMATION
 AS REQUIRED UNDER SECTION 51(17) OF THE PLANNING ACT (R.S.O. 1990 C.P. 13)
 A) AS SHOWN ON DRAFT PLAN. G) AS SHOWN ON DRAFT AND KEY PLANS.
 B) AS SHOWN ON DRAFT AND KEY PLAN. H) MUNICIPAL SERVICES TO BE PROVIDED.
 C) AS SHOWN ON KEY PLANS. I) SOIL IS CLAYEY SILT.
 D) AS SHOWN IN LAND USE SCHEDULE. J) AS SHOWN ON DRAFT PLAN.
 E) AS SHOWN ON DRAFT PLAN. K) MUNICIPAL SERVICES TO BE PROVIDED.
 F) AS SHOWN ON DRAFT PLAN. L) NONE.


OWNER'S AUTHORIZATION:
 THE UNDERSIGNED, BEING THE OWNER OF THE SUBJECT LANDS HEREBY AUTHORIZE CANDEVCON LIMITED TO ACT ON OUR BEHALF AS AGENTS AND TO PREPARE AND SUBMIT A DRAFT PLAN OF SUBDIVISION FOR APPROVAL.

DATE _____ HILLSBURGH HEIGHTS INC.
(BRIARWOOD DEVELOPMENTS GROUP)

SURVEYOR'S CERTIFICATE:
 I HEREBY CERTIFY THAT THE BOUNDARIES OF THE LAND TO BE SUBDIVIDED AND THEIR RELATIONSHIP TO THE ADJOINING PROPERTIES ARE CORRECTLY SHOWN ON THIS PLAN

DATE _____ RAYMOND J. SIBTHORP
 ONTARIO LAND SURVEYORS
 BLACK, SHOEMAKER, ROBINSON & DONALDSON LTD.
 457 WOODLAWN ROAD WEST, UNIT 101 GUELPH ONTARIO
 TEL: (519) 882-1220 www.rjssurveys.com

DRAFT PLAN OF SUBDIVISION
 5916 TRAFALGAR ROAD NORTH
 (PLAN 61R-9590)
 PART OF LOT 26, CONCESSION 7
 TOWN OF ERIN
 COUNTY OF WELLINGTON

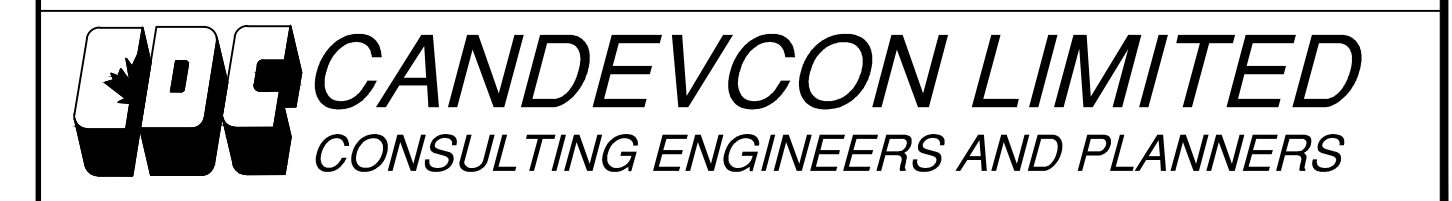

TEL: (905) 794-0600 FAX: (905) 794-0611
 SCALE: 1:1500 DWG. No. PL-1
 DATE: NOV., 12th 2021 PROJECT No. W21081

APPENDIX “E”

Storm Water Management Calculations

SWM Pond - (WEST) Pond Stage Storage Calculations

	LAND USE TYPES						Total Area (Ha)	Composite Runoff Coeff.	Composite Imperv. %
	Resid. Dev. Area	Multiple Family (Townhouses)	Road ROW	Park/ Open Space	External Drainage (Wood Lot-North)	SWM Pond			
Typical C Value	0.50	0.75	0.90	0.25	0.25	0.50			
Typical Impervious %	60%	80%	95%	10%	10%	75%			
Pond No- West	8.99	4.20	5.10	2.03	4.28	1.66	26.26	0.558	59%

MOE Water Quality Storage Requirement = **199.33** m³/ha (Includes 40m³/ha Extended Detention)

(Based on Table 3.2. Enhanced Level , 80% Long Term TSS Removal)

Permanent Pool Volume Required = 5,234 m³ (26.26 Ha x 199.33 m³/Ha)

Permanent Pool Volume Provided = 10,225 m³

STAGE VS STORAGE TABLE

Elevations (m)	Total Area (m ²)	Average Area (m ²)	Depth (m)	Delta Volume (m ³)	Total Volume (m ³)	
456.30	3280	4188	1.00	4188	4188	
457.30	5096	6037	1.00	6037	4188	
458.30	6978				10225	Permanent Pool Storage
458.30	6978	8804	1.00	8804	8804	
459.30	10630	11344	0.70	7941	8804	
460.00	12058				16745	

Pre-Development Model Parameters :

**Existing Drainage Area Breakdown ;
Area (Ha)**

External Drainage from North 4.28 (Refer to Pre-Development Plan - EX-DR-1)
Farm Land 25.86 (Refer to Pre-Development Plan - EX-DR-1, Area No. A-1, A-2 and A-3)
A-1 = 4.70 Ha (draining to Adjacent Lands)
A-2 = 16.73 Ha (draining to a low point the west)
A-3 = 4.43 Ha (draining to a low point the west)

	NHYD	DT (min)	Area (Ha)	CN	IA (mm)	N	TP (hr)
External Drainage from North	1	10	4.28	64	8	3	0.2
Farm Land	2	10	25.86	64	8	3	0.2

Total Pre-Development Drainage to CVC lands = 30.14 Ha

Pre-Development (Hydrograph Results) :

	NHYD	Flow Type	DT (Hr)	Area (Ha)	PKFW (m ³ /s)	TP (hr)	RV (mm)
Malton Rainfall Data-2yr 24hr 15min SCS	3	Outflow	0.167	30.15	0.881	12.333	12.45
Malton Rainfall Data-5yr 24hr 15min SCS	3	Outflow	0.167	30.15	1.477	12.333	20.52
Malton Rainfall Data-10yr 24hr 15min SCS	3	Outflow	0.167	30.15	1.963	12.333	27.056
Malton Rainfall Data-25yr 24hr 15min SCS	3	Outflow	0.167	30.15	2.600	12.333	35.592
Malton Rainfall Data-50yr 24hr 15min SCS	3	Outflow	0.167	30.15	3.169	12.333	43.192
Malton Rainfall Data-100yr 24hr 15min SCS	3	Outflow	0.167	30.15	3.645	12.333	49.547

Release Rate Targets for SWM Pond

Post-Development Results :

Total Drainage Area as per Drainage Area Plan = 26.26 Ha

Note: Under Post-Development Condition, the overall drainage to the west is less than compared to Pre-development areas as some portion of the West areas will drain to East Pond. Refer to Grading Plan and Storm Drainage Area Plan attached in the Report

SUMMARY OF VO MODELLING RESULTS FOR WEST POND

Storm Event	Control Structure Data			VO RESULTS			
	Pre-Dev Targets	Control Structure Release Rate	Storage Provided in Pond	Inflows/Peak Flows Generated	Outflows	Max Storage Used	Elevation in Pond
	(m ³ /s)	(m ³ /s)	(m ³)	(m ³ /s)	(m ³ /s)	(m ³)	(m)
2-Year	0.881	0.187	6,751	2.910	0.183	6,612	459.10
5-Year	1.477	0.506	8,381	4.000	0.489	8,312	459.26
10-Year	1.963	0.782	9,953	4.784	0.709	9,547	459.37
25-Year	2.600	1.158	10,970	5.839	1.141	10,948	459.50
50-Year	3.169	1.547	12,310	7.126	1.485	12,162	459.62
100-Year	3.645	2.151	13,219	7.856	1.992	12,983	459.70

CVC's 25mm Erosion Control Requirement :

Contributing Drainage Area (ha) = 26.26 Ha

25mm 4Hr Chicago Post Development Runoff Volume in Depth = 15.22 mm (Refer to 25mm VO Results appended)
(R. V x Drainage Area)

25mm 4Hr Chicago Post Development Storage Volume = 3997 m³ (Required)

25mm 4Hr Chicago Post Development Storage Volume = 4390 m³ (Provided)

25mm 4-hour Chicago storm to be stored and released over a min. of 48-hour period ;

Erosion Target Rate = 83.266 m³/hr 23.129 L/s

Drawdown Time for Water Quality Level - WEST POND :

Based on Equation 4.11 MOE SWM Planning and Design Manual

$$t = \frac{0.66 C_2 h^{1.5} + 2 C_3 h^{0.5}}{2.75 A_o}$$

t = Drawdown time in seconds

A_p = Surface area of the pond (m^2)

C = Discharge Coefficient (typically 0.63)

A_o = Cross-sectional area of the orifice (m^2)

g = Gravitational acceleration constant (9.81 m/s)


h_1 = Starting water elevation above the orifice (m)

h_2 = Ending water elevation above the orifice (m)

C_2 = Slope coefficient from the area-depth linear regression

C_3 = Intercept from the area-depth linear regression

Elevation(m)	Head (m)	AREA (m^2)
458.30	0.00	6978
458.40	0.10	7343
458.50	0.20	7708
458.60	0.30	8073
458.70	0.40	8439
458.80	0.50	8804
458.85	0.55	9169
458.90	0.60	9534

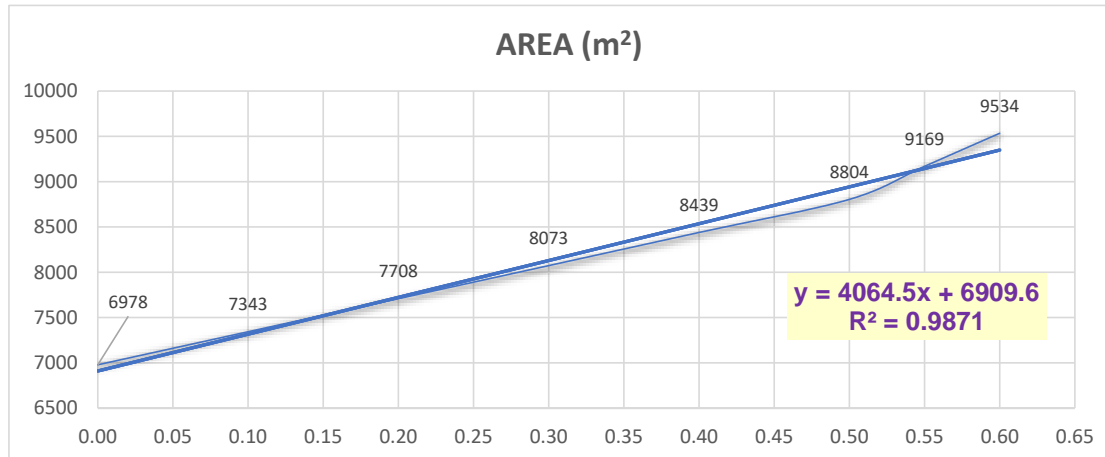

Intercept of Regression , C_3 =	6909.6
Slope coef. of Regression, C_2 =	4064.5
Ultimate Ponding Elevation =	458.85 m (25m Water Quality Level)
Depth over orifice =	0.55 m (25mm Level - Permanent Pool Elevation)
	(458.85 - 458.30)

Orifice Diameter =	120 mm
Orifice Area =	0.01131 m^2
Drawdown Time (t)=	364699 seconds
	101 hours

Emergency Spillway Design - West Pond

Notes : * As per MOE SWM Manual definition, the Emergency Spillway is designed to convey storm drainage flows out of the facility in the event that the other outlets (in control structure) are not functioning properly.

The Emergency spillway is proposed at 100-year Elevation = **459.70 m**

100-Year Storm Peak Flows (Q_{inflow})* = **7.856** m^3/s (Refer to 100-Yr VO Model Results)
 Regional Storm Peak Flows (Q_{inflow})* = **3.590** m^3/s (Refer to Regional VO Model Results)

*Peak Flows generated by 100-year is more than that of Regional (Hurricane Hazel) Storm ; the Spillway is designed for 100-Year Peak Flows

Emergency Spillway Weir Parameters


Top Width of Weir = 32 m
 Downstream Width of Weir = 27 m
 Median Width (B) = 29.5 m
 Weir Sill Elevation = 459.70 m
 Weir Top Elevation = 460.00 m
 Depth of Weir = 0.30 m
 Weir Side Slopes = 10 : 1

Weir Equation;

$$Q_w = (CL)(H^{3/2})$$

Stage :	0.05		
	Depth	Cd	Q
459.70	0	1.67	0.000
459.75	0.05	1.67	0.551
459.80	0.10	1.67	1.558
459.85	0.15	1.67	2.862
459.90	0.20	1.67	4.406
459.95	0.25	1.67	6.158
460.00	0.30	1.67	8.095

Therefore, Maximum capacity of Spillway is = **8.095** m^3/s > **7.856** m^3/s
 (100-Year Storm Peak Flows)

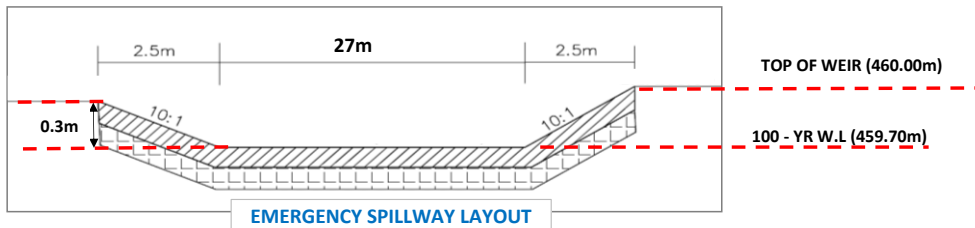

FOREBAY DESIGN CALCULATIONS - POND WEST

Settling Calculations

Forebay Settling Length (MOE Equation 4.5)

$$\text{Dist} = \sqrt{\frac{rQ_p}{V_s}}$$

For Forebay - A - South

Length-to-width ratio of forebay (r) = 2 : 1 (INLET-1)

Peak Quality flow rate (Q_p) from pond based on release rate and volume of extended detention.

Peak flow rate from the pond during design quality storm (Q_p) = 43.465 m³/Hr 0.012074 m³/s

$$= \frac{\text{25mm-Storage Volume (m}^3\text{)}}{\text{Drawdown Time (hrs)}}$$

Settling Velocity (V_s) = 0.0003 m/s (Recommended from MOEE Manual)

Forebay Settling Length Required = 9.0 m

Total Forebay Length Provided = 45.0 m

Dispersion Length Calculations

Length of Dispersion (MOE Equation 4.6)

$$\text{Dist} = \frac{8Q}{dV_f}$$

Inlet flow rate (Q) = 2.907 m³/s (Refer to Storm Design Sheet)

Depth of permanent pool in the forebay (d) = 2.0 m

Desired velocity in the forebay (V_f) = 0.5 m/s (Recommended from MOEE Manual)

Length of Dispersion = 23.3 m

Total Forebay Length Provided = 45.0 m

Minimum Forebay Deep Zone Bottom Width

Minimum Forebay Deep Zone Bottom Width (MOE Equation 4.7)

$$\text{Width} = \frac{\text{Dist}}{8}$$


Distance (D_R) = 23.3 m (Required Dispersion Length)

Width (W_R) = 2.91 m (Required Forebay Bottom Width)

Forebay Bottom Width (W_P) = 23.00 m (Provided Forebay Bottom Width)

PRE-DEVELOPMENT CONDITION

VO SCHEMATIC

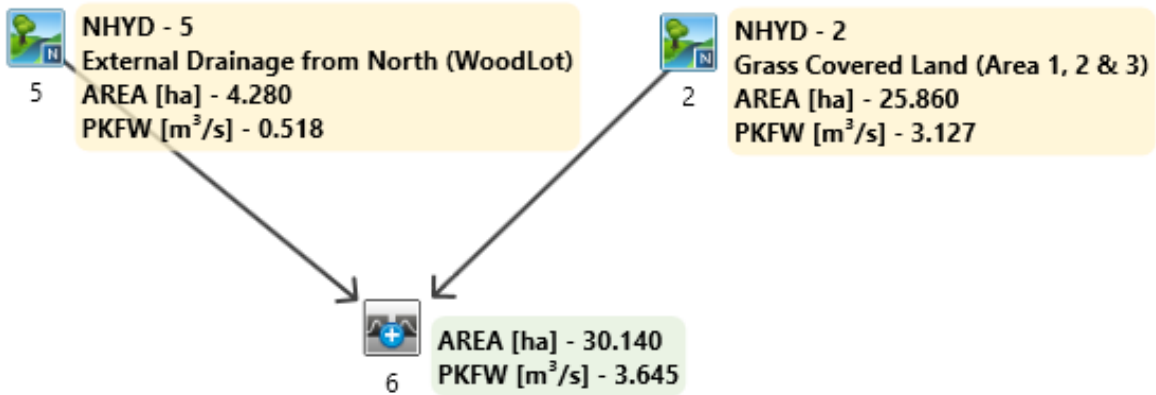

	NHYD	Flow Type	DT (Hr)	Area (Ha)	PKFW (m ³ /s)	TP (hr)	RV (mm)
Malton Rainfall Data-2yr 24hr 15min SCS	3	Outflow	0.167	30.15	0.881	12.333	12.45
Malton Rainfall Data-5yr 24hr 15min SCS	3	Outflow	0.167	30.15	1.477	12.333	20.52
Malton Rainfall Data-10yr 24hr 15min SCS	3	Outflow	0.167	30.15	1.963	12.333	27.056
Malton Rainfall Data-25yr 24hr 15min SCS	3	Outflow	0.167	30.15	2.600	12.333	35.592
Malton Rainfall Data-50yr 24hr 15min SCS	3	Outflow	0.167	30.15	3.169	12.333	43.192
Malton Rainfall Data-100yr 24hr 15min SCS	3	Outflow	0.167	30.15	3.645	12.333	49.547

MALTON IDF CURVES FOR SCS TYPE II, 24 Hr Storm

(CVC Criteria)

PRE-DEVELOPMENT MODEL

 ** SIMULATION : Malton Rainfall Data-2yr 24hr **

 | READ STORM | Filename: C:\Users\shuchi\AppData
 | | ata\Local\Temp\
 | | 040552e1-671d-4190-8868-
 607e6b50438b\1b6033eb
 | Ptotal= 57.60 mm | Comments: Malton Rainfall Data-2yr 24hr 15min SCS

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.00	0.00	0.00	6.25	1.04	12.50	8.29	18.75
1.04	0.25	0.63	6.50	1.04	12.75	4.26	19.00
1.04	0.50	0.63	6.75	1.04	13.00	4.26	19.25
1.04	0.75	0.63	7.00	1.04	13.25	3.11	19.50
1.04	1.00	0.63	7.25	1.27	13.50	3.11	19.75
1.04	1.25	0.63	7.50	1.27	13.75	2.42	20.00
1.04	1.50	0.63	7.75	1.27	14.00	2.42	20.25
0.69	1.75	0.63	8.00	1.27	14.25	1.73	20.50
0.69	2.00	0.63	8.25	1.50	14.50	1.73	20.75
0.69	2.25	0.75	8.50	1.50	14.75	1.73	21.00
0.69	2.50	0.75	8.75	1.61	15.00	1.73	21.25
0.69	2.75	0.75	9.00	1.61	15.25	1.73	21.50
0.69	3.00	0.75	9.25	1.84	15.50	1.73	21.75
0.69	3.25	0.75	9.50	1.84	15.75	1.73	22.00
0.69	3.50	0.75	9.75	2.07	16.00	1.73	22.25
0.69	3.75	0.75	10.00	2.07	16.25	1.04	22.50
0.69	4.00	0.75	10.25	2.65	16.50	1.04	22.75

0.69	4.25	0.92		10.50	2.65		16.75	1.04		23.00
0.69	4.50	0.92		10.75	3.57		17.00	1.04		23.25
0.69	4.75	0.92		11.00	3.57		17.25	1.04		23.50
0.69	5.00	0.92		11.25	5.53		17.50	1.04		23.75
0.69	5.25	0.92		11.50	5.53		17.75	1.04		24.00
	5.50	0.92		11.75	17.05		18.00	1.04		
	5.75	0.92		12.00	70.50		18.25	1.04		
	6.00	0.92		12.25	8.29		18.50	1.04		


```

-----
| CALIB          |
| NASHYD ( 0002) | Area      (ha)= 25.86   Curve Number  (CN)= 64.0
| ID= 1 DT=10.0 min | Ia       (mm)=  8.00   # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)=  0.20

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN		TIME	RAIN		TIME	RAIN		TIME
mm/hr	hrs	mm/hr		hrs	mm/hr		hrs	mm/hr		hrs
1.04	0.167	0.00		6.333	0.98		12.500	8.29		18.67
1.04	0.333	0.32		6.500	1.04		12.667	8.29		18.83
1.04	0.500	0.63		6.667	1.04		12.833	6.28		19.00
1.04	0.667	0.63		6.833	1.04		13.000	4.26		19.17
1.04	0.833	0.63		7.000	1.04		13.167	4.26		19.33
1.04	1.000	0.63		7.167	1.04		13.333	3.69		19.50
1.04	1.167	0.63		7.333	1.15		13.500	3.11		19.67
1.04	1.333	0.63		7.500	1.27		13.667	3.11		19.83
1.04	1.500	0.63		7.667	1.27		13.833	2.76		20.00
1.04	1.667	0.63		7.833	1.27		14.000	2.42		20.17
0.86	1.833	0.63		8.000	1.27		14.167	2.42		20.33

0.69	2.000	0.63	8.167	1.27	14.333	2.07	20.50
0.69	2.167	0.63	8.333	1.38	14.500	1.73	20.67
0.69	2.333	0.69	8.500	1.50	14.667	1.73	20.83
0.69	2.500	0.75	8.667	1.50	14.833	1.73	21.00
0.69	2.667	0.75	8.833	1.56	15.000	1.73	21.17
0.69	2.833	0.75	9.000	1.61	15.167	1.73	21.33
0.69	3.000	0.75	9.167	1.61	15.333	1.73	21.50
0.69	3.167	0.75	9.333	1.73	15.500	1.73	21.67
0.69	3.333	0.75	9.500	1.84	15.667	1.73	21.83
0.69	3.500	0.75	9.667	1.84	15.833	1.73	22.00
0.69	3.667	0.75	9.833	1.96	16.000	1.73	22.17
0.69	3.833	0.75	10.000	2.07	16.167	1.73	22.33
0.69	4.000	0.75	10.167	2.07	16.333	1.38	22.50
0.69	4.167	0.75	10.333	2.36	16.500	1.04	22.67
0.69	4.333	0.84	10.500	2.65	16.667	1.04	22.83
0.69	4.500	0.92	10.667	2.65	16.833	1.04	23.00
0.69	4.667	0.92	10.833	3.11	17.000	1.04	23.17
0.69	4.833	0.92	11.000	3.57	17.167	1.04	23.33
0.69	5.000	0.92	11.167	3.57	17.333	1.04	23.50
0.69	5.167	0.92	11.333	4.55	17.500	1.04	23.67
0.69	5.333	0.92	11.500	5.53	17.667	1.04	23.83
0.69	5.500	0.92	11.667	5.53	17.833	1.04	24.00
0.69	5.667	0.92	11.833	11.29	18.000	1.04	24.17
0.69	5.833	0.92	12.000	17.05	18.167	1.04	24.33
0.35	6.000	0.92	12.167	70.50	18.333	1.04	
	6.167	0.92	12.333	39.40	18.500	1.04	

Unit Hyd Qpeak (cms)= 4.939

PEAK FLOW (cms)= 0.756 (i)

TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 12.450
 TOTAL RAINFALL (mm)= 57.600
 RUNOFF COEFFICIENT = 0.216

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| NASHYD ( 0005) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
| U.H. Tp(hrs)= 0.20
  
```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
      hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
RAIN
mm/hr
0.167      0.00 | 6.333      0.98 |12.500      8.29 | 18.67
1.04
0.333      0.32 | 6.500      1.04 |12.667      8.29 | 18.83
1.04
0.500      0.63 | 6.667      1.04 |12.833      6.28 | 19.00
1.04
0.667      0.63 | 6.833      1.04 |13.000      4.26 | 19.17
1.04
0.833      0.63 | 7.000      1.04 |13.167      4.26 | 19.33
1.04
1.000      0.63 | 7.167      1.04 |13.333      3.69 | 19.50
1.04
1.167      0.63 | 7.333      1.15 |13.500      3.11 | 19.67
1.04
1.333      0.63 | 7.500      1.27 |13.667      3.11 | 19.83
1.04
1.500      0.63 | 7.667      1.27 |13.833      2.76 | 20.00
1.04
1.667      0.63 | 7.833      1.27 |14.000      2.42 | 20.17
1.04
1.833      0.63 | 8.000      1.27 |14.167      2.42 | 20.33
0.86
2.000      0.63 | 8.167      1.27 |14.333      2.07 | 20.50
0.69
2.167      0.63 | 8.333      1.38 |14.500      1.73 | 20.67
0.69
2.333      0.69 | 8.500      1.50 |14.667      1.73 | 20.83
0.69
2.500      0.75 | 8.667      1.50 |14.833      1.73 | 21.00
0.69
  
```

0.69	2.667	0.75	8.833	1.56	15.000	1.73	21.17
0.69	2.833	0.75	9.000	1.61	15.167	1.73	21.33
0.69	3.000	0.75	9.167	1.61	15.333	1.73	21.50
0.69	3.167	0.75	9.333	1.73	15.500	1.73	21.67
0.69	3.333	0.75	9.500	1.84	15.667	1.73	21.83
0.69	3.500	0.75	9.667	1.84	15.833	1.73	22.00
0.69	3.667	0.75	9.833	1.96	16.000	1.73	22.17
0.69	3.833	0.75	10.000	2.07	16.167	1.73	22.33
0.69	4.000	0.75	10.167	2.07	16.333	1.38	22.50
0.69	4.167	0.75	10.333	2.36	16.500	1.04	22.67
0.69	4.333	0.84	10.500	2.65	16.667	1.04	22.83
0.69	4.500	0.92	10.667	2.65	16.833	1.04	23.00
0.69	4.667	0.92	10.833	3.11	17.000	1.04	23.17
0.69	4.833	0.92	11.000	3.57	17.167	1.04	23.33
0.69	5.000	0.92	11.167	3.57	17.333	1.04	23.50
0.69	5.167	0.92	11.333	4.55	17.500	1.04	23.67
0.69	5.333	0.92	11.500	5.53	17.667	1.04	23.83
0.69	5.500	0.92	11.667	5.53	17.833	1.04	24.00
0.69	5.667	0.92	11.833	11.29	18.000	1.04	24.17
0.69	5.833	0.92	12.000	17.05	18.167	1.04	24.33
0.35	6.000	0.92	12.167	70.50	18.333	1.04	
	6.167	0.92	12.333	39.40	18.500	1.04	

Unit Hyd Qpeak (cms)= 0.817

PEAK FLOW (cms)= 0.125 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 12.450
 TOTAL RAINFALL (mm)= 57.600
 RUNOFF COEFFICIENT = 0.216

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
      ID1= 1 ( 0002):  25.86   0.756   12.33   12.45
+ ID2= 2 ( 0005):   4.28   0.125   12.33   12.45
=====
      ID = 3 ( 0006):  30.14   0.881   12.33   12.45

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

PRE-DEVELOPMENT MODEL

 ** SIMULATION : Malton Rainfall Data-5yr 24hr **

 | READ STORM | Filename: C:\Users\shuchi\AppData
 | | ata\Local\Temp\
 | | 040552e1-671d-4190-8868-
 607e6b50438b\aa5dc3dc
 | Ptotal= 74.40 mm | Comments: Malton Rainfall Data-5yr 24hr 15min SCS

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.34	0.00	0.00	6.25	1.34	12.50	10.71	18.75
1.34	0.25	0.82	6.50	1.34	12.75	5.51	19.00
1.34	0.50	0.82	6.75	1.34	13.00	5.51	19.25
1.34	0.75	0.82	7.00	1.34	13.25	4.02	19.50
1.34	1.00	0.82	7.25	1.64	13.50	4.02	19.75
1.34	1.25	0.82	7.50	1.64	13.75	3.12	20.00
0.89	1.50	0.82	7.75	1.64	14.00	3.12	20.25
0.89	1.75	0.82	8.00	1.64	14.25	2.23	20.50
0.89	2.00	0.82	8.25	1.93	14.50	2.23	20.75
0.89	2.25	0.97	8.50	1.93	14.75	2.23	21.00
0.89	2.50	0.97	8.75	2.08	15.00	2.23	21.25
0.89	2.75	0.97	9.00	2.08	15.25	2.23	21.50
0.89	3.00	0.97	9.25	2.38	15.50	2.23	21.75
0.89	3.25	0.97	9.50	2.38	15.75	2.23	22.00
0.89	3.50	0.97	9.75	2.68	16.00	2.23	22.25
0.89	3.75	0.97	10.00	2.68	16.25	1.34	22.50
0.89	4.00	0.97	10.25	3.42	16.50	1.34	22.75

0.89	2.000	0.82	8.167	1.64	14.333	2.68	20.50
0.89	2.167	0.82	8.333	1.79	14.500	2.23	20.67
0.89	2.333	0.89	8.500	1.93	14.667	2.23	20.83
0.89	2.500	0.97	8.667	1.93	14.833	2.23	21.00
0.89	2.667	0.97	8.833	2.01	15.000	2.23	21.17
0.89	2.833	0.97	9.000	2.08	15.167	2.23	21.33
0.89	3.000	0.97	9.167	2.08	15.333	2.23	21.50
0.89	3.167	0.97	9.333	2.23	15.500	2.23	21.67
0.89	3.333	0.97	9.500	2.38	15.667	2.23	21.83
0.89	3.500	0.97	9.667	2.38	15.833	2.23	22.00
0.89	3.667	0.97	9.833	2.53	16.000	2.23	22.17
0.89	3.833	0.97	10.000	2.68	16.167	2.23	22.33
0.89	4.000	0.97	10.167	2.68	16.333	1.79	22.50
0.89	4.167	0.97	10.333	3.05	16.500	1.34	22.67
0.89	4.333	1.08	10.500	3.42	16.667	1.34	22.83
0.89	4.500	1.19	10.667	3.42	16.833	1.34	23.00
0.89	4.667	1.19	10.833	4.02	17.000	1.34	23.17
0.89	4.833	1.19	11.000	4.61	17.167	1.34	23.33
0.89	5.000	1.19	11.167	4.61	17.333	1.34	23.50
0.89	5.167	1.19	11.333	5.88	17.500	1.34	23.67
0.89	5.333	1.19	11.500	7.14	17.667	1.34	23.83
0.89	5.500	1.19	11.667	7.14	17.833	1.34	24.00
0.89	5.667	1.19	11.833	14.58	18.000	1.34	24.17
0.89	5.833	1.19	12.000	22.02	18.167	1.34	24.33
0.45	6.000	1.19	12.167	91.07	18.333	1.34	
	6.167	1.19	12.333	50.89	18.500	1.34	

Unit Hyd Qpeak (cms)= 4.939

PEAK FLOW (cms)= 1.268 (i)

TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 20.520
 TOTAL RAINFALL (mm)= 74.400
 RUNOFF COEFFICIENT = 0.276

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| NASHYD ( 0005) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
| U.H. Tp(hrs)= 0.20
  
```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
      hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
mm/hr
0.167      0.00 | 6.333      1.26 |12.500     10.71 | 18.67
1.34
0.333      0.41 | 6.500      1.34 |12.667     10.71 | 18.83
1.34
0.500      0.82 | 6.667      1.34 |12.833      8.11 | 19.00
1.34
0.667      0.82 | 6.833      1.34 |13.000      5.51 | 19.17
1.34
0.833      0.82 | 7.000      1.34 |13.167      5.51 | 19.33
1.34
1.000      0.82 | 7.167      1.34 |13.333      4.76 | 19.50
1.34
1.167      0.82 | 7.333      1.49 |13.500      4.02 | 19.67
1.34
1.333      0.82 | 7.500      1.64 |13.667      4.02 | 19.83
1.34
1.500      0.82 | 7.667      1.64 |13.833      3.57 | 20.00
1.34
1.667      0.82 | 7.833      1.64 |14.000      3.12 | 20.17
1.34
1.833      0.82 | 8.000      1.64 |14.167      3.12 | 20.33
1.12
2.000      0.82 | 8.167      1.64 |14.333      2.68 | 20.50
0.89
2.167      0.82 | 8.333      1.79 |14.500      2.23 | 20.67
0.89
2.333      0.89 | 8.500      1.93 |14.667      2.23 | 20.83
0.89
2.500      0.97 | 8.667      1.93 |14.833      2.23 | 21.00
0.89
  
```

0.89	2.667	0.97 8.833	2.01 15.000	2.23 21.17
0.89	2.833	0.97 9.000	2.08 15.167	2.23 21.33
0.89	3.000	0.97 9.167	2.08 15.333	2.23 21.50
0.89	3.167	0.97 9.333	2.23 15.500	2.23 21.67
0.89	3.333	0.97 9.500	2.38 15.667	2.23 21.83
0.89	3.500	0.97 9.667	2.38 15.833	2.23 22.00
0.89	3.667	0.97 9.833	2.53 16.000	2.23 22.17
0.89	3.833	0.97 10.000	2.68 16.167	2.23 22.33
0.89	4.000	0.97 10.167	2.68 16.333	1.79 22.50
0.89	4.167	0.97 10.333	3.05 16.500	1.34 22.67
0.89	4.333	1.08 10.500	3.42 16.667	1.34 22.83
0.89	4.500	1.19 10.667	3.42 16.833	1.34 23.00
0.89	4.667	1.19 10.833	4.02 17.000	1.34 23.17
0.89	4.833	1.19 11.000	4.61 17.167	1.34 23.33
0.89	5.000	1.19 11.167	4.61 17.333	1.34 23.50
0.89	5.167	1.19 11.333	5.88 17.500	1.34 23.67
0.89	5.333	1.19 11.500	7.14 17.667	1.34 23.83
0.89	5.500	1.19 11.667	7.14 17.833	1.34 24.00
0.89	5.667	1.19 11.833	14.58 18.000	1.34 24.17
0.89	5.833	1.19 12.000	22.02 18.167	1.34 24.33
0.45	6.000	1.19 12.167	91.07 18.333	1.34
	6.167	1.19 12.333	50.89 18.500	1.34

Unit Hyd Qpeak (cms)= 0.817

PEAK FLOW (cms)= 0.210 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 20.520
 TOTAL RAINFALL (mm)= 74.400
 RUNOFF COEFFICIENT = 0.276

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0002):  25.86    1.268    12.33    20.52
+ ID2= 2 ( 0005):   4.28    0.210    12.33    20.52
=====
ID = 3 ( 0006):  30.14    1.477    12.33    20.52

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

PRE-DEVELOPMENT MODEL

 ** SIMULATION : Malton Rainfall Data-10yr 24h **

 | READ STORM | Filename: C:\Users\shuchi\AppData
 | | ata\Local\Temp\
 | | 040552e1-671d-4190-8868-
 607e6b50438b\ee354f0b
 | Ptotal= 86.40 mm | Comments: Malton Rainfall Data-10yr 24hr 15min SCS

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.56	0.00	0.00	6.25	1.56	12.50	12.44	18.75
1.56	0.25	0.95	6.50	1.56	12.75	6.39	19.00
1.56	0.50	0.95	6.75	1.56	13.00	6.39	19.25
1.56	0.75	0.95	7.00	1.56	13.25	4.67	19.50
1.56	1.00	0.95	7.25	1.90	13.50	4.67	19.75
1.56	1.25	0.95	7.50	1.90	13.75	3.63	20.00
1.04	1.50	0.95	7.75	1.90	14.00	3.63	20.25
1.04	1.75	0.95	8.00	1.90	14.25	2.59	20.50
1.04	2.00	0.95	8.25	2.25	14.50	2.59	20.75
1.04	2.25	1.12	8.50	2.25	14.75	2.59	21.00
1.04	2.50	1.12	8.75	2.42	15.00	2.59	21.25
1.04	2.75	1.12	9.00	2.42	15.25	2.59	21.50
1.04	3.00	1.12	9.25	2.76	15.50	2.59	21.75
1.04	3.25	1.12	9.50	2.76	15.75	2.59	22.00
1.04	3.50	1.12	9.75	3.11	16.00	2.59	22.25
1.04	3.75	1.12	10.00	3.11	16.25	1.56	22.50
1.04	4.00	1.12	10.25	3.97	16.50	1.56	22.75

1.04	2.000	0.95	8.167	1.90	14.333	3.11	20.50
1.04	2.167	0.95	8.333	2.07	14.500	2.59	20.67
1.04	2.333	1.04	8.500	2.25	14.667	2.59	20.83
1.04	2.500	1.12	8.667	2.25	14.833	2.59	21.00
1.04	2.667	1.12	8.833	2.33	15.000	2.59	21.17
1.04	2.833	1.12	9.000	2.42	15.167	2.59	21.33
1.04	3.000	1.12	9.167	2.42	15.333	2.59	21.50
1.04	3.167	1.12	9.333	2.59	15.500	2.59	21.67
1.04	3.333	1.12	9.500	2.76	15.667	2.59	21.83
1.04	3.500	1.12	9.667	2.76	15.833	2.59	22.00
1.04	3.667	1.12	9.833	2.94	16.000	2.59	22.17
1.04	3.833	1.12	10.000	3.11	16.167	2.59	22.33
1.04	4.000	1.12	10.167	3.11	16.333	2.07	22.50
1.04	4.167	1.12	10.333	3.54	16.500	1.56	22.67
1.04	4.333	1.25	10.500	3.97	16.667	1.56	22.83
1.04	4.500	1.38	10.667	3.97	16.833	1.56	23.00
1.04	4.667	1.38	10.833	4.67	17.000	1.56	23.17
1.04	4.833	1.38	11.000	5.36	17.167	1.56	23.33
1.04	5.000	1.38	11.167	5.36	17.333	1.56	23.50
1.04	5.167	1.38	11.333	6.83	17.500	1.56	23.67
1.04	5.333	1.38	11.500	8.29	17.667	1.56	23.83
1.04	5.500	1.38	11.667	8.29	17.833	1.56	24.00
1.04	5.667	1.38	11.833	16.93	18.000	1.56	24.17
1.04	5.833	1.38	12.000	25.58	18.167	1.56	24.33
0.52	6.000	1.38	12.167	105.75	18.333	1.56	
	6.167	1.38	12.333	59.10	18.500	1.56	

Unit Hyd Qpeak (cms)= 4.939

PEAK FLOW (cms)= 1.685 (i)

TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 27.056
 TOTAL RAINFALL (mm)= 86.400
 RUNOFF COEFFICIENT = 0.313

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| NASHYD ( 0005) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
| U.H. Tp(hrs)= 0.20
  
```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
      hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
mm/hr
0.167      0.00 | 6.333      1.47 |12.500     12.44 | 18.67
1.56
0.333      0.48 | 6.500      1.56 |12.667     12.44 | 18.83
1.56
0.500      0.95 | 6.667      1.56 |12.833      9.42 | 19.00
1.56
0.667      0.95 | 6.833      1.56 |13.000      6.39 | 19.17
1.56
0.833      0.95 | 7.000      1.56 |13.167      6.39 | 19.33
1.56
1.000      0.95 | 7.167      1.56 |13.333      5.53 | 19.50
1.56
1.167      0.95 | 7.333      1.73 |13.500      4.67 | 19.67
1.56
1.333      0.95 | 7.500      1.90 |13.667      4.67 | 19.83
1.56
1.500      0.95 | 7.667      1.90 |13.833      4.15 | 20.00
1.56
1.667      0.95 | 7.833      1.90 |14.000      3.63 | 20.17
1.56
1.833      0.95 | 8.000      1.90 |14.167      3.63 | 20.33
1.30
2.000      0.95 | 8.167      1.90 |14.333      3.11 | 20.50
1.04
2.167      0.95 | 8.333      2.07 |14.500      2.59 | 20.67
1.04
2.333      1.04 | 8.500      2.25 |14.667      2.59 | 20.83
1.04
2.500      1.12 | 8.667      2.25 |14.833      2.59 | 21.00
1.04
  
```

1.04	2.667	1.12	8.833	2.33	15.000	2.59	21.17
1.04	2.833	1.12	9.000	2.42	15.167	2.59	21.33
1.04	3.000	1.12	9.167	2.42	15.333	2.59	21.50
1.04	3.167	1.12	9.333	2.59	15.500	2.59	21.67
1.04	3.333	1.12	9.500	2.76	15.667	2.59	21.83
1.04	3.500	1.12	9.667	2.76	15.833	2.59	22.00
1.04	3.667	1.12	9.833	2.94	16.000	2.59	22.17
1.04	3.833	1.12	10.000	3.11	16.167	2.59	22.33
1.04	4.000	1.12	10.167	3.11	16.333	2.07	22.50
1.04	4.167	1.12	10.333	3.54	16.500	1.56	22.67
1.04	4.333	1.25	10.500	3.97	16.667	1.56	22.83
1.04	4.500	1.38	10.667	3.97	16.833	1.56	23.00
1.04	4.667	1.38	10.833	4.67	17.000	1.56	23.17
1.04	4.833	1.38	11.000	5.36	17.167	1.56	23.33
1.04	5.000	1.38	11.167	5.36	17.333	1.56	23.50
1.04	5.167	1.38	11.333	6.83	17.500	1.56	23.67
1.04	5.333	1.38	11.500	8.29	17.667	1.56	23.83
1.04	5.500	1.38	11.667	8.29	17.833	1.56	24.00
1.04	5.667	1.38	11.833	16.93	18.000	1.56	24.17
1.04	5.833	1.38	12.000	25.58	18.167	1.56	24.33
0.52	6.000	1.38	12.167	105.75	18.333	1.56	
	6.167	1.38	12.333	59.10	18.500	1.56	

Unit Hyd Qpeak (cms)= 0.817

PEAK FLOW (cms)= 0.279 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 27.056
 TOTAL RAINFALL (mm)= 86.400
 RUNOFF COEFFICIENT = 0.313

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
      ID1= 1 ( 0002):  25.86   1.685   12.33   27.06
+ ID2= 2 ( 0005):   4.28   0.279   12.33   27.06
=====
      ID = 3 ( 0006):  30.14   1.963   12.33   27.06

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

PRE-DEVELOPMENT MODEL

 ** SIMULATION : Malton Rainfall Data-25yr 24h **

 | READ STORM | Filename: C:\Users\shuchi\AppData
 | | ata\Local\Temp\
 | | 040552e1-671d-4190-8868-
 607e6b50438b\a83b4691
 | Ptotal=100.80 mm | Comments: Malton Rainfall Data-25yr 24hr 15min SCS

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.81	0.00	0.00	6.25	1.81	12.50	14.52	18.75
1.81	0.25	1.11	6.50	1.81	12.75	7.46	19.00
1.81	0.50	1.11	6.75	1.81	13.00	7.46	19.25
1.81	0.75	1.11	7.00	1.81	13.25	5.44	19.50
1.81	1.00	1.11	7.25	2.22	13.50	5.44	19.75
1.81	1.25	1.11	7.50	2.22	13.75	4.23	20.00
1.21	1.50	1.11	7.75	2.22	14.00	4.23	20.25
1.21	1.75	1.11	8.00	2.22	14.25	3.02	20.50
1.21	2.00	1.11	8.25	2.62	14.50	3.02	20.75
1.21	2.25	1.31	8.50	2.62	14.75	3.02	21.00
1.21	2.50	1.31	8.75	2.82	15.00	3.02	21.25
1.21	2.75	1.31	9.00	2.82	15.25	3.02	21.50
1.21	3.00	1.31	9.25	3.23	15.50	3.02	21.75
1.21	3.25	1.31	9.50	3.23	15.75	3.02	22.00
1.21	3.50	1.31	9.75	3.63	16.00	3.02	22.25
1.21	3.75	1.31	10.00	3.63	16.25	1.81	22.50
1.21	4.00	1.31	10.25	4.64	16.50	1.81	22.75

1.21	2.000	1.11 8.167	2.22 14.333	3.63 20.50
1.21	2.167	1.11 8.333	2.42 14.500	3.02 20.67
1.21	2.333	1.21 8.500	2.62 14.667	3.02 20.83
1.21	2.500	1.31 8.667	2.62 14.833	3.02 21.00
1.21	2.667	1.31 8.833	2.72 15.000	3.02 21.17
1.21	2.833	1.31 9.000	2.82 15.167	3.02 21.33
1.21	3.000	1.31 9.167	2.82 15.333	3.02 21.50
1.21	3.167	1.31 9.333	3.02 15.500	3.02 21.67
1.21	3.333	1.31 9.500	3.23 15.667	3.02 21.83
1.21	3.500	1.31 9.667	3.23 15.833	3.02 22.00
1.21	3.667	1.31 9.833	3.43 16.000	3.02 22.17
1.21	3.833	1.31 10.000	3.63 16.167	3.02 22.33
1.21	4.000	1.31 10.167	3.63 16.333	2.42 22.50
1.21	4.167	1.31 10.333	4.13 16.500	1.81 22.67
1.21	4.333	1.46 10.500	4.64 16.667	1.81 22.83
1.21	4.500	1.61 10.667	4.64 16.833	1.81 23.00
1.21	4.667	1.61 10.833	5.44 17.000	1.81 23.17
1.21	4.833	1.61 11.000	6.25 17.167	1.81 23.33
1.21	5.000	1.61 11.167	6.25 17.333	1.81 23.50
1.21	5.167	1.61 11.333	7.96 17.500	1.81 23.67
1.21	5.333	1.61 11.500	9.68 17.667	1.81 23.83
1.21	5.500	1.61 11.667	9.68 17.833	1.81 24.00
1.21	5.667	1.61 11.833	19.76 18.000	1.81 24.17
1.21	5.833	1.61 12.000	29.84 18.167	1.81 24.33
0.60	6.000	1.61 12.167	123.38 18.333	1.81
	6.167	1.61 12.333	68.94 18.500	1.81

Unit Hyd Qpeak (cms)= 4.939

PEAK FLOW (cms)= 2.231 (i)

TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 35.592
 TOTAL RAINFALL (mm)= 100.800
 RUNOFF COEFFICIENT = 0.353

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| NASHYD ( 0005) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
| U.H. Tp(hrs)= 0.20
  
```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
      hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
RAIN
mm/hr
0.167      0.00 | 6.333      1.71 | 12.500     14.52 | 18.67
1.81
0.333      0.55 | 6.500      1.81 | 12.667     14.52 | 18.83
1.81
0.500      1.11 | 6.667      1.81 | 12.833     10.99 | 19.00
1.81
0.667      1.11 | 6.833      1.81 | 13.000      7.46 | 19.17
1.81
0.833      1.11 | 7.000      1.81 | 13.167      7.46 | 19.33
1.81
1.000      1.11 | 7.167      1.81 | 13.333      6.45 | 19.50
1.81
1.167      1.11 | 7.333      2.02 | 13.500      5.44 | 19.67
1.81
1.333      1.11 | 7.500      2.22 | 13.667      5.44 | 19.83
1.81
1.500      1.11 | 7.667      2.22 | 13.833      4.84 | 20.00
1.81
1.667      1.11 | 7.833      2.22 | 14.000      4.23 | 20.17
1.81
1.833      1.11 | 8.000      2.22 | 14.167      4.23 | 20.33
1.51
2.000      1.11 | 8.167      2.22 | 14.333      3.63 | 20.50
1.21
2.167      1.11 | 8.333      2.42 | 14.500      3.02 | 20.67
1.21
2.333      1.21 | 8.500      2.62 | 14.667      3.02 | 20.83
1.21
2.500      1.31 | 8.667      2.62 | 14.833      3.02 | 21.00
1.21
  
```


1.21	2.667	1.31	8.833	2.72	15.000	3.02	21.17
1.21	2.833	1.31	9.000	2.82	15.167	3.02	21.33
1.21	3.000	1.31	9.167	2.82	15.333	3.02	21.50
1.21	3.167	1.31	9.333	3.02	15.500	3.02	21.67
1.21	3.333	1.31	9.500	3.23	15.667	3.02	21.83
1.21	3.500	1.31	9.667	3.23	15.833	3.02	22.00
1.21	3.667	1.31	9.833	3.43	16.000	3.02	22.17
1.21	3.833	1.31	10.000	3.63	16.167	3.02	22.33
1.21	4.000	1.31	10.167	3.63	16.333	2.42	22.50
1.21	4.167	1.31	10.333	4.13	16.500	1.81	22.67
1.21	4.333	1.46	10.500	4.64	16.667	1.81	22.83
1.21	4.500	1.61	10.667	4.64	16.833	1.81	23.00
1.21	4.667	1.61	10.833	5.44	17.000	1.81	23.17
1.21	4.833	1.61	11.000	6.25	17.167	1.81	23.33
1.21	5.000	1.61	11.167	6.25	17.333	1.81	23.50
1.21	5.167	1.61	11.333	7.96	17.500	1.81	23.67
1.21	5.333	1.61	11.500	9.68	17.667	1.81	23.83
1.21	5.500	1.61	11.667	9.68	17.833	1.81	24.00
1.21	5.667	1.61	11.833	19.76	18.000	1.81	24.17
1.21	5.833	1.61	12.000	29.84	18.167	1.81	24.33
0.60	6.000	1.61	12.167	123.38	18.333	1.81	
	6.167	1.61	12.333	68.94	18.500	1.81	

Unit Hyd Qpeak (cms)= 0.817

PEAK FLOW (cms)= 0.369 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 35.592
 TOTAL RAINFALL (mm)= 100.800
 RUNOFF COEFFICIENT = 0.353

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
      ID1= 1 ( 0002):  25.86   2.231   12.33   35.59
+ ID2= 2 ( 0005):   4.28   0.369   12.33   35.59
=====
      ID = 3 ( 0006):  30.14   2.600   12.33   35.59

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

1.35	2.000	1.24 8.167	2.48 14.333	4.06 20.50
1.35	2.167	1.24 8.333	2.71 14.500	3.38 20.67
1.35	2.333	1.35 8.500	2.93 14.667	3.38 20.83
1.35	2.500	1.47 8.667	2.93 14.833	3.38 21.00
1.35	2.667	1.47 8.833	3.05 15.000	3.38 21.17
1.35	2.833	1.47 9.000	3.16 15.167	3.38 21.33
1.35	3.000	1.47 9.167	3.16 15.333	3.38 21.50
1.35	3.167	1.47 9.333	3.38 15.500	3.38 21.67
1.35	3.333	1.47 9.500	3.61 15.667	3.38 21.83
1.35	3.500	1.47 9.667	3.61 15.833	3.38 22.00
1.35	3.667	1.47 9.833	3.84 16.000	3.38 22.17
1.35	3.833	1.47 10.000	4.06 16.167	3.38 22.33
1.35	4.000	1.47 10.167	4.06 16.333	2.71 22.50
1.35	4.167	1.47 10.333	4.62 16.500	2.03 22.67
1.35	4.333	1.64 10.500	5.19 16.667	2.03 22.83
1.35	4.500	1.80 10.667	5.19 16.833	2.03 23.00
1.35	4.667	1.80 10.833	6.09 17.000	2.03 23.17
1.35	4.833	1.80 11.000	6.99 17.167	2.03 23.33
1.35	5.000	1.80 11.167	6.99 17.333	2.03 23.50
1.35	5.167	1.80 11.333	8.91 17.500	2.03 23.67
1.35	5.333	1.80 11.500	10.83 17.667	2.03 23.83
1.35	5.500	1.80 11.667	10.83 17.833	2.03 24.00
1.35	5.667	1.80 11.833	22.11 18.000	2.03 24.17
1.35	5.833	1.80 12.000	33.39 18.167	2.03 24.33
0.68	6.000	1.80 12.167	138.07 18.333	2.03
	6.167	1.80 12.333	77.15 18.500	2.03

Unit Hyd Qpeak (cms)= 4.939

PEAK FLOW (cms)= 2.719 (i)

TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 43.192
 TOTAL RAINFALL (mm)= 112.800
 RUNOFF COEFFICIENT = 0.383

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| NASHYD ( 0005) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
| U.H. Tp(hrs)= 0.20
  
```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
      hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
mm/hr
0.167      0.00 | 6.333      1.92 |12.500     16.24 | 18.67
2.03
0.333      0.62 | 6.500      2.03 |12.667     16.24 | 18.83
2.03
0.500      1.24 | 6.667      2.03 |12.833     12.29 | 19.00
2.03
0.667      1.24 | 6.833      2.03 |13.000      8.35 | 19.17
2.03
0.833      1.24 | 7.000      2.03 |13.167      8.35 | 19.33
2.03
1.000      1.24 | 7.167      2.03 |13.333      7.22 | 19.50
2.03
1.167      1.24 | 7.333      2.26 |13.500      6.09 | 19.67
2.03
1.333      1.24 | 7.500      2.48 |13.667      6.09 | 19.83
2.03
1.500      1.24 | 7.667      2.48 |13.833      5.41 | 20.00
2.03
1.667      1.24 | 7.833      2.48 |14.000      4.74 | 20.17
2.03
1.833      1.24 | 8.000      2.48 |14.167      4.74 | 20.33
1.69
2.000      1.24 | 8.167      2.48 |14.333      4.06 | 20.50
1.35
2.167      1.24 | 8.333      2.71 |14.500      3.38 | 20.67
1.35
2.333      1.35 | 8.500      2.93 |14.667      3.38 | 20.83
1.35
2.500      1.47 | 8.667      2.93 |14.833      3.38 | 21.00
1.35
  
```

1.35	2.667	1.47	8.833	3.05	15.000	3.38	21.17
1.35	2.833	1.47	9.000	3.16	15.167	3.38	21.33
1.35	3.000	1.47	9.167	3.16	15.333	3.38	21.50
1.35	3.167	1.47	9.333	3.38	15.500	3.38	21.67
1.35	3.333	1.47	9.500	3.61	15.667	3.38	21.83
1.35	3.500	1.47	9.667	3.61	15.833	3.38	22.00
1.35	3.667	1.47	9.833	3.84	16.000	3.38	22.17
1.35	3.833	1.47	10.000	4.06	16.167	3.38	22.33
1.35	4.000	1.47	10.167	4.06	16.333	2.71	22.50
1.35	4.167	1.47	10.333	4.62	16.500	2.03	22.67
1.35	4.333	1.64	10.500	5.19	16.667	2.03	22.83
1.35	4.500	1.80	10.667	5.19	16.833	2.03	23.00
1.35	4.667	1.80	10.833	6.09	17.000	2.03	23.17
1.35	4.833	1.80	11.000	6.99	17.167	2.03	23.33
1.35	5.000	1.80	11.167	6.99	17.333	2.03	23.50
1.35	5.167	1.80	11.333	8.91	17.500	2.03	23.67
1.35	5.333	1.80	11.500	10.83	17.667	2.03	23.83
1.35	5.500	1.80	11.667	10.83	17.833	2.03	24.00
1.35	5.667	1.80	11.833	22.11	18.000	2.03	24.17
1.35	5.833	1.80	12.000	33.39	18.167	2.03	24.33
0.68	6.000	1.80	12.167	138.07	18.333	2.03	
	6.167	1.80	12.333	77.15	18.500	2.03	

Unit Hyd Qpeak (cms)= 0.817

PEAK FLOW (cms)= 0.450 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 43.192
 TOTAL RAINFALL (mm)= 112.800
 RUNOFF COEFFICIENT = 0.383

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0002):  25.86    2.719    12.33    43.19
+ ID2= 2 ( 0005):   4.28    0.450    12.33    43.19
=====
ID = 3 ( 0006):  30.14    3.169    12.33    43.19

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

PRE-DEVELOPMENT MODEL

 ** SIMULATION : Malton Rainfall Data-100yr 24 **

 | READ STORM | Filename: C:\Users\shuchi\AppData
 | | ata\Local\Temp\
 | | 040552e1-671d-4190-8868-
 607e6b50438b\ce73ad6e
 | Ptotal=122.40 mm | Comments: Malton Rainfall Data-100yr 24hr 15min SC

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.00	0.00	0.00	6.25	2.20	12.50	17.63	18.75
2.20	0.25	1.35	6.50	2.20	12.75	9.06	19.00
2.20	0.50	1.35	6.75	2.20	13.00	9.06	19.25
2.20	0.75	1.35	7.00	2.20	13.25	6.61	19.50
2.20	1.00	1.35	7.25	2.69	13.50	6.61	19.75
2.20	1.25	1.35	7.50	2.69	13.75	5.14	20.00
1.47	1.50	1.35	7.75	2.69	14.00	5.14	20.25
1.47	1.75	1.35	8.00	2.69	14.25	3.67	20.50
1.47	2.00	1.35	8.25	3.18	14.50	3.67	20.75
1.47	2.25	1.59	8.50	3.18	14.75	3.67	21.00
1.47	2.50	1.59	8.75	3.43	15.00	3.67	21.25
1.47	2.75	1.59	9.00	3.43	15.25	3.67	21.50
1.47	3.00	1.59	9.25	3.92	15.50	3.67	21.75
1.47	3.25	1.59	9.50	3.92	15.75	3.67	22.00
1.47	3.50	1.59	9.75	4.41	16.00	3.67	22.25
1.47	3.75	1.59	10.00	4.41	16.25	2.20	22.50
1.47	4.00	1.59	10.25	5.63	16.50	2.20	22.75

1.47	2.000	1.35 8.167	2.69 14.333	4.41 20.50
1.47	2.167	1.35 8.333	2.94 14.500	3.67 20.67
1.47	2.333	1.47 8.500	3.18 14.667	3.67 20.83
1.47	2.500	1.59 8.667	3.18 14.833	3.67 21.00
1.47	2.667	1.59 8.833	3.30 15.000	3.67 21.17
1.47	2.833	1.59 9.000	3.43 15.167	3.67 21.33
1.47	3.000	1.59 9.167	3.43 15.333	3.67 21.50
1.47	3.167	1.59 9.333	3.67 15.500	3.67 21.67
1.47	3.333	1.59 9.500	3.92 15.667	3.67 21.83
1.47	3.500	1.59 9.667	3.92 15.833	3.67 22.00
1.47	3.667	1.59 9.833	4.16 16.000	3.67 22.17
1.47	3.833	1.59 10.000	4.41 16.167	3.67 22.33
1.47	4.000	1.59 10.167	4.41 16.333	2.94 22.50
1.47	4.167	1.59 10.333	5.02 16.500	2.20 22.67
1.47	4.333	1.77 10.500	5.63 16.667	2.20 22.83
1.47	4.500	1.96 10.667	5.63 16.833	2.20 23.00
1.47	4.667	1.96 10.833	6.61 17.000	2.20 23.17
1.47	4.833	1.96 11.000	7.59 17.167	2.20 23.33
1.47	5.000	1.96 11.167	7.59 17.333	2.20 23.50
1.47	5.167	1.96 11.333	9.67 17.500	2.20 23.67
1.47	5.333	1.96 11.500	11.75 17.667	2.20 23.83
1.47	5.500	1.96 11.667	11.75 17.833	2.20 24.00
1.47	5.667	1.96 11.833	23.99 18.000	2.20 24.17
1.47	5.833	1.96 12.000	36.23 18.167	2.20 24.33
0.73	6.000	1.96 12.167	149.82 18.333	2.20
	6.167	1.96 12.333	83.72 18.500	2.20

Unit Hyd Qpeak (cms)= 4.939

PEAK FLOW (cms)= 3.127 (i)

TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 49.547
 TOTAL RAINFALL (mm)= 122.400
 RUNOFF COEFFICIENT = 0.405

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| NASHYD ( 0005) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
| U.H. Tp(hrs)= 0.20
  
```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
      hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
mm/hr
0.167      0.00 | 6.333      2.08 |12.500      17.63 | 18.67
2.20
0.333      0.67 | 6.500      2.20 |12.667      17.63 | 18.83
2.20
0.500      1.35 | 6.667      2.20 |12.833      13.34 | 19.00
2.20
0.667      1.35 | 6.833      2.20 |13.000      9.06 | 19.17
2.20
0.833      1.35 | 7.000      2.20 |13.167      9.06 | 19.33
2.20
1.000      1.35 | 7.167      2.20 |13.333      7.83 | 19.50
2.20
1.167      1.35 | 7.333      2.45 |13.500      6.61 | 19.67
2.20
1.333      1.35 | 7.500      2.69 |13.667      6.61 | 19.83
2.20
1.500      1.35 | 7.667      2.69 |13.833      5.88 | 20.00
2.20
1.667      1.35 | 7.833      2.69 |14.000      5.14 | 20.17
2.20
1.833      1.35 | 8.000      2.69 |14.167      5.14 | 20.33
1.84
2.000      1.35 | 8.167      2.69 |14.333      4.41 | 20.50
1.47
2.167      1.35 | 8.333      2.94 |14.500      3.67 | 20.67
1.47
2.333      1.47 | 8.500      3.18 |14.667      3.67 | 20.83
1.47
2.500      1.59 | 8.667      3.18 |14.833      3.67 | 21.00
1.47
  
```

1.47	2.667	1.59	8.833	3.30	15.000	3.67	21.17
1.47	2.833	1.59	9.000	3.43	15.167	3.67	21.33
1.47	3.000	1.59	9.167	3.43	15.333	3.67	21.50
1.47	3.167	1.59	9.333	3.67	15.500	3.67	21.67
1.47	3.333	1.59	9.500	3.92	15.667	3.67	21.83
1.47	3.500	1.59	9.667	3.92	15.833	3.67	22.00
1.47	3.667	1.59	9.833	4.16	16.000	3.67	22.17
1.47	3.833	1.59	10.000	4.41	16.167	3.67	22.33
1.47	4.000	1.59	10.167	4.41	16.333	2.94	22.50
1.47	4.167	1.59	10.333	5.02	16.500	2.20	22.67
1.47	4.333	1.77	10.500	5.63	16.667	2.20	22.83
1.47	4.500	1.96	10.667	5.63	16.833	2.20	23.00
1.47	4.667	1.96	10.833	6.61	17.000	2.20	23.17
1.47	4.833	1.96	11.000	7.59	17.167	2.20	23.33
1.47	5.000	1.96	11.167	7.59	17.333	2.20	23.50
1.47	5.167	1.96	11.333	9.67	17.500	2.20	23.67
1.47	5.333	1.96	11.500	11.75	17.667	2.20	23.83
1.47	5.500	1.96	11.667	11.75	17.833	2.20	24.00
1.47	5.667	1.96	11.833	23.99	18.000	2.20	24.17
1.47	5.833	1.96	12.000	36.23	18.167	2.20	24.33
0.73	6.000	1.96	12.167	149.82	18.333	2.20	
	6.167	1.96	12.333	83.72	18.500	2.20	

Unit Hyd Qpeak (cms)= 0.817

PEAK FLOW (cms)= 0.518 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 49.547
 TOTAL RAINFALL (mm)= 122.400
 RUNOFF COEFFICIENT = 0.405

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
      ID1= 1 ( 0002):  25.86   3.127   12.33   49.55
      + ID2= 2 ( 0005):   4.28   0.518   12.33   49.55
      =====
      ID = 3 ( 0006):  30.14   3.645   12.33   49.55

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
-----
FINISH
=====
=====

```

25mm EROSION CONTROL

VO SCHEMATIC

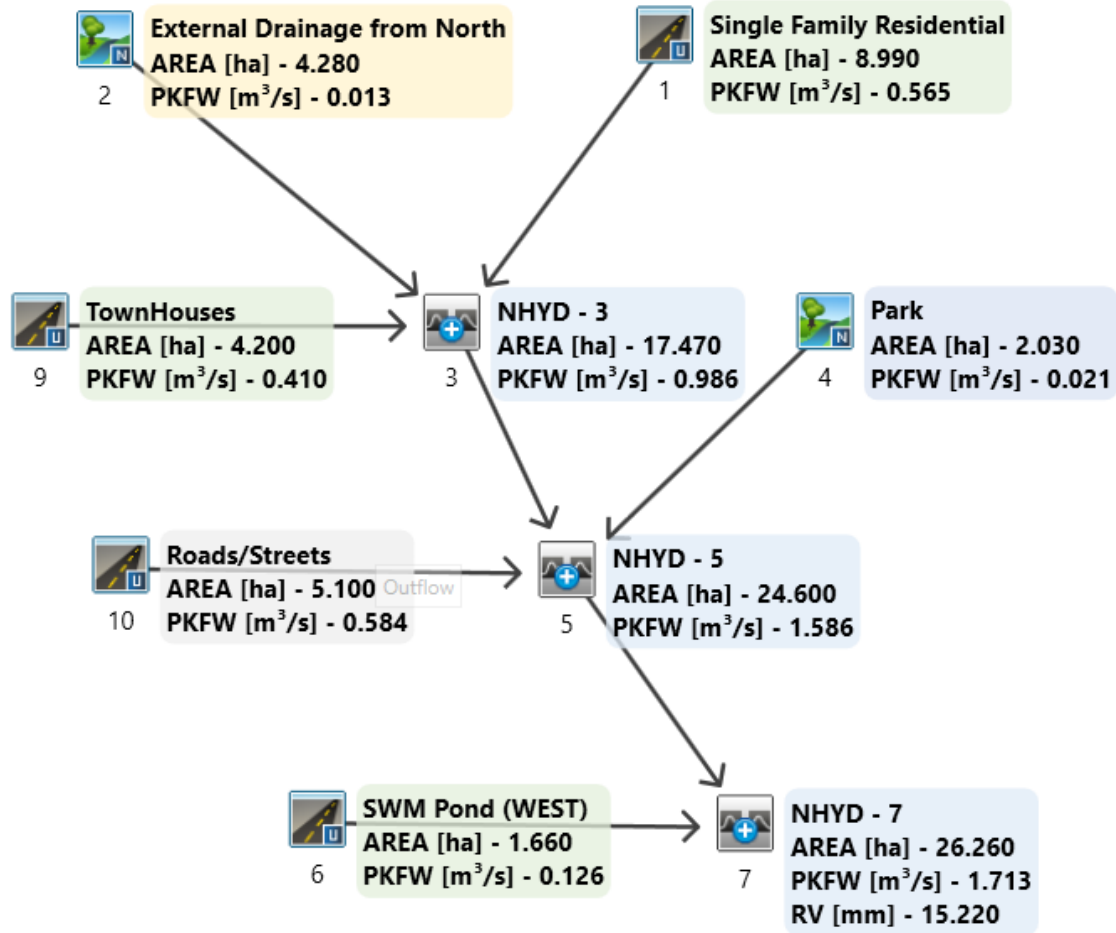

=====

V V I SSSSS U U A L (v 6.2.2010)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

OOO TTTTT TTTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2021 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

** SIMULATION : 25mm-4Hr **

| READ STORM |
| |
| |
676e4b20b82e\0b3efdac
| Ptotal= 25.00 mm |

Filename: C:\Users\shuchi\AppData
ata\Local\Temp\
39290c56-acb1-47e4-b8cc-
Comments: 25MM-4HR

RAIN	TIME	RAIN	TIME	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	hrs	mm/hr	hrs
2.80	0.00	2.07	1.00	2.00	5.19	3.00
2.62	0.17	2.27	1.17	2.17	4.47	3.17
2.48	0.33	2.52	1.33	2.33	3.95	3.33
2.35	0.50	2.88	1.50	2.50	3.56	3.50
2.23	0.67	3.38	1.67	2.67	3.25	3.67
2.14	0.83	4.18	1.83	2.83	3.01	3.83

| CALIB |


```

| NASHYD ( 0002) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.15

```

Unit Hyd Qpeak (cms)= 1.090

```

PEAK FLOW (cms)= 0.013 (i)
TIME TO PEAK (hrs)= 1.667
RUNOFF VOLUME (mm)= 1.680
TOTAL RAINFALL (mm)= 24.997
RUNOFF COEFFICIENT = 0.067

```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

| CALIB |
| STANDHYD ( 0001) | Area (ha)= 8.99
| ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00
-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	5.39	3.60	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	244.81	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	50.21	14.81	
over (min)	10.00	30.00	
Storage Coeff. (min)=	5.76 (ii)	20.91 (ii)	
Unit Hyd. Tpeak (min)=	10.00	30.00	
Unit Hyd. peak (cms)=	0.14	0.05	
			* TOTALS*
PEAK FLOW (cms)=	0.54	0.08	0.565 (iii)
TIME TO PEAK (hrs)=	1.50	1.83	1.50
RUNOFF VOLUME (mm)=	24.00	9.49	16.74
TOTAL RAINFALL (mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT =	0.96	0.38	0.67

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

| CALIB |
| STANDHYD ( 0009) | Area (ha)= 4.20
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00

```

```

-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	3.36	0.84	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	167.33	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	50.21	14.81	
over (min)	10.00	20.00	
Storage Coeff. (min)=	4.58 (ii)	19.73 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.15	0.06	
			* TOTALS*
PEAK FLOW (cms)=	0.40	0.02	0.410 (iii)
TIME TO PEAK (hrs)=	1.50	1.67	1.50
RUNOFF VOLUME (mm)=	24.00	9.49	20.37
TOTAL RAINFALL (mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT =	0.96	0.38	0.81

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----

```

```

-----
| ADD HYD ( 0003) |
| 1 + 2 = 3 |
-----

```

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 1 (0001):	8.99	0.565	1.50	16.74
+ ID2= 2 (0002):	4.28	0.013	1.67	1.68
=====				
ID = 3 (0003):	13.27	0.575	1.50	11.89

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
-----

```

```

-----
| ADD HYD ( 0003) |
| 3 + 2 = 1 |
-----

```

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 3 (0003):	13.27	0.575	1.50	11.89
+ ID2= 2 (0009):	4.20	0.410	1.50	20.37
=====				
ID = 1 (0003):	17.47	0.986	1.50	13.92

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
-----
| CALIB |
| NASHYD ( 0004) | Area (ha)= 2.03 Curve Number (CN)= 80.0
| ID= 1 DT=10.0 min | Ia (mm)= 5.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.20

```

Unit Hyd Qpeak (cms)= 0.388

PEAK FLOW (cms)= 0.021 (i)
 TIME TO PEAK (hrs)= 1.667
 RUNOFF VOLUME (mm)= 4.664
 TOTAL RAINFALL (mm)= 24.997
 RUNOFF COEFFICIENT = 0.187

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| STANDHYD ( 0010) | Area (ha)= 5.10
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00
-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	4.84	0.26	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	184.39	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	50.21	48.59	
over (min)	10.00	20.00	
Storage Coeff. (min)=	4.86 (ii)	14.28 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.15	0.07	
			* TOTALS*
PEAK FLOW (cms)=	0.57	0.02	0.584 (iii)
TIME TO PEAK (hrs)=	1.50	1.67	1.50
RUNOFF VOLUME (mm)=	24.00	12.60	22.86
TOTAL RAINFALL (mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT =	0.96	0.50	0.91

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
      ID1= 1 ( 0010):    5.10    0.584    1.50    22.86
+ ID2= 2 ( 0003):    17.47    0.986    1.50    13.92
=====
      ID = 3 ( 0005):    22.57    1.570    1.50    15.94

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0005) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
      ID1= 3 ( 0005):    22.57    1.570    1.50    15.94
+ ID2= 2 ( 0004):     2.03    0.021    1.67     4.66
=====
      ID = 1 ( 0005):    24.60    1.586    1.50    15.01

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| CALIB |
| STANDHYD ( 0006) | Area (ha)= 1.66
|ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00
-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	1.25	0.42	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	105.20	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	50.21	48.59	
over (min)	10.00	20.00	
Storage Coeff. (min)=	3.47 (ii)	12.89 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.16	0.07	
			* TOTALS*
PEAK FLOW (cms)=	0.11	0.03	0.126 (iii)
TIME TO PEAK (hrs)=	1.50	1.67	1.50
RUNOFF VOLUME (mm)=	24.00	12.60	18.29
TOTAL RAINFALL (mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT =	0.96	0.50	0.73

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)

- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0007) |
| 1 + 2 = 3 |
-----

```

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 1 (0005):	24.60	1.586	1.50	15.01
+ ID2= 2 (0006):	1.66	0.126	1.50	18.29
=====				
ID = 3 (0007):	26.26	1.713	1.50	15.22

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0008) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min |
-----

```

	OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
	0.0000	0.0000	1.5900	0.7907
	0.2980	0.4695	2.1460	0.8592
	0.7300	0.5938	2.3680	0.9292
	1.1320	0.6906	0.0000	0.0000

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW : ID= 2 (0007)	26.260	1.713	1.50	15.22
OUTFLOW: ID= 1 (0008)	26.260	0.163	3.17	15.20

PEAK FLOW REDUCTION [Qout/Qin] (%) = 9.53
 TIME SHIFT OF PEAK FLOW (min) = 100.00
 MAXIMUM STORAGE USED (ha.m.) = 0.2573

FINISH


```

=====
=====

```

POST-DEVELOPMENT CONDITION

VO SCHEMATIC

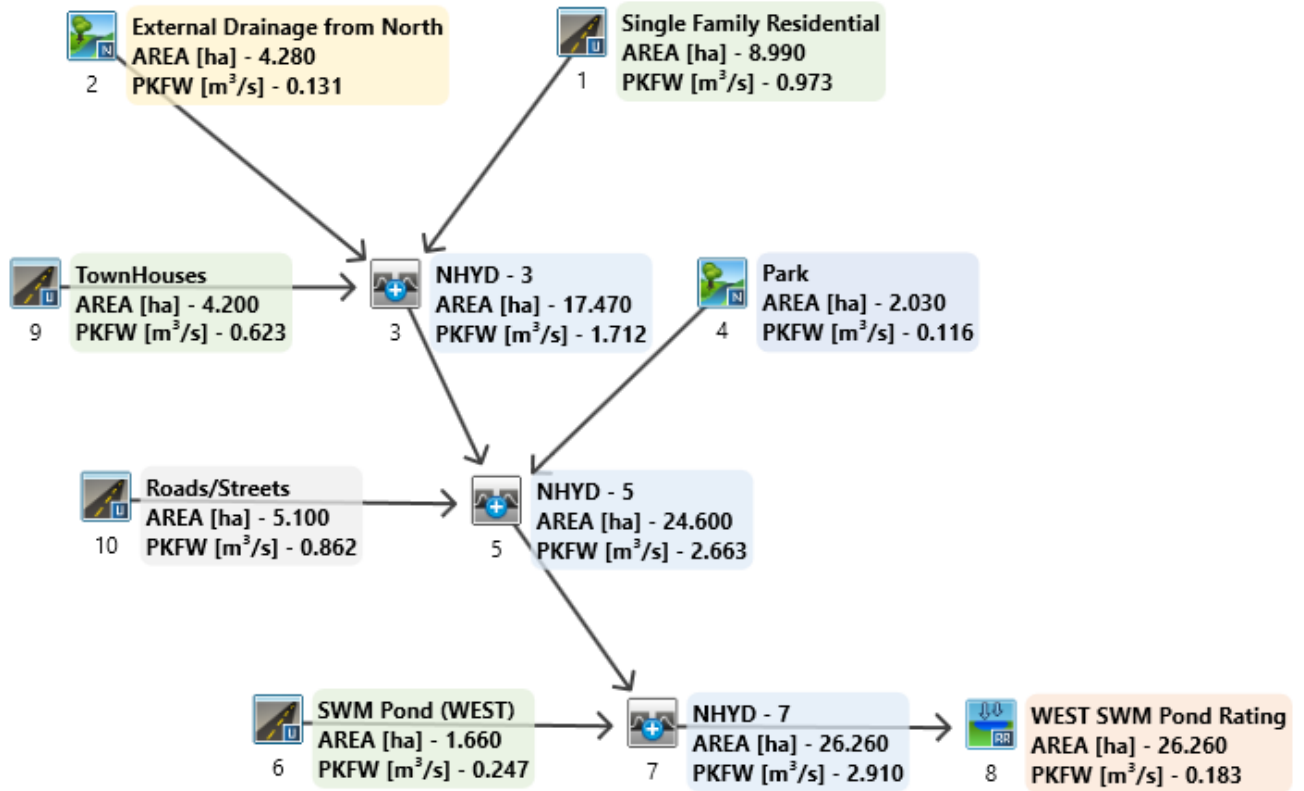

SUMMARY OF VO MODELLING RESULTS FOR WEST POND

Storm Event	Control Structure Data			VO RESULTS			
	Pre-Dev Targets	Control Structure Release Rate	Storage Provided in Pond	Inflows/Peak Flows Generated	Outflows	Max Storage Used	Elevation in Pond
	(m³/s)	(m³/s)	(m³)	(m³/s)	(m³/s)	(m³)	(m)
2-Year	0.881	0.187	6,751	2.910	0.183	6,612	459.10
5-Year	1.477	0.506	8,381	4.000	0.489	8,312	459.26
10-Year	1.963	0.782	9,953	4.784	0.709	9,547	459.37
25-Year	2.600	1.158	10,970	5.839	1.141	10,948	459.50
50-Year	3.169	1.547	12,310	7.126	1.485	12,162	459.62
100-Year	3.645	2.151	13,219	7.856	1.992	12,983	459.70

MALTON IDF CURVES FOR SCS TYPE II, 24 Hr Storm
(CVC Criteria)

POST-DEVELOPMENT MODEL

=====

```

V   V   I   SSSSS U   U   A   L           (v 6.2.2010)
V   V   I   SS    U   U   A A   L
V   V   I   SS    U   U   AAAAA L
V   V   I   SS    U   U   A   A   L
VV    I   SSSSS UUUUU A   A   LLLLL

```

```

OOO   TTTTT TTTTT H   H   Y   Y   M   M   OOO   TM
O   O   T   T   H   H   Y Y   MM MM O   O
O   O   T   T   H   H   Y   M   M   O   O
OOO   T   T   H   H   Y   M   M   OOO

```

Developed and Distributed by Smart City Water Inc
 Copyright 2007 - 2021 Smart City Water Inc
 All rights reserved.

***** D E T A I L E D O U T P U T *****

```

*****
** SIMULATION : Malton Rainfall Data-2yr 24hr **
*****

```

```

-----
|   READ STORM   |   Filename: C:\Users\shuchi\AppData
|               |   ata\Local\Temp\
|               |   84b8a492-9782-4cfd-b409-
| bfb60ba4c411\bbc104e8 |
| Ptotal= 57.60 mm |   Comments: Malton Rainfall Data-2yr 24hr 15min SCS
-----

```

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.04	0.00	0.00	6.25	1.04	12.50	8.29	18.75
1.04	0.25	0.63	6.50	1.04	12.75	4.26	19.00
1.04	0.50	0.63	6.75	1.04	13.00	4.26	19.25
1.04	0.75	0.63	7.00	1.04	13.25	3.11	19.50
1.04	1.00	0.63	7.25	1.27	13.50	3.11	19.75
1.04	1.25	0.63	7.50	1.27	13.75	2.42	20.00
0.69	1.50	0.63	7.75	1.27	14.00	2.42	20.25
0.69	1.75	0.63	8.00	1.27	14.25	1.73	20.50

1.04	0.500	0.63 6.667	1.04 12.833	6.28 19.00
1.04	0.667	0.63 6.833	1.04 13.000	4.26 19.17
1.04	0.833	0.63 7.000	1.04 13.167	4.26 19.33
1.04	1.000	0.63 7.167	1.04 13.333	3.69 19.50
1.04	1.167	0.63 7.333	1.15 13.500	3.11 19.67
1.04	1.333	0.63 7.500	1.27 13.667	3.11 19.83
1.04	1.500	0.63 7.667	1.27 13.833	2.76 20.00
1.04	1.667	0.63 7.833	1.27 14.000	2.42 20.17
1.04	1.833	0.63 8.000	1.27 14.167	2.42 20.33
0.86	2.000	0.63 8.167	1.27 14.333	2.07 20.50
0.69	2.167	0.63 8.333	1.38 14.500	1.73 20.67
0.69	2.333	0.69 8.500	1.50 14.667	1.73 20.83
0.69	2.500	0.75 8.667	1.50 14.833	1.73 21.00
0.69	2.667	0.75 8.833	1.56 15.000	1.73 21.17
0.69	2.833	0.75 9.000	1.61 15.167	1.73 21.33
0.69	3.000	0.75 9.167	1.61 15.333	1.73 21.50
0.69	3.167	0.75 9.333	1.73 15.500	1.73 21.67
0.69	3.333	0.75 9.500	1.84 15.667	1.73 21.83
0.69	3.500	0.75 9.667	1.84 15.833	1.73 22.00
0.69	3.667	0.75 9.833	1.96 16.000	1.73 22.17
0.69	3.833	0.75 10.000	2.07 16.167	1.73 22.33
0.69	4.000	0.75 10.167	2.07 16.333	1.38 22.50
0.69	4.167	0.75 10.333	2.36 16.500	1.04 22.67
0.69	4.333	0.84 10.500	2.65 16.667	1.04 22.83
0.69	4.500	0.92 10.667	2.65 16.833	1.04 23.00
0.69	4.667	0.92 10.833	3.11 17.000	1.04 23.17
0.69	4.833	0.92 11.000	3.57 17.167	1.04 23.33

0.69	5.000	0.92	11.167	3.57	17.333	1.04	23.50
0.69	5.167	0.92	11.333	4.55	17.500	1.04	23.67
0.69	5.333	0.92	11.500	5.53	17.667	1.04	23.83
0.69	5.500	0.92	11.667	5.53	17.833	1.04	24.00
0.69	5.667	0.92	11.833	11.29	18.000	1.04	24.17
0.35	5.833	0.92	12.000	17.05	18.167	1.04	24.33
	6.000	0.92	12.167	70.50	18.333	1.04	
	6.167	0.92	12.333	39.40	18.500	1.04	

Unit Hyd Qpeak (cms)= 1.090

PEAK FLOW (cms)= 0.131 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 11.884
 TOTAL RAINFALL (mm)= 57.600
 RUNOFF COEFFICIENT = 0.206

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0001) | Area (ha)= 8.99
 | ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	5.39	3.60
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	244.81	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.04	0.167	0.00	6.333	0.98	12.500	8.29	18.67
1.04	0.333	0.32	6.500	1.04	12.667	8.29	18.83
1.04	0.500	0.63	6.667	1.04	12.833	6.28	19.00

1.04	0.667	0.63 6.833	1.04 13.000	4.26 19.17
1.04	0.833	0.63 7.000	1.04 13.167	4.26 19.33
1.04	1.000	0.63 7.167	1.04 13.333	3.69 19.50
1.04	1.167	0.63 7.333	1.15 13.500	3.11 19.67
1.04	1.333	0.63 7.500	1.27 13.667	3.11 19.83
1.04	1.500	0.63 7.667	1.27 13.833	2.76 20.00
1.04	1.667	0.63 7.833	1.27 14.000	2.42 20.17
1.04	1.833	0.63 8.000	1.27 14.167	2.42 20.33
0.86	2.000	0.63 8.167	1.27 14.333	2.07 20.50
0.69	2.167	0.63 8.333	1.38 14.500	1.73 20.67
0.69	2.333	0.69 8.500	1.50 14.667	1.73 20.83
0.69	2.500	0.75 8.667	1.50 14.833	1.73 21.00
0.69	2.667	0.75 8.833	1.56 15.000	1.73 21.17
0.69	2.833	0.75 9.000	1.61 15.167	1.73 21.33
0.69	3.000	0.75 9.167	1.61 15.333	1.73 21.50
0.69	3.167	0.75 9.333	1.73 15.500	1.73 21.67
0.69	3.333	0.75 9.500	1.84 15.667	1.73 21.83
0.69	3.500	0.75 9.667	1.84 15.833	1.73 22.00
0.69	3.667	0.75 9.833	1.96 16.000	1.73 22.17
0.69	3.833	0.75 10.000	2.07 16.167	1.73 22.33
0.69	4.000	0.75 10.167	2.07 16.333	1.38 22.50
0.69	4.167	0.75 10.333	2.36 16.500	1.04 22.67
0.69	4.333	0.84 10.500	2.65 16.667	1.04 22.83
0.69	4.500	0.92 10.667	2.65 16.833	1.04 23.00
0.69	4.667	0.92 10.833	3.11 17.000	1.04 23.17
0.69	4.833	0.92 11.000	3.57 17.167	1.04 23.33
0.69	5.000	0.92 11.167	3.57 17.333	1.04 23.50

0.69	5.167	0.92	11.333	4.55	17.500	1.04	23.67
0.69	5.333	0.92	11.500	5.53	17.667	1.04	23.83
0.69	5.500	0.92	11.667	5.53	17.833	1.04	24.00
0.69	5.667	0.92	11.833	11.29	18.000	1.04	24.17
0.69	5.833	0.92	12.000	17.05	18.167	1.04	24.33
0.35	6.000	0.92	12.167	70.50	18.333	1.04	
	6.167	0.92	12.333	39.40	18.500	1.04	

Max.Eff.Inten.(mm/hr)= 70.50 57.49
over (min) 10.00 20.00
Storage Coeff. (min)= 5.03 (ii) 13.83 (ii)
Unit Hyd. Tpeak (min)= 10.00 20.00
Unit Hyd. peak (cms)= 0.15 0.07

PEAK FLOW (cms)= 0.79 0.34 0.973 (iii)
TIME TO PEAK (hrs)= 12.17 12.33 12.17
RUNOFF VOLUME (mm)= 56.60 34.48 45.54
TOTAL RAINFALL (mm)= 57.60 57.60 57.60
RUNOFF COEFFICIENT = 0.98 0.60 0.79

* TOTALS*

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0009) | Area (ha)= 4.20
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	3.36	0.84
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	167.33	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----
TIME RAIN | TIME RAIN | TIME RAIN | TIME
RAIN

mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.167	0.00	6.333	0.98	12.500	8.29	18.67
1.04	0.333	0.32	6.500	1.04	12.667	8.29	18.83
1.04	0.500	0.63	6.667	1.04	12.833	6.28	19.00
1.04	0.667	0.63	6.833	1.04	13.000	4.26	19.17
1.04	0.833	0.63	7.000	1.04	13.167	4.26	19.33
1.04	1.000	0.63	7.167	1.04	13.333	3.69	19.50
1.04	1.167	0.63	7.333	1.15	13.500	3.11	19.67
1.04	1.333	0.63	7.500	1.27	13.667	3.11	19.83
1.04	1.500	0.63	7.667	1.27	13.833	2.76	20.00
1.04	1.667	0.63	7.833	1.27	14.000	2.42	20.17
1.04	1.833	0.63	8.000	1.27	14.167	2.42	20.33
0.86	2.000	0.63	8.167	1.27	14.333	2.07	20.50
0.69	2.167	0.63	8.333	1.38	14.500	1.73	20.67
0.69	2.333	0.69	8.500	1.50	14.667	1.73	20.83
0.69	2.500	0.75	8.667	1.50	14.833	1.73	21.00
0.69	2.667	0.75	8.833	1.56	15.000	1.73	21.17
0.69	2.833	0.75	9.000	1.61	15.167	1.73	21.33
0.69	3.000	0.75	9.167	1.61	15.333	1.73	21.50
0.69	3.167	0.75	9.333	1.73	15.500	1.73	21.67
0.69	3.333	0.75	9.500	1.84	15.667	1.73	21.83
0.69	3.500	0.75	9.667	1.84	15.833	1.73	22.00
0.69	3.667	0.75	9.833	1.96	16.000	1.73	22.17
0.69	3.833	0.75	10.000	2.07	16.167	1.73	22.33
0.69	4.000	0.75	10.167	2.07	16.333	1.38	22.50
0.69	4.167	0.75	10.333	2.36	16.500	1.04	22.67
0.69	4.333	0.84	10.500	2.65	16.667	1.04	22.83

0.69	4.500	0.92	10.667	2.65	16.833	1.04	23.00
0.69	4.667	0.92	10.833	3.11	17.000	1.04	23.17
0.69	4.833	0.92	11.000	3.57	17.167	1.04	23.33
0.69	5.000	0.92	11.167	3.57	17.333	1.04	23.50
0.69	5.167	0.92	11.333	4.55	17.500	1.04	23.67
0.69	5.333	0.92	11.500	5.53	17.667	1.04	23.83
0.69	5.500	0.92	11.667	5.53	17.833	1.04	24.00
0.69	5.667	0.92	11.833	11.29	18.000	1.04	24.17
0.69	5.833	0.92	12.000	17.05	18.167	1.04	24.33
0.35	6.000	0.92	12.167	70.50	18.333	1.04	
	6.167	0.92	12.333	39.40	18.500	1.04	

Max.Eff.Inten.(mm/hr)= 70.50 57.49
over (min) 10.00 20.00
Storage Coeff. (min)= 4.00 (ii) 12.81 (ii)
Unit Hyd. Tpeak (min)= 10.00 20.00
Unit Hyd. peak (cms)= 0.16 0.07

* TOTALS*
0.623 (iii)
12.17
51.07
57.60
0.89

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0003) |
| 1 + 2 = 3 |
-----

```

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 1 (0001):	8.99	0.973	12.17	45.54
+ ID2= 2 (0002):	4.28	0.131	12.33	11.88
=====				
ID = 3 (0003):	13.27	1.089	12.17	34.68

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0003) |
| 3 + 2 = 1 |
-----
AREA      QPEAK      TPEAK      R.V.
  (ha)    (cms)     (hrs)     (mm)
ID1= 3 ( 0003):  13.27  1.089   12.17   34.68
+ ID2= 2 ( 0009):   4.20  0.623   12.17   51.07
=====
ID = 1 ( 0003):   17.47  1.712   12.17   38.62

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| CALIB |
| NASHYD ( 0004) | Area (ha)= 2.03 Curve Number (CN)= 80.0
| ID= 1 DT=10.0 min | Ia (mm)= 5.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.20

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
  hrs     mm/hr |  hrs     mm/hr |  hrs     mm/hr |  hrs
mm/hr
0.167     0.00 | 6.333     0.98 |12.500     8.29 | 18.67
1.04
0.333     0.32 | 6.500     1.04 |12.667     8.29 | 18.83
1.04
0.500     0.63 | 6.667     1.04 |12.833     6.28 | 19.00
1.04
0.667     0.63 | 6.833     1.04 |13.000     4.26 | 19.17
1.04
0.833     0.63 | 7.000     1.04 |13.167     4.26 | 19.33
1.04
1.000     0.63 | 7.167     1.04 |13.333     3.69 | 19.50
1.04
1.167     0.63 | 7.333     1.15 |13.500     3.11 | 19.67
1.04
1.333     0.63 | 7.500     1.27 |13.667     3.11 | 19.83
1.04
1.500     0.63 | 7.667     1.27 |13.833     2.76 | 20.00
1.04
1.667     0.63 | 7.833     1.27 |14.000     2.42 | 20.17
1.04
1.833     0.63 | 8.000     1.27 |14.167     2.42 | 20.33
0.86
2.000     0.63 | 8.167     1.27 |14.333     2.07 | 20.50
0.69

```

0.69	2.167	0.63	8.333	1.38	14.500	1.73	20.67
0.69	2.333	0.69	8.500	1.50	14.667	1.73	20.83
0.69	2.500	0.75	8.667	1.50	14.833	1.73	21.00
0.69	2.667	0.75	8.833	1.56	15.000	1.73	21.17
0.69	2.833	0.75	9.000	1.61	15.167	1.73	21.33
0.69	3.000	0.75	9.167	1.61	15.333	1.73	21.50
0.69	3.167	0.75	9.333	1.73	15.500	1.73	21.67
0.69	3.333	0.75	9.500	1.84	15.667	1.73	21.83
0.69	3.500	0.75	9.667	1.84	15.833	1.73	22.00
0.69	3.667	0.75	9.833	1.96	16.000	1.73	22.17
0.69	3.833	0.75	10.000	2.07	16.167	1.73	22.33
0.69	4.000	0.75	10.167	2.07	16.333	1.38	22.50
0.69	4.167	0.75	10.333	2.36	16.500	1.04	22.67
0.69	4.333	0.84	10.500	2.65	16.667	1.04	22.83
0.69	4.500	0.92	10.667	2.65	16.833	1.04	23.00
0.69	4.667	0.92	10.833	3.11	17.000	1.04	23.17
0.69	4.833	0.92	11.000	3.57	17.167	1.04	23.33
0.69	5.000	0.92	11.167	3.57	17.333	1.04	23.50
0.69	5.167	0.92	11.333	4.55	17.500	1.04	23.67
0.69	5.333	0.92	11.500	5.53	17.667	1.04	23.83
0.69	5.500	0.92	11.667	5.53	17.833	1.04	24.00
0.69	5.667	0.92	11.833	11.29	18.000	1.04	24.17
0.69	5.833	0.92	12.000	17.05	18.167	1.04	24.33
0.35	6.000	0.92	12.167	70.50	18.333	1.04	
	6.167	0.92	12.333	39.40	18.500	1.04	

Unit Hyd Qpeak (cms)= 0.388

PEAK FLOW (cms)= 0.116 (i)

TIME TO PEAK (hrs)= 12.333

RUNOFF VOLUME (mm)= 23.211

TOTAL RAINFALL (mm)= 57.600
 RUNOFF COEFFICIENT = 0.403

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| STANDHYD ( 0010) | Area (ha)= 5.10
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00
-----
  
```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	4.84	0.26
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	184.39	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
      hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
RAIN
mm/hr
0.167      0.00 | 6.333      0.98 |12.500      8.29 | 18.67
1.04
0.333      0.32 | 6.500      1.04 |12.667      8.29 | 18.83
1.04
0.500      0.63 | 6.667      1.04 |12.833      6.28 | 19.00
1.04
0.667      0.63 | 6.833      1.04 |13.000      4.26 | 19.17
1.04
0.833      0.63 | 7.000      1.04 |13.167      4.26 | 19.33
1.04
1.000      0.63 | 7.167      1.04 |13.333      3.69 | 19.50
1.04
1.167      0.63 | 7.333      1.15 |13.500      3.11 | 19.67
1.04
1.333      0.63 | 7.500      1.27 |13.667      3.11 | 19.83
1.04
1.500      0.63 | 7.667      1.27 |13.833      2.76 | 20.00
1.04
1.667      0.63 | 7.833      1.27 |14.000      2.42 | 20.17
1.04
1.833      0.63 | 8.000      1.27 |14.167      2.42 | 20.33
0.86
2.000      0.63 | 8.167      1.27 |14.333      2.07 | 20.50
0.69
2.167      0.63 | 8.333      1.38 |14.500      1.73 | 20.67
0.69
  
```

0.69	2.333	0.69	8.500	1.50	14.667	1.73	20.83
0.69	2.500	0.75	8.667	1.50	14.833	1.73	21.00
0.69	2.667	0.75	8.833	1.56	15.000	1.73	21.17
0.69	2.833	0.75	9.000	1.61	15.167	1.73	21.33
0.69	3.000	0.75	9.167	1.61	15.333	1.73	21.50
0.69	3.167	0.75	9.333	1.73	15.500	1.73	21.67
0.69	3.333	0.75	9.500	1.84	15.667	1.73	21.83
0.69	3.500	0.75	9.667	1.84	15.833	1.73	22.00
0.69	3.667	0.75	9.833	1.96	16.000	1.73	22.17
0.69	3.833	0.75	10.000	2.07	16.167	1.73	22.33
0.69	4.000	0.75	10.167	2.07	16.333	1.38	22.50
0.69	4.167	0.75	10.333	2.36	16.500	1.04	22.67
0.69	4.333	0.84	10.500	2.65	16.667	1.04	22.83
0.69	4.500	0.92	10.667	2.65	16.833	1.04	23.00
0.69	4.667	0.92	10.833	3.11	17.000	1.04	23.17
0.69	4.833	0.92	11.000	3.57	17.167	1.04	23.33
0.69	5.000	0.92	11.167	3.57	17.333	1.04	23.50
0.69	5.167	0.92	11.333	4.55	17.500	1.04	23.67
0.69	5.333	0.92	11.500	5.53	17.667	1.04	23.83
0.69	5.500	0.92	11.667	5.53	17.833	1.04	24.00
0.69	5.667	0.92	11.833	11.29	18.000	1.04	24.17
0.69	5.833	0.92	12.000	17.05	18.167	1.04	24.33
0.35	6.000	0.92	12.167	70.50	18.333	1.04	
	6.167	0.92	12.333	39.40	18.500	1.04	

Max.Eff.Inten. (mm/hr)= 70.50 109.93
 over (min) 10.00 20.00
 Storage Coeff. (min)= 4.24 (ii) 11.04 (ii)
 Unit Hyd. Tpeak (min)= 10.00 20.00
 Unit Hyd. peak (cms)= 0.15 0.08

PEAK FLOW (cms)= 0.83 0.05 * TOTALS* 0.862 (iii)

TIME TO PEAK	(hrs)=	12.17	12.33	12.17
RUNOFF VOLUME	(mm)=	56.60	40.78	55.02
TOTAL RAINFALL	(mm)=	57.60	57.60	57.60
RUNOFF COEFFICIENT	=	0.98	0.71	0.96

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0010):  5.10    0.862    12.17    55.02
+ ID2= 2 ( 0003): 17.47    1.712    12.17    38.62
=====
ID = 3 ( 0005):  22.57    2.574    12.17    42.33

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| ADD HYD ( 0005) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0005): 22.57    2.574    12.17    42.33
+ ID2= 2 ( 0004):  2.03    0.116    12.33    23.21
=====
ID = 1 ( 0005):  24.60    2.663    12.17    40.75

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| CALIB |
| STANDHYD ( 0006) | Area (ha)= 1.66
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	1.25	0.42
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	105.20	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.04	0.167	0.00	6.333	0.98	12.500	8.29	18.67
1.04	0.333	0.32	6.500	1.04	12.667	8.29	18.83
1.04	0.500	0.63	6.667	1.04	12.833	6.28	19.00
1.04	0.667	0.63	6.833	1.04	13.000	4.26	19.17
1.04	0.833	0.63	7.000	1.04	13.167	4.26	19.33
1.04	1.000	0.63	7.167	1.04	13.333	3.69	19.50
1.04	1.167	0.63	7.333	1.15	13.500	3.11	19.67
1.04	1.333	0.63	7.500	1.27	13.667	3.11	19.83
1.04	1.500	0.63	7.667	1.27	13.833	2.76	20.00
1.04	1.667	0.63	7.833	1.27	14.000	2.42	20.17
0.86	1.833	0.63	8.000	1.27	14.167	2.42	20.33
0.69	2.000	0.63	8.167	1.27	14.333	2.07	20.50
0.69	2.167	0.63	8.333	1.38	14.500	1.73	20.67
0.69	2.333	0.69	8.500	1.50	14.667	1.73	20.83
0.69	2.500	0.75	8.667	1.50	14.833	1.73	21.00
0.69	2.667	0.75	8.833	1.56	15.000	1.73	21.17
0.69	2.833	0.75	9.000	1.61	15.167	1.73	21.33
0.69	3.000	0.75	9.167	1.61	15.333	1.73	21.50
0.69	3.167	0.75	9.333	1.73	15.500	1.73	21.67
0.69	3.333	0.75	9.500	1.84	15.667	1.73	21.83
0.69	3.500	0.75	9.667	1.84	15.833	1.73	22.00
0.69	3.667	0.75	9.833	1.96	16.000	1.73	22.17
0.69	3.833	0.75	10.000	2.07	16.167	1.73	22.33

0.69	4.000	0.75	10.167	2.07	16.333	1.38	22.50
0.69	4.167	0.75	10.333	2.36	16.500	1.04	22.67
0.69	4.333	0.84	10.500	2.65	16.667	1.04	22.83
0.69	4.500	0.92	10.667	2.65	16.833	1.04	23.00
0.69	4.667	0.92	10.833	3.11	17.000	1.04	23.17
0.69	4.833	0.92	11.000	3.57	17.167	1.04	23.33
0.69	5.000	0.92	11.167	3.57	17.333	1.04	23.50
0.69	5.167	0.92	11.333	4.55	17.500	1.04	23.67
0.69	5.333	0.92	11.500	5.53	17.667	1.04	23.83
0.69	5.500	0.92	11.667	5.53	17.833	1.04	24.00
0.69	5.667	0.92	11.833	11.29	18.000	1.04	24.17
0.69	5.833	0.92	12.000	17.05	18.167	1.04	24.33
0.35	6.000	0.92	12.167	70.50	18.333	1.04	
	6.167	0.92	12.333	39.40	18.500	1.04	

Max.Eff.Inten.(mm/hr)= 70.50 109.93
over (min) 10.00 10.00
Storage Coeff. (min)= 3.03 (ii) 9.82 (ii)
Unit Hyd. Tpeak (min)= 10.00 10.00
Unit Hyd. peak (cms)= 0.16 0.11

PEAK FLOW (cms)= 0.16 0.09 0.247 (iii)
TIME TO PEAK (hrs)= 12.17 12.17 12.17
RUNOFF VOLUME (mm)= 56.60 40.77 48.68
TOTAL RAINFALL (mm)= 57.60 57.60 57.60
RUNOFF COEFFICIENT = 0.98 0.71 0.85

* TOTALS*

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| ADD HYD (0007) |
1 + 2 = 3

AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)

```

ID1= 1 ( 0005):    24.60    2.663    12.17    40.75
+ ID2= 2 ( 0006):    1.66    0.247    12.17    48.68
=====
ID = 3 ( 0007):    26.26    2.910    12.17    41.25

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0008) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min    |
-----
          OUTFLOW    STORAGE    |    OUTFLOW    STORAGE
          (cms)      (ha.m.)    |    (cms)      (ha.m.)
          0.0000    0.0000    |    1.1580    1.0970
          0.1870    0.6751    |    1.5470    1.2310
          0.5060    0.8381    |    2.1510    1.3219
          0.7820    0.9953    |    0.0000    0.0000

          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
INFLOW : ID= 2 ( 0007)  26.260    2.910    12.17    41.25
OUTFLOW: ID= 1 ( 0008)  26.260    0.183    13.83    41.22

```

```

          PEAK FLOW REDUCTION [Qout/Qin] (%)= 6.29
          TIME SHIFT OF PEAK FLOW (min)=100.00
          MAXIMUM STORAGE USED (ha.m.)= 0.6612

```

POST-DEVELOPMENT MODEL

=====

```

V   V   I   SSSSS U   U   A   L           (v 6.2.2010)
V   V   I   SS    U   U   A A   L
V   V   I   SS    U   U   AAAAA L
V   V   I   SS    U   U   A   A   L
VV    I   SSSSS UUUUU A   A   LLLLL

```

```

OOO   TTTTT TTTTT H   H   Y   Y   M   M   OOO   TM
O   O   T     T   H   H   Y Y   MM MM O   O
O   O   T     T   H   H   Y   M   M   O   O
OOO   T     T   H   H   Y   M   M   OOO

```

Developed and Distributed by Smart City Water Inc
 Copyright 2007 - 2021 Smart City Water Inc
 All rights reserved.

***** D E T A I L E D O U T P U T *****

```

*****
** SIMULATION : Malton Rainfall Data-5yr 24hr **
*****

```

```

-----
|   READ STORM   |   Filename: C:\Users\shuchi\AppData
|                 |   ata\Local\Temp\
|                 |   84b8a492-9782-4cfd-b409-
| bfb60ba4c411\67d09d63 |
| Ptotal= 74.40 mm |   Comments: Malton Rainfall Data-5yr 24hr 15min SCS
-----

```

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.34	0.00	0.00	6.25	1.34	12.50	10.71	18.75
1.34	0.25	0.82	6.50	1.34	12.75	5.51	19.00
1.34	0.50	0.82	6.75	1.34	13.00	5.51	19.25
1.34	0.75	0.82	7.00	1.34	13.25	4.02	19.50
1.34	1.00	0.82	7.25	1.64	13.50	4.02	19.75
1.34	1.25	0.82	7.50	1.64	13.75	3.12	20.00
0.89	1.50	0.82	7.75	1.64	14.00	3.12	20.25
0.89	1.75	0.82	8.00	1.64	14.25	2.23	20.50

1.34	0.500	0.82 6.667	1.34 12.833	8.11 19.00
1.34	0.667	0.82 6.833	1.34 13.000	5.51 19.17
1.34	0.833	0.82 7.000	1.34 13.167	5.51 19.33
1.34	1.000	0.82 7.167	1.34 13.333	4.76 19.50
1.34	1.167	0.82 7.333	1.49 13.500	4.02 19.67
1.34	1.333	0.82 7.500	1.64 13.667	4.02 19.83
1.34	1.500	0.82 7.667	1.64 13.833	3.57 20.00
1.34	1.667	0.82 7.833	1.64 14.000	3.12 20.17
1.34	1.833	0.82 8.000	1.64 14.167	3.12 20.33
1.12	2.000	0.82 8.167	1.64 14.333	2.68 20.50
0.89	2.167	0.82 8.333	1.79 14.500	2.23 20.67
0.89	2.333	0.89 8.500	1.93 14.667	2.23 20.83
0.89	2.500	0.97 8.667	1.93 14.833	2.23 21.00
0.89	2.667	0.97 8.833	2.01 15.000	2.23 21.17
0.89	2.833	0.97 9.000	2.08 15.167	2.23 21.33
0.89	3.000	0.97 9.167	2.08 15.333	2.23 21.50
0.89	3.167	0.97 9.333	2.23 15.500	2.23 21.67
0.89	3.333	0.97 9.500	2.38 15.667	2.23 21.83
0.89	3.500	0.97 9.667	2.38 15.833	2.23 22.00
0.89	3.667	0.97 9.833	2.53 16.000	2.23 22.17
0.89	3.833	0.97 10.000	2.68 16.167	2.23 22.33
0.89	4.000	0.97 10.167	2.68 16.333	1.79 22.50
0.89	4.167	0.97 10.333	3.05 16.500	1.34 22.67
0.89	4.333	1.08 10.500	3.42 16.667	1.34 22.83
0.89	4.500	1.19 10.667	3.42 16.833	1.34 23.00
0.89	4.667	1.19 10.833	4.02 17.000	1.34 23.17
0.89	4.833	1.19 11.000	4.61 17.167	1.34 23.33

0.89	5.000	1.19	11.167	4.61	17.333	1.34	23.50
0.89	5.167	1.19	11.333	5.88	17.500	1.34	23.67
0.89	5.333	1.19	11.500	7.14	17.667	1.34	23.83
0.89	5.500	1.19	11.667	7.14	17.833	1.34	24.00
0.89	5.667	1.19	11.833	14.58	18.000	1.34	24.17
0.89	5.833	1.19	12.000	22.02	18.167	1.34	24.33
0.45	6.000	1.19	12.167	91.07	18.333	1.34	
	6.167	1.19	12.333	50.89	18.500	1.34	

Unit Hyd Qpeak (cms)= 1.090

PEAK FLOW (cms)= 0.218 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 19.587
 TOTAL RAINFALL (mm)= 74.400
 RUNOFF COEFFICIENT = 0.263

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0001) | Area (ha)= 8.99
 | ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	5.39	3.60
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	244.81	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.34	0.167	0.00	6.333	1.26	12.500	10.71	18.67
1.34	0.333	0.41	6.500	1.34	12.667	10.71	18.83
1.34	0.500	0.82	6.667	1.34	12.833	8.11	19.00

1.34	0.667	0.82 6.833	1.34 13.000	5.51 19.17
1.34	0.833	0.82 7.000	1.34 13.167	5.51 19.33
1.34	1.000	0.82 7.167	1.34 13.333	4.76 19.50
1.34	1.167	0.82 7.333	1.49 13.500	4.02 19.67
1.34	1.333	0.82 7.500	1.64 13.667	4.02 19.83
1.34	1.500	0.82 7.667	1.64 13.833	3.57 20.00
1.34	1.667	0.82 7.833	1.64 14.000	3.12 20.17
1.34	1.833	0.82 8.000	1.64 14.167	3.12 20.33
1.12	2.000	0.82 8.167	1.64 14.333	2.68 20.50
0.89	2.167	0.82 8.333	1.79 14.500	2.23 20.67
0.89	2.333	0.89 8.500	1.93 14.667	2.23 20.83
0.89	2.500	0.97 8.667	1.93 14.833	2.23 21.00
0.89	2.667	0.97 8.833	2.01 15.000	2.23 21.17
0.89	2.833	0.97 9.000	2.08 15.167	2.23 21.33
0.89	3.000	0.97 9.167	2.08 15.333	2.23 21.50
0.89	3.167	0.97 9.333	2.23 15.500	2.23 21.67
0.89	3.333	0.97 9.500	2.38 15.667	2.23 21.83
0.89	3.500	0.97 9.667	2.38 15.833	2.23 22.00
0.89	3.667	0.97 9.833	2.53 16.000	2.23 22.17
0.89	3.833	0.97 10.000	2.68 16.167	2.23 22.33
0.89	4.000	0.97 10.167	2.68 16.333	1.79 22.50
0.89	4.167	0.97 10.333	3.05 16.500	1.34 22.67
0.89	4.333	1.08 10.500	3.42 16.667	1.34 22.83
0.89	4.500	1.19 10.667	3.42 16.833	1.34 23.00
0.89	4.667	1.19 10.833	4.02 17.000	1.34 23.17
0.89	4.833	1.19 11.000	4.61 17.167	1.34 23.33
0.89	5.000	1.19 11.167	4.61 17.333	1.34 23.50

0.89	5.167	1.19	11.333	5.88	17.500	1.34	23.67
0.89	5.333	1.19	11.500	7.14	17.667	1.34	23.83
0.89	5.500	1.19	11.667	7.14	17.833	1.34	24.00
0.89	5.667	1.19	11.833	14.58	18.000	1.34	24.17
0.89	5.833	1.19	12.000	22.02	18.167	1.34	24.33
0.45	6.000	1.19	12.167	91.07	18.333	1.34	
	6.167	1.19	12.333	50.89	18.500	1.34	

Max.Eff.Inten. (mm/hr)=	91.07	82.54	
over (min)	10.00	20.00	
Storage Coeff. (min)=	4.54 (ii)	12.16 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.15	0.07	
			* TOTALS*
PEAK FLOW (cms)=	1.04	0.52	1.326 (iii)
TIME TO PEAK (hrs)=	12.17	12.33	12.17
RUNOFF VOLUME (mm)=	73.40	49.13	61.26
TOTAL RAINFALL (mm)=	74.40	74.40	74.40
RUNOFF COEFFICIENT =	0.99	0.66	0.82

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| STANDHYD ( 0009) | Area (ha)= 4.20
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	3.36	0.84
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	167.33	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
RAIN      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME

```

mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.167	0.00	6.333	1.26	12.500	10.71	18.67
1.34	0.333	0.41	6.500	1.34	12.667	10.71	18.83
1.34	0.500	0.82	6.667	1.34	12.833	8.11	19.00
1.34	0.667	0.82	6.833	1.34	13.000	5.51	19.17
1.34	0.833	0.82	7.000	1.34	13.167	5.51	19.33
1.34	1.000	0.82	7.167	1.34	13.333	4.76	19.50
1.34	1.167	0.82	7.333	1.49	13.500	4.02	19.67
1.34	1.333	0.82	7.500	1.64	13.667	4.02	19.83
1.34	1.500	0.82	7.667	1.64	13.833	3.57	20.00
1.34	1.667	0.82	7.833	1.64	14.000	3.12	20.17
1.34	1.833	0.82	8.000	1.64	14.167	3.12	20.33
1.12	2.000	0.82	8.167	1.64	14.333	2.68	20.50
0.89	2.167	0.82	8.333	1.79	14.500	2.23	20.67
0.89	2.333	0.89	8.500	1.93	14.667	2.23	20.83
0.89	2.500	0.97	8.667	1.93	14.833	2.23	21.00
0.89	2.667	0.97	8.833	2.01	15.000	2.23	21.17
0.89	2.833	0.97	9.000	2.08	15.167	2.23	21.33
0.89	3.000	0.97	9.167	2.08	15.333	2.23	21.50
0.89	3.167	0.97	9.333	2.23	15.500	2.23	21.67
0.89	3.333	0.97	9.500	2.38	15.667	2.23	21.83
0.89	3.500	0.97	9.667	2.38	15.833	2.23	22.00
0.89	3.667	0.97	9.833	2.53	16.000	2.23	22.17
0.89	3.833	0.97	10.000	2.68	16.167	2.23	22.33
0.89	4.000	0.97	10.167	2.68	16.333	1.79	22.50
0.89	4.167	0.97	10.333	3.05	16.500	1.34	22.67
0.89	4.333	1.08	10.500	3.42	16.667	1.34	22.83

0.89	4.500	1.19	10.667	3.42	16.833	1.34	23.00
0.89	4.667	1.19	10.833	4.02	17.000	1.34	23.17
0.89	4.833	1.19	11.000	4.61	17.167	1.34	23.33
0.89	5.000	1.19	11.167	4.61	17.333	1.34	23.50
0.89	5.167	1.19	11.333	5.88	17.500	1.34	23.67
0.89	5.333	1.19	11.500	7.14	17.667	1.34	23.83
0.89	5.500	1.19	11.667	7.14	17.833	1.34	24.00
0.89	5.667	1.19	11.833	14.58	18.000	1.34	24.17
0.89	5.833	1.19	12.000	22.02	18.167	1.34	24.33
0.45	6.000	1.19	12.167	91.07	18.333	1.34	
	6.167	1.19	12.333	50.89	18.500	1.34	

Max.Eff.Inten.(mm/hr)= 91.07 82.54
over (min) 10.00 20.00
Storage Coeff. (min)= 3.61 (ii) 11.23 (ii)
Unit Hyd. Tpeak (min)= 10.00 20.00
Unit Hyd. peak (cms)= 0.16 0.08

* TOTALS*
PEAK FLOW (cms)= 0.76 0.12 0.827 (iii)
TIME TO PEAK (hrs)= 12.17 12.33 12.17
RUNOFF VOLUME (mm)= 73.40 49.13 67.33
TOTAL RAINFALL (mm)= 74.40 74.40 74.40
RUNOFF COEFFICIENT = 0.99 0.66 0.90

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0003) |
| 1 + 2 = 3 |
-----

```

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 1 (0001):	8.99	1.326	12.17	61.26
+ ID2= 2 (0002):	4.28	0.218	12.33	19.59
=====				
ID = 3 (0003):	13.27	1.524	12.17	47.82

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0003) |
| 3 + 2 = 1 |
-----
AREA      QPEAK      TPEAK      R.V.
  (ha)    (cms)     (hrs)     (mm)
ID1= 3 ( 0003):  13.27  1.524   12.17   47.82
+ ID2= 2 ( 0009):   4.20  0.827   12.17   67.33
=====
ID = 1 ( 0003):   17.47  2.351   12.17   52.51

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| CALIB |
| NASHYD ( 0004) | Area (ha)= 2.03 Curve Number (CN)= 80.0
| ID= 1 DT=10.0 min | Ia (mm)= 5.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.20

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
  hrs     mm/hr |  hrs     mm/hr |  hrs     mm/hr |  hrs
mm/hr
0.167     0.00 | 6.333     1.26 |12.500     10.71 | 18.67
1.34
0.333     0.41 | 6.500     1.34 |12.667     10.71 | 18.83
1.34
0.500     0.82 | 6.667     1.34 |12.833      8.11 | 19.00
1.34
0.667     0.82 | 6.833     1.34 |13.000      5.51 | 19.17
1.34
0.833     0.82 | 7.000     1.34 |13.167      5.51 | 19.33
1.34
1.000     0.82 | 7.167     1.34 |13.333      4.76 | 19.50
1.34
1.167     0.82 | 7.333     1.49 |13.500      4.02 | 19.67
1.34
1.333     0.82 | 7.500     1.64 |13.667      4.02 | 19.83
1.34
1.500     0.82 | 7.667     1.64 |13.833      3.57 | 20.00
1.34
1.667     0.82 | 7.833     1.64 |14.000      3.12 | 20.17
1.34
1.833     0.82 | 8.000     1.64 |14.167      3.12 | 20.33
1.12
2.000     0.82 | 8.167     1.64 |14.333      2.68 | 20.50
0.89

```

0.89	2.167	0.82	8.333	1.79	14.500	2.23	20.67
0.89	2.333	0.89	8.500	1.93	14.667	2.23	20.83
0.89	2.500	0.97	8.667	1.93	14.833	2.23	21.00
0.89	2.667	0.97	8.833	2.01	15.000	2.23	21.17
0.89	2.833	0.97	9.000	2.08	15.167	2.23	21.33
0.89	3.000	0.97	9.167	2.08	15.333	2.23	21.50
0.89	3.167	0.97	9.333	2.23	15.500	2.23	21.67
0.89	3.333	0.97	9.500	2.38	15.667	2.23	21.83
0.89	3.500	0.97	9.667	2.38	15.833	2.23	22.00
0.89	3.667	0.97	9.833	2.53	16.000	2.23	22.17
0.89	3.833	0.97	10.000	2.68	16.167	2.23	22.33
0.89	4.000	0.97	10.167	2.68	16.333	1.79	22.50
0.89	4.167	0.97	10.333	3.05	16.500	1.34	22.67
0.89	4.333	1.08	10.500	3.42	16.667	1.34	22.83
0.89	4.500	1.19	10.667	3.42	16.833	1.34	23.00
0.89	4.667	1.19	10.833	4.02	17.000	1.34	23.17
0.89	4.833	1.19	11.000	4.61	17.167	1.34	23.33
0.89	5.000	1.19	11.167	4.61	17.333	1.34	23.50
0.89	5.167	1.19	11.333	5.88	17.500	1.34	23.67
0.89	5.333	1.19	11.500	7.14	17.667	1.34	23.83
0.89	5.500	1.19	11.667	7.14	17.833	1.34	24.00
0.89	5.667	1.19	11.833	14.58	18.000	1.34	24.17
0.89	5.833	1.19	12.000	22.02	18.167	1.34	24.33
0.45	6.000	1.19	12.167	91.07	18.333	1.34	
	6.167	1.19	12.333	50.89	18.500	1.34	

Unit Hyd Qpeak (cms)= 0.388

PEAK FLOW (cms)= 0.177 (i)

TIME TO PEAK (hrs)= 12.333

RUNOFF VOLUME (mm)= 35.299

TOTAL RAINFALL (mm)= 74.400
 RUNOFF COEFFICIENT = 0.474

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB          |
| STANDHYD ( 0010) | Area (ha)= 5.10
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00
-----
  
```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	4.84	0.26
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	184.39	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
RAIN          hrs  mm/hr | hrs  mm/hr | hrs  mm/hr | hrs
mm/hr
0.167      0.00 | 6.333      1.26 |12.500      10.71 | 18.67
1.34
0.333      0.41 | 6.500      1.34 |12.667      10.71 | 18.83
1.34
0.500      0.82 | 6.667      1.34 |12.833       8.11 | 19.00
1.34
0.667      0.82 | 6.833      1.34 |13.000       5.51 | 19.17
1.34
0.833      0.82 | 7.000      1.34 |13.167       5.51 | 19.33
1.34
1.000      0.82 | 7.167      1.34 |13.333       4.76 | 19.50
1.34
1.167      0.82 | 7.333      1.49 |13.500       4.02 | 19.67
1.34
1.333      0.82 | 7.500      1.64 |13.667       4.02 | 19.83
1.34
1.500      0.82 | 7.667      1.64 |13.833       3.57 | 20.00
1.34
1.667      0.82 | 7.833      1.64 |14.000       3.12 | 20.17
1.34
1.833      0.82 | 8.000      1.64 |14.167       3.12 | 20.33
1.12
2.000      0.82 | 8.167      1.64 |14.333       2.68 | 20.50
0.89
2.167      0.82 | 8.333      1.79 |14.500       2.23 | 20.67
0.89
  
```

0.89	2.333	0.89 8.500	1.93 14.667	2.23 20.83
0.89	2.500	0.97 8.667	1.93 14.833	2.23 21.00
0.89	2.667	0.97 8.833	2.01 15.000	2.23 21.17
0.89	2.833	0.97 9.000	2.08 15.167	2.23 21.33
0.89	3.000	0.97 9.167	2.08 15.333	2.23 21.50
0.89	3.167	0.97 9.333	2.23 15.500	2.23 21.67
0.89	3.333	0.97 9.500	2.38 15.667	2.23 21.83
0.89	3.500	0.97 9.667	2.38 15.833	2.23 22.00
0.89	3.667	0.97 9.833	2.53 16.000	2.23 22.17
0.89	3.833	0.97 10.000	2.68 16.167	2.23 22.33
0.89	4.000	0.97 10.167	2.68 16.333	1.79 22.50
0.89	4.167	0.97 10.333	3.05 16.500	1.34 22.67
0.89	4.333	1.08 10.500	3.42 16.667	1.34 22.83
0.89	4.500	1.19 10.667	3.42 16.833	1.34 23.00
0.89	4.667	1.19 10.833	4.02 17.000	1.34 23.17
0.89	4.833	1.19 11.000	4.61 17.167	1.34 23.33
0.89	5.000	1.19 11.167	4.61 17.333	1.34 23.50
0.89	5.167	1.19 11.333	5.88 17.500	1.34 23.67
0.89	5.333	1.19 11.500	7.14 17.667	1.34 23.83
0.89	5.500	1.19 11.667	7.14 17.833	1.34 24.00
0.89	5.667	1.19 11.833	14.58 18.000	1.34 24.17
0.89	5.833	1.19 12.000	22.02 18.167	1.34 24.33
0.45	6.000	1.19 12.167	91.07 18.333	1.34
	6.167	1.19 12.333	50.89 18.500	1.34

Max.Eff.Inten. (mm/hr)=	91.07	152.21
over (min)	10.00	10.00
Storage Coeff. (min)=	3.83 (ii)	9.79 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	0.16	0.11

PEAK FLOW (cms)=	1.10	0.08	* TOTALS*
			1.172 (iii)

TIME TO PEAK	(hrs)=	12.17	12.17	12.17
RUNOFF VOLUME	(mm)=	73.40	56.47	71.71
TOTAL RAINFALL	(mm)=	74.40	74.40	74.40
RUNOFF COEFFICIENT	=	0.99	0.76	0.96

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0010):  5.10    1.172    12.17    71.71
+ ID2= 2 ( 0003): 17.47    2.351    12.17    52.51
=====
ID = 3 ( 0005):  22.57    3.523    12.17    56.85

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| ADD HYD ( 0005) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0005): 22.57    3.523    12.17    56.85
+ ID2= 2 ( 0004):  2.03    0.177    12.33    35.30
=====
ID = 1 ( 0005):  24.60    3.664    12.17    55.07

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| CALIB |
| STANDHYD ( 0006) | Area (ha)= 1.66
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	1.25	0.42
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	105.20	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.34	0.167	0.00	6.333	1.26	12.500	10.71	18.67
1.34	0.333	0.41	6.500	1.34	12.667	10.71	18.83
1.34	0.500	0.82	6.667	1.34	12.833	8.11	19.00
1.34	0.667	0.82	6.833	1.34	13.000	5.51	19.17
1.34	0.833	0.82	7.000	1.34	13.167	5.51	19.33
1.34	1.000	0.82	7.167	1.34	13.333	4.76	19.50
1.34	1.167	0.82	7.333	1.49	13.500	4.02	19.67
1.34	1.333	0.82	7.500	1.64	13.667	4.02	19.83
1.34	1.500	0.82	7.667	1.64	13.833	3.57	20.00
1.34	1.667	0.82	7.833	1.64	14.000	3.12	20.17
1.12	1.833	0.82	8.000	1.64	14.167	3.12	20.33
0.89	2.000	0.82	8.167	1.64	14.333	2.68	20.50
0.89	2.167	0.82	8.333	1.79	14.500	2.23	20.67
0.89	2.333	0.89	8.500	1.93	14.667	2.23	20.83
0.89	2.500	0.97	8.667	1.93	14.833	2.23	21.00
0.89	2.667	0.97	8.833	2.01	15.000	2.23	21.17
0.89	2.833	0.97	9.000	2.08	15.167	2.23	21.33
0.89	3.000	0.97	9.167	2.08	15.333	2.23	21.50
0.89	3.167	0.97	9.333	2.23	15.500	2.23	21.67
0.89	3.333	0.97	9.500	2.38	15.667	2.23	21.83
0.89	3.500	0.97	9.667	2.38	15.833	2.23	22.00
0.89	3.667	0.97	9.833	2.53	16.000	2.23	22.17
0.89	3.833	0.97	10.000	2.68	16.167	2.23	22.33

0.89	4.000	0.97	10.167	2.68	16.333	1.79	22.50
0.89	4.167	0.97	10.333	3.05	16.500	1.34	22.67
0.89	4.333	1.08	10.500	3.42	16.667	1.34	22.83
0.89	4.500	1.19	10.667	3.42	16.833	1.34	23.00
0.89	4.667	1.19	10.833	4.02	17.000	1.34	23.17
0.89	4.833	1.19	11.000	4.61	17.167	1.34	23.33
0.89	5.000	1.19	11.167	4.61	17.333	1.34	23.50
0.89	5.167	1.19	11.333	5.88	17.500	1.34	23.67
0.89	5.333	1.19	11.500	7.14	17.667	1.34	23.83
0.89	5.500	1.19	11.667	7.14	17.833	1.34	24.00
0.89	5.667	1.19	11.833	14.58	18.000	1.34	24.17
0.89	5.833	1.19	12.000	22.02	18.167	1.34	24.33
0.45	6.000	1.19	12.167	91.07	18.333	1.34	
	6.167	1.19	12.333	50.89	18.500	1.34	

Max.Eff.Inten. (mm/hr)=	91.07	152.21	
over (min)	10.00	10.00	
Storage Coeff. (min)=	2.73 (ii)	8.70 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.17	0.12	
			* TOTALS*
PEAK FLOW (cms)=	0.21	0.13	0.336 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	73.40	56.47	64.93
TOTAL RAINFALL (mm)=	74.40	74.40	74.40
RUNOFF COEFFICIENT =	0.99	0.76	0.87

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | ADD HYD (0007) |
1 + 2 = 3

AREA	QPEAK	TPEAK	R.V.
(ha)	(cms)	(hrs)	(mm)

```

ID1= 1 ( 0005):    24.60    3.664    12.17    55.07
+ ID2= 2 ( 0006):    1.66    0.336    12.17    64.93
=====
ID = 3 ( 0007):    26.26    4.000    12.17    55.69

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0008) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min    |
-----
      OUTFLOW    STORAGE    |    OUTFLOW    STORAGE
      (cms)      (ha.m.)    |    (cms)      (ha.m.)
      0.0000    0.0000    |    1.1580    1.0970
      0.1870    0.6751    |    1.5470    1.2310
      0.5060    0.8381    |    2.1510    1.3219
      0.7820    0.9953    |    0.0000    0.0000

```

```

              AREA      QPEAK      TPEAK      R.V.
              (ha)      (cms)      (hrs)      (mm)
INFLOW : ID= 2 ( 0007)  26.260      4.000      12.17      55.69
OUTFLOW: ID= 1 ( 0008)  26.260      0.489      13.00      55.66

```

```

PEAK FLOW REDUCTION [Qout/Qin] (%)= 12.24
TIME SHIFT OF PEAK FLOW (min)= 50.00
MAXIMUM STORAGE USED (ha.m.)= 0.8312

```

POST-DEVELOPMENT MODEL

=====

```

V   V   I   SSSSS U   U   A   L           (v 6.2.2010)
V   V   I   SS    U   U   A A  L
V   V   I   SS    U   U   AAAAA L
V   V   I   SS    U   U   A   A  L
VV    I   SSSSS UUUUU A   A  LLLLL

```

```

OOO   TTTTT TTTTT H   H   Y   Y   M   M   OOO   TM
O   O   T     T   H   H   Y Y   MM MM  O   O
O   O   T     T   H   H   Y   M   M   O   O
OOO   T     T   H   H   Y   M   M   OOO

```

Developed and Distributed by Smart City Water Inc
 Copyright 2007 - 2021 Smart City Water Inc
 All rights reserved.

***** D E T A I L E D O U T P U T *****

```

*****
** SIMULATION : Malton Rainfall Data-10yr 24h **
*****

```

```

-----
|   READ STORM   |   Filename: C:\Users\shuchi\AppData
|                 |   ata\Local\Temp\
|                 |   84b8a492-9782-4cfd-b409-
|                 |   bfb60ba4c411\75d7fb9b
| Ptotal= 86.40 mm |   Comments: Malton Rainfall Data-10yr 24hr 15min SCS
-----

```

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
mm/hr							
1.56	0.00	0.00	6.25	1.56	12.50	12.44	18.75
1.56	0.25	0.95	6.50	1.56	12.75	6.39	19.00
1.56	0.50	0.95	6.75	1.56	13.00	6.39	19.25
1.56	0.75	0.95	7.00	1.56	13.25	4.67	19.50
1.56	1.00	0.95	7.25	1.90	13.50	4.67	19.75
1.56	1.25	0.95	7.50	1.90	13.75	3.63	20.00
1.04	1.50	0.95	7.75	1.90	14.00	3.63	20.25
1.04	1.75	0.95	8.00	1.90	14.25	2.59	20.50

1.04	2.00	0.95		8.25	2.25		14.50	2.59		20.75
1.04	2.25	1.12		8.50	2.25		14.75	2.59		21.00
1.04	2.50	1.12		8.75	2.42		15.00	2.59		21.25
1.04	2.75	1.12		9.00	2.42		15.25	2.59		21.50
1.04	3.00	1.12		9.25	2.76		15.50	2.59		21.75
1.04	3.25	1.12		9.50	2.76		15.75	2.59		22.00
1.04	3.50	1.12		9.75	3.11		16.00	2.59		22.25
1.04	3.75	1.12		10.00	3.11		16.25	1.56		22.50
1.04	4.00	1.12		10.25	3.97		16.50	1.56		22.75
1.04	4.25	1.38		10.50	3.97		16.75	1.56		23.00
1.04	4.50	1.38		10.75	5.36		17.00	1.56		23.25
1.04	4.75	1.38		11.00	5.36		17.25	1.56		23.50
1.04	5.00	1.38		11.25	8.29		17.50	1.56		23.75
1.04	5.25	1.38		11.50	8.29		17.75	1.56		24.00
	5.50	1.38		11.75	25.57		18.00	1.56		
	5.75	1.38		12.00	105.75		18.25	1.56		
	6.00	1.38		12.25	12.44		18.50	1.56		


```

-----
| CALIB |
| NASHYD ( 0002) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.15

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN		TIME	RAIN		TIME	RAIN		TIME
	hrs	mm/hr		hrs	mm/hr		hrs	mm/hr		hrs
1.56	0.167	0.00		6.333	1.47		12.500	12.44		18.67
1.56	0.333	0.48		6.500	1.56		12.667	12.44		18.83

1.56	0.500	0.95 6.667	1.56 12.833	9.42 19.00
1.56	0.667	0.95 6.833	1.56 13.000	6.39 19.17
1.56	0.833	0.95 7.000	1.56 13.167	6.39 19.33
1.56	1.000	0.95 7.167	1.56 13.333	5.53 19.50
1.56	1.167	0.95 7.333	1.73 13.500	4.67 19.67
1.56	1.333	0.95 7.500	1.90 13.667	4.67 19.83
1.56	1.500	0.95 7.667	1.90 13.833	4.15 20.00
1.56	1.667	0.95 7.833	1.90 14.000	3.63 20.17
1.56	1.833	0.95 8.000	1.90 14.167	3.63 20.33
1.30	2.000	0.95 8.167	1.90 14.333	3.11 20.50
1.04	2.167	0.95 8.333	2.07 14.500	2.59 20.67
1.04	2.333	1.04 8.500	2.25 14.667	2.59 20.83
1.04	2.500	1.12 8.667	2.25 14.833	2.59 21.00
1.04	2.667	1.12 8.833	2.33 15.000	2.59 21.17
1.04	2.833	1.12 9.000	2.42 15.167	2.59 21.33
1.04	3.000	1.12 9.167	2.42 15.333	2.59 21.50
1.04	3.167	1.12 9.333	2.59 15.500	2.59 21.67
1.04	3.333	1.12 9.500	2.76 15.667	2.59 21.83
1.04	3.500	1.12 9.667	2.76 15.833	2.59 22.00
1.04	3.667	1.12 9.833	2.94 16.000	2.59 22.17
1.04	3.833	1.12 10.000	3.11 16.167	2.59 22.33
1.04	4.000	1.12 10.167	3.11 16.333	2.07 22.50
1.04	4.167	1.12 10.333	3.54 16.500	1.56 22.67
1.04	4.333	1.25 10.500	3.97 16.667	1.56 22.83
1.04	4.500	1.38 10.667	3.97 16.833	1.56 23.00
1.04	4.667	1.38 10.833	4.67 17.000	1.56 23.17
1.04	4.833	1.38 11.000	5.36 17.167	1.56 23.33

1.04	5.000	1.38	11.167	5.36	17.333	1.56	23.50
1.04	5.167	1.38	11.333	6.83	17.500	1.56	23.67
1.04	5.333	1.38	11.500	8.29	17.667	1.56	23.83
1.04	5.500	1.38	11.667	8.29	17.833	1.56	24.00
1.04	5.667	1.38	11.833	16.93	18.000	1.56	24.17
1.04	5.833	1.38	12.000	25.58	18.167	1.56	24.33
0.52	6.000	1.38	12.167	105.75	18.333	1.56	
	6.167	1.38	12.333	59.10	18.500	1.56	

Unit Hyd Qpeak (cms)= 1.090

PEAK FLOW (cms)= 0.288 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 25.826
 TOTAL RAINFALL (mm)= 86.400
 RUNOFF COEFFICIENT = 0.299

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0001) | Area (ha)= 8.99
 | ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	5.39	3.60
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	244.81	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.167	0.00	6.333	1.47	12.500	12.44	18.67
1.56	0.333	0.48	6.500	1.56	12.667	12.44	18.83
1.56	0.500	0.95	6.667	1.56	12.833	9.42	19.00
1.56							

1.56	0.667	0.95 6.833	1.56 13.000	6.39 19.17
1.56	0.833	0.95 7.000	1.56 13.167	6.39 19.33
1.56	1.000	0.95 7.167	1.56 13.333	5.53 19.50
1.56	1.167	0.95 7.333	1.73 13.500	4.67 19.67
1.56	1.333	0.95 7.500	1.90 13.667	4.67 19.83
1.56	1.500	0.95 7.667	1.90 13.833	4.15 20.00
1.56	1.667	0.95 7.833	1.90 14.000	3.63 20.17
1.56	1.833	0.95 8.000	1.90 14.167	3.63 20.33
1.30	2.000	0.95 8.167	1.90 14.333	3.11 20.50
1.04	2.167	0.95 8.333	2.07 14.500	2.59 20.67
1.04	2.333	1.04 8.500	2.25 14.667	2.59 20.83
1.04	2.500	1.12 8.667	2.25 14.833	2.59 21.00
1.04	2.667	1.12 8.833	2.33 15.000	2.59 21.17
1.04	2.833	1.12 9.000	2.42 15.167	2.59 21.33
1.04	3.000	1.12 9.167	2.42 15.333	2.59 21.50
1.04	3.167	1.12 9.333	2.59 15.500	2.59 21.67
1.04	3.333	1.12 9.500	2.76 15.667	2.59 21.83
1.04	3.500	1.12 9.667	2.76 15.833	2.59 22.00
1.04	3.667	1.12 9.833	2.94 16.000	2.59 22.17
1.04	3.833	1.12 10.000	3.11 16.167	2.59 22.33
1.04	4.000	1.12 10.167	3.11 16.333	2.07 22.50
1.04	4.167	1.12 10.333	3.54 16.500	1.56 22.67
1.04	4.333	1.25 10.500	3.97 16.667	1.56 22.83
1.04	4.500	1.38 10.667	3.97 16.833	1.56 23.00
1.04	4.667	1.38 10.833	4.67 17.000	1.56 23.17
1.04	4.833	1.38 11.000	5.36 17.167	1.56 23.33
1.04	5.000	1.38 11.167	5.36 17.333	1.56 23.50

1.04	5.167	1.38	11.333	6.83	17.500	1.56	23.67
1.04	5.333	1.38	11.500	8.29	17.667	1.56	23.83
1.04	5.500	1.38	11.667	8.29	17.833	1.56	24.00
1.04	5.667	1.38	11.833	16.93	18.000	1.56	24.17
0.52	5.833	1.38	12.000	25.58	18.167	1.56	24.33
	6.000	1.38	12.167	105.75	18.333	1.56	
	6.167	1.38	12.333	59.10	18.500	1.56	

Max.Eff.Inten. (mm/hr)=	105.75	100.98	
over (min)	10.00	20.00	
Storage Coeff. (min)=	4.27 (ii)	11.31 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.15	0.08	
			* TOTALS*
PEAK FLOW (cms)=	1.22	0.65	1.583 (iii)
TIME TO PEAK (hrs)=	12.17	12.33	12.17
RUNOFF VOLUME (mm)=	85.40	59.96	72.68
TOTAL RAINFALL (mm)=	86.40	86.40	86.40
RUNOFF COEFFICIENT =	0.99	0.69	0.84

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| STANDHYD ( 0009) | Area (ha)= 4.20
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	3.36	0.84
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	167.33	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
RAIN      TIME  RAIN | TIME  RAIN | TIME  RAIN | TIME

```

mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.167	0.00	6.333	1.47	12.500	12.44	18.67
1.56	0.333	0.48	6.500	1.56	12.667	12.44	18.83
1.56	0.500	0.95	6.667	1.56	12.833	9.42	19.00
1.56	0.667	0.95	6.833	1.56	13.000	6.39	19.17
1.56	0.833	0.95	7.000	1.56	13.167	6.39	19.33
1.56	1.000	0.95	7.167	1.56	13.333	5.53	19.50
1.56	1.167	0.95	7.333	1.73	13.500	4.67	19.67
1.56	1.333	0.95	7.500	1.90	13.667	4.67	19.83
1.56	1.500	0.95	7.667	1.90	13.833	4.15	20.00
1.56	1.667	0.95	7.833	1.90	14.000	3.63	20.17
1.56	1.833	0.95	8.000	1.90	14.167	3.63	20.33
1.30	2.000	0.95	8.167	1.90	14.333	3.11	20.50
1.04	2.167	0.95	8.333	2.07	14.500	2.59	20.67
1.04	2.333	1.04	8.500	2.25	14.667	2.59	20.83
1.04	2.500	1.12	8.667	2.25	14.833	2.59	21.00
1.04	2.667	1.12	8.833	2.33	15.000	2.59	21.17
1.04	2.833	1.12	9.000	2.42	15.167	2.59	21.33
1.04	3.000	1.12	9.167	2.42	15.333	2.59	21.50
1.04	3.167	1.12	9.333	2.59	15.500	2.59	21.67
1.04	3.333	1.12	9.500	2.76	15.667	2.59	21.83
1.04	3.500	1.12	9.667	2.76	15.833	2.59	22.00
1.04	3.667	1.12	9.833	2.94	16.000	2.59	22.17
1.04	3.833	1.12	10.000	3.11	16.167	2.59	22.33
1.04	4.000	1.12	10.167	3.11	16.333	2.07	22.50
1.04	4.167	1.12	10.333	3.54	16.500	1.56	22.67
1.04	4.333	1.25	10.500	3.97	16.667	1.56	22.83

1.04	4.500	1.38	10.667	3.97	16.833	1.56	23.00
1.04	4.667	1.38	10.833	4.67	17.000	1.56	23.17
1.04	4.833	1.38	11.000	5.36	17.167	1.56	23.33
1.04	5.000	1.38	11.167	5.36	17.333	1.56	23.50
1.04	5.167	1.38	11.333	6.83	17.500	1.56	23.67
1.04	5.333	1.38	11.500	8.29	17.667	1.56	23.83
1.04	5.500	1.38	11.667	8.29	17.833	1.56	24.00
1.04	5.667	1.38	11.833	16.93	18.000	1.56	24.17
1.04	5.833	1.38	12.000	25.58	18.167	1.56	24.33
0.52	6.000	1.38	12.167	105.75	18.333	1.56	
	6.167	1.38	12.333	59.10	18.500	1.56	

Max.Eff.Inten.(mm/hr)= 105.75 100.98
over (min) 10.00 20.00
Storage Coeff. (min)= 3.40 (ii) 10.43 (ii)
Unit Hyd. Tpeak (min)= 10.00 20.00
Unit Hyd. peak (cms)= 0.16 0.08

* TOTALS*
PEAK FLOW (cms)= 0.89 0.16 0.975 (iii)
TIME TO PEAK (hrs)= 12.17 12.33 12.17
RUNOFF VOLUME (mm)= 85.40 59.96 79.04
TOTAL RAINFALL (mm)= 86.40 86.40 86.40
RUNOFF COEFFICIENT = 0.99 0.69 0.91

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0003) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0001):  8.99      1.583      12.17      72.68
+ ID2= 2 ( 0002):  4.28      0.288      12.33      25.83
=====
ID = 3 ( 0003):  13.27      1.850      12.17      57.57

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0003) |
| 3 + 2 = 1 |
-----
AREA      QPEAK      TPEAK      R.V.
  (ha)    (cms)     (hrs)     (mm)
ID1= 3 ( 0003):  13.27  1.850   12.17   57.57
+ ID2= 2 ( 0009):   4.20  0.975   12.17   79.04
=====
ID = 1 ( 0003):   17.47  2.825   12.17   62.73

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| CALIB |
| NASHYD ( 0004) | Area (ha)= 2.03 Curve Number (CN)= 80.0
| ID= 1 DT=10.0 min | Ia (mm)= 5.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.20

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
  hrs     mm/hr |  hrs     mm/hr |  hrs     mm/hr |  hrs
mm/hr
0.167     0.00 | 6.333     1.47 |12.500     12.44 | 18.67
1.56
0.333     0.48 | 6.500     1.56 |12.667     12.44 | 18.83
1.56
0.500     0.95 | 6.667     1.56 |12.833     9.42 | 19.00
1.56
0.667     0.95 | 6.833     1.56 |13.000     6.39 | 19.17
1.56
0.833     0.95 | 7.000     1.56 |13.167     6.39 | 19.33
1.56
1.000     0.95 | 7.167     1.56 |13.333     5.53 | 19.50
1.56
1.167     0.95 | 7.333     1.73 |13.500     4.67 | 19.67
1.56
1.333     0.95 | 7.500     1.90 |13.667     4.67 | 19.83
1.56
1.500     0.95 | 7.667     1.90 |13.833     4.15 | 20.00
1.56
1.667     0.95 | 7.833     1.90 |14.000     3.63 | 20.17
1.56
1.833     0.95 | 8.000     1.90 |14.167     3.63 | 20.33
1.30
2.000     0.95 | 8.167     1.90 |14.333     3.11 | 20.50
1.04

```

1.04	2.167	0.95	8.333	2.07	14.500	2.59	20.67
1.04	2.333	1.04	8.500	2.25	14.667	2.59	20.83
1.04	2.500	1.12	8.667	2.25	14.833	2.59	21.00
1.04	2.667	1.12	8.833	2.33	15.000	2.59	21.17
1.04	2.833	1.12	9.000	2.42	15.167	2.59	21.33
1.04	3.000	1.12	9.167	2.42	15.333	2.59	21.50
1.04	3.167	1.12	9.333	2.59	15.500	2.59	21.67
1.04	3.333	1.12	9.500	2.76	15.667	2.59	21.83
1.04	3.500	1.12	9.667	2.76	15.833	2.59	22.00
1.04	3.667	1.12	9.833	2.94	16.000	2.59	22.17
1.04	3.833	1.12	10.000	3.11	16.167	2.59	22.33
1.04	4.000	1.12	10.167	3.11	16.333	2.07	22.50
1.04	4.167	1.12	10.333	3.54	16.500	1.56	22.67
1.04	4.333	1.25	10.500	3.97	16.667	1.56	22.83
1.04	4.500	1.38	10.667	3.97	16.833	1.56	23.00
1.04	4.667	1.38	10.833	4.67	17.000	1.56	23.17
1.04	4.833	1.38	11.000	5.36	17.167	1.56	23.33
1.04	5.000	1.38	11.167	5.36	17.333	1.56	23.50
1.04	5.167	1.38	11.333	6.83	17.500	1.56	23.67
1.04	5.333	1.38	11.500	8.29	17.667	1.56	23.83
1.04	5.500	1.38	11.667	8.29	17.833	1.56	24.00
1.04	5.667	1.38	11.833	16.93	18.000	1.56	24.17
1.04	5.833	1.38	12.000	25.58	18.167	1.56	24.33
0.52	6.000	1.38	12.167	105.75	18.333	1.56	
	6.167	1.38	12.333	59.10	18.500	1.56	

Unit Hyd Qpeak (cms)= 0.388

PEAK FLOW (cms)= 0.224 (i)

TIME TO PEAK (hrs)= 12.333

RUNOFF VOLUME (mm)= 44.539

TOTAL RAINFALL (mm)= 86.400
 RUNOFF COEFFICIENT = 0.516

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0010) | Area (ha)= 5.10
 | ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	4.84	0.26
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	184.39	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.167	0.00	6.333	1.47	12.500	12.44	18.67
1.56	0.333	0.48	6.500	1.56	12.667	12.44	18.83
1.56	0.500	0.95	6.667	1.56	12.833	9.42	19.00
1.56	0.667	0.95	6.833	1.56	13.000	6.39	19.17
1.56	0.833	0.95	7.000	1.56	13.167	6.39	19.33
1.56	1.000	0.95	7.167	1.56	13.333	5.53	19.50
1.56	1.167	0.95	7.333	1.73	13.500	4.67	19.67
1.56	1.333	0.95	7.500	1.90	13.667	4.67	19.83
1.56	1.500	0.95	7.667	1.90	13.833	4.15	20.00
1.56	1.667	0.95	7.833	1.90	14.000	3.63	20.17
1.56	1.833	0.95	8.000	1.90	14.167	3.63	20.33
1.30	2.000	0.95	8.167	1.90	14.333	3.11	20.50
1.04	2.167	0.95	8.333	2.07	14.500	2.59	20.67
1.04							

1.04	2.333	1.04	8.500	2.25	14.667	2.59	20.83
1.04	2.500	1.12	8.667	2.25	14.833	2.59	21.00
1.04	2.667	1.12	8.833	2.33	15.000	2.59	21.17
1.04	2.833	1.12	9.000	2.42	15.167	2.59	21.33
1.04	3.000	1.12	9.167	2.42	15.333	2.59	21.50
1.04	3.167	1.12	9.333	2.59	15.500	2.59	21.67
1.04	3.333	1.12	9.500	2.76	15.667	2.59	21.83
1.04	3.500	1.12	9.667	2.76	15.833	2.59	22.00
1.04	3.667	1.12	9.833	2.94	16.000	2.59	22.17
1.04	3.833	1.12	10.000	3.11	16.167	2.59	22.33
1.04	4.000	1.12	10.167	3.11	16.333	2.07	22.50
1.04	4.167	1.12	10.333	3.54	16.500	1.56	22.67
1.04	4.333	1.25	10.500	3.97	16.667	1.56	22.83
1.04	4.500	1.38	10.667	3.97	16.833	1.56	23.00
1.04	4.667	1.38	10.833	4.67	17.000	1.56	23.17
1.04	4.833	1.38	11.000	5.36	17.167	1.56	23.33
1.04	5.000	1.38	11.167	5.36	17.333	1.56	23.50
1.04	5.167	1.38	11.333	6.83	17.500	1.56	23.67
1.04	5.333	1.38	11.500	8.29	17.667	1.56	23.83
1.04	5.500	1.38	11.667	8.29	17.833	1.56	24.00
1.04	5.667	1.38	11.833	16.93	18.000	1.56	24.17
1.04	5.833	1.38	12.000	25.58	18.167	1.56	24.33
0.52	6.000	1.38	12.167	105.75	18.333	1.56	
	6.167	1.38	12.333	59.10	18.500	1.56	

Max.Eff.Inten. (mm/hr)=	105.75	182.66
over (min)	10.00	10.00
Storage Coeff. (min)=	3.61 (ii)	9.15 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	0.16	0.11

PEAK FLOW (cms)=	1.28	0.09	* TOTALS*
			1.378 (iii)

TIME TO PEAK	(hrs)=	12.17	12.17	12.17
RUNOFF VOLUME	(mm)=	85.40	67.89	83.65
TOTAL RAINFALL	(mm)=	86.40	86.40	86.40
RUNOFF COEFFICIENT	=	0.99	0.79	0.97

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0010):  5.10    1.378    12.17    83.65
+ ID2= 2 ( 0003): 17.47    2.825    12.17    62.73
=====
ID = 3 ( 0005):  22.57    4.203    12.17    67.46

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| ADD HYD ( 0005) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0005): 22.57    4.203    12.17    67.46
+ ID2= 2 ( 0004):  2.03    0.224    12.33    44.54
=====
ID = 1 ( 0005):  24.60    4.383    12.17    65.57

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| CALIB |
| STANDHYD ( 0006) | Area (ha)= 1.66
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	1.25	0.42
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	105.20	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.56	0.167	0.00	6.333	1.47	12.500	12.44	18.67
1.56	0.333	0.48	6.500	1.56	12.667	12.44	18.83
1.56	0.500	0.95	6.667	1.56	12.833	9.42	19.00
1.56	0.667	0.95	6.833	1.56	13.000	6.39	19.17
1.56	0.833	0.95	7.000	1.56	13.167	6.39	19.33
1.56	1.000	0.95	7.167	1.56	13.333	5.53	19.50
1.56	1.167	0.95	7.333	1.73	13.500	4.67	19.67
1.56	1.333	0.95	7.500	1.90	13.667	4.67	19.83
1.56	1.500	0.95	7.667	1.90	13.833	4.15	20.00
1.56	1.667	0.95	7.833	1.90	14.000	3.63	20.17
1.30	1.833	0.95	8.000	1.90	14.167	3.63	20.33
1.04	2.000	0.95	8.167	1.90	14.333	3.11	20.50
1.04	2.167	0.95	8.333	2.07	14.500	2.59	20.67
1.04	2.333	1.04	8.500	2.25	14.667	2.59	20.83
1.04	2.500	1.12	8.667	2.25	14.833	2.59	21.00
1.04	2.667	1.12	8.833	2.33	15.000	2.59	21.17
1.04	2.833	1.12	9.000	2.42	15.167	2.59	21.33
1.04	3.000	1.12	9.167	2.42	15.333	2.59	21.50
1.04	3.167	1.12	9.333	2.59	15.500	2.59	21.67
1.04	3.333	1.12	9.500	2.76	15.667	2.59	21.83
1.04	3.500	1.12	9.667	2.76	15.833	2.59	22.00
1.04	3.667	1.12	9.833	2.94	16.000	2.59	22.17
1.04	3.833	1.12	10.000	3.11	16.167	2.59	22.33

1.04	4.000	1.12	10.167	3.11	16.333	2.07	22.50
1.04	4.167	1.12	10.333	3.54	16.500	1.56	22.67
1.04	4.333	1.25	10.500	3.97	16.667	1.56	22.83
1.04	4.500	1.38	10.667	3.97	16.833	1.56	23.00
1.04	4.667	1.38	10.833	4.67	17.000	1.56	23.17
1.04	4.833	1.38	11.000	5.36	17.167	1.56	23.33
1.04	5.000	1.38	11.167	5.36	17.333	1.56	23.50
1.04	5.167	1.38	11.333	6.83	17.500	1.56	23.67
1.04	5.333	1.38	11.500	8.29	17.667	1.56	23.83
1.04	5.500	1.38	11.667	8.29	17.833	1.56	24.00
1.04	5.667	1.38	11.833	16.93	18.000	1.56	24.17
0.52	5.833	1.38	12.000	25.58	18.167	1.56	24.33
	6.000	1.38	12.167	105.75	18.333	1.56	
	6.167	1.38	12.333	59.10	18.500	1.56	

Max.Eff.Inten. (mm/hr)=	105.75	182.66	
over (min)	10.00	10.00	
Storage Coeff. (min)=	2.58 (ii)	8.12 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.17	0.12	
			* TOTALS*
PEAK FLOW (cms)=	0.24	0.16	0.401 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	85.40	67.89	76.64
TOTAL RAINFALL (mm)=	86.40	86.40	86.40
RUNOFF COEFFICIENT =	0.99	0.79	0.89

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| ADD HYD (0007) |
| 1 + 2 = 3 |

AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)

```

ID1= 1 ( 0005):    24.60    4.383    12.17    65.57
+ ID2= 2 ( 0006):    1.66    0.401    12.17    76.64
=====
ID = 3 ( 0007):    26.26    4.784    12.17    66.27

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0008) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min    |
-----
      OUTFLOW    STORAGE    |    OUTFLOW    STORAGE
      (cms)      (ha.m.)    |    (cms)      (ha.m.)
      0.0000    0.0000    |    1.1580    1.0970
      0.1870    0.6751    |    1.5470    1.2310
      0.5060    0.8381    |    2.1510    1.3219
      0.7820    0.9953    |    0.0000    0.0000

                        AREA    QPEAK    TPEAK    R.V.
                        (ha)    (cms)    (hrs)    (mm)
INFLOW : ID= 2 ( 0007)  26.260    4.784    12.17    66.27
OUTFLOW: ID= 1 ( 0008)  26.260    0.709    12.83    66.23

```

```

      PEAK FLOW REDUCTION [Qout/Qin] (%)= 14.82
      TIME SHIFT OF PEAK FLOW (min)= 40.00
      MAXIMUM STORAGE USED (ha.m.)= 0.9547

```

=====

```

V   V   I   SSSSS U   U   A   L           (v 6.2.2010)
V   V   I   SS    U   U   A A   L
V   V   I   SS    U   U   AAAAA L
V   V   I   SS    U   U   A   A   L
VV    I   SSSSS UUUUU A   A   LLLLL

```

```

OOO   TTTTT TTTTT H   H   Y   Y   M   M   OOO   TM
O   O   T   T   H   H   Y   Y   MM MM O   O
O   O   T   T   H   H   Y   M   M   O   O
OOO   T   T   H   H   Y   M   M   OOO

```

Developed and Distributed by Smart City Water Inc
 Copyright 2007 - 2021 Smart City Water Inc
 All rights reserved.

***** D E T A I L E D O U T P U T *****

```

*****
** SIMULATION : Malton Rainfall Data-25yr 24h **
*****

```

```

-----
|   READ STORM   |   Filename: C:\Users\shuchi\AppData
|               |   ata\Local\Temp\
|               |   84b8a492-9782-4cfd-b409-
| bfb60ba4c411\c1d1748f |
| Ptotal=100.80 mm |   Comments: Malton Rainfall Data-25yr 24hr 15min SCS
-----

```

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.81	0.00	0.00	6.25	1.81	12.50	14.52	18.75
1.81	0.25	1.11	6.50	1.81	12.75	7.46	19.00
1.81	0.50	1.11	6.75	1.81	13.00	7.46	19.25
1.81	0.75	1.11	7.00	1.81	13.25	5.44	19.50
1.81	1.00	1.11	7.25	2.22	13.50	5.44	19.75
1.81	1.25	1.11	7.50	2.22	13.75	4.23	20.00
1.21	1.50	1.11	7.75	2.22	14.00	4.23	20.25
1.21	1.75	1.11	8.00	2.22	14.25	3.02	20.50

1.21	2.00	1.11	8.25	2.62	14.50	3.02	20.75
1.21	2.25	1.31	8.50	2.62	14.75	3.02	21.00
1.21	2.50	1.31	8.75	2.82	15.00	3.02	21.25
1.21	2.75	1.31	9.00	2.82	15.25	3.02	21.50
1.21	3.00	1.31	9.25	3.23	15.50	3.02	21.75
1.21	3.25	1.31	9.50	3.23	15.75	3.02	22.00
1.21	3.50	1.31	9.75	3.63	16.00	3.02	22.25
1.21	3.75	1.31	10.00	3.63	16.25	1.81	22.50
1.21	4.00	1.31	10.25	4.64	16.50	1.81	22.75
1.21	4.25	1.61	10.50	4.64	16.75	1.81	23.00
1.21	4.50	1.61	10.75	6.25	17.00	1.81	23.25
1.21	4.75	1.61	11.00	6.25	17.25	1.81	23.50
1.21	5.00	1.61	11.25	9.68	17.50	1.81	23.75
1.21	5.25	1.61	11.50	9.68	17.75	1.81	24.00
1.21	5.50	1.61	11.75	29.84	18.00	1.81	
	5.75	1.61	12.00	123.38	18.25	1.81	
	6.00	1.61	12.25	14.52	18.50	1.81	


```

-----
| CALIB |
| NASHYD ( 0002) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.15

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.81	0.167	0.00	6.333	1.71	12.500	14.52	18.67
1.81	0.333	0.55	6.500	1.81	12.667	14.52	18.83

1.81	0.500	1.11 6.667	1.81 12.833	10.99 19.00
1.81	0.667	1.11 6.833	1.81 13.000	7.46 19.17
1.81	0.833	1.11 7.000	1.81 13.167	7.46 19.33
1.81	1.000	1.11 7.167	1.81 13.333	6.45 19.50
1.81	1.167	1.11 7.333	2.02 13.500	5.44 19.67
1.81	1.333	1.11 7.500	2.22 13.667	5.44 19.83
1.81	1.500	1.11 7.667	2.22 13.833	4.84 20.00
1.81	1.667	1.11 7.833	2.22 14.000	4.23 20.17
1.81	1.833	1.11 8.000	2.22 14.167	4.23 20.33
1.51	2.000	1.11 8.167	2.22 14.333	3.63 20.50
1.21	2.167	1.11 8.333	2.42 14.500	3.02 20.67
1.21	2.333	1.21 8.500	2.62 14.667	3.02 20.83
1.21	2.500	1.31 8.667	2.62 14.833	3.02 21.00
1.21	2.667	1.31 8.833	2.72 15.000	3.02 21.17
1.21	2.833	1.31 9.000	2.82 15.167	3.02 21.33
1.21	3.000	1.31 9.167	2.82 15.333	3.02 21.50
1.21	3.167	1.31 9.333	3.02 15.500	3.02 21.67
1.21	3.333	1.31 9.500	3.23 15.667	3.02 21.83
1.21	3.500	1.31 9.667	3.23 15.833	3.02 22.00
1.21	3.667	1.31 9.833	3.43 16.000	3.02 22.17
1.21	3.833	1.31 10.000	3.63 16.167	3.02 22.33
1.21	4.000	1.31 10.167	3.63 16.333	2.42 22.50
1.21	4.167	1.31 10.333	4.13 16.500	1.81 22.67
1.21	4.333	1.46 10.500	4.64 16.667	1.81 22.83
1.21	4.500	1.61 10.667	4.64 16.833	1.81 23.00
1.21	4.667	1.61 10.833	5.44 17.000	1.81 23.17
1.21	4.833	1.61 11.000	6.25 17.167	1.81 23.33

1.21	5.000	1.61	11.167	6.25	17.333	1.81	23.50
1.21	5.167	1.61	11.333	7.96	17.500	1.81	23.67
1.21	5.333	1.61	11.500	9.68	17.667	1.81	23.83
1.21	5.500	1.61	11.667	9.68	17.833	1.81	24.00
1.21	5.667	1.61	11.833	19.76	18.000	1.81	24.17
1.21	5.833	1.61	12.000	29.84	18.167	1.81	24.33
0.60	6.000	1.61	12.167	123.38	18.333	1.81	
	6.167	1.61	12.333	68.94	18.500	1.81	

Unit Hyd Qpeak (cms)= 1.090

PEAK FLOW (cms)= 0.380 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 33.974
 TOTAL RAINFALL (mm)= 100.800
 RUNOFF COEFFICIENT = 0.337

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0001) | Area (ha)= 8.99
 | ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	5.39	3.60
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	244.81	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.167	0.00	6.333	1.71	12.500	14.52	18.67
1.81	0.333	0.55	6.500	1.81	12.667	14.52	18.83
1.81	0.500	1.11	6.667	1.81	12.833	10.99	19.00
1.81							

1.81	0.667	1.11 6.833	1.81 13.000	7.46 19.17
1.81	0.833	1.11 7.000	1.81 13.167	7.46 19.33
1.81	1.000	1.11 7.167	1.81 13.333	6.45 19.50
1.81	1.167	1.11 7.333	2.02 13.500	5.44 19.67
1.81	1.333	1.11 7.500	2.22 13.667	5.44 19.83
1.81	1.500	1.11 7.667	2.22 13.833	4.84 20.00
1.81	1.667	1.11 7.833	2.22 14.000	4.23 20.17
1.81	1.833	1.11 8.000	2.22 14.167	4.23 20.33
1.51	2.000	1.11 8.167	2.22 14.333	3.63 20.50
1.21	2.167	1.11 8.333	2.42 14.500	3.02 20.67
1.21	2.333	1.21 8.500	2.62 14.667	3.02 20.83
1.21	2.500	1.31 8.667	2.62 14.833	3.02 21.00
1.21	2.667	1.31 8.833	2.72 15.000	3.02 21.17
1.21	2.833	1.31 9.000	2.82 15.167	3.02 21.33
1.21	3.000	1.31 9.167	2.82 15.333	3.02 21.50
1.21	3.167	1.31 9.333	3.02 15.500	3.02 21.67
1.21	3.333	1.31 9.500	3.23 15.667	3.02 21.83
1.21	3.500	1.31 9.667	3.23 15.833	3.02 22.00
1.21	3.667	1.31 9.833	3.43 16.000	3.02 22.17
1.21	3.833	1.31 10.000	3.63 16.167	3.02 22.33
1.21	4.000	1.31 10.167	3.63 16.333	2.42 22.50
1.21	4.167	1.31 10.333	4.13 16.500	1.81 22.67
1.21	4.333	1.46 10.500	4.64 16.667	1.81 22.83
1.21	4.500	1.61 10.667	4.64 16.833	1.81 23.00
1.21	4.667	1.61 10.833	5.44 17.000	1.81 23.17
1.21	4.833	1.61 11.000	6.25 17.167	1.81 23.33
1.21	5.000	1.61 11.167	6.25 17.333	1.81 23.50

1.21	5.167	1.61	11.333	7.96	17.500	1.81	23.67
1.21	5.333	1.61	11.500	9.68	17.667	1.81	23.83
1.21	5.500	1.61	11.667	9.68	17.833	1.81	24.00
1.21	5.667	1.61	11.833	19.76	18.000	1.81	24.17
0.60	5.833	1.61	12.000	29.84	18.167	1.81	24.33
	6.000	1.61	12.167	123.38	18.333	1.81	
	6.167	1.61	12.333	68.94	18.500	1.81	

Max.Eff.Inten. (mm/hr)=	123.38	123.45	
over (min)	10.00	20.00	
Storage Coeff. (min)=	4.02 (ii)	10.51 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.16	0.08	
			* TOTALS*
PEAK FLOW (cms)=	1.44	0.82	1.898 (iii)
TIME TO PEAK (hrs)=	12.17	12.33	12.17
RUNOFF VOLUME (mm)=	99.80	73.23	86.52
TOTAL RAINFALL (mm)=	100.80	100.80	100.80
RUNOFF COEFFICIENT =	0.99	0.73	0.86

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| STANDHYD ( 0009) | Area (ha)= 4.20
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	3.36	0.84
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	167.33	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
RAIN      TIME    RAIN | TIME    RAIN | TIME    RAIN | TIME

```

mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.167	0.00	6.333	1.71	12.500	14.52	18.67
1.81	0.333	0.55	6.500	1.81	12.667	14.52	18.83
1.81	0.500	1.11	6.667	1.81	12.833	10.99	19.00
1.81	0.667	1.11	6.833	1.81	13.000	7.46	19.17
1.81	0.833	1.11	7.000	1.81	13.167	7.46	19.33
1.81	1.000	1.11	7.167	1.81	13.333	6.45	19.50
1.81	1.167	1.11	7.333	2.02	13.500	5.44	19.67
1.81	1.333	1.11	7.500	2.22	13.667	5.44	19.83
1.81	1.500	1.11	7.667	2.22	13.833	4.84	20.00
1.81	1.667	1.11	7.833	2.22	14.000	4.23	20.17
1.81	1.833	1.11	8.000	2.22	14.167	4.23	20.33
1.51	2.000	1.11	8.167	2.22	14.333	3.63	20.50
1.21	2.167	1.11	8.333	2.42	14.500	3.02	20.67
1.21	2.333	1.21	8.500	2.62	14.667	3.02	20.83
1.21	2.500	1.31	8.667	2.62	14.833	3.02	21.00
1.21	2.667	1.31	8.833	2.72	15.000	3.02	21.17
1.21	2.833	1.31	9.000	2.82	15.167	3.02	21.33
1.21	3.000	1.31	9.167	2.82	15.333	3.02	21.50
1.21	3.167	1.31	9.333	3.02	15.500	3.02	21.67
1.21	3.333	1.31	9.500	3.23	15.667	3.02	21.83
1.21	3.500	1.31	9.667	3.23	15.833	3.02	22.00
1.21	3.667	1.31	9.833	3.43	16.000	3.02	22.17
1.21	3.833	1.31	10.000	3.63	16.167	3.02	22.33
1.21	4.000	1.31	10.167	3.63	16.333	2.42	22.50
1.21	4.167	1.31	10.333	4.13	16.500	1.81	22.67
1.21	4.333	1.46	10.500	4.64	16.667	1.81	22.83
1.21							

1.21	4.500	1.61	10.667	4.64	16.833	1.81	23.00
1.21	4.667	1.61	10.833	5.44	17.000	1.81	23.17
1.21	4.833	1.61	11.000	6.25	17.167	1.81	23.33
1.21	5.000	1.61	11.167	6.25	17.333	1.81	23.50
1.21	5.167	1.61	11.333	7.96	17.500	1.81	23.67
1.21	5.333	1.61	11.500	9.68	17.667	1.81	23.83
1.21	5.500	1.61	11.667	9.68	17.833	1.81	24.00
1.21	5.667	1.61	11.833	19.76	18.000	1.81	24.17
1.21	5.833	1.61	12.000	29.84	18.167	1.81	24.33
0.60	6.000	1.61	12.167	123.38	18.333	1.81	
	6.167	1.61	12.333	68.94	18.500	1.81	

Max.Eff.Inten. (mm/hr)=	123.38	123.45	
over (min)	10.00	10.00	
Storage Coeff. (min)=	3.20 (ii)	9.69 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.16	0.11	
			* TOTALS*
PEAK FLOW (cms)=	1.04	0.20	1.247 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	99.80	73.23	93.16
TOTAL RAINFALL (mm)=	100.80	100.80	100.80
RUNOFF COEFFICIENT =	0.99	0.73	0.92

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0003) |
| 1 + 2 = 3 |
-----

```

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 1 (0001):	8.99	1.898	12.17	86.52
+ ID2= 2 (0002):	4.28	0.380	12.33	33.97
=====				
ID = 3 (0003):	13.27	2.255	12.17	69.57

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0003) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0003):  13.27  2.255  12.17  69.57
+ ID2= 2 ( 0009):   4.20  1.247  12.17  93.16
=====
ID = 1 ( 0003):   17.47  3.503  12.17  75.24

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| CALIB |
| NASHYD ( 0004) | Area (ha)= 2.03 Curve Number (CN)= 80.0
| ID= 1 DT=10.0 min | Ia (mm)= 5.00 # of Linear Res.(N)= 3.00
-----
                U.H. Tp(hrs)= 0.20

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

                ----- TRANSFORMED HYETOGRAPH -----
                TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
RAIN
                hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
mm/hr
                0.167    0.00 | 6.333    1.71 |12.500    14.52 | 18.67
1.81
                0.333    0.55 | 6.500    1.81 |12.667    14.52 | 18.83
1.81
                0.500    1.11 | 6.667    1.81 |12.833    10.99 | 19.00
1.81
                0.667    1.11 | 6.833    1.81 |13.000     7.46 | 19.17
1.81
                0.833    1.11 | 7.000    1.81 |13.167     7.46 | 19.33
1.81
                1.000    1.11 | 7.167    1.81 |13.333     6.45 | 19.50
1.81
                1.167    1.11 | 7.333    2.02 |13.500     5.44 | 19.67
1.81
                1.333    1.11 | 7.500    2.22 |13.667     5.44 | 19.83
1.81
                1.500    1.11 | 7.667    2.22 |13.833     4.84 | 20.00
1.81
                1.667    1.11 | 7.833    2.22 |14.000     4.23 | 20.17
1.81
                1.833    1.11 | 8.000    2.22 |14.167     4.23 | 20.33
1.51
                2.000    1.11 | 8.167    2.22 |14.333     3.63 | 20.50
1.21

```

1.21	2.167	1.11	8.333	2.42	14.500	3.02	20.67
1.21	2.333	1.21	8.500	2.62	14.667	3.02	20.83
1.21	2.500	1.31	8.667	2.62	14.833	3.02	21.00
1.21	2.667	1.31	8.833	2.72	15.000	3.02	21.17
1.21	2.833	1.31	9.000	2.82	15.167	3.02	21.33
1.21	3.000	1.31	9.167	2.82	15.333	3.02	21.50
1.21	3.167	1.31	9.333	3.02	15.500	3.02	21.67
1.21	3.333	1.31	9.500	3.23	15.667	3.02	21.83
1.21	3.500	1.31	9.667	3.23	15.833	3.02	22.00
1.21	3.667	1.31	9.833	3.43	16.000	3.02	22.17
1.21	3.833	1.31	10.000	3.63	16.167	3.02	22.33
1.21	4.000	1.31	10.167	3.63	16.333	2.42	22.50
1.21	4.167	1.31	10.333	4.13	16.500	1.81	22.67
1.21	4.333	1.46	10.500	4.64	16.667	1.81	22.83
1.21	4.500	1.61	10.667	4.64	16.833	1.81	23.00
1.21	4.667	1.61	10.833	5.44	17.000	1.81	23.17
1.21	4.833	1.61	11.000	6.25	17.167	1.81	23.33
1.21	5.000	1.61	11.167	6.25	17.333	1.81	23.50
1.21	5.167	1.61	11.333	7.96	17.500	1.81	23.67
1.21	5.333	1.61	11.500	9.68	17.667	1.81	23.83
1.21	5.500	1.61	11.667	9.68	17.833	1.81	24.00
1.21	5.667	1.61	11.833	19.76	18.000	1.81	24.17
1.21	5.833	1.61	12.000	29.84	18.167	1.81	24.33
0.60	6.000	1.61	12.167	123.38	18.333	1.81	
	6.167	1.61	12.333	68.94	18.500	1.81	

Unit Hyd Qpeak (cms)= 0.388

PEAK FLOW (cms)= 0.283 (i)

TIME TO PEAK (hrs)= 12.333

RUNOFF VOLUME (mm)= 56.115

TOTAL RAINFALL (mm)= 100.800
 RUNOFF COEFFICIENT = 0.557

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0010) | Area (ha)= 5.10
 | ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	4.84	0.26
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	184.39	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.81	0.167	0.00	6.333	1.71	12.500	14.52	18.67
1.81	0.333	0.55	6.500	1.81	12.667	14.52	18.83
1.81	0.500	1.11	6.667	1.81	12.833	10.99	19.00
1.81	0.667	1.11	6.833	1.81	13.000	7.46	19.17
1.81	0.833	1.11	7.000	1.81	13.167	7.46	19.33
1.81	1.000	1.11	7.167	1.81	13.333	6.45	19.50
1.81	1.167	1.11	7.333	2.02	13.500	5.44	19.67
1.81	1.333	1.11	7.500	2.22	13.667	5.44	19.83
1.81	1.500	1.11	7.667	2.22	13.833	4.84	20.00
1.81	1.667	1.11	7.833	2.22	14.000	4.23	20.17
1.81	1.833	1.11	8.000	2.22	14.167	4.23	20.33
1.51	2.000	1.11	8.167	2.22	14.333	3.63	20.50
1.21	2.167	1.11	8.333	2.42	14.500	3.02	20.67
1.21							

1.21	2.333	1.21	8.500	2.62	14.667	3.02	20.83
1.21	2.500	1.31	8.667	2.62	14.833	3.02	21.00
1.21	2.667	1.31	8.833	2.72	15.000	3.02	21.17
1.21	2.833	1.31	9.000	2.82	15.167	3.02	21.33
1.21	3.000	1.31	9.167	2.82	15.333	3.02	21.50
1.21	3.167	1.31	9.333	3.02	15.500	3.02	21.67
1.21	3.333	1.31	9.500	3.23	15.667	3.02	21.83
1.21	3.500	1.31	9.667	3.23	15.833	3.02	22.00
1.21	3.667	1.31	9.833	3.43	16.000	3.02	22.17
1.21	3.833	1.31	10.000	3.63	16.167	3.02	22.33
1.21	4.000	1.31	10.167	3.63	16.333	2.42	22.50
1.21	4.167	1.31	10.333	4.13	16.500	1.81	22.67
1.21	4.333	1.46	10.500	4.64	16.667	1.81	22.83
1.21	4.500	1.61	10.667	4.64	16.833	1.81	23.00
1.21	4.667	1.61	10.833	5.44	17.000	1.81	23.17
1.21	4.833	1.61	11.000	6.25	17.167	1.81	23.33
1.21	5.000	1.61	11.167	6.25	17.333	1.81	23.50
1.21	5.167	1.61	11.333	7.96	17.500	1.81	23.67
1.21	5.333	1.61	11.500	9.68	17.667	1.81	23.83
1.21	5.500	1.61	11.667	9.68	17.833	1.81	24.00
1.21	5.667	1.61	11.833	19.76	18.000	1.81	24.17
1.21	5.833	1.61	12.000	29.84	18.167	1.81	24.33
0.60	6.000	1.61	12.167	123.38	18.333	1.81	
	6.167	1.61	12.333	68.94	18.500	1.81	

Max.Eff.Inten. (mm/hr)=	123.38	219.27
over (min)	10.00	10.00
Storage Coeff. (min)=	3.39 (ii)	8.55 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	0.16	0.12

PEAK FLOW (cms)=	1.51	0.12	* TOTALS*
			1.627 (iii)

TIME TO PEAK	(hrs)=	12.17	12.17	12.17
RUNOFF VOLUME	(mm)=	99.80	81.74	97.99
TOTAL RAINFALL	(mm)=	100.80	100.80	100.80
RUNOFF COEFFICIENT	=	0.99	0.81	0.97

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0010):  5.10    1.627    12.17    97.99
+ ID2= 2 ( 0003): 17.47    3.503    12.17    75.24
=====
ID = 3 ( 0005):  22.57    5.130    12.17    80.38

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| ADD HYD ( 0005) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0005): 22.57    5.130    12.17    80.38
+ ID2= 2 ( 0004):  2.03    0.283    12.33    56.12
=====
ID = 1 ( 0005):  24.60    5.359    12.17    78.38

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| CALIB |
| STANDHYD ( 0006) | Area (ha)= 1.66
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	1.25	0.42
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	105.20	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
1.81	0.167	0.00	6.333	1.71	12.500	14.52	18.67
1.81	0.333	0.55	6.500	1.81	12.667	14.52	18.83
1.81	0.500	1.11	6.667	1.81	12.833	10.99	19.00
1.81	0.667	1.11	6.833	1.81	13.000	7.46	19.17
1.81	0.833	1.11	7.000	1.81	13.167	7.46	19.33
1.81	1.000	1.11	7.167	1.81	13.333	6.45	19.50
1.81	1.167	1.11	7.333	2.02	13.500	5.44	19.67
1.81	1.333	1.11	7.500	2.22	13.667	5.44	19.83
1.81	1.500	1.11	7.667	2.22	13.833	4.84	20.00
1.81	1.667	1.11	7.833	2.22	14.000	4.23	20.17
1.51	1.833	1.11	8.000	2.22	14.167	4.23	20.33
1.21	2.000	1.11	8.167	2.22	14.333	3.63	20.50
1.21	2.167	1.11	8.333	2.42	14.500	3.02	20.67
1.21	2.333	1.21	8.500	2.62	14.667	3.02	20.83
1.21	2.500	1.31	8.667	2.62	14.833	3.02	21.00
1.21	2.667	1.31	8.833	2.72	15.000	3.02	21.17
1.21	2.833	1.31	9.000	2.82	15.167	3.02	21.33
1.21	3.000	1.31	9.167	2.82	15.333	3.02	21.50
1.21	3.167	1.31	9.333	3.02	15.500	3.02	21.67
1.21	3.333	1.31	9.500	3.23	15.667	3.02	21.83
1.21	3.500	1.31	9.667	3.23	15.833	3.02	22.00
1.21	3.667	1.31	9.833	3.43	16.000	3.02	22.17
1.21	3.833	1.31	10.000	3.63	16.167	3.02	22.33

1.21	4.000	1.31	10.167	3.63	16.333	2.42	22.50
1.21	4.167	1.31	10.333	4.13	16.500	1.81	22.67
1.21	4.333	1.46	10.500	4.64	16.667	1.81	22.83
1.21	4.500	1.61	10.667	4.64	16.833	1.81	23.00
1.21	4.667	1.61	10.833	5.44	17.000	1.81	23.17
1.21	4.833	1.61	11.000	6.25	17.167	1.81	23.33
1.21	5.000	1.61	11.167	6.25	17.333	1.81	23.50
1.21	5.167	1.61	11.333	7.96	17.500	1.81	23.67
1.21	5.333	1.61	11.500	9.68	17.667	1.81	23.83
1.21	5.500	1.61	11.667	9.68	17.833	1.81	24.00
1.21	5.667	1.61	11.833	19.76	18.000	1.81	24.17
1.21	5.833	1.61	12.000	29.84	18.167	1.81	24.33
0.60	6.000	1.61	12.167	123.38	18.333	1.81	
	6.167	1.61	12.333	68.94	18.500	1.81	

Max.Eff.Inten. (mm/hr)=	123.38	219.27	
over (min)	10.00	10.00	
Storage Coeff. (min)=	2.42 (ii)	7.58 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.17	0.12	
			* TOTALS*
PEAK FLOW (cms)=	0.28	0.20	0.480 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	99.80	81.74	90.77
TOTAL RAINFALL (mm)=	100.80	100.80	100.80
RUNOFF COEFFICIENT =	0.99	0.81	0.90

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | ADD HYD (0007) |
1 + 2 = 3

AREA	QPEAK	TPEAK	R.V.
(ha)	(cms)	(hrs)	(mm)

```

ID1= 1 ( 0005):    24.60    5.359    12.17    78.38
+ ID2= 2 ( 0006):     1.66    0.480    12.17    90.77
=====
ID = 3 ( 0007):    26.26    5.839    12.17    79.16

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0008) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min    |
-----
      OUTFLOW    STORAGE    |    OUTFLOW    STORAGE
      (cms)      (ha.m.)    |    (cms)      (ha.m.)
      0.0000    0.0000    |    1.1580    1.0970
      0.1870    0.6751    |    1.5470    1.2310
      0.5060    0.8381    |    2.1510    1.3219
      0.7820    0.9953    |    0.0000    0.0000

                        AREA    QPEAK    TPEAK    R.V.
                        (ha)    (cms)    (hrs)    (mm)
INFLOW : ID= 2 ( 0007)  26.260    5.839    12.17    79.16
OUTFLOW: ID= 1 ( 0008)  26.260    1.141    12.67    79.13

```

```

      PEAK FLOW REDUCTION [Qout/Qin] (%)= 19.54
      TIME SHIFT OF PEAK FLOW (min)= 30.00
      MAXIMUM STORAGE USED (ha.m.)= 1.0948

```

=====

V V I SSSSS U U A L (v 6.2.2010)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

OOO TTTTT TTTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2021 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

** SIMULATION : Malton Rainfall Data-50yr 24h **

| READ STORM | Filename: C:\Users\shuchi\AppData
| | ata\Local\Temp\
| | 84b8a492-9782-4cfd-b409-
bfb60ba4c411\f662c08a
| Ptotal=112.80 mm | Comments: Malton Rainfall Data-50yr 24hr 15min SCS

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.03	0.00	0.00	6.25	2.03	12.50	16.24	18.75
2.03	0.25	1.24	6.50	2.03	12.75	8.35	19.00
2.03	0.50	1.24	6.75	2.03	13.00	8.35	19.25
2.03	0.75	1.24	7.00	2.03	13.25	6.09	19.50
2.03	1.00	1.24	7.25	2.48	13.50	6.09	19.75
2.03	1.25	1.24	7.50	2.48	13.75	4.74	20.00
1.35	1.50	1.24	7.75	2.48	14.00	4.74	20.25
1.35	1.75	1.24	8.00	2.48	14.25	3.38	20.50

1.35	2.00	1.24	8.25	2.93	14.50	3.38	20.75
1.35	2.25	1.47	8.50	2.93	14.75	3.38	21.00
1.35	2.50	1.47	8.75	3.16	15.00	3.38	21.25
1.35	2.75	1.47	9.00	3.16	15.25	3.38	21.50
1.35	3.00	1.47	9.25	3.61	15.50	3.38	21.75
1.35	3.25	1.47	9.50	3.61	15.75	3.38	22.00
1.35	3.50	1.47	9.75	4.06	16.00	3.38	22.25
1.35	3.75	1.47	10.00	4.06	16.25	2.03	22.50
1.35	4.00	1.47	10.25	5.19	16.50	2.03	22.75
1.35	4.25	1.80	10.50	5.19	16.75	2.03	23.00
1.35	4.50	1.80	10.75	6.99	17.00	2.03	23.25
1.35	4.75	1.80	11.00	6.99	17.25	2.03	23.50
1.35	5.00	1.80	11.25	10.83	17.50	2.03	23.75
1.35	5.25	1.80	11.50	10.83	17.75	2.03	24.00
	5.50	1.80	11.75	33.39	18.00	2.03	
	5.75	1.80	12.00	138.07	18.25	2.03	
	6.00	1.80	12.25	16.24	18.50	2.03	


```

-----
| CALIB |
| NASHYD ( 0002) | Area (ha)= 4.28 Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
| U.H. Tp(hrs)= 0.15

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.03	0.167	0.00	6.333	1.92	12.500	16.24	18.67
2.03	0.333	0.62	6.500	2.03	12.667	16.24	18.83

2.03	0.500	1.24 6.667	2.03 12.833	12.29 19.00
2.03	0.667	1.24 6.833	2.03 13.000	8.35 19.17
2.03	0.833	1.24 7.000	2.03 13.167	8.35 19.33
2.03	1.000	1.24 7.167	2.03 13.333	7.22 19.50
2.03	1.167	1.24 7.333	2.26 13.500	6.09 19.67
2.03	1.333	1.24 7.500	2.48 13.667	6.09 19.83
2.03	1.500	1.24 7.667	2.48 13.833	5.41 20.00
2.03	1.667	1.24 7.833	2.48 14.000	4.74 20.17
2.03	1.833	1.24 8.000	2.48 14.167	4.74 20.33
1.69	2.000	1.24 8.167	2.48 14.333	4.06 20.50
1.35	2.167	1.24 8.333	2.71 14.500	3.38 20.67
1.35	2.333	1.35 8.500	2.93 14.667	3.38 20.83
1.35	2.500	1.47 8.667	2.93 14.833	3.38 21.00
1.35	2.667	1.47 8.833	3.05 15.000	3.38 21.17
1.35	2.833	1.47 9.000	3.16 15.167	3.38 21.33
1.35	3.000	1.47 9.167	3.16 15.333	3.38 21.50
1.35	3.167	1.47 9.333	3.38 15.500	3.38 21.67
1.35	3.333	1.47 9.500	3.61 15.667	3.38 21.83
1.35	3.500	1.47 9.667	3.61 15.833	3.38 22.00
1.35	3.667	1.47 9.833	3.84 16.000	3.38 22.17
1.35	3.833	1.47 10.000	4.06 16.167	3.38 22.33
1.35	4.000	1.47 10.167	4.06 16.333	2.71 22.50
1.35	4.167	1.47 10.333	4.62 16.500	2.03 22.67
1.35	4.333	1.64 10.500	5.19 16.667	2.03 22.83
1.35	4.500	1.80 10.667	5.19 16.833	2.03 23.00
1.35	4.667	1.80 10.833	6.09 17.000	2.03 23.17
1.35	4.833	1.80 11.000	6.99 17.167	2.03 23.33

1.35	5.000	1.80	11.167	6.99	17.333	2.03	23.50
1.35	5.167	1.80	11.333	8.91	17.500	2.03	23.67
1.35	5.333	1.80	11.500	10.83	17.667	2.03	23.83
1.35	5.500	1.80	11.667	10.83	17.833	2.03	24.00
1.35	5.667	1.80	11.833	22.11	18.000	2.03	24.17
0.68	5.833	1.80	12.000	33.39	18.167	2.03	24.33
	6.000	1.80	12.167	138.07	18.333	2.03	
	6.167	1.80	12.333	77.15	18.500	2.03	

Unit Hyd Qpeak (cms)= 1.090

PEAK FLOW (cms)= 0.462 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 41.229
 TOTAL RAINFALL (mm)= 112.800
 RUNOFF COEFFICIENT = 0.366

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0001) | Area (ha)= 8.99
 | ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	5.39	3.60
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	244.81	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
mm/hr	0.167	0.00	6.333	1.92	12.500	16.24	18.67
2.03	0.333	0.62	6.500	2.03	12.667	16.24	18.83
2.03	0.500	1.24	6.667	2.03	12.833	12.29	19.00
2.03							

2.03	0.667	1.24 6.833	2.03 13.000	8.35 19.17
2.03	0.833	1.24 7.000	2.03 13.167	8.35 19.33
2.03	1.000	1.24 7.167	2.03 13.333	7.22 19.50
2.03	1.167	1.24 7.333	2.26 13.500	6.09 19.67
2.03	1.333	1.24 7.500	2.48 13.667	6.09 19.83
2.03	1.500	1.24 7.667	2.48 13.833	5.41 20.00
2.03	1.667	1.24 7.833	2.48 14.000	4.74 20.17
2.03	1.833	1.24 8.000	2.48 14.167	4.74 20.33
1.69	2.000	1.24 8.167	2.48 14.333	4.06 20.50
1.35	2.167	1.24 8.333	2.71 14.500	3.38 20.67
1.35	2.333	1.35 8.500	2.93 14.667	3.38 20.83
1.35	2.500	1.47 8.667	2.93 14.833	3.38 21.00
1.35	2.667	1.47 8.833	3.05 15.000	3.38 21.17
1.35	2.833	1.47 9.000	3.16 15.167	3.38 21.33
1.35	3.000	1.47 9.167	3.16 15.333	3.38 21.50
1.35	3.167	1.47 9.333	3.38 15.500	3.38 21.67
1.35	3.333	1.47 9.500	3.61 15.667	3.38 21.83
1.35	3.500	1.47 9.667	3.61 15.833	3.38 22.00
1.35	3.667	1.47 9.833	3.84 16.000	3.38 22.17
1.35	3.833	1.47 10.000	4.06 16.167	3.38 22.33
1.35	4.000	1.47 10.167	4.06 16.333	2.71 22.50
1.35	4.167	1.47 10.333	4.62 16.500	2.03 22.67
1.35	4.333	1.64 10.500	5.19 16.667	2.03 22.83
1.35	4.500	1.80 10.667	5.19 16.833	2.03 23.00
1.35	4.667	1.80 10.833	6.09 17.000	2.03 23.17
1.35	4.833	1.80 11.000	6.99 17.167	2.03 23.33
1.35	5.000	1.80 11.167	6.99 17.333	2.03 23.50

1.35	5.167	1.80	11.333	8.91	17.500	2.03	23.67
1.35	5.333	1.80	11.500	10.83	17.667	2.03	23.83
1.35	5.500	1.80	11.667	10.83	17.833	2.03	24.00
1.35	5.667	1.80	11.833	22.11	18.000	2.03	24.17
0.68	5.833	1.80	12.000	33.39	18.167	2.03	24.33
	6.000	1.80	12.167	138.07	18.333	2.03	
	6.167	1.80	12.333	77.15	18.500	2.03	

Max.Eff.Inten. (mm/hr)=	138.07	142.34	
over (min)	10.00	10.00	
Storage Coeff. (min)=	3.84 (ii)	9.97 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.16	0.11	
			* TOTALS*
PEAK FLOW (cms)=	1.63	0.99	2.621 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	111.80	84.46	98.13
TOTAL RAINFALL (mm)=	112.80	112.80	112.80
RUNOFF COEFFICIENT =	0.99	0.75	0.87

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| STANDHYD ( 0009) | Area (ha)= 4.20
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	3.36	0.84
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	167.33	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
RAIN      TIME    RAIN | TIME    RAIN | TIME    RAIN | TIME

```

mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.03	0.167	0.00	6.333	1.92	12.500	16.24	18.67
2.03	0.333	0.62	6.500	2.03	12.667	16.24	18.83
2.03	0.500	1.24	6.667	2.03	12.833	12.29	19.00
2.03	0.667	1.24	6.833	2.03	13.000	8.35	19.17
2.03	0.833	1.24	7.000	2.03	13.167	8.35	19.33
2.03	1.000	1.24	7.167	2.03	13.333	7.22	19.50
2.03	1.167	1.24	7.333	2.26	13.500	6.09	19.67
2.03	1.333	1.24	7.500	2.48	13.667	6.09	19.83
2.03	1.500	1.24	7.667	2.48	13.833	5.41	20.00
2.03	1.667	1.24	7.833	2.48	14.000	4.74	20.17
1.69	1.833	1.24	8.000	2.48	14.167	4.74	20.33
1.35	2.000	1.24	8.167	2.48	14.333	4.06	20.50
1.35	2.167	1.24	8.333	2.71	14.500	3.38	20.67
1.35	2.333	1.35	8.500	2.93	14.667	3.38	20.83
1.35	2.500	1.47	8.667	2.93	14.833	3.38	21.00
1.35	2.667	1.47	8.833	3.05	15.000	3.38	21.17
1.35	2.833	1.47	9.000	3.16	15.167	3.38	21.33
1.35	3.000	1.47	9.167	3.16	15.333	3.38	21.50
1.35	3.167	1.47	9.333	3.38	15.500	3.38	21.67
1.35	3.333	1.47	9.500	3.61	15.667	3.38	21.83
1.35	3.500	1.47	9.667	3.61	15.833	3.38	22.00
1.35	3.667	1.47	9.833	3.84	16.000	3.38	22.17
1.35	3.833	1.47	10.000	4.06	16.167	3.38	22.33
1.35	4.000	1.47	10.167	4.06	16.333	2.71	22.50
1.35	4.167	1.47	10.333	4.62	16.500	2.03	22.67
1.35	4.333	1.64	10.500	5.19	16.667	2.03	22.83

1.35	4.500	1.80	10.667	5.19	16.833	2.03	23.00
1.35	4.667	1.80	10.833	6.09	17.000	2.03	23.17
1.35	4.833	1.80	11.000	6.99	17.167	2.03	23.33
1.35	5.000	1.80	11.167	6.99	17.333	2.03	23.50
1.35	5.167	1.80	11.333	8.91	17.500	2.03	23.67
1.35	5.333	1.80	11.500	10.83	17.667	2.03	23.83
1.35	5.500	1.80	11.667	10.83	17.833	2.03	24.00
1.35	5.667	1.80	11.833	22.11	18.000	2.03	24.17
0.68	5.833	1.80	12.000	33.39	18.167	2.03	24.33
	6.000	1.80	12.167	138.07	18.333	2.03	
	6.167	1.80	12.333	77.15	18.500	2.03	

Max.Eff.Inten. (mm/hr)=	138.07	142.34	
over (min)	10.00	10.00	
Storage Coeff. (min)=	3.06 (ii)	9.19 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.16	0.11	
			* TOTALS*
PEAK FLOW (cms)=	1.17	0.24	1.414 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	111.80	84.46	104.96
TOTAL RAINFALL (mm)=	112.80	112.80	112.80
RUNOFF COEFFICIENT =	0.99	0.75	0.93

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0003) |
| 1 + 2 = 3 |
-----

```

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 1 (0001):	8.99	2.621	12.17	98.13
+ ID2= 2 (0002):	4.28	0.462	12.33	41.23
=====				
ID = 3 (0003):	13.27	3.060	12.17	79.78

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0003) |
| 3 + 2 = 1 |
-----
AREA      QPEAK      TPEAK      R.V.
  (ha)    (cms)     (hrs)     (mm)
ID1= 3 ( 0003):  13.27  3.060   12.17   79.78
+ ID2= 2 ( 0009):   4.20  1.414   12.17  104.96
=====
ID = 1 ( 0003):   17.47  4.474   12.17   85.83

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| CALIB |
| NASHYD ( 0004) | Area (ha)= 2.03 Curve Number (CN)= 80.0
| ID= 1 DT=10.0 min | Ia (mm)= 5.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.20

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
  hrs     mm/hr |  hrs     mm/hr |  hrs     mm/hr |  hrs
mm/hr
0.167     0.00 | 6.333     1.92 |12.500     16.24 | 18.67
2.03
0.333     0.62 | 6.500     2.03 |12.667     16.24 | 18.83
2.03
0.500     1.24 | 6.667     2.03 |12.833     12.29 | 19.00
2.03
0.667     1.24 | 6.833     2.03 |13.000      8.35 | 19.17
2.03
0.833     1.24 | 7.000     2.03 |13.167      8.35 | 19.33
2.03
1.000     1.24 | 7.167     2.03 |13.333      7.22 | 19.50
2.03
1.167     1.24 | 7.333     2.26 |13.500      6.09 | 19.67
2.03
1.333     1.24 | 7.500     2.48 |13.667      6.09 | 19.83
2.03
1.500     1.24 | 7.667     2.48 |13.833      5.41 | 20.00
2.03
1.667     1.24 | 7.833     2.48 |14.000      4.74 | 20.17
2.03
1.833     1.24 | 8.000     2.48 |14.167      4.74 | 20.33
1.69
2.000     1.24 | 8.167     2.48 |14.333      4.06 | 20.50
1.35

```

1.35	2.167	1.24 8.333	2.71 14.500	3.38 20.67
1.35	2.333	1.35 8.500	2.93 14.667	3.38 20.83
1.35	2.500	1.47 8.667	2.93 14.833	3.38 21.00
1.35	2.667	1.47 8.833	3.05 15.000	3.38 21.17
1.35	2.833	1.47 9.000	3.16 15.167	3.38 21.33
1.35	3.000	1.47 9.167	3.16 15.333	3.38 21.50
1.35	3.167	1.47 9.333	3.38 15.500	3.38 21.67
1.35	3.333	1.47 9.500	3.61 15.667	3.38 21.83
1.35	3.500	1.47 9.667	3.61 15.833	3.38 22.00
1.35	3.667	1.47 9.833	3.84 16.000	3.38 22.17
1.35	3.833	1.47 10.000	4.06 16.167	3.38 22.33
1.35	4.000	1.47 10.167	4.06 16.333	2.71 22.50
1.35	4.167	1.47 10.333	4.62 16.500	2.03 22.67
1.35	4.333	1.64 10.500	5.19 16.667	2.03 22.83
1.35	4.500	1.80 10.667	5.19 16.833	2.03 23.00
1.35	4.667	1.80 10.833	6.09 17.000	2.03 23.17
1.35	4.833	1.80 11.000	6.99 17.167	2.03 23.33
1.35	5.000	1.80 11.167	6.99 17.333	2.03 23.50
1.35	5.167	1.80 11.333	8.91 17.500	2.03 23.67
1.35	5.333	1.80 11.500	10.83 17.667	2.03 23.83
1.35	5.500	1.80 11.667	10.83 17.833	2.03 24.00
1.35	5.667	1.80 11.833	22.11 18.000	2.03 24.17
1.35	5.833	1.80 12.000	33.39 18.167	2.03 24.33
0.68	6.000	1.80 12.167	138.07 18.333	2.03
	6.167	1.80 12.333	77.15 18.500	2.03

Unit Hyd Qpeak (cms)= 0.388

PEAK FLOW (cms)= 0.333 (i)

TIME TO PEAK (hrs)= 12.333

RUNOFF VOLUME (mm)= 66.076

TOTAL RAINFALL (mm)= 112.800
 RUNOFF COEFFICIENT = 0.586

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| CALIB |
| STANDHYD ( 0010) | Area (ha)= 5.10
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00
-----
  
```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	4.84	0.26
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	184.39	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
      hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
RAIN
mm/hr
0.167      0.00 | 6.333      1.92 |12.500      16.24 | 18.67
2.03
0.333      0.62 | 6.500      2.03 |12.667      16.24 | 18.83
2.03
0.500      1.24 | 6.667      2.03 |12.833      12.29 | 19.00
2.03
0.667      1.24 | 6.833      2.03 |13.000       8.35 | 19.17
2.03
0.833      1.24 | 7.000      2.03 |13.167       8.35 | 19.33
2.03
1.000      1.24 | 7.167      2.03 |13.333       7.22 | 19.50
2.03
1.167      1.24 | 7.333      2.26 |13.500       6.09 | 19.67
2.03
1.333      1.24 | 7.500      2.48 |13.667       6.09 | 19.83
2.03
1.500      1.24 | 7.667      2.48 |13.833       5.41 | 20.00
2.03
1.667      1.24 | 7.833      2.48 |14.000       4.74 | 20.17
2.03
1.833      1.24 | 8.000      2.48 |14.167       4.74 | 20.33
1.69
2.000      1.24 | 8.167      2.48 |14.333       4.06 | 20.50
1.35
2.167      1.24 | 8.333      2.71 |14.500       3.38 | 20.67
1.35
  
```

1.35	2.333	1.35 8.500	2.93 14.667	3.38 20.83
1.35	2.500	1.47 8.667	2.93 14.833	3.38 21.00
1.35	2.667	1.47 8.833	3.05 15.000	3.38 21.17
1.35	2.833	1.47 9.000	3.16 15.167	3.38 21.33
1.35	3.000	1.47 9.167	3.16 15.333	3.38 21.50
1.35	3.167	1.47 9.333	3.38 15.500	3.38 21.67
1.35	3.333	1.47 9.500	3.61 15.667	3.38 21.83
1.35	3.500	1.47 9.667	3.61 15.833	3.38 22.00
1.35	3.667	1.47 9.833	3.84 16.000	3.38 22.17
1.35	3.833	1.47 10.000	4.06 16.167	3.38 22.33
1.35	4.000	1.47 10.167	4.06 16.333	2.71 22.50
1.35	4.167	1.47 10.333	4.62 16.500	2.03 22.67
1.35	4.333	1.64 10.500	5.19 16.667	2.03 22.83
1.35	4.500	1.80 10.667	5.19 16.833	2.03 23.00
1.35	4.667	1.80 10.833	6.09 17.000	2.03 23.17
1.35	4.833	1.80 11.000	6.99 17.167	2.03 23.33
1.35	5.000	1.80 11.167	6.99 17.333	2.03 23.50
1.35	5.167	1.80 11.333	8.91 17.500	2.03 23.67
1.35	5.333	1.80 11.500	10.83 17.667	2.03 23.83
1.35	5.500	1.80 11.667	10.83 17.833	2.03 24.00
1.35	5.667	1.80 11.833	22.11 18.000	2.03 24.17
1.35	5.833	1.80 12.000	33.39 18.167	2.03 24.33
0.68	6.000	1.80 12.167	138.07 18.333	2.03
	6.167	1.80 12.333	77.15 18.500	2.03

Max.Eff.Inten. (mm/hr)=	138.07	249.77
over (min)	10.00	10.00
Storage Coeff. (min)=	3.24 (ii)	8.14 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	0.16	0.12

PEAK FLOW (cms)=	1.70	0.14	* TOTALS*
			1.834 (iii)

TIME TO PEAK	(hrs)=	12.17	12.17	12.17
RUNOFF VOLUME	(mm)=	111.80	93.37	109.96
TOTAL RAINFALL	(mm)=	112.80	112.80	112.80
RUNOFF COEFFICIENT	=	0.99	0.83	0.97

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0010):  5.10      1.834      12.17      109.96
+ ID2= 2 ( 0003): 17.47      4.474      12.17      85.83
=====
ID = 3 ( 0005):  22.57      6.308      12.17      91.28

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| ADD HYD ( 0005) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0005): 22.57      6.308      12.17      91.28
+ ID2= 2 ( 0004):  2.03      0.333      12.33      66.08
=====
ID = 1 ( 0005):  24.60      6.580      12.17      89.20

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| CALIB |
| STANDHYD ( 0006) | Area (ha)= 1.66
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	1.25	0.42
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	105.20	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.03	0.167	0.00	6.333	1.92	12.500	16.24	18.67
2.03	0.333	0.62	6.500	2.03	12.667	16.24	18.83
2.03	0.500	1.24	6.667	2.03	12.833	12.29	19.00
2.03	0.667	1.24	6.833	2.03	13.000	8.35	19.17
2.03	0.833	1.24	7.000	2.03	13.167	8.35	19.33
2.03	1.000	1.24	7.167	2.03	13.333	7.22	19.50
2.03	1.167	1.24	7.333	2.26	13.500	6.09	19.67
2.03	1.333	1.24	7.500	2.48	13.667	6.09	19.83
2.03	1.500	1.24	7.667	2.48	13.833	5.41	20.00
2.03	1.667	1.24	7.833	2.48	14.000	4.74	20.17
1.69	1.833	1.24	8.000	2.48	14.167	4.74	20.33
1.35	2.000	1.24	8.167	2.48	14.333	4.06	20.50
1.35	2.167	1.24	8.333	2.71	14.500	3.38	20.67
1.35	2.333	1.35	8.500	2.93	14.667	3.38	20.83
1.35	2.500	1.47	8.667	2.93	14.833	3.38	21.00
1.35	2.667	1.47	8.833	3.05	15.000	3.38	21.17
1.35	2.833	1.47	9.000	3.16	15.167	3.38	21.33
1.35	3.000	1.47	9.167	3.16	15.333	3.38	21.50
1.35	3.167	1.47	9.333	3.38	15.500	3.38	21.67
1.35	3.333	1.47	9.500	3.61	15.667	3.38	21.83
1.35	3.500	1.47	9.667	3.61	15.833	3.38	22.00
1.35	3.667	1.47	9.833	3.84	16.000	3.38	22.17
1.35	3.833	1.47	10.000	4.06	16.167	3.38	22.33

1.35	4.000	1.47	10.167	4.06	16.333	2.71	22.50
1.35	4.167	1.47	10.333	4.62	16.500	2.03	22.67
1.35	4.333	1.64	10.500	5.19	16.667	2.03	22.83
1.35	4.500	1.80	10.667	5.19	16.833	2.03	23.00
1.35	4.667	1.80	10.833	6.09	17.000	2.03	23.17
1.35	4.833	1.80	11.000	6.99	17.167	2.03	23.33
1.35	5.000	1.80	11.167	6.99	17.333	2.03	23.50
1.35	5.167	1.80	11.333	8.91	17.500	2.03	23.67
1.35	5.333	1.80	11.500	10.83	17.667	2.03	23.83
1.35	5.500	1.80	11.667	10.83	17.833	2.03	24.00
1.35	5.667	1.80	11.833	22.11	18.000	2.03	24.17
1.35	5.833	1.80	12.000	33.39	18.167	2.03	24.33
0.68	6.000	1.80	12.167	138.07	18.333	2.03	
	6.167	1.80	12.333	77.15	18.500	2.03	

Max.Eff.Inten. (mm/hr)=	138.07	249.77	
over (min)	10.00	10.00	
Storage Coeff. (min)=	2.31 (ii)	7.21 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.17	0.13	
			* TOTALS*
PEAK FLOW (cms)=	0.32	0.23	0.546 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	111.80	93.37	102.59
TOTAL RAINFALL (mm)=	112.80	112.80	112.80
RUNOFF COEFFICIENT =	0.99	0.83	0.91

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| ADD HYD (0007) |
| 1 + 2 = 3 |

AREA	QPEAK	TPEAK	R.V.
(ha)	(cms)	(hrs)	(mm)

```

ID1= 1 ( 0005):    24.60    6.580    12.17    89.20
+ ID2= 2 ( 0006):    1.66    0.546    12.17    102.59
=====
ID = 3 ( 0007):    26.26    7.126    12.17    90.05

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0008) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min    |
-----
      OUTFLOW    STORAGE    |    OUTFLOW    STORAGE
      (cms)      (ha.m.)    |    (cms)      (ha.m.)
      0.0000    0.0000    |    1.1580    1.0970
      0.1870    0.6751    |    1.5470    1.2310
      0.5060    0.8381    |    2.1510    1.3219
      0.7820    0.9953    |    0.0000    0.0000

```

```

              AREA    QPEAK    TPEAK    R.V.
              (ha)    (cms)    (hrs)    (mm)
INFLOW : ID= 2 ( 0007)  26.260    7.126    12.17    90.05
OUTFLOW: ID= 1 ( 0008)  26.260    1.485    12.67    90.02

```

```

PEAK FLOW REDUCTION [Qout/Qin] (%)= 20.84
TIME SHIFT OF PEAK FLOW (min)= 30.00
MAXIMUM STORAGE USED (ha.m.)= 1.2162

```

=====

V V I SSSSS U U A L (v 6.2.2010)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

OOO TTTTT TTTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2021 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

** SIMULATION : Malton Rainfall Data-100yr 24 **

| READ STORM | Filename: C:\Users\shuchi\AppData
| | ata\Local\Temp\
| | 84b8a492-9782-4cfd-b409-
bfb60ba4c411\676c82fa
| Ptotal=122.40 mm | Comments: Malton Rainfall Data-100yr 24hr 15min SC

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.00	0.00	6.25	2.20	12.50	17.63	18.75
2.20	0.25	1.35	6.50	2.20	12.75	9.06	19.00
2.20	0.50	1.35	6.75	2.20	13.00	9.06	19.25
2.20	0.75	1.35	7.00	2.20	13.25	6.61	19.50
2.20	1.00	1.35	7.25	2.69	13.50	6.61	19.75
2.20	1.25	1.35	7.50	2.69	13.75	5.14	20.00
2.20	1.50	1.35	7.75	2.69	14.00	5.14	20.25
1.47	1.75	1.35	8.00	2.69	14.25	3.67	20.50
1.47							

2.20	0.500	1.35 6.667	2.20 12.833	13.34 19.00
2.20	0.667	1.35 6.833	2.20 13.000	9.06 19.17
2.20	0.833	1.35 7.000	2.20 13.167	9.06 19.33
2.20	1.000	1.35 7.167	2.20 13.333	7.83 19.50
2.20	1.167	1.35 7.333	2.45 13.500	6.61 19.67
2.20	1.333	1.35 7.500	2.69 13.667	6.61 19.83
2.20	1.500	1.35 7.667	2.69 13.833	5.88 20.00
2.20	1.667	1.35 7.833	2.69 14.000	5.14 20.17
2.20	1.833	1.35 8.000	2.69 14.167	5.14 20.33
1.84	2.000	1.35 8.167	2.69 14.333	4.41 20.50
1.47	2.167	1.35 8.333	2.94 14.500	3.67 20.67
1.47	2.333	1.47 8.500	3.18 14.667	3.67 20.83
1.47	2.500	1.59 8.667	3.18 14.833	3.67 21.00
1.47	2.667	1.59 8.833	3.30 15.000	3.67 21.17
1.47	2.833	1.59 9.000	3.43 15.167	3.67 21.33
1.47	3.000	1.59 9.167	3.43 15.333	3.67 21.50
1.47	3.167	1.59 9.333	3.67 15.500	3.67 21.67
1.47	3.333	1.59 9.500	3.92 15.667	3.67 21.83
1.47	3.500	1.59 9.667	3.92 15.833	3.67 22.00
1.47	3.667	1.59 9.833	4.16 16.000	3.67 22.17
1.47	3.833	1.59 10.000	4.41 16.167	3.67 22.33
1.47	4.000	1.59 10.167	4.41 16.333	2.94 22.50
1.47	4.167	1.59 10.333	5.02 16.500	2.20 22.67
1.47	4.333	1.77 10.500	5.63 16.667	2.20 22.83
1.47	4.500	1.96 10.667	5.63 16.833	2.20 23.00
1.47	4.667	1.96 10.833	6.61 17.000	2.20 23.17
1.47	4.833	1.96 11.000	7.59 17.167	2.20 23.33

1.47	5.000	1.96	11.167	7.59	17.333	2.20	23.50
1.47	5.167	1.96	11.333	9.67	17.500	2.20	23.67
1.47	5.333	1.96	11.500	11.75	17.667	2.20	23.83
1.47	5.500	1.96	11.667	11.75	17.833	2.20	24.00
1.47	5.667	1.96	11.833	23.99	18.000	2.20	24.17
0.73	5.833	1.96	12.000	36.23	18.167	2.20	24.33
	6.000	1.96	12.167	149.82	18.333	2.20	
	6.167	1.96	12.333	83.72	18.500	2.20	

Unit Hyd Qpeak (cms)= 1.090

PEAK FLOW (cms)= 0.530 (i)
 TIME TO PEAK (hrs)= 12.333
 RUNOFF VOLUME (mm)= 47.295
 TOTAL RAINFALL (mm)= 122.400
 RUNOFF COEFFICIENT = 0.386

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0001) | Area (ha)= 8.99
 | ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	5.39	3.60
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	244.81	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.167	0.00	6.333	2.08	12.500	17.63	18.67
2.20	0.333	0.67	6.500	2.20	12.667	17.63	18.83
2.20	0.500	1.35	6.667	2.20	12.833	13.34	19.00
2.20							

2.20	0.667	1.35 6.833	2.20 13.000	9.06 19.17
2.20	0.833	1.35 7.000	2.20 13.167	9.06 19.33
2.20	1.000	1.35 7.167	2.20 13.333	7.83 19.50
2.20	1.167	1.35 7.333	2.45 13.500	6.61 19.67
2.20	1.333	1.35 7.500	2.69 13.667	6.61 19.83
2.20	1.500	1.35 7.667	2.69 13.833	5.88 20.00
2.20	1.667	1.35 7.833	2.69 14.000	5.14 20.17
2.20	1.833	1.35 8.000	2.69 14.167	5.14 20.33
1.84	2.000	1.35 8.167	2.69 14.333	4.41 20.50
1.47	2.167	1.35 8.333	2.94 14.500	3.67 20.67
1.47	2.333	1.47 8.500	3.18 14.667	3.67 20.83
1.47	2.500	1.59 8.667	3.18 14.833	3.67 21.00
1.47	2.667	1.59 8.833	3.30 15.000	3.67 21.17
1.47	2.833	1.59 9.000	3.43 15.167	3.67 21.33
1.47	3.000	1.59 9.167	3.43 15.333	3.67 21.50
1.47	3.167	1.59 9.333	3.67 15.500	3.67 21.67
1.47	3.333	1.59 9.500	3.92 15.667	3.67 21.83
1.47	3.500	1.59 9.667	3.92 15.833	3.67 22.00
1.47	3.667	1.59 9.833	4.16 16.000	3.67 22.17
1.47	3.833	1.59 10.000	4.41 16.167	3.67 22.33
1.47	4.000	1.59 10.167	4.41 16.333	2.94 22.50
1.47	4.167	1.59 10.333	5.02 16.500	2.20 22.67
1.47	4.333	1.77 10.500	5.63 16.667	2.20 22.83
1.47	4.500	1.96 10.667	5.63 16.833	2.20 23.00
1.47	4.667	1.96 10.833	6.61 17.000	2.20 23.17
1.47	4.833	1.96 11.000	7.59 17.167	2.20 23.33
1.47	5.000	1.96 11.167	7.59 17.333	2.20 23.50

1.47	5.167	1.96	11.333	9.67	17.500	2.20	23.67
1.47	5.333	1.96	11.500	11.75	17.667	2.20	23.83
1.47	5.500	1.96	11.667	11.75	17.833	2.20	24.00
1.47	5.667	1.96	11.833	23.99	18.000	2.20	24.17
0.73	5.833	1.96	12.000	36.23	18.167	2.20	24.33
	6.000	1.96	12.167	149.82	18.333	2.20	
	6.167	1.96	12.333	83.72	18.500	2.20	

Max.Eff.Inten. (mm/hr)=	149.82	157.53	
over (min)	10.00	10.00	
Storage Coeff. (min)=	3.72 (ii)	9.60 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.16	0.11	
			* TOTALS*
PEAK FLOW (cms)=	1.77	1.12	2.894 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	121.40	93.53	107.46
TOTAL RAINFALL (mm)=	122.40	122.40	122.40
RUNOFF COEFFICIENT =	0.99	0.76	0.88

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB			
STANDHYD (0009)		Area (ha)=	4.20
ID= 1 DT=10.0 min		Total Imp(%)=	80.00
		Dir. Conn.(%)=	75.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	3.36	0.84
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	167.33	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
RAIN						

mm/hr	hrs	mm/hr		hrs	mm/hr	'	hrs	mm/hr		hrs
	0.167	0.00		6.333	2.08	12.500		17.63		18.67
2.20	0.333	0.67		6.500	2.20	12.667		17.63		18.83
2.20	0.500	1.35		6.667	2.20	12.833		13.34		19.00
2.20	0.667	1.35		6.833	2.20	13.000		9.06		19.17
2.20	0.833	1.35		7.000	2.20	13.167		9.06		19.33
2.20	1.000	1.35		7.167	2.20	13.333		7.83		19.50
2.20	1.167	1.35		7.333	2.45	13.500		6.61		19.67
2.20	1.333	1.35		7.500	2.69	13.667		6.61		19.83
2.20	1.500	1.35		7.667	2.69	13.833		5.88		20.00
2.20	1.667	1.35		7.833	2.69	14.000		5.14		20.17
2.20	1.833	1.35		8.000	2.69	14.167		5.14		20.33
1.84	2.000	1.35		8.167	2.69	14.333		4.41		20.50
1.47	2.167	1.35		8.333	2.94	14.500		3.67		20.67
1.47	2.333	1.47		8.500	3.18	14.667		3.67		20.83
1.47	2.500	1.59		8.667	3.18	14.833		3.67		21.00
1.47	2.667	1.59		8.833	3.30	15.000		3.67		21.17
1.47	2.833	1.59		9.000	3.43	15.167		3.67		21.33
1.47	3.000	1.59		9.167	3.43	15.333		3.67		21.50
1.47	3.167	1.59		9.333	3.67	15.500		3.67		21.67
1.47	3.333	1.59		9.500	3.92	15.667		3.67		21.83
1.47	3.500	1.59		9.667	3.92	15.833		3.67		22.00
1.47	3.667	1.59		9.833	4.16	16.000		3.67		22.17
1.47	3.833	1.59		10.000	4.41	16.167		3.67		22.33
1.47	4.000	1.59		10.167	4.41	16.333		2.94		22.50
1.47	4.167	1.59		10.333	5.02	16.500		2.20		22.67
1.47	4.333	1.77		10.500	5.63	16.667		2.20		22.83

1.47	4.500	1.96	10.667	5.63	16.833	2.20	23.00
1.47	4.667	1.96	10.833	6.61	17.000	2.20	23.17
1.47	4.833	1.96	11.000	7.59	17.167	2.20	23.33
1.47	5.000	1.96	11.167	7.59	17.333	2.20	23.50
1.47	5.167	1.96	11.333	9.67	17.500	2.20	23.67
1.47	5.333	1.96	11.500	11.75	17.667	2.20	23.83
1.47	5.500	1.96	11.667	11.75	17.833	2.20	24.00
1.47	5.667	1.96	11.833	23.99	18.000	2.20	24.17
1.47	5.833	1.96	12.000	36.23	18.167	2.20	24.33
0.73	6.000	1.96	12.167	149.82	18.333	2.20	
	6.167	1.96	12.333	83.72	18.500	2.20	

Max.Eff.Inten.(mm/hr)= 149.82 157.53
over (min) 10.00 10.00
Storage Coeff. (min)= 2.96 (ii) 8.84 (ii)
Unit Hyd. Tpeak (min)= 10.00 10.00
Unit Hyd. peak (cms)= 0.16 0.12

* TOTALS*

PEAK FLOW (cms)=	1.28	0.27	1.548 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	121.40	93.53	114.43
TOTAL RAINFALL (mm)=	122.40	122.40	122.40
RUNOFF COEFFICIENT =	0.99	0.76	0.93

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0003) |
| 1 + 2 = 3 |
-----

```

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 1 (0001):	8.99	2.894	12.17	107.46
+ ID2= 2 (0002):	4.28	0.530	12.33	47.29
=====				
ID = 3 (0003):	13.27	3.401	12.17	88.06

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0003) |
| 3 + 2 = 1 |
-----
AREA      QPEAK      TPEAK      R.V.
  (ha)    (cms)     (hrs)     (mm)
ID1= 3 ( 0003):  13.27  3.401  12.17  88.06
+ ID2= 2 ( 0009):   4.20  1.548  12.17  114.43
=====
ID = 1 ( 0003):   17.47  4.950  12.17  94.40

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| CALIB |
| NASHYD ( 0004) | Area (ha)= 2.03 Curve Number (CN)= 80.0
| ID= 1 DT=10.0 min | Ia (mm)= 5.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.20

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
  hrs     mm/hr |  hrs     mm/hr |  hrs     mm/hr |  hrs
mm/hr
0.167     0.00 | 6.333     2.08 | 12.500    17.63 | 18.67
2.20
0.333     0.67 | 6.500     2.20 | 12.667    17.63 | 18.83
2.20
0.500     1.35 | 6.667     2.20 | 12.833    13.34 | 19.00
2.20
0.667     1.35 | 6.833     2.20 | 13.000     9.06 | 19.17
2.20
0.833     1.35 | 7.000     2.20 | 13.167     9.06 | 19.33
2.20
1.000     1.35 | 7.167     2.20 | 13.333     7.83 | 19.50
2.20
1.167     1.35 | 7.333     2.45 | 13.500     6.61 | 19.67
2.20
1.333     1.35 | 7.500     2.69 | 13.667     6.61 | 19.83
2.20
1.500     1.35 | 7.667     2.69 | 13.833     5.88 | 20.00
2.20
1.667     1.35 | 7.833     2.69 | 14.000     5.14 | 20.17
2.20
1.833     1.35 | 8.000     2.69 | 14.167     5.14 | 20.33
1.84
2.000     1.35 | 8.167     2.69 | 14.333     4.41 | 20.50
1.47

```

1.47	2.167	1.35	8.333	2.94	14.500	3.67	20.67
1.47	2.333	1.47	8.500	3.18	14.667	3.67	20.83
1.47	2.500	1.59	8.667	3.18	14.833	3.67	21.00
1.47	2.667	1.59	8.833	3.30	15.000	3.67	21.17
1.47	2.833	1.59	9.000	3.43	15.167	3.67	21.33
1.47	3.000	1.59	9.167	3.43	15.333	3.67	21.50
1.47	3.167	1.59	9.333	3.67	15.500	3.67	21.67
1.47	3.333	1.59	9.500	3.92	15.667	3.67	21.83
1.47	3.500	1.59	9.667	3.92	15.833	3.67	22.00
1.47	3.667	1.59	9.833	4.16	16.000	3.67	22.17
1.47	3.833	1.59	10.000	4.41	16.167	3.67	22.33
1.47	4.000	1.59	10.167	4.41	16.333	2.94	22.50
1.47	4.167	1.59	10.333	5.02	16.500	2.20	22.67
1.47	4.333	1.77	10.500	5.63	16.667	2.20	22.83
1.47	4.500	1.96	10.667	5.63	16.833	2.20	23.00
1.47	4.667	1.96	10.833	6.61	17.000	2.20	23.17
1.47	4.833	1.96	11.000	7.59	17.167	2.20	23.33
1.47	5.000	1.96	11.167	7.59	17.333	2.20	23.50
1.47	5.167	1.96	11.333	9.67	17.500	2.20	23.67
1.47	5.333	1.96	11.500	11.75	17.667	2.20	23.83
1.47	5.500	1.96	11.667	11.75	17.833	2.20	24.00
1.47	5.667	1.96	11.833	23.99	18.000	2.20	24.17
1.47	5.833	1.96	12.000	36.23	18.167	2.20	24.33
0.73	6.000	1.96	12.167	149.82	18.333	2.20	
	6.167	1.96	12.333	83.72	18.500	2.20	

Unit Hyd Qpeak (cms)= 0.388

PEAK FLOW (cms)= 0.374 (i)

TIME TO PEAK (hrs)= 12.333

RUNOFF VOLUME (mm)= 74.210

TOTAL RAINFALL (mm)= 122.400
 RUNOFF COEFFICIENT = 0.606

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0010) | Area (ha)= 5.10
 | ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	4.84	0.26
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	184.39	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.167	0.00	6.333	2.08	12.500	17.63	18.67
2.20	0.333	0.67	6.500	2.20	12.667	17.63	18.83
2.20	0.500	1.35	6.667	2.20	12.833	13.34	19.00
2.20	0.667	1.35	6.833	2.20	13.000	9.06	19.17
2.20	0.833	1.35	7.000	2.20	13.167	9.06	19.33
2.20	1.000	1.35	7.167	2.20	13.333	7.83	19.50
2.20	1.167	1.35	7.333	2.45	13.500	6.61	19.67
2.20	1.333	1.35	7.500	2.69	13.667	6.61	19.83
2.20	1.500	1.35	7.667	2.69	13.833	5.88	20.00
2.20	1.667	1.35	7.833	2.69	14.000	5.14	20.17
2.20	1.833	1.35	8.000	2.69	14.167	5.14	20.33
1.84	2.000	1.35	8.167	2.69	14.333	4.41	20.50
1.47	2.167	1.35	8.333	2.94	14.500	3.67	20.67
1.47							

1.47	2.333	1.47		8.500	3.18		14.667	3.67		20.83
1.47	2.500	1.59		8.667	3.18		14.833	3.67		21.00
1.47	2.667	1.59		8.833	3.30		15.000	3.67		21.17
1.47	2.833	1.59		9.000	3.43		15.167	3.67		21.33
1.47	3.000	1.59		9.167	3.43		15.333	3.67		21.50
1.47	3.167	1.59		9.333	3.67		15.500	3.67		21.67
1.47	3.333	1.59		9.500	3.92		15.667	3.67		21.83
1.47	3.500	1.59		9.667	3.92		15.833	3.67		22.00
1.47	3.667	1.59		9.833	4.16		16.000	3.67		22.17
1.47	3.833	1.59		10.000	4.41		16.167	3.67		22.33
1.47	4.000	1.59		10.167	4.41		16.333	2.94		22.50
1.47	4.167	1.59		10.333	5.02		16.500	2.20		22.67
1.47	4.333	1.77		10.500	5.63		16.667	2.20		22.83
1.47	4.500	1.96		10.667	5.63		16.833	2.20		23.00
1.47	4.667	1.96		10.833	6.61		17.000	2.20		23.17
1.47	4.833	1.96		11.000	7.59		17.167	2.20		23.33
1.47	5.000	1.96		11.167	7.59		17.333	2.20		23.50
1.47	5.167	1.96		11.333	9.67		17.500	2.20		23.67
1.47	5.333	1.96		11.500	11.75		17.667	2.20		23.83
1.47	5.500	1.96		11.667	11.75		17.833	2.20		24.00
1.47	5.667	1.96		11.833	23.99		18.000	2.20		24.17
1.47	5.833	1.96		12.000	36.23		18.167	2.20		24.33
0.73	6.000	1.96		12.167	149.82		18.333	2.20		
	6.167	1.96		12.333	83.72		18.500	2.20		

Max.Eff.Inten. (mm/hr)=	149.82	274.14
over (min)	10.00	10.00
Storage Coeff. (min)=	3.14 (ii)	7.85 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	0.16	0.12

PEAK FLOW (cms)=	1.85	0.15	* TOTALS*
			2.001 (iii)

TIME TO PEAK	(hrs)=	12.17	12.17	12.17
RUNOFF VOLUME	(mm)=	121.40	102.72	119.53
TOTAL RAINFALL	(mm)=	122.40	122.40	122.40
RUNOFF COEFFICIENT	=	0.99	0.84	0.98

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0010):  5.10      2.001      12.17      119.53
+ ID2= 2 ( 0003): 17.47      4.950      12.17      94.40
=====
ID = 3 ( 0005):  22.57      6.950      12.17      100.08

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| ADD HYD ( 0005) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0005): 22.57      6.950      12.17      100.08
+ ID2= 2 ( 0004):  2.03      0.374      12.33      74.21
=====
ID = 1 ( 0005):  24.60      7.258      12.17      97.94

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| CALIB |
| STANDHYD ( 0006) | Area (ha)= 1.66
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	1.25	0.42
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	105.20	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.20	0.167	0.00	6.333	2.08	12.500	17.63	18.67
2.20	0.333	0.67	6.500	2.20	12.667	17.63	18.83
2.20	0.500	1.35	6.667	2.20	12.833	13.34	19.00
2.20	0.667	1.35	6.833	2.20	13.000	9.06	19.17
2.20	0.833	1.35	7.000	2.20	13.167	9.06	19.33
2.20	1.000	1.35	7.167	2.20	13.333	7.83	19.50
2.20	1.167	1.35	7.333	2.45	13.500	6.61	19.67
2.20	1.333	1.35	7.500	2.69	13.667	6.61	19.83
2.20	1.500	1.35	7.667	2.69	13.833	5.88	20.00
2.20	1.667	1.35	7.833	2.69	14.000	5.14	20.17
1.84	1.833	1.35	8.000	2.69	14.167	5.14	20.33
1.47	2.000	1.35	8.167	2.69	14.333	4.41	20.50
1.47	2.167	1.35	8.333	2.94	14.500	3.67	20.67
1.47	2.333	1.47	8.500	3.18	14.667	3.67	20.83
1.47	2.500	1.59	8.667	3.18	14.833	3.67	21.00
1.47	2.667	1.59	8.833	3.30	15.000	3.67	21.17
1.47	2.833	1.59	9.000	3.43	15.167	3.67	21.33
1.47	3.000	1.59	9.167	3.43	15.333	3.67	21.50
1.47	3.167	1.59	9.333	3.67	15.500	3.67	21.67
1.47	3.333	1.59	9.500	3.92	15.667	3.67	21.83
1.47	3.500	1.59	9.667	3.92	15.833	3.67	22.00
1.47	3.667	1.59	9.833	4.16	16.000	3.67	22.17
1.47	3.833	1.59	10.000	4.41	16.167	3.67	22.33

1.47	4.000	1.59	10.167	4.41	16.333	2.94	22.50
1.47	4.167	1.59	10.333	5.02	16.500	2.20	22.67
1.47	4.333	1.77	10.500	5.63	16.667	2.20	22.83
1.47	4.500	1.96	10.667	5.63	16.833	2.20	23.00
1.47	4.667	1.96	10.833	6.61	17.000	2.20	23.17
1.47	4.833	1.96	11.000	7.59	17.167	2.20	23.33
1.47	5.000	1.96	11.167	7.59	17.333	2.20	23.50
1.47	5.167	1.96	11.333	9.67	17.500	2.20	23.67
1.47	5.333	1.96	11.500	11.75	17.667	2.20	23.83
1.47	5.500	1.96	11.667	11.75	17.833	2.20	24.00
1.47	5.667	1.96	11.833	23.99	18.000	2.20	24.17
1.47	5.833	1.96	12.000	36.23	18.167	2.20	24.33
0.73	6.000	1.96	12.167	149.82	18.333	2.20	
	6.167	1.96	12.333	83.72	18.500	2.20	

Max.Eff.Inten. (mm/hr)=	149.82	274.14	
over (min)	10.00	10.00	
Storage Coeff. (min)=	2.24 (ii)	6.96 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.17	0.13	
			* TOTALS*
PEAK FLOW (cms)=	0.34	0.26	0.599 (iii)
TIME TO PEAK (hrs)=	12.17	12.17	12.17
RUNOFF VOLUME (mm)=	121.40	102.72	112.06
TOTAL RAINFALL (mm)=	122.40	122.40	122.40
RUNOFF COEFFICIENT =	0.99	0.84	0.92

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | ADD HYD (0007) |
1 + 2 = 3

AREA	QPEAK	TPEAK	R.V.
(ha)	(cms)	(hrs)	(mm)

```

ID1= 1 ( 0005):    24.60    7.258    12.17    97.94
+ ID2= 2 ( 0006):     1.66    0.599    12.17   112.06
=====
ID = 3 ( 0007):    26.26    7.856    12.17    98.83

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0008) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min    |
-----
      OUTFLOW    STORAGE    |    OUTFLOW    STORAGE
      (cms)      (ha.m.)    |    (cms)      (ha.m.)
      0.0000     0.0000    |    1.1580     1.0970
      0.1870     0.6751    |    1.5470     1.2310
      0.5060     0.8381    |    2.1510     1.3219
      0.7820     0.9953    |    0.0000     0.0000

                        AREA    QPEAK    TPEAK    R.V.
                        (ha)    (cms)    (hrs)    (mm)
INFLOW : ID= 2 ( 0007)  26.260    7.856    12.17    98.83
OUTFLOW: ID= 1 ( 0008)  26.260    1.992    12.50    98.80

```

```

      PEAK FLOW REDUCTION [Qout/Qin] (%)= 25.35
      TIME SHIFT OF PEAK FLOW (min)= 20.00
      MAXIMUM STORAGE USED (ha.m.)= 1.2983

```

=====

V V I SSSSS U U A L (v 6.2.2010)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

OOO TTTTT TTTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2021 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

** SIMULATION : Hurricane Hazel-Regional **

| READ STORM | Filename: C:\Users\shuchi\AppData
| | ata\Local\Temp\
| | 84b8a492-9782-4cfd-b409-
bfb60ba4c411\4d9a829c
| Ptotal=285.00 mm | Comments: Hurricane Hazel-Regional

RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.00	0.00	6.00	12.00	2.00	24.00
2.00	1.00	4.00	13.00	2.00	25.00
2.00	2.00	6.00	14.00	2.00	26.00
2.00	3.00	13.00	15.00	2.00	27.00
2.00	4.00	17.00	16.00	2.00	28.00
2.00	5.00	13.00	17.00	2.00	29.00
2.00	6.00	23.00	18.00	2.00	30.00
2.00	7.00	13.00	19.00	2.00	31.00

2.00	8.00	13.00		20.00	2.00		32.00	2.00		44.00
2.00	9.00	53.00		21.00	2.00		33.00	2.00		45.00
2.00	10.00	38.00		22.00	2.00		34.00	2.00		46.00
3.00	11.00	13.00		23.00	2.00		35.00	2.00		47.00


```

-----
| CALIB          |
| NASHYD ( 0002) | Area      (ha)= 4.28   Curve Number (CN)= 64.0
| ID= 1 DT=10.0 min | Ia       (mm)= 8.00   # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.15

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----

```

RAIN	TIME	RAIN		TIME	RAIN		TIME	RAIN		TIME
mm/hr	hrs	mm/hr		hrs	mm/hr		hrs	mm/hr		hrs
2.00	0.167	6.00		12.167	2.00		24.167	2.00		36.17
2.00	0.333	6.00		12.333	2.00		24.333	2.00		36.33
2.00	0.500	6.00		12.500	2.00		24.500	2.00		36.50
2.00	0.667	6.00		12.667	2.00		24.667	2.00		36.67
2.00	0.833	6.00		12.833	2.00		24.833	2.00		36.83
2.00	1.000	6.00		13.000	2.00		25.000	2.00		37.00
2.00	1.167	4.00		13.167	2.00		25.167	2.00		37.17
2.00	1.333	4.00		13.333	2.00		25.333	2.00		37.33
2.00	1.500	4.00		13.500	2.00		25.500	2.00		37.50
2.00	1.667	4.00		13.667	2.00		25.667	2.00		37.67
2.00	1.833	4.00		13.833	2.00		25.833	2.00		37.83
2.00	2.000	4.00		14.000	2.00		26.000	2.00		38.00
2.00	2.167	6.00		14.167	2.00		26.167	2.00		38.17
2.00	2.333	6.00		14.333	2.00		26.333	2.00		38.33

2.00	2.500	6.00	14.500	2.00	26.500	2.00	38.50
2.00	2.667	6.00	14.667	2.00	26.667	2.00	38.67
2.00	2.833	6.00	14.833	2.00	26.833	2.00	38.83
2.00	3.000	6.00	15.000	2.00	27.000	2.00	39.00
2.00	3.167	13.00	15.167	2.00	27.167	2.00	39.17
2.00	3.333	13.00	15.333	2.00	27.333	2.00	39.33
2.00	3.500	13.00	15.500	2.00	27.500	2.00	39.50
2.00	3.667	13.00	15.667	2.00	27.667	2.00	39.67
2.00	3.833	13.00	15.833	2.00	27.833	2.00	39.83
2.00	4.000	13.00	16.000	2.00	28.000	2.00	40.00
2.00	4.167	17.00	16.167	2.00	28.167	2.00	40.17
2.00	4.333	17.00	16.333	2.00	28.333	2.00	40.33
2.00	4.500	17.00	16.500	2.00	28.500	2.00	40.50
2.00	4.667	17.00	16.667	2.00	28.667	2.00	40.67
2.00	4.833	17.00	16.833	2.00	28.833	2.00	40.83
2.00	5.000	17.00	17.000	2.00	29.000	2.00	41.00
2.00	5.167	13.00	17.167	2.00	29.167	2.00	41.17
2.00	5.333	13.00	17.333	2.00	29.333	2.00	41.33
2.00	5.500	13.00	17.500	2.00	29.500	2.00	41.50
2.00	5.667	13.00	17.667	2.00	29.667	2.00	41.67
2.00	5.833	13.00	17.833	2.00	29.833	2.00	41.83
2.00	6.000	13.00	18.000	2.00	30.000	2.00	42.00
2.00	6.167	23.00	18.167	2.00	30.167	2.00	42.17
2.00	6.333	23.00	18.333	2.00	30.333	2.00	42.33
2.00	6.500	23.00	18.500	2.00	30.500	2.00	42.50
2.00	6.667	23.00	18.667	2.00	30.667	2.00	42.67
2.00	6.833	23.00	18.833	2.00	30.833	2.00	42.83

2.00	7.000	23.00	19.000	2.00	31.000	2.00	43.00
2.00	7.167	13.00	19.167	2.00	31.167	2.00	43.17
2.00	7.333	13.00	19.333	2.00	31.333	2.00	43.33
2.00	7.500	13.00	19.500	2.00	31.500	2.00	43.50
2.00	7.667	13.00	19.667	2.00	31.667	2.00	43.67
2.00	7.833	13.00	19.833	2.00	31.833	2.00	43.83
2.00	8.000	13.00	20.000	2.00	32.000	2.00	44.00
2.00	8.167	13.00	20.167	2.00	32.167	2.00	44.17
2.00	8.333	13.00	20.333	2.00	32.333	2.00	44.33
2.00	8.500	13.00	20.500	2.00	32.500	2.00	44.50
2.00	8.667	13.00	20.667	2.00	32.667	2.00	44.67
2.00	8.833	13.00	20.833	2.00	32.833	2.00	44.83
2.00	9.000	13.00	21.000	2.00	33.000	2.00	45.00
2.00	9.167	53.00	21.167	2.00	33.167	2.00	45.17
2.00	9.333	53.00	21.333	2.00	33.333	2.00	45.33
2.00	9.500	53.00	21.500	2.00	33.500	2.00	45.50
2.00	9.667	53.00	21.667	2.00	33.667	2.00	45.67
2.00	9.833	53.00	21.833	2.00	33.833	2.00	45.83
2.00	10.000	53.00	22.000	2.00	34.000	2.00	46.00
2.00	10.167	38.00	22.167	2.00	34.167	2.00	46.17
2.00	10.333	38.00	22.333	2.00	34.333	2.00	46.33
2.00	10.500	38.00	22.500	2.00	34.500	2.00	46.50
2.00	10.667	38.00	22.667	2.00	34.667	2.00	46.67
2.00	10.833	38.00	22.833	2.00	34.833	2.00	46.83
2.00	11.000	38.00	23.000	2.00	35.000	2.00	47.00
3.00	11.167	13.00	23.167	2.00	35.167	2.00	47.17
3.00	11.333	13.00	23.333	2.00	35.333	2.00	47.33

3.00	11.500	13.00	23.500	2.00	35.500	2.00	47.50
3.00	11.667	13.00	23.667	2.00	35.667	2.00	47.67
3.00	11.833	13.00	23.833	2.00	35.833	2.00	47.83
3.00	12.000	13.00	24.000	2.00	36.000	2.00	48.00

Unit Hyd Qpeak (cms)= 1.090

PEAK FLOW (cms)= 0.441 (i)
 TIME TO PEAK (hrs)= 10.000
 RUNOFF VOLUME (mm)= 169.903
 TOTAL RAINFALL (mm)= 285.000
 RUNOFF COEFFICIENT = 0.596

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB |
 | STANDHYD (0001) | Area (ha)= 8.99
 | ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	5.39	3.60
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	244.81	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
mm/hr	0.167	6.00	12.167	2.00	24.167	2.00	36.17
2.00	0.333	6.00	12.333	2.00	24.333	2.00	36.33
2.00	0.500	6.00	12.500	2.00	24.500	2.00	36.50
2.00	0.667	6.00	12.667	2.00	24.667	2.00	36.67
2.00	0.833	6.00	12.833	2.00	24.833	2.00	36.83
2.00	1.000	6.00	13.000	2.00	25.000	2.00	37.00

2.00	1.167	4.00	13.167	2.00	25.167	2.00	37.17
2.00	1.333	4.00	13.333	2.00	25.333	2.00	37.33
2.00	1.500	4.00	13.500	2.00	25.500	2.00	37.50
2.00	1.667	4.00	13.667	2.00	25.667	2.00	37.67
2.00	1.833	4.00	13.833	2.00	25.833	2.00	37.83
2.00	2.000	4.00	14.000	2.00	26.000	2.00	38.00
2.00	2.167	6.00	14.167	2.00	26.167	2.00	38.17
2.00	2.333	6.00	14.333	2.00	26.333	2.00	38.33
2.00	2.500	6.00	14.500	2.00	26.500	2.00	38.50
2.00	2.667	6.00	14.667	2.00	26.667	2.00	38.67
2.00	2.833	6.00	14.833	2.00	26.833	2.00	38.83
2.00	3.000	6.00	15.000	2.00	27.000	2.00	39.00
2.00	3.167	13.00	15.167	2.00	27.167	2.00	39.17
2.00	3.333	13.00	15.333	2.00	27.333	2.00	39.33
2.00	3.500	13.00	15.500	2.00	27.500	2.00	39.50
2.00	3.667	13.00	15.667	2.00	27.667	2.00	39.67
2.00	3.833	13.00	15.833	2.00	27.833	2.00	39.83
2.00	4.000	13.00	16.000	2.00	28.000	2.00	40.00
2.00	4.167	17.00	16.167	2.00	28.167	2.00	40.17
2.00	4.333	17.00	16.333	2.00	28.333	2.00	40.33
2.00	4.500	17.00	16.500	2.00	28.500	2.00	40.50
2.00	4.667	17.00	16.667	2.00	28.667	2.00	40.67
2.00	4.833	17.00	16.833	2.00	28.833	2.00	40.83
2.00	5.000	17.00	17.000	2.00	29.000	2.00	41.00
2.00	5.167	13.00	17.167	2.00	29.167	2.00	41.17
2.00	5.333	13.00	17.333	2.00	29.333	2.00	41.33
2.00	5.500	13.00	17.500	2.00	29.500	2.00	41.50

2.00	5.667	13.00	17.667	2.00	29.667	2.00	41.67
2.00	5.833	13.00	17.833	2.00	29.833	2.00	41.83
2.00	6.000	13.00	18.000	2.00	30.000	2.00	42.00
2.00	6.167	23.00	18.167	2.00	30.167	2.00	42.17
2.00	6.333	23.00	18.333	2.00	30.333	2.00	42.33
2.00	6.500	23.00	18.500	2.00	30.500	2.00	42.50
2.00	6.667	23.00	18.667	2.00	30.667	2.00	42.67
2.00	6.833	23.00	18.833	2.00	30.833	2.00	42.83
2.00	7.000	23.00	19.000	2.00	31.000	2.00	43.00
2.00	7.167	13.00	19.167	2.00	31.167	2.00	43.17
2.00	7.333	13.00	19.333	2.00	31.333	2.00	43.33
2.00	7.500	13.00	19.500	2.00	31.500	2.00	43.50
2.00	7.667	13.00	19.667	2.00	31.667	2.00	43.67
2.00	7.833	13.00	19.833	2.00	31.833	2.00	43.83
2.00	8.000	13.00	20.000	2.00	32.000	2.00	44.00
2.00	8.167	13.00	20.167	2.00	32.167	2.00	44.17
2.00	8.333	13.00	20.333	2.00	32.333	2.00	44.33
2.00	8.500	13.00	20.500	2.00	32.500	2.00	44.50
2.00	8.667	13.00	20.667	2.00	32.667	2.00	44.67
2.00	8.833	13.00	20.833	2.00	32.833	2.00	44.83
2.00	9.000	13.00	21.000	2.00	33.000	2.00	45.00
2.00	9.167	53.00	21.167	2.00	33.167	2.00	45.17
2.00	9.333	53.00	21.333	2.00	33.333	2.00	45.33
2.00	9.500	53.00	21.500	2.00	33.500	2.00	45.50
2.00	9.667	53.00	21.667	2.00	33.667	2.00	45.67
2.00	9.833	53.00	21.833	2.00	33.833	2.00	45.83
2.00	10.000	53.00	22.000	2.00	34.000	2.00	46.00

2.00	10.167	38.00	22.167	2.00	34.167	2.00	46.17
2.00	10.333	38.00	22.333	2.00	34.333	2.00	46.33
2.00	10.500	38.00	22.500	2.00	34.500	2.00	46.50
2.00	10.667	38.00	22.667	2.00	34.667	2.00	46.67
2.00	10.833	38.00	22.833	2.00	34.833	2.00	46.83
2.00	11.000	38.00	23.000	2.00	35.000	2.00	47.00
3.00	11.167	13.00	23.167	2.00	35.167	2.00	47.17
3.00	11.333	13.00	23.333	2.00	35.333	2.00	47.33
3.00	11.500	13.00	23.500	2.00	35.500	2.00	47.50
3.00	11.667	13.00	23.667	2.00	35.667	2.00	47.67
3.00	11.833	13.00	23.833	2.00	35.833	2.00	47.83
3.00	12.000	13.00	24.000	2.00	36.000	2.00	48.00

Max.Eff.Inten.(mm/hr)= 53.00 63.92
over (min) 10.00 20.00
Storage Coeff. (min)= 5.64 (ii) 14.08 (ii)
Unit Hyd. Tpeak (min)= 10.00 20.00
Unit Hyd. peak (cms)= 0.14 0.07

PEAK FLOW (cms)= 0.66 0.62 1.285 (iii)
TIME TO PEAK (hrs)= 10.00 10.00 10.00
RUNOFF VOLUME (mm)= 284.00 251.96 267.98
TOTAL RAINFALL (mm)= 285.00 285.00 285.00
RUNOFF COEFFICIENT = 1.00 0.88 0.94

* TOTALS*

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0009) | Area (ha)= 4.20
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00

Surface Area (ha)= IMPERVIOUS 3.36 PERVIOUS (i) 0.84

Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	167.33	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

		----- TRANSFORMED HYETOGRAPH -----									
RAIN		TIME	RAIN		TIME	RAIN		TIME	RAIN		TIME
mm/hr		hrs	mm/hr		hrs	mm/hr		hrs	mm/hr		hrs
	2.00	0.167	6.00		12.167	2.00		24.167	2.00		36.17
	2.00	0.333	6.00		12.333	2.00		24.333	2.00		36.33
	2.00	0.500	6.00		12.500	2.00		24.500	2.00		36.50
	2.00	0.667	6.00		12.667	2.00		24.667	2.00		36.67
	2.00	0.833	6.00		12.833	2.00		24.833	2.00		36.83
	2.00	1.000	6.00		13.000	2.00		25.000	2.00		37.00
	2.00	1.167	4.00		13.167	2.00		25.167	2.00		37.17
	2.00	1.333	4.00		13.333	2.00		25.333	2.00		37.33
	2.00	1.500	4.00		13.500	2.00		25.500	2.00		37.50
	2.00	1.667	4.00		13.667	2.00		25.667	2.00		37.67
	2.00	1.833	4.00		13.833	2.00		25.833	2.00		37.83
	2.00	2.000	4.00		14.000	2.00		26.000	2.00		38.00
	2.00	2.167	6.00		14.167	2.00		26.167	2.00		38.17
	2.00	2.333	6.00		14.333	2.00		26.333	2.00		38.33
	2.00	2.500	6.00		14.500	2.00		26.500	2.00		38.50
	2.00	2.667	6.00		14.667	2.00		26.667	2.00		38.67
	2.00	2.833	6.00		14.833	2.00		26.833	2.00		38.83
	2.00	3.000	6.00		15.000	2.00		27.000	2.00		39.00
	2.00	3.167	13.00		15.167	2.00		27.167	2.00		39.17
	2.00	3.333	13.00		15.333	2.00		27.333	2.00		39.33

2.00	3.500	13.00	15.500	2.00	27.500	2.00	39.50
2.00	3.667	13.00	15.667	2.00	27.667	2.00	39.67
2.00	3.833	13.00	15.833	2.00	27.833	2.00	39.83
2.00	4.000	13.00	16.000	2.00	28.000	2.00	40.00
2.00	4.167	17.00	16.167	2.00	28.167	2.00	40.17
2.00	4.333	17.00	16.333	2.00	28.333	2.00	40.33
2.00	4.500	17.00	16.500	2.00	28.500	2.00	40.50
2.00	4.667	17.00	16.667	2.00	28.667	2.00	40.67
2.00	4.833	17.00	16.833	2.00	28.833	2.00	40.83
2.00	5.000	17.00	17.000	2.00	29.000	2.00	41.00
2.00	5.167	13.00	17.167	2.00	29.167	2.00	41.17
2.00	5.333	13.00	17.333	2.00	29.333	2.00	41.33
2.00	5.500	13.00	17.500	2.00	29.500	2.00	41.50
2.00	5.667	13.00	17.667	2.00	29.667	2.00	41.67
2.00	5.833	13.00	17.833	2.00	29.833	2.00	41.83
2.00	6.000	13.00	18.000	2.00	30.000	2.00	42.00
2.00	6.167	23.00	18.167	2.00	30.167	2.00	42.17
2.00	6.333	23.00	18.333	2.00	30.333	2.00	42.33
2.00	6.500	23.00	18.500	2.00	30.500	2.00	42.50
2.00	6.667	23.00	18.667	2.00	30.667	2.00	42.67
2.00	6.833	23.00	18.833	2.00	30.833	2.00	42.83
2.00	7.000	23.00	19.000	2.00	31.000	2.00	43.00
2.00	7.167	13.00	19.167	2.00	31.167	2.00	43.17
2.00	7.333	13.00	19.333	2.00	31.333	2.00	43.33
2.00	7.500	13.00	19.500	2.00	31.500	2.00	43.50
2.00	7.667	13.00	19.667	2.00	31.667	2.00	43.67
2.00	7.833	13.00	19.833	2.00	31.833	2.00	43.83

2.00	8.000	13.00	20.000	2.00	32.000	2.00	44.00
2.00	8.167	13.00	20.167	2.00	32.167	2.00	44.17
2.00	8.333	13.00	20.333	2.00	32.333	2.00	44.33
2.00	8.500	13.00	20.500	2.00	32.500	2.00	44.50
2.00	8.667	13.00	20.667	2.00	32.667	2.00	44.67
2.00	8.833	13.00	20.833	2.00	32.833	2.00	44.83
2.00	9.000	13.00	21.000	2.00	33.000	2.00	45.00
2.00	9.167	53.00	21.167	2.00	33.167	2.00	45.17
2.00	9.333	53.00	21.333	2.00	33.333	2.00	45.33
2.00	9.500	53.00	21.500	2.00	33.500	2.00	45.50
2.00	9.667	53.00	21.667	2.00	33.667	2.00	45.67
2.00	9.833	53.00	21.833	2.00	33.833	2.00	45.83
2.00	10.000	53.00	22.000	2.00	34.000	2.00	46.00
2.00	10.167	38.00	22.167	2.00	34.167	2.00	46.17
2.00	10.333	38.00	22.333	2.00	34.333	2.00	46.33
2.00	10.500	38.00	22.500	2.00	34.500	2.00	46.50
2.00	10.667	38.00	22.667	2.00	34.667	2.00	46.67
2.00	10.833	38.00	22.833	2.00	34.833	2.00	46.83
2.00	11.000	38.00	23.000	2.00	35.000	2.00	47.00
3.00	11.167	13.00	23.167	2.00	35.167	2.00	47.17
3.00	11.333	13.00	23.333	2.00	35.333	2.00	47.33
3.00	11.500	13.00	23.500	2.00	35.500	2.00	47.50
3.00	11.667	13.00	23.667	2.00	35.667	2.00	47.67
3.00	11.833	13.00	23.833	2.00	35.833	2.00	47.83
3.00	12.000	13.00	24.000	2.00	36.000	2.00	48.00

Max.Eff.Inten. (mm/hr)= 53.00 63.92
 over (min) 10.00 20.00
 Storage Coeff. (min)= 4.49 (ii) 12.93 (ii)

Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.15	0.07	
			* TOTALS*
PEAK FLOW (cms)=	0.46	0.15	0.610 (iii)
TIME TO PEAK (hrs)=	10.00	10.00	10.00
RUNOFF VOLUME (mm)=	284.00	251.96	275.99
TOTAL RAINFALL (mm)=	285.00	285.00	285.00
RUNOFF COEFFICIENT =	1.00	0.88	0.97

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

| ADD HYD ( 0003) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0001):  8.99  1.285  10.00  267.98
+ ID2= 2 ( 0002):  4.28  0.441  10.00  169.90
=====
ID = 3 ( 0003):  13.27  1.726  10.00  236.35

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

| ADD HYD ( 0003) |
| 3 + 2 = 1 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0003):  13.27  1.726  10.00  236.35
+ ID2= 2 ( 0009):  4.20  0.610  10.00  275.99
=====
ID = 1 ( 0003):  17.47  2.336  10.00  245.88

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

| CALIB |
| NASHYD ( 0004) | Area (ha)= 2.03 Curve Number (CN)= 80.0
| ID= 1 DT=10.0 min | Ia (mm)= 5.00 # of Linear Res.(N)= 3.00
|-----| U.H. Tp(hrs)= 0.20

```

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.00	0.167	6.00	12.167	2.00	24.167	2.00	36.17
2.00	0.333	6.00	12.333	2.00	24.333	2.00	36.33
2.00	0.500	6.00	12.500	2.00	24.500	2.00	36.50
2.00	0.667	6.00	12.667	2.00	24.667	2.00	36.67
2.00	0.833	6.00	12.833	2.00	24.833	2.00	36.83
2.00	1.000	6.00	13.000	2.00	25.000	2.00	37.00
2.00	1.167	4.00	13.167	2.00	25.167	2.00	37.17
2.00	1.333	4.00	13.333	2.00	25.333	2.00	37.33
2.00	1.500	4.00	13.500	2.00	25.500	2.00	37.50
2.00	1.667	4.00	13.667	2.00	25.667	2.00	37.67
2.00	1.833	4.00	13.833	2.00	25.833	2.00	37.83
2.00	2.000	4.00	14.000	2.00	26.000	2.00	38.00
2.00	2.167	6.00	14.167	2.00	26.167	2.00	38.17
2.00	2.333	6.00	14.333	2.00	26.333	2.00	38.33
2.00	2.500	6.00	14.500	2.00	26.500	2.00	38.50
2.00	2.667	6.00	14.667	2.00	26.667	2.00	38.67
2.00	2.833	6.00	14.833	2.00	26.833	2.00	38.83
2.00	3.000	6.00	15.000	2.00	27.000	2.00	39.00
2.00	3.167	13.00	15.167	2.00	27.167	2.00	39.17
2.00	3.333	13.00	15.333	2.00	27.333	2.00	39.33
2.00	3.500	13.00	15.500	2.00	27.500	2.00	39.50
2.00	3.667	13.00	15.667	2.00	27.667	2.00	39.67
2.00	3.833	13.00	15.833	2.00	27.833	2.00	39.83
2.00	4.000	13.00	16.000	2.00	28.000	2.00	40.00

2.00	4.167	17.00	16.167	2.00	28.167	2.00	40.17
2.00	4.333	17.00	16.333	2.00	28.333	2.00	40.33
2.00	4.500	17.00	16.500	2.00	28.500	2.00	40.50
2.00	4.667	17.00	16.667	2.00	28.667	2.00	40.67
2.00	4.833	17.00	16.833	2.00	28.833	2.00	40.83
2.00	5.000	17.00	17.000	2.00	29.000	2.00	41.00
2.00	5.167	13.00	17.167	2.00	29.167	2.00	41.17
2.00	5.333	13.00	17.333	2.00	29.333	2.00	41.33
2.00	5.500	13.00	17.500	2.00	29.500	2.00	41.50
2.00	5.667	13.00	17.667	2.00	29.667	2.00	41.67
2.00	5.833	13.00	17.833	2.00	29.833	2.00	41.83
2.00	6.000	13.00	18.000	2.00	30.000	2.00	42.00
2.00	6.167	23.00	18.167	2.00	30.167	2.00	42.17
2.00	6.333	23.00	18.333	2.00	30.333	2.00	42.33
2.00	6.500	23.00	18.500	2.00	30.500	2.00	42.50
2.00	6.667	23.00	18.667	2.00	30.667	2.00	42.67
2.00	6.833	23.00	18.833	2.00	30.833	2.00	42.83
2.00	7.000	23.00	19.000	2.00	31.000	2.00	43.00
2.00	7.167	13.00	19.167	2.00	31.167	2.00	43.17
2.00	7.333	13.00	19.333	2.00	31.333	2.00	43.33
2.00	7.500	13.00	19.500	2.00	31.500	2.00	43.50
2.00	7.667	13.00	19.667	2.00	31.667	2.00	43.67
2.00	7.833	13.00	19.833	2.00	31.833	2.00	43.83
2.00	8.000	13.00	20.000	2.00	32.000	2.00	44.00
2.00	8.167	13.00	20.167	2.00	32.167	2.00	44.17
2.00	8.333	13.00	20.333	2.00	32.333	2.00	44.33
2.00	8.500	13.00	20.500	2.00	32.500	2.00	44.50

2.00	8.667	13.00	20.667	2.00	32.667	2.00	44.67
2.00	8.833	13.00	20.833	2.00	32.833	2.00	44.83
2.00	9.000	13.00	21.000	2.00	33.000	2.00	45.00
2.00	9.167	53.00	21.167	2.00	33.167	2.00	45.17
2.00	9.333	53.00	21.333	2.00	33.333	2.00	45.33
2.00	9.500	53.00	21.500	2.00	33.500	2.00	45.50
2.00	9.667	53.00	21.667	2.00	33.667	2.00	45.67
2.00	9.833	53.00	21.833	2.00	33.833	2.00	45.83
2.00	10.000	53.00	22.000	2.00	34.000	2.00	46.00
2.00	10.167	38.00	22.167	2.00	34.167	2.00	46.17
2.00	10.333	38.00	22.333	2.00	34.333	2.00	46.33
2.00	10.500	38.00	22.500	2.00	34.500	2.00	46.50
2.00	10.667	38.00	22.667	2.00	34.667	2.00	46.67
2.00	10.833	38.00	22.833	2.00	34.833	2.00	46.83
2.00	11.000	38.00	23.000	2.00	35.000	2.00	47.00
2.00	11.167	13.00	23.167	2.00	35.167	2.00	47.17
3.00	11.333	13.00	23.333	2.00	35.333	2.00	47.33
3.00	11.500	13.00	23.500	2.00	35.500	2.00	47.50
3.00	11.667	13.00	23.667	2.00	35.667	2.00	47.67
3.00	11.833	13.00	23.833	2.00	35.833	2.00	47.83
3.00	12.000	13.00	24.000	2.00	36.000	2.00	48.00

Unit Hyd Qpeak (cms)= 0.388

PEAK FLOW (cms)= 0.263 (i)

TIME TO PEAK (hrs)= 10.000

RUNOFF VOLUME (mm)= 222.308

TOTAL RAINFALL (mm)= 285.000

RUNOFF COEFFICIENT = 0.780

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| STANDHYD ( 0010) | Area (ha)= 5.10
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	4.84	0.26
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	184.39	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----

```

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.167	6.00	12.167	2.00	24.167	2.00	36.17	
2.00	0.333	6.00	12.333	2.00	24.333	2.00	36.33
2.00	0.500	6.00	12.500	2.00	24.500	2.00	36.50
2.00	0.667	6.00	12.667	2.00	24.667	2.00	36.67
2.00	0.833	6.00	12.833	2.00	24.833	2.00	36.83
2.00	1.000	6.00	13.000	2.00	25.000	2.00	37.00
2.00	1.167	4.00	13.167	2.00	25.167	2.00	37.17
2.00	1.333	4.00	13.333	2.00	25.333	2.00	37.33
2.00	1.500	4.00	13.500	2.00	25.500	2.00	37.50
2.00	1.667	4.00	13.667	2.00	25.667	2.00	37.67
2.00	1.833	4.00	13.833	2.00	25.833	2.00	37.83
2.00	2.000	4.00	14.000	2.00	26.000	2.00	38.00
2.00	2.167	6.00	14.167	2.00	26.167	2.00	38.17
2.00	2.333	6.00	14.333	2.00	26.333	2.00	38.33
2.00	2.500	6.00	14.500	2.00	26.500	2.00	38.50
2.00	2.667	6.00	14.667	2.00	26.667	2.00	38.67

2.00	2.833	6.00	14.833	2.00	26.833	2.00	38.83
2.00	3.000	6.00	15.000	2.00	27.000	2.00	39.00
2.00	3.167	13.00	15.167	2.00	27.167	2.00	39.17
2.00	3.333	13.00	15.333	2.00	27.333	2.00	39.33
2.00	3.500	13.00	15.500	2.00	27.500	2.00	39.50
2.00	3.667	13.00	15.667	2.00	27.667	2.00	39.67
2.00	3.833	13.00	15.833	2.00	27.833	2.00	39.83
2.00	4.000	13.00	16.000	2.00	28.000	2.00	40.00
2.00	4.167	17.00	16.167	2.00	28.167	2.00	40.17
2.00	4.333	17.00	16.333	2.00	28.333	2.00	40.33
2.00	4.500	17.00	16.500	2.00	28.500	2.00	40.50
2.00	4.667	17.00	16.667	2.00	28.667	2.00	40.67
2.00	4.833	17.00	16.833	2.00	28.833	2.00	40.83
2.00	5.000	17.00	17.000	2.00	29.000	2.00	41.00
2.00	5.167	13.00	17.167	2.00	29.167	2.00	41.17
2.00	5.333	13.00	17.333	2.00	29.333	2.00	41.33
2.00	5.500	13.00	17.500	2.00	29.500	2.00	41.50
2.00	5.667	13.00	17.667	2.00	29.667	2.00	41.67
2.00	5.833	13.00	17.833	2.00	29.833	2.00	41.83
2.00	6.000	13.00	18.000	2.00	30.000	2.00	42.00
2.00	6.167	23.00	18.167	2.00	30.167	2.00	42.17
2.00	6.333	23.00	18.333	2.00	30.333	2.00	42.33
2.00	6.500	23.00	18.500	2.00	30.500	2.00	42.50
2.00	6.667	23.00	18.667	2.00	30.667	2.00	42.67
2.00	6.833	23.00	18.833	2.00	30.833	2.00	42.83
2.00	7.000	23.00	19.000	2.00	31.000	2.00	43.00
2.00	7.167	13.00	19.167	2.00	31.167	2.00	43.17

2.00	7.333	13.00	19.333	2.00	31.333	2.00	43.33
2.00	7.500	13.00	19.500	2.00	31.500	2.00	43.50
2.00	7.667	13.00	19.667	2.00	31.667	2.00	43.67
2.00	7.833	13.00	19.833	2.00	31.833	2.00	43.83
2.00	8.000	13.00	20.000	2.00	32.000	2.00	44.00
2.00	8.167	13.00	20.167	2.00	32.167	2.00	44.17
2.00	8.333	13.00	20.333	2.00	32.333	2.00	44.33
2.00	8.500	13.00	20.500	2.00	32.500	2.00	44.50
2.00	8.667	13.00	20.667	2.00	32.667	2.00	44.67
2.00	8.833	13.00	20.833	2.00	32.833	2.00	44.83
2.00	9.000	13.00	21.000	2.00	33.000	2.00	45.00
2.00	9.167	53.00	21.167	2.00	33.167	2.00	45.17
2.00	9.333	53.00	21.333	2.00	33.333	2.00	45.33
2.00	9.500	53.00	21.500	2.00	33.500	2.00	45.50
2.00	9.667	53.00	21.667	2.00	33.667	2.00	45.67
2.00	9.833	53.00	21.833	2.00	33.833	2.00	45.83
2.00	10.000	53.00	22.000	2.00	34.000	2.00	46.00
2.00	10.167	38.00	22.167	2.00	34.167	2.00	46.17
2.00	10.333	38.00	22.333	2.00	34.333	2.00	46.33
2.00	10.500	38.00	22.500	2.00	34.500	2.00	46.50
2.00	10.667	38.00	22.667	2.00	34.667	2.00	46.67
2.00	10.833	38.00	22.833	2.00	34.833	2.00	46.83
2.00	11.000	38.00	23.000	2.00	35.000	2.00	47.00
3.00	11.167	13.00	23.167	2.00	35.167	2.00	47.17
3.00	11.333	13.00	23.333	2.00	35.333	2.00	47.33
3.00	11.500	13.00	23.500	2.00	35.500	2.00	47.50
3.00	11.667	13.00	23.667	2.00	35.667	2.00	47.67

3.00 11.833 13.00 | 23.833 2.00 | 35.833 2.00 | 47.83
 3.00 12.000 13.00 | 24.000 2.00 | 36.000 2.00 | 48.00

Max.Eff.Inten.(mm/hr)= 53.00 104.32
 over (min) 10.00 20.00
 Storage Coeff. (min)= 4.75 (ii) 11.69 (ii)
 Unit Hyd. Tpeak (min)= 10.00 20.00
 Unit Hyd. peak (cms)= 0.15 0.08

 * TOTALS*
 PEAK FLOW (cms)= 0.68 0.07 0.749 (iii)
 TIME TO PEAK (hrs)= 10.00 10.00 10.00
 RUNOFF VOLUME (mm)= 284.00 263.47 281.95
 TOTAL RAINFALL (mm)= 285.00 285.00 285.00
 RUNOFF COEFFICIENT = 1.00 0.92 0.99

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
  ID1= 1 ( 0010):   5.10   0.749   10.00   281.95
+ ID2= 2 ( 0003):  17.47   2.336   10.00   245.88
=====
  ID = 3 ( 0005):  22.57   3.085   10.00   254.03
  
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0005) |
| 3 + 2 = 1 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
  ID1= 3 ( 0005):  22.57   3.085   10.00   254.03
+ ID2= 2 ( 0004):   2.03   0.263   10.00   222.31
=====
  ID = 1 ( 0005):  24.60   3.349   10.00   251.41
  
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

| CALIB |
| STANDHYD ( 0006) | Area (ha)= 1.66
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00
-----

```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	1.25	0.42
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	105.20	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 10.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
      TIME      RAIN | TIME      RAIN | TIME      RAIN | TIME
      hrs      mm/hr | hrs      mm/hr | hrs      mm/hr | hrs
RAIN
mm/hr
0.167      6.00 |12.167      2.00 |24.167      2.00 | 36.17
2.00
0.333      6.00 |12.333      2.00 |24.333      2.00 | 36.33
2.00
0.500      6.00 |12.500      2.00 |24.500      2.00 | 36.50
2.00
0.667      6.00 |12.667      2.00 |24.667      2.00 | 36.67
2.00
0.833      6.00 |12.833      2.00 |24.833      2.00 | 36.83
2.00
1.000      6.00 |13.000      2.00 |25.000      2.00 | 37.00
2.00
1.167      4.00 |13.167      2.00 |25.167      2.00 | 37.17
2.00
1.333      4.00 |13.333      2.00 |25.333      2.00 | 37.33
2.00
1.500      4.00 |13.500      2.00 |25.500      2.00 | 37.50
2.00
1.667      4.00 |13.667      2.00 |25.667      2.00 | 37.67
2.00
1.833      4.00 |13.833      2.00 |25.833      2.00 | 37.83
2.00
2.000      4.00 |14.000      2.00 |26.000      2.00 | 38.00
2.00
2.167      6.00 |14.167      2.00 |26.167      2.00 | 38.17
2.00
2.333      6.00 |14.333      2.00 |26.333      2.00 | 38.33
2.00
2.500      6.00 |14.500      2.00 |26.500      2.00 | 38.50
2.00
2.667      6.00 |14.667      2.00 |26.667      2.00 | 38.67
2.00
2.833      6.00 |14.833      2.00 |26.833      2.00 | 38.83
2.00

```

2.00	3.000	6.00	15.000	2.00	27.000	2.00	39.00
2.00	3.167	13.00	15.167	2.00	27.167	2.00	39.17
2.00	3.333	13.00	15.333	2.00	27.333	2.00	39.33
2.00	3.500	13.00	15.500	2.00	27.500	2.00	39.50
2.00	3.667	13.00	15.667	2.00	27.667	2.00	39.67
2.00	3.833	13.00	15.833	2.00	27.833	2.00	39.83
2.00	4.000	13.00	16.000	2.00	28.000	2.00	40.00
2.00	4.167	17.00	16.167	2.00	28.167	2.00	40.17
2.00	4.333	17.00	16.333	2.00	28.333	2.00	40.33
2.00	4.500	17.00	16.500	2.00	28.500	2.00	40.50
2.00	4.667	17.00	16.667	2.00	28.667	2.00	40.67
2.00	4.833	17.00	16.833	2.00	28.833	2.00	40.83
2.00	5.000	17.00	17.000	2.00	29.000	2.00	41.00
2.00	5.167	13.00	17.167	2.00	29.167	2.00	41.17
2.00	5.333	13.00	17.333	2.00	29.333	2.00	41.33
2.00	5.500	13.00	17.500	2.00	29.500	2.00	41.50
2.00	5.667	13.00	17.667	2.00	29.667	2.00	41.67
2.00	5.833	13.00	17.833	2.00	29.833	2.00	41.83
2.00	6.000	13.00	18.000	2.00	30.000	2.00	42.00
2.00	6.167	23.00	18.167	2.00	30.167	2.00	42.17
2.00	6.333	23.00	18.333	2.00	30.333	2.00	42.33
2.00	6.500	23.00	18.500	2.00	30.500	2.00	42.50
2.00	6.667	23.00	18.667	2.00	30.667	2.00	42.67
2.00	6.833	23.00	18.833	2.00	30.833	2.00	42.83
2.00	7.000	23.00	19.000	2.00	31.000	2.00	43.00
2.00	7.167	13.00	19.167	2.00	31.167	2.00	43.17
2.00	7.333	13.00	19.333	2.00	31.333	2.00	43.33

2.00	7.500	13.00	19.500	2.00	31.500	2.00	43.50
2.00	7.667	13.00	19.667	2.00	31.667	2.00	43.67
2.00	7.833	13.00	19.833	2.00	31.833	2.00	43.83
2.00	8.000	13.00	20.000	2.00	32.000	2.00	44.00
2.00	8.167	13.00	20.167	2.00	32.167	2.00	44.17
2.00	8.333	13.00	20.333	2.00	32.333	2.00	44.33
2.00	8.500	13.00	20.500	2.00	32.500	2.00	44.50
2.00	8.667	13.00	20.667	2.00	32.667	2.00	44.67
2.00	8.833	13.00	20.833	2.00	32.833	2.00	44.83
2.00	9.000	13.00	21.000	2.00	33.000	2.00	45.00
2.00	9.167	53.00	21.167	2.00	33.167	2.00	45.17
2.00	9.333	53.00	21.333	2.00	33.333	2.00	45.33
2.00	9.500	53.00	21.500	2.00	33.500	2.00	45.50
2.00	9.667	53.00	21.667	2.00	33.667	2.00	45.67
2.00	9.833	53.00	21.833	2.00	33.833	2.00	45.83
2.00	10.000	53.00	22.000	2.00	34.000	2.00	46.00
2.00	10.167	38.00	22.167	2.00	34.167	2.00	46.17
2.00	10.333	38.00	22.333	2.00	34.333	2.00	46.33
2.00	10.500	38.00	22.500	2.00	34.500	2.00	46.50
2.00	10.667	38.00	22.667	2.00	34.667	2.00	46.67
2.00	10.833	38.00	22.833	2.00	34.833	2.00	46.83
2.00	11.000	38.00	23.000	2.00	35.000	2.00	47.00
3.00	11.167	13.00	23.167	2.00	35.167	2.00	47.17
3.00	11.333	13.00	23.333	2.00	35.333	2.00	47.33
3.00	11.500	13.00	23.500	2.00	35.500	2.00	47.50
3.00	11.667	13.00	23.667	2.00	35.667	2.00	47.67
3.00	11.833	13.00	23.833	2.00	35.833	2.00	47.83

3.00 12.000 13.00 | 24.000 2.00 | 36.000 2.00 | 48.00

```

Max.Eff.Inten.(mm/hr)=      53.00      104.32
      over (min)           10.00      20.00
Storage Coeff. (min)=      3.39 (ii)   10.33 (ii)
Unit Hyd. Tpeak (min)=     10.00      20.00
Unit Hyd. peak (cms)=      0.16       0.08

                                     * TOTALS*
PEAK FLOW (cms)=           0.12       0.12      0.242 (iii)
TIME TO PEAK (hrs)=        10.00      10.00      10.00
RUNOFF VOLUME (mm)=       284.00     263.47     273.74
TOTAL RAINFALL (mm)=      285.00     285.00     285.00
RUNOFF COEFFICIENT =      1.00       0.92       0.96
  
```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| ADD HYD ( 0007) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0005):  24.60   3.349   10.00   251.41
+ ID2= 2 ( 0006):  1.66   0.242   10.00   273.74
=====
ID = 3 ( 0007):  26.26   3.590   10.00   252.82
  
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| RESERVOIR( 0008) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min |
-----
                OUTFLOW      STORAGE      | OUTFLOW      STORAGE
                (cms)      (ha.m.)      | (cms)      (ha.m.)
                0.0000      0.0000      | 1.1580      1.0970
                0.1870      0.6751      | 1.5470      1.2310
                0.5060      0.8381      | 2.1510      1.3219
                0.7820      0.9953      | 0.0000      0.0000
  
```

```

                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
INFLOW : ID= 2 ( 0007)  26.260      3.590      10.00     252.82
OUTFLOW: ID= 1 ( 0008)  26.260      3.104      10.17     252.79
  
```

PEAK FLOW REDUCTION [Qout/Qin] (%)= 86.46

TIME SHIFT OF PEAK FLOW (min)= 10.00
MAXIMUM STORAGE USED (ha.m.)= 1.4696

FINISH

=====
=====

SWM POND-1 (EAST)

Project Number : W21081	Prepared By : S.S
Project Name : Hillsburgh	Checked By: Scott/D.K.H
Date : 04/08/2022	

Pre-Development Scenario/ Release Rate targets for proposed SWM Pond - EAST ;

Note : Data Extracted from Strittmatter Residential Development SWM Report ;

Revised Stormwater Management Report and Design Drawings Proposed Strittmatter Residential Development	Village of Hillsburgh Town of Erin
---	---------------------------------------

3.4 Ultimate Development Condition

Consideration was given to the possibility of future development of the McMurchy lands. A hydrologic analysis was conducted to determine if a reasonable sized stormwater management facility could be constructed on McMurchy lands that would allow an appropriate discharge rate during storm events without having adverse effects on the Strittmatter stormwater management system.

For the hydrologic analysis an assumed development scenario was established for the McMurchy lands; this scenario is furthered referred to as the Ultimate Condition. The development of the 22.4 hectare property consisted of the following:

- 10 hectares Open Space (non-developable), and
- 12.4 hectares @ 30% impervious (similar to Strittmatter development)

Under the above conditions the following storage and outflow values were found to adhere to the requirements previously stated:

- 5 year: 2600 m³ controlled to 0.06 m³/s, and
- 100 year: 7300 m³ controlled to 0.16 m³/s.

Allowable Release Rate Targets for Proposed East Pond ;

5-Year Target = 0.060 m³/s
100-Year Target = 0.160 m³/s

The SWM Strategy is to control the Post-development peak flows to the above mentioned targets ; routed flows from proposed East SWM Pond will connect to existing 450mm sewers located on McMurchy Lane.

CVC's 25mm Erosion Control Requirement ;

Contributing Drainage Area (ha) = 21.68 Ha

25mm 4Hr Chicago Post Development Runoff Volume in Depth = 18.249 mm (Refer to VO Results)
 (R. V x Drainage Area)

25mm 4Hr Chicago Post Development Storage Volume = **3,956.38 m³**

25mm 4-hour Chicago storm to be stored and released over a min. of 48-hour period ;

Erosion Target Rate = 82.425 m³/hr 22.896 L/s

The Total Volume provided for Erosion Control in SWM Pond = 4194 m³

SWM Pond -East - Pond Stage Storage Calculations

	LAND USE TYPES							Total	Composite Runoff Coeff.	Composite Imperv. %
	Resid. Dev. Area	Multiple Family (Townhouses)	Road ROW	Retail / Commercial	School	External Drainage (Wood Lot- North)	SWM Pond			
Typical C Value	0.50	0.75	0.90	0.90	0.75	0.25	0.50			
Typical Impervious %	60%	80%	95%	95%	80%	10%	75%			
Pond No - East	6.15	2.83	5.06	1.79	2.24	1.97	1.64	21.68	0.662	72%

MOE Standard Requirements = 228.33 (Excludes 40m³/ha Extended Detention)
 Permanent Pool Volume Required = 4,950 m³
 Permanent Pool Volume Provided = 7,777 m³

Elevations	Total Area	Average Area	Depth	Delta Volume	Total Volume
(m)	(m ²)	(m ²)	(m)	(m ³)	(m ³)
450.00	2347				
451.00	3857	3102	1.00	3102	3102
452.00	5493	4675	1.00	4675	7777
452.00	5493				0
453.50	9919	7706	1.50	11559	11559
454.50	12229	11074	1.00	11074	22632

**Permanent Pool
Storage**

EAST POND CONTROL STRUCTURE DESIGN

Project Number : W21081

Prepared By : S.S

Project Name : HillsBurgh

Checked By: D.K.H/Scott

Date : 04/08/2022

Orifice No. 1 (25mm Erosion Control)

Orifice Plate Diameter = 0.100 m
 Area = 0.0079 m²
 Orifice Coeff. (C) = 0.63
 Invert = 452.00 m
 Orifice Plate Centroid = 452.05 m

Submerged Orifice Equation = $Q_o = 0.63 \times A \times [2 \times g \times H]^{1/2}$

Where,

- Q_o = Flow rate (m³/s)
- C = Discharge Coefficient
- A = Area of opening (m²)
- H = Net head above the orifice (m)
- g = Acceleration due to gravity (m/s)

Weir/Orifice No.2 (To Control 2 - 100-Year)

Orifice Width = 0.15 m
 Orifice Height = 0.10 m
 Area of Opening = 0.015 m²
 Orifice Coeff. (C) = 0.63
 Invert = 452.90 m
 Orifice Centroid = 452.95 m

BOX CUT-OUT DETAILS

Weir Equation = $Q_w = 1.67 \times L \times H^{1.5}$

Where,

- | | |
|---|--|
| <p>Weir Specifications</p> <ul style="list-style-type: none"> Length of Weir = 0.15 m Weir Sill = 452.90 m Weir Top = 453.00 m Weir Coefficient = 1.67 | <ul style="list-style-type: none"> Q_w = Flow rate (m³/s) C = Discharge Coefficient L = Weir Length (m) H = Net Head on the Orifice (m) |
|---|--|

Stage (m):	0.10	ORIFICE CONTROL-1 (ORIFICE PLATE)		ORIFICE/WEIR CONTROL - 2 (BOX CUT-OUT)				
Active Storage (m ³)	Elevation (m)	Depth above orifice Centroid (m)	Orifice No.1 Flow (m ³ /s)	Depth above orifice Centroid (m)	Orifice No.2 Flow (m ³ /s)	Depth Above Weir (m)	Weir No.2 Flow (m ³ /s)	Total Flow (m ³ /s)
0	452.00	0	0					0.000
564	452.10	0	0					0.000
1158	452.20	0	0					0.000
1781	452.30	0.25	0.011					0.011
2433	452.40	0.35	0.013					0.013
3115	452.50	0.45	0.015					0.015
3827	452.60	0.55	0.016					0.016
4194	452.65	0.60	0.017					0.017
4568	452.70	0.65	0.018					0.018
5339	452.80	0.75	0.019					0.019
6139	452.90	0.85	0.020			0.00	0.000	0.020
6968	453.00	0.95	0.021			0.10	0.008	0.029
7828	453.10	1.05	0.022			0.20	0.022	0.045
8536	453.18	1.13	0.023			0.28	0.037	0.060
8716	453.20	1.15	0.024			0.30	0.041	0.065
9364	453.30	1.25	0.025	0.35	0.025			0.049
10582	453.40	1.35	0.025	0.45	0.028			0.054
11559	453.50	1.45	0.026	0.55	0.031			0.057
12563	453.60	1.55	0.027	0.65	0.034			0.061
13589	453.70	1.65	0.028	0.75	0.036			0.064
14639	453.80	1.75	0.029	0.85	0.039			0.068
15712	453.90	1.85	0.030	0.95	0.041			0.071
16808	454.00	1.95	0.031	1.05	0.043			0.073
17926	454.10	2.05	0.031	1.15	0.045			0.076
19069	454.20	2.15	0.032	1.25	0.047			0.079
20234	454.30	2.25	0.033	1.35	0.049			0.082
21422	454.40	2.35	0.034	1.45	0.050			0.084
22633	454.50	2.45	0.034	1.55	0.052			0.086

Permanent Pool Elevation

25mm Chicago - Erosion Control (Target)

5-Year (Target - 0.06 m³/s)

100-Year (Target - 0.160 m³/s)

Emergency Spillway


Drawdown Time for Water Quality Level :

Based on Equation 4.11 MOE SWM Planning and Design Manual

$$t = \frac{0.66 C_2 h^{1.5} + 2 C_3 h^{0.5}}{2.75 A_o}$$

- t = Drawdown time in seconds
- A_p = Surface area of the pond (m²)
- C = Discharge Coefficient (typically 0.63)
- A_o = Cross-sectional area of the orifice (m²)
- g = Gravitational acceleration constant (9.81 m/s)
- h₁ = Starting water elevation above the orifice (m)
- h₂ = Ending water elevation above the orifice (m)
- C₂ = Slope coefficient from the area-depth linear regression
- C₃ = Intercept from the area-depth linear regression

Elevation(m)	Head (m)	AREA (m ²)
452.00	0.00	5493
452.10	0.10	5788
452.20	0.20	6083
452.30	0.30	6378
452.40	0.40	6673
452.50	0.50	6968
452.60	0.60	7264
452.65	0.65	7411
452.70	0.70	7559

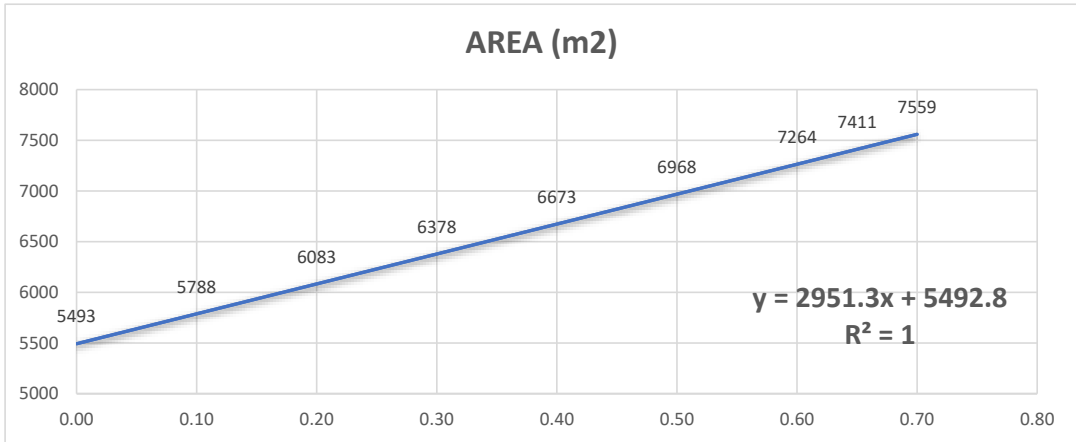

- Intercept of Regression , C₃ = 5492.8
- Slope coef. of Regression, C₂ = 2951.3
- Ultimate Ponding Elevation = 452.65 m (25m Water Quality Level)
- Depth over orifice = 0.65 m (25mm Level - Permanent Pool Elevation)
(452.65-452.0)

Orifice Diameter =	100 mm
Orifice Area =	0.00785 m ²
Drawdown Time (t)=	457331 seconds 127 hours

Sediment Forebay Calculations

Forebay Settling Length (MOE Equation 4.5)

$$\text{Dist} = \sqrt{\frac{r Q_p}{V_s}}$$

Length-to-width ratio of forebay (r) =	2.0 : 1 (Min)
Peak flow rate from the pond during design quality storm (Q_p)=	25mm Storage / detention time (minimum) 41.94 m ³ /hr therefore, = 0.0117432 m ³ /s
Settling Velocity (V_s) =	0.0003 m/s (Recommended from MOEE Manual)
Forebay Settling Length Required =	9 m
Total Forebay Length Provided =	40 m

Dispersion Length Calculations

Length of Dispersion (MOE Equation 4.6)

$$\text{Dist} = \frac{8Q}{dV_f}$$

Inlet flow rate (Q) =	3.284 m ³ /s (from Storm Design Sheet)
Depth of permanent pool in the forebay (d) =	2.0 m
Desired velocity in the forebay (V_f) =	0.5 m/s (Recommended from MOEE Manual)
Length of Dispersion =	26.3 m
Total Forebay Length Provided =	40 m

Minimum Forebay Deep Zone Bottom Width


Minimum Forebay Deep Zone Bottom Width (MOE Equation 4.7)

$$\text{Width} = \frac{\text{Dist}}{8}$$

Width Required =	5 m
Width Provided =	16 m

25mm EROSION CONTROL

VO SCHEMATIC – EAST POND

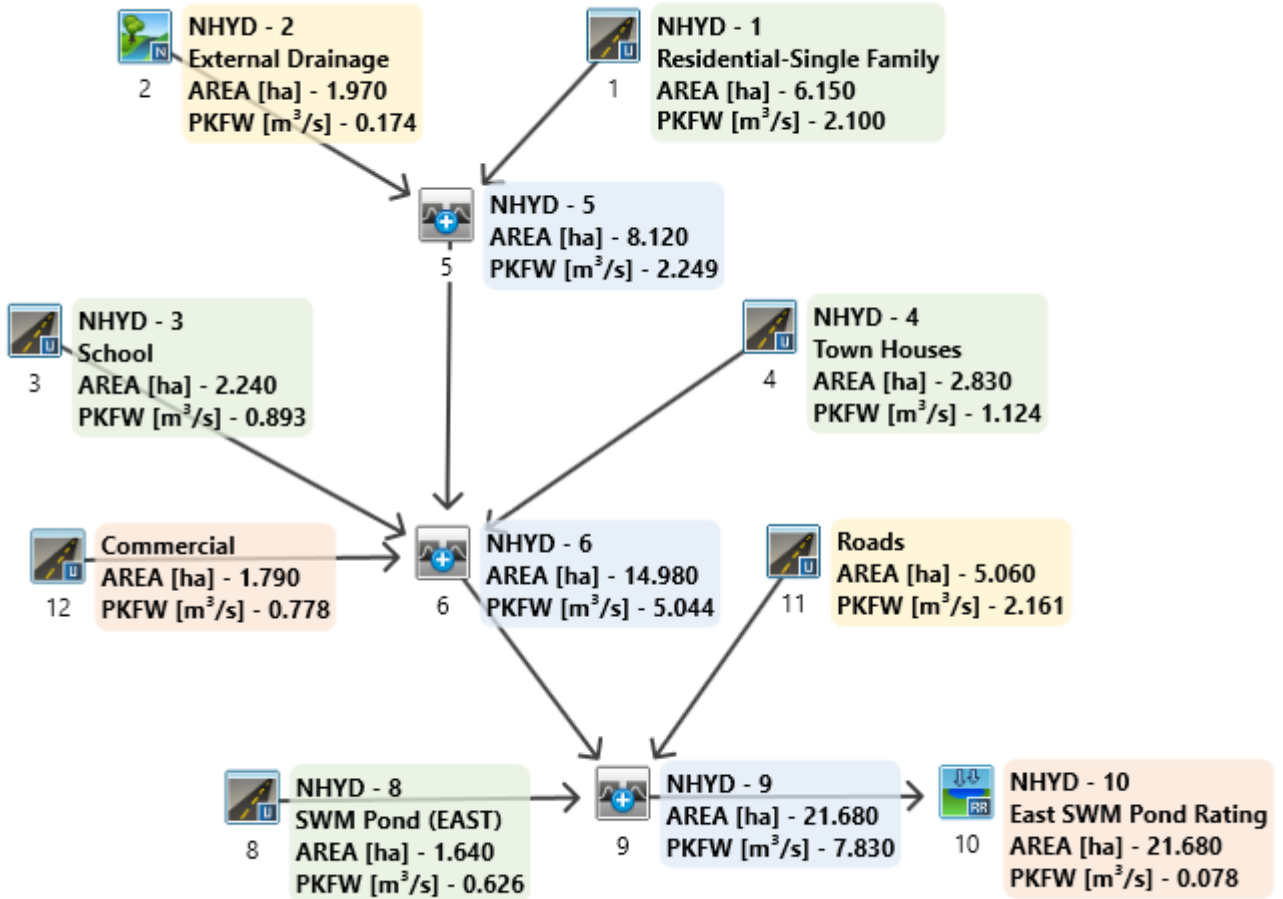

=====

V V I SSSSS U U A L (v 6.2.2010)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

OOO TTTTT TTTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2021 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat
Output filename: C:\Users\shuchi\AppData\Local\Civica\XH5\7b32db7d-
cfd4-42bf-b204-af6a18cc82b1\d94c01d1-d617-417c-99bf-5c79dd6e2f79\scena
Summary filename: C:\Users\shuchi\AppData\Local\Civica\XH5\7b32db7d-
cfd4-42bf-b204-af6a18cc82b1\d94c01d1-d617-417c-99bf-5c79dd6e2f79\scena

DATE: 08/04/2022

TIME: 02:13:32

USER:

COMMENTS: _____

** SIMULATION : 25MM-4HR **

| READ STORM | Filename: C:\Users\shuchi\AppData
| | ata\Local\Temp\
| | 8fd29dce-4d12-4ee7-ab0a-
ad3bc04b9cb4\17594965
| Ptotal= 25.00 mm | Comments: 25MM-4HR

RAIN TIME RAIN | TIME RAIN | TIME RAIN | TIME

mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.80	0.00	2.07	1.00	5.70	2.00	5.19	3.00
2.62	0.17	2.27	1.17	10.78	2.17	4.47	3.17
2.48	0.33	2.52	1.33	50.21	2.33	3.95	3.33
2.35	0.50	2.88	1.50	13.37	2.50	3.56	3.50
2.23	0.67	3.38	1.67	8.29	2.67	3.25	3.67
2.14	0.83	4.18	1.83	6.30	2.83	3.01	3.83


```

-----
| CALIB |
| NASHYD ( 0002) | Area (ha)= 1.97 Curve Number (CN)= 60.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= 0.15

```

```

Unit Hyd Qpeak (cms)= 0.502

PEAK FLOW (cms)= 0.005 (i)
TIME TO PEAK (hrs)= 1.667
RUNOFF VOLUME (mm)= 1.441
TOTAL RAINFALL (mm)= 24.997
RUNOFF COEFFICIENT = 0.058

```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| CALIB |
| STANDHYD ( 0001) | Area (ha)= 6.15
| ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	3.69	2.46
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	202.48	40.00
Mannings n =	0.013	0.250
Max.Eff.Inten. (mm/hr)=	50.21	14.81
over (min)	10.00	30.00
Storage Coeff. (min)=	5.14 (ii)	20.29 (ii)
Unit Hyd. Tpeak (min)=	10.00	30.00
Unit Hyd. peak (cms)=	0.15	0.05

* TOTALS*

PEAK FLOW	(cms)=	0.38	0.06	0.399 (iii)
TIME TO PEAK	(hrs)=	1.50	1.83	1.50
RUNOFF VOLUME	(mm)=	24.00	9.49	16.74
TOTAL RAINFALL	(mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT	=	0.96	0.38	0.67

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD (0005)				
1 + 2 = 3	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
ID1= 1 (0001):	6.15	0.399	1.50	16.74
+ ID2= 2 (0002):	1.97	0.005	1.67	1.44
=====				
ID = 3 (0005):	8.12	0.403	1.50	13.03

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

CALIB				
STANDHYD (0003)	Area	(ha)=	2.24	
ID= 1 DT=10.0 min	Total Imp(%)=	80.00	Dir. Conn.(%)=	75.00

		IMPERVIOUS	PERVIOUS (i)	
Surface Area	(ha)=	1.79	0.45	
Dep. Storage	(mm)=	1.00	1.50	
Average Slope	(%)=	1.00	2.00	
Length	(m)=	122.20	40.00	
Mannings n	=	0.013	0.250	
Max.Eff.Inten.(mm/hr)=		50.21	14.81	
over (min)		10.00	20.00	
Storage Coeff. (min)=		3.80 (ii)	18.95 (ii)	
Unit Hyd. Tpeak (min)=		10.00	20.00	
Unit Hyd. peak (cms)=		0.16	0.06	
				* TOTALS*
PEAK FLOW	(cms)=	0.22	0.01	0.227 (iii)
TIME TO PEAK	(hrs)=	1.50	1.67	1.50
RUNOFF VOLUME	(mm)=	24.00	9.49	20.37
TOTAL RAINFALL	(mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT	=	0.96	0.38	0.81

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| STANDHYD ( 0004) | Area (ha)= 2.83
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00
-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	2.26	0.57	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	137.36	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	50.21	14.81	
over (min)	10.00	20.00	
Storage Coeff. (min)=	4.07 (ii)	19.22 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.16	0.06	
			* TOTALS*
PEAK FLOW (cms)=	0.28	0.01	0.283 (iii)
TIME TO PEAK (hrs)=	1.50	1.67	1.50
RUNOFF VOLUME (mm)=	24.00	9.49	20.37
TOTAL RAINFALL (mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT =	0.96	0.38	0.81

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
-----
| CALIB |
| STANDHYD ( 0012) | Area (ha)= 1.79
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	1.70	0.09
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	109.24	40.00
Mannings n =	0.013	0.250

Max.Eff.Inten. (mm/hr)=	50.21	48.59	
over (min)	10.00	20.00	
Storage Coeff. (min)=	3.55 (ii)	12.97 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.16	0.07	
			* TOTALS*
PEAK FLOW (cms)=	0.21	0.01	0.217 (iii)
TIME TO PEAK (hrs)=	1.50	1.67	1.50
RUNOFF VOLUME (mm)=	24.00	12.60	22.85
TOTAL RAINFALL (mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT =	0.96	0.50	0.91

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----

```

	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
ID1= 1 (0012):	1.79	0.217	1.50	22.85
+ ID2= 2 (0003):	2.24	0.227	1.50	20.37
=====				
ID = 3 (0006):	4.03	0.444	1.50	21.47

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| ADD HYD ( 0006) |
| 3 + 2 = 1 |
-----

```

	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
ID1= 3 (0006):	4.03	0.444	1.50	21.47
+ ID2= 2 (0004):	2.83	0.283	1.50	20.37
=====				
ID = 1 (0006):	6.86	0.727	1.50	21.02

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----

```

	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)

ID1= 1 (0006):	6.86	0.727	1.50	21.02
+ ID2= 2 (0005):	8.12	0.403	1.50	13.03
=====				
ID = 3 (0006):	14.98	1.130	1.50	16.69

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| CALIB |
| STANDHYD ( 0008) | Area (ha)= 1.64
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00
-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	1.23	0.41	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	104.56	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	50.21	48.59	
over (min)	10.00	20.00	
Storage Coeff. (min)=	3.46 (ii)	12.88 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.16	0.07	
			* TOTALS*
PEAK FLOW (cms)=	0.11	0.03	0.125 (iii)
TIME TO PEAK (hrs)=	1.50	1.67	1.50
RUNOFF VOLUME (mm)=	24.00	12.60	18.29
TOTAL RAINFALL (mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT =	0.96	0.50	0.73

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| CALIB |
| STANDHYD ( 0011) | Area (ha)= 5.06
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	4.81	0.25
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	183.67	40.00
Mannings n =	0.013	0.250

Max.Eff.Inten. (mm/hr)=	50.21	48.59	
over (min)	10.00	20.00	
Storage Coeff. (min)=	4.85 (ii)	14.27 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.15	0.07	
			* TOTALS*
PEAK FLOW (cms)=	0.57	0.02	0.580 (iii)
TIME TO PEAK (hrs)=	1.50	1.67	1.50
RUNOFF VOLUME (mm)=	24.00	12.60	22.86
TOTAL RAINFALL (mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT =	0.96	0.50	0.91

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0009) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
    ID1= 1 ( 0011):    5.06    0.580    1.50    22.86
+ ID2= 2 ( 0006):   14.98    1.130    1.50    16.69
=====
    ID = 3 ( 0009):   20.04    1.710    1.50    18.24

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0009) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
    ID1= 3 ( 0009):   20.04    1.710    1.50    18.24
+ ID2= 2 ( 0008):    1.64    0.125    1.50    18.29
=====
    ID = 1 ( 0009):   21.68    1.835    1.50    18.25

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0010) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min |
-----
                OUTFLOW      STORAGE      | OUTFLOW      STORAGE
                (cms)      (ha.m.)      | (cms)      (ha.m.)
                0.0000      0.0000      | 0.0800      1.9069

```

0.0600 0.8536 | 0.0000 0.0000


	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW : ID= 2 (0009)	21.680	1.835	1.50	18.25
OUTFLOW: ID= 1 (0010)	21.680	0.026	4.17	18.08

PEAK FLOW REDUCTION [Qout/Qin] (%)= 1.42
TIME SHIFT OF PEAK FLOW (min)=160.00
MAXIMUM STORAGE USED (ha.m.)= 0.3714

FINISH

=====
=====

POST DEVELOPMENT VO SCHEMATIC – EAST POND

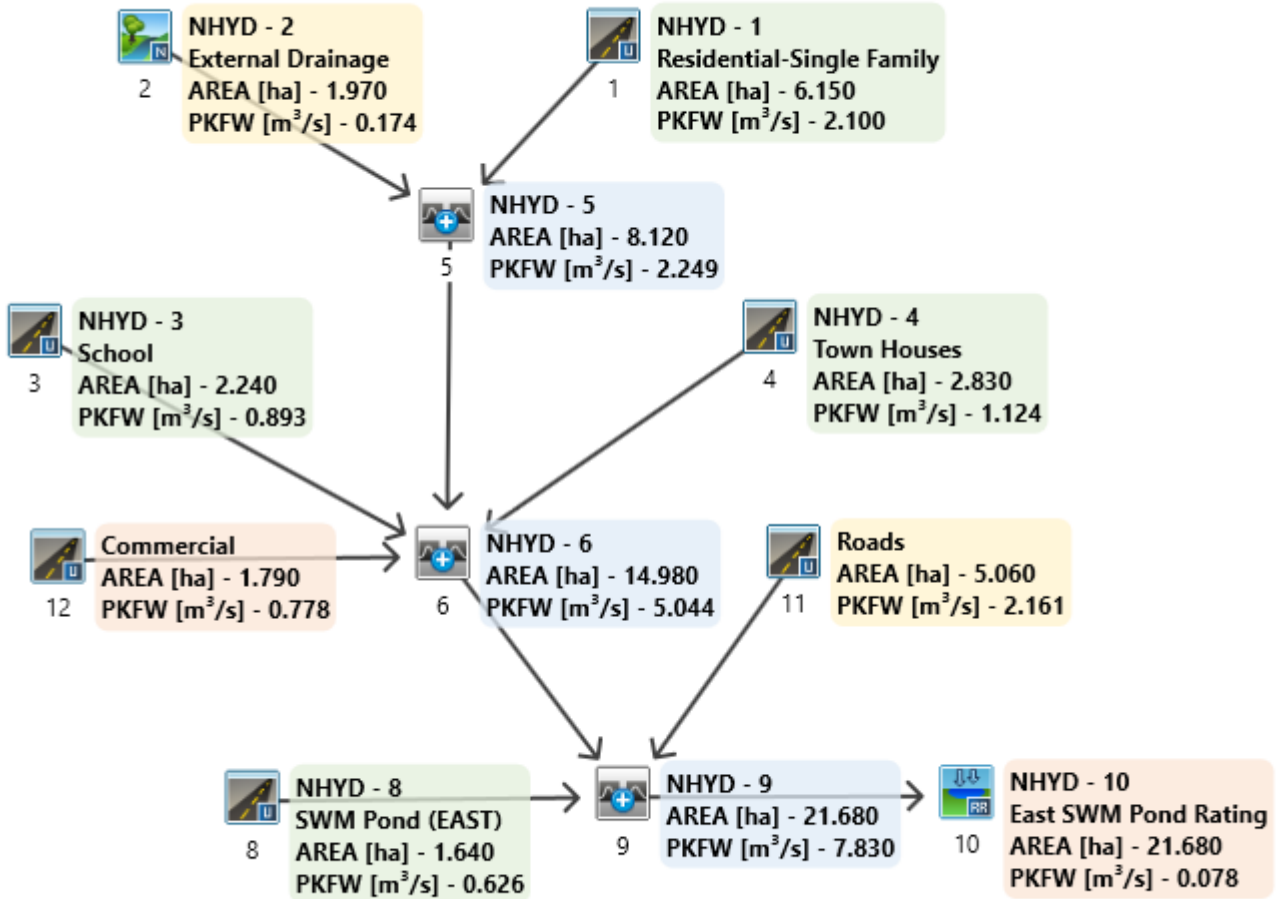

=====

V V I SSSSS U U A L (v 6.2.2010)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

OOO TTTTT TTTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2021 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat
Output filename: C:\Users\shuchi\AppData\Local\Civica\VH5\7b32db7d-
cfd4-42bf-b204-af6a18cc82b1\7f055f3f-b553-49ae-8110-3fd1056ea86c\scena
Summary filename: C:\Users\shuchi\AppData\Local\Civica\VH5\7b32db7d-
cfd4-42bf-b204-af6a18cc82b1\7f055f3f-b553-49ae-8110-3fd1056ea86c\scena

DATE: 08/04/2022

TIME: 01:11:33

USER:

COMMENTS: _____

** SIMULATION : 5yr - 3hr 10min Chicago **

| CHICAGO STORM |
Ptotal= 50.13 mm

IDF curve parameters: A=1439.371
B= 13.688
C= 0.846
used in: INTENSITY = A / (t + B)^C

Duration of storm = 3.00 hrs
Storm time step = 10.00 min
Time to peak ratio = 0.33

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.26	0.00	4.51	0.83	98.93	1.67	8.92	2.50
3.86	0.17	5.80	1.00	42.93	1.83	7.34	2.67
3.53	0.33	8.12	1.17	23.16	2.00	6.22	2.83
	0.50	13.33	1.33	15.36	2.17	5.39	
	0.67	33.02	1.50	11.33	2.33	4.76	


```

| CALIB |
| NASHYD ( 0002) | Area (ha)= 1.97 Curve Number (CN)= 60.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00
----- U.H. Tp(hrs)= 0.15

```

```

Unit Hyd Qpeak (cms)= 0.502

PEAK FLOW (cms)= 0.048 (i)
TIME TO PEAK (hrs)= 1.167
RUNOFF VOLUME (mm)= 7.804
TOTAL RAINFALL (mm)= 50.130
RUNOFF COEFFICIENT = 0.156

```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

| CALIB |
| STANDHYD ( 0001) | Area (ha)= 6.15
| ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00
-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	3.69	2.46	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	202.48	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	98.93	67.19	
over (min)	10.00	20.00	
Storage Coeff. (min)=	3.92 (ii)	12.19 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.16	0.07	
			* TOTALS*
PEAK FLOW (cms)=	0.80	0.27	0.940 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.00

RUNOFF VOLUME	(mm)=	49.13	28.24	38.68
TOTAL RAINFALL	(mm)=	50.13	50.13	50.13
RUNOFF COEFFICIENT	=	0.98	0.56	0.77

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.


```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
| AREA QPEAK TPEAK R.V. |
| (ha) (cms) (hrs) (mm) |
ID1= 1 ( 0001): 6.15 0.940 1.00 38.68
+ ID2= 2 ( 0002): 1.97 0.048 1.17 7.80
=====
ID = 3 ( 0005): 8.12 0.978 1.00 31.19

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.


```

-----
| CALIB |
| STANDHYD ( 0003) | Area (ha)= 2.24
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00
-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	1.79	0.45	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	122.20	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	98.93	67.19	
over (min)	10.00	20.00	
Storage Coeff. (min)=	2.89 (ii)	11.17 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	0.16	0.08	
			* TOTALS*
PEAK FLOW (cms)=	0.45	0.05	0.478 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.00
RUNOFF VOLUME (mm)=	49.13	28.24	43.90
TOTAL RAINFALL (mm)=	50.13	50.13	50.13
RUNOFF COEFFICIENT =	0.98	0.56	0.88

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:

CN* = 85.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0004) | Area (ha)= 2.83
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00

		IMPERVIOUS	PERVIOUS (i)	
Surface Area	(ha)=	2.26	0.57	
Dep. Storage	(mm)=	1.00	1.50	
Average Slope	(%)=	1.00	2.00	
Length	(m)=	137.36	40.00	
Mannings n	=	0.013	0.250	
Max.Eff.Inten.(mm/hr)=		98.93	67.19	
over (min)		10.00	20.00	
Storage Coeff. (min)=		3.10 (ii)	11.38 (ii)	
Unit Hyd. Tpeak (min)=		10.00	20.00	
Unit Hyd. peak (cms)=		0.16	0.08	
				* TOTALS*
PEAK FLOW (cms)=		0.57	0.07	0.601 (iii)
TIME TO PEAK (hrs)=		1.00	1.17	1.00
RUNOFF VOLUME (mm)=		49.13	28.24	43.90
TOTAL RAINFALL (mm)=		50.13	50.13	50.13
RUNOFF COEFFICIENT =		0.98	0.56	0.88

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0012) | Area (ha)= 1.79
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	1.70	0.09
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	109.24	40.00
Mannings n	=	0.013	0.250
Max.Eff.Inten.(mm/hr)=		98.93	135.30

over (min)	10.00	10.00	
Storage Coeff. (min)=	2.71 (ii)	8.96 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.17	0.11	
			* TOTALS*
PEAK FLOW (cms)=	0.44	0.02	0.460 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.00
RUNOFF VOLUME (mm)=	49.13	33.96	47.61
TOTAL RAINFALL (mm)=	50.13	50.13	50.13
RUNOFF COEFFICIENT =	0.98	0.68	0.95

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0012):  1.79  0.460  1.00  47.61
+ ID2= 2 ( 0003):  2.24  0.478  1.00  43.90
=====
ID = 3 ( 0006):  4.03  0.938  1.00  45.55

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0006) |
| 3 + 2 = 1 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0006):  4.03  0.938  1.00  45.55
+ ID2= 2 ( 0004):  2.83  0.601  1.00  43.90
=====
ID = 1 ( 0006):  6.86  1.539  1.00  44.87

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0006):  6.86  1.539  1.00  44.87
+ ID2= 2 ( 0005):  8.12  0.978  1.00  31.19

```

=====

ID = 3 (0006): 14.98 2.517 1.00 37.46

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

| CALIB |
| STANDHYD (0008) | Area (ha)= 1.64
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	1.23	0.41	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	104.56	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	98.93	135.30	
over (min)	10.00	10.00	
Storage Coeff. (min)=	2.64 (ii)	8.89 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.17	0.11	
			* TOTALS*
PEAK FLOW (cms)=	0.22	0.11	0.334 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.00
RUNOFF VOLUME (mm)=	49.13	33.96	41.54
TOTAL RAINFALL (mm)=	50.13	50.13	50.13
RUNOFF COEFFICIENT =	0.98	0.68	0.83

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0011) | Area (ha)= 5.06
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	4.81	0.25	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	183.67	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	98.93	135.30	
over (min)	10.00	10.00	

Storage Coeff. (min)=	3.70 (ii)	9.95 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.16	0.11	
			* TOTALS*
PEAK FLOW (cms)=	1.19	0.07	1.260 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.00
RUNOFF VOLUME (mm)=	49.13	33.96	47.61
TOTAL RAINFALL (mm)=	50.13	50.13	50.13
RUNOFF COEFFICIENT =	0.98	0.68	0.95

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0009) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
  ID1= 1 ( 0011):   5.06   1.260   1.00   47.61
+ ID2= 2 ( 0006):  14.98   2.517   1.00   37.46
=====
  ID = 3 ( 0009):  20.04   3.777   1.00   40.02

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0009) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
  ID1= 3 ( 0009):  20.04   3.777   1.00   40.02
+ ID2= 2 ( 0008):   1.64   0.334   1.00   41.54
=====
  ID = 1 ( 0009):  21.68   4.111   1.00   40.14

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0010) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min |
-----
                OUTFLOW      STORAGE      | OUTFLOW      STORAGE
                (cms)      (ha.m.)      | (cms)      (ha.m.)
                0.0000      0.0000      | 0.0800      1.9069
                0.0600      0.8536      | 0.0000      0.0000

```

	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
INFLOW : ID= 2 (0009)	21.680	4.111	1.00	40.14
OUTFLOW: ID= 1 (0010)	21.680	0.058	3.17	39.97

PEAK FLOW REDUCTION [Qout/Qin] (%) = 1.42
 TIME SHIFT OF PEAK FLOW (min) = 130.00
 MAXIMUM STORAGE USED (ha.m.) = 0.8281

FINISH

=====
=====

=====

V V I SSSSS U U A L (v 6.2.2010)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

OOO TTTTT TTTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2021 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat
Output filename: C:\Users\shuchi\AppData\Local\Civica\XH5\7b32db7d-
cfd4-42bf-b204-af6a18cc82b1\617ded23-b602-4d1c-88f4-4351c3a5a46d\scena
Summary filename: C:\Users\shuchi\AppData\Local\Civica\XH5\7b32db7d-
cfd4-42bf-b204-af6a18cc82b1\617ded23-b602-4d1c-88f4-4351c3a5a46d\scena

DATE: 08/04/2022

TIME: 01:11:33

USER:

COMMENTS: _____

** SIMULATION : 100yr - 3hr 10min Chicago **

| CHICAGO STORM |
Ptotal= 98.94 mm

IDF curve parameters: A=3113.230
B= 21.416
C= 0.857
used in: INTENSITY = A / (t + B)^C

Duration of storm = 3.00 hrs
Storm time step = 10.00 min
Time to peak ratio = 0.33

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
	0.00	9.88	0.83	162.24	1.67	20.03	2.50
9.32	0.17	12.87	1.00	85.37	1.83	16.41	2.67
8.39	0.33	18.19	1.17	50.07	2.00	13.84	2.83
7.62	0.50	29.75	1.33	34.16	2.17	11.93	
	0.67	67.68	1.50	25.43	2.33	10.47	

| CALIB |
| NASHYD (0002) | Area (ha)= 1.97 Curve Number (CN)= 60.0
| ID= 1 DT=10.0 min | Ia (mm)= 8.00 # of Linear Res.(N)= 3.00

U.H. Tp(hrs)= 0.15

Unit Hyd Qpeak (cms)= 0.502

PEAK FLOW (cms)= 0.174 (i)
TIME TO PEAK (hrs)= 1.167
RUNOFF VOLUME (mm)= 29.541
TOTAL RAINFALL (mm)= 98.938
RUNOFF COEFFICIENT = 0.299

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0001) | Area (ha)= 6.15
| ID= 1 DT=10.0 min | Total Imp(%)= 60.00 Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	3.69	2.46	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	202.48	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten. (mm/hr)=	162.24	149.50	
over (min)	10.00	10.00	
Storage Coeff. (min)=	3.21 (ii)	9.22 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.16	0.11	
			* TOTALS*
PEAK FLOW (cms)=	1.35	0.75	2.100 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.00

RUNOFF VOLUME	(mm)=	97.94	71.50	84.72
TOTAL RAINFALL	(mm)=	98.94	98.94	98.94
RUNOFF COEFFICIENT	=	0.99	0.72	0.86

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD (0005)				
1 + 2 = 3	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
ID1= 1 (0001):	6.15	2.100	1.00	84.72
+ ID2= 2 (0002):	1.97	0.174	1.17	29.54
=====				
ID = 3 (0005):	8.12	2.249	1.00	71.33

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

CALIB				
STANDHYD (0003)	Area	(ha)=	2.24	
ID= 1 DT=10.0 min	Total Imp(%)=	80.00	Dir. Conn.(%)=	75.00

		IMPERVIOUS	PERVIOUS (i)	
Surface Area	(ha)=	1.79	0.45	
Dep. Storage	(mm)=	1.00	1.50	
Average Slope	(%)=	1.00	2.00	
Length	(m)=	122.20	40.00	
Mannings n	=	0.013	0.250	
Max.Eff.Inten.(mm/hr)=		162.24	149.50	
over (min)		10.00	10.00	
Storage Coeff. (min)=		2.37 (ii)	8.38 (ii)	
Unit Hyd. Tpeak (min)=		10.00	10.00	
Unit Hyd. peak (cms)=		0.17	0.12	
				* TOTALS*
PEAK FLOW	(cms)=	0.75	0.14	0.893 (iii)
TIME TO PEAK	(hrs)=	1.00	1.00	1.00
RUNOFF VOLUME	(mm)=	97.94	71.50	91.33
TOTAL RAINFALL	(mm)=	98.94	98.94	98.94
RUNOFF COEFFICIENT	=	0.99	0.72	0.92

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:

CN* = 85.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0004) | Area (ha)= 2.83
| ID= 1 DT=10.0 min | Total Imp(%)= 80.00 Dir. Conn.(%)= 75.00

		IMPERVIOUS	PERVIOUS (i)	
Surface Area	(ha)=	2.26	0.57	
Dep. Storage	(mm)=	1.00	1.50	
Average Slope	(%)=	1.00	2.00	
Length	(m)=	137.36	40.00	
Mannings n	=	0.013	0.250	
Max.Eff.Inten.(mm/hr)=		162.24	149.50	
over (min)		10.00	10.00	
Storage Coeff. (min)=		2.55 (ii)	8.56 (ii)	
Unit Hyd. Tpeak (min)=		10.00	10.00	
Unit Hyd. peak (cms)=		0.17	0.12	
				* TOTALS*
PEAK FLOW (cms)=		0.95	0.18	1.124 (iii)
TIME TO PEAK (hrs)=		1.00	1.00	1.00
RUNOFF VOLUME (mm)=		97.94	71.50	91.33
TOTAL RAINFALL (mm)=		98.94	98.94	98.94
RUNOFF COEFFICIENT =		0.99	0.72	0.92

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0012) | Area (ha)= 1.79
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	1.70	0.09
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	109.24	40.00
Mannings n	=	0.013	0.250
Max.Eff.Inten.(mm/hr)=		162.24	273.69

Storage Coeff. (min)=	over (min)	10.00	10.00	
Unit Hyd. Tpeak (min)=		2.22 (ii)	6.94 (ii)	
Unit Hyd. peak (cms)=		0.17	0.13	
				* TOTALS*
PEAK FLOW (cms)=		0.72	0.06	0.778 (iii)
TIME TO PEAK (hrs)=		1.00	1.00	1.00
RUNOFF VOLUME (mm)=		97.94	79.94	96.14
TOTAL RAINFALL (mm)=		98.94	98.94	98.94
RUNOFF COEFFICIENT =		0.99	0.81	0.97

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0012):  1.79  0.778  1.00  96.14
+ ID2= 2 ( 0003):  2.24  0.893  1.00  91.33
=====
ID = 3 ( 0006):  4.03  1.670  1.00  93.46

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0006) |
| 3 + 2 = 1 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0006):  4.03  1.670  1.00  93.46
+ ID2= 2 ( 0004):  2.83  1.124  1.00  91.33
=====
ID = 1 ( 0006):  6.86  2.794  1.00  92.58

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0006) |
| 1 + 2 = 3 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0006):  6.86  2.794  1.00  92.58
+ ID2= 2 ( 0005):  8.12  2.249  1.00  71.33

```

=====
ID = 3 (0006): 14.98 5.044 1.00 81.06

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

| CALIB |
| STANDHYD (0008) | Area (ha)= 1.64
| ID= 1 DT=10.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	1.23	0.41	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	104.56	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	162.24	273.69	
over (min)	10.00	10.00	
Storage Coeff. (min)=	2.16 (ii)	6.88 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.17	0.13	
			* TOTALS*
PEAK FLOW (cms)=	0.37	0.26	0.626 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.00
RUNOFF VOLUME (mm)=	97.94	79.94	88.94
TOTAL RAINFALL (mm)=	98.94	98.94	98.94
RUNOFF COEFFICIENT =	0.99	0.81	0.90

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0011) | Area (ha)= 5.06
| ID= 1 DT=10.0 min | Total Imp(%)= 95.00 Dir. Conn.(%)= 90.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	4.81	0.25	
Dep. Storage (mm)=	1.00	1.50	
Average Slope (%)=	1.00	2.00	
Length (m)=	183.67	40.00	
Mannings n =	0.013	0.250	
Max.Eff.Inten.(mm/hr)=	162.24	273.69	
over (min)	10.00	10.00	

Storage Coeff. (min)=	3.03 (ii)	7.75 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	0.16	0.12	
			* TOTALS*
PEAK FLOW (cms)=	2.01	0.15	2.161 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.00
RUNOFF VOLUME (mm)=	97.94	79.94	96.14
TOTAL RAINFALL (mm)=	98.94	98.94	98.94
RUNOFF COEFFICIENT =	0.99	0.81	0.97

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0009) |
| 1 + 2 = 3 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 1 ( 0011):    5.06    2.161    1.00    96.14
+ ID2= 2 ( 0006):  14.98    5.044    1.00    81.06
=====
ID = 3 ( 0009):   20.04    7.204    1.00    84.87

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0009) |
| 3 + 2 = 1 |
-----
                AREA      QPEAK      TPEAK      R.V.
                (ha)      (cms)      (hrs)      (mm)
ID1= 3 ( 0009):   20.04    7.204    1.00    84.87
+ ID2= 2 ( 0008):    1.64    0.626    1.00    88.94
=====
ID = 1 ( 0009):   21.68    7.830    1.00    85.18

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0010) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 10.0 min |
-----
                OUTFLOW      STORAGE      | OUTFLOW      STORAGE
                (cms)      (ha.m.)      | (cms)      (ha.m.)
                0.0000      0.0000      | 0.0800      1.9069
                0.0600      0.8536      | 0.0000      0.0000

```

	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
INFLOW : ID= 2 (0009)	21.680	7.830	1.00	85.18
OUTFLOW: ID= 1 (0010)	21.680	0.078	3.17	85.01

PEAK FLOW REDUCTION [Qout/Qin] (%) = 0.99
 TIME SHIFT OF PEAK FLOW (min) = 130.00
 MAXIMUM STORAGE USED (ha.m.) = 1.7856

APPENDIX “F”

Stittmater SWM Report

**Stormwater Management Report
& Design Drawings
Proposed Strittmatter Subdivision
Village of Hillsburgh, Town of Erin**

July 2000

RJB File: S-405

**Prepared For:
Triton Engineering**

**Prepared By:
Burnside Development Services
A Division of R. J. Burnside & Associates Limited
8500 Torbram Road, Suite 56
BRAMPTON, ON
L6T 5C6**

Table of Contents

Section		Page No.
1.0	Introduction	1
2.0	Site Description	1
3.0	Hydrology	4
3.1	Pre-Development Hydrologic Parameters	4
3.2	Post Development Conditions	4
3.3	Results	6
3.4	Ultimate Development Condition	9
4.0	Detention Ponds	9
4.1	Location	9
4.2	Detention Pond Details	10
5.0	Sedimentation and Erosion Control Plan	14
6.0	Summary	15

Tables

Table 1	Pre-Development Parameters	4
Table 2	Summary of Peak Flows	6
Table 3	Post Strittmatter Development Pond Performance	10

Figures

Figure 1	Location Plan	2
Figure 2	Location of Pre-Development Sub Watershed	3
Figure 3	Location of Post Development Sub Watershed	7
Figure 4	Schematic - Post Development Conditions	8
Figure 5	Detail of Pond 1	11
Figure 6	Detail of Pond 2	12
Figure 7	Detail of McMurphy Pond	13

Appendix

Appendix A	SWMHYMO Modelling Results (Post Strittmatter Development)	
Appendix B	SWMHYMO Modelling Results (Ultimate Condition – Post McMurphy Development)	

1.0 Introduction

The proposed Strittmatter residential development (Figure 1) is located in the north end of the Village of Hillsburgh, Town of Erin (formerly Township of Erin). Andrew Brodie & Associates Inc. prepared a hydrologic analysis and preliminary stormwater management study for this development in June 1987. That report was updated in January of 1988.

This report uses Brodie's findings as background for the detailed grading design and drainage systems. In order to accurately address the stormwater management concerns, significant revisions have been made to Pond 1 and its hydrologic modelling. This report addresses the peak flow quantity control, erosion and sediment control during construction and reflects the modifications to design and hydrologic modelling of Pond 1.


2.0 Site Description

The proposed Strittmatter development is located within the watershed of the Credit River. Drainage from the subject lands flows southerly, outletting into an existing pond in the Village referred to as the Hillsburgh Pond. The flow from the pond discharges into the Erin branch of the Credit River.

The drainage areas for the property are delineated in Figure 2. Sub-area A drains to the southeast corner of the property, continuing southward through a culvert under George Street, and eventually into the Hillsburgh pond. The remainder of the development area, sub-areas B, C and D drain westerly to a second outlet, which also discharges into the Hillsburgh pond.

The existing land is agricultural and mainly used for pasture. The proposed development consists of single family residential housing. The Ministry of Natural Resources has requested that the treed area in the southwest corner of the development remain undisturbed. This area has been zoned as open space and forms part of Lot 30.


The soils in this area consist of sandy loam and are classified in hydrologic soil Group A. The site is fairly hilly with slopes ranging from approximately four percent in the east to approximately twenty percent in the south.

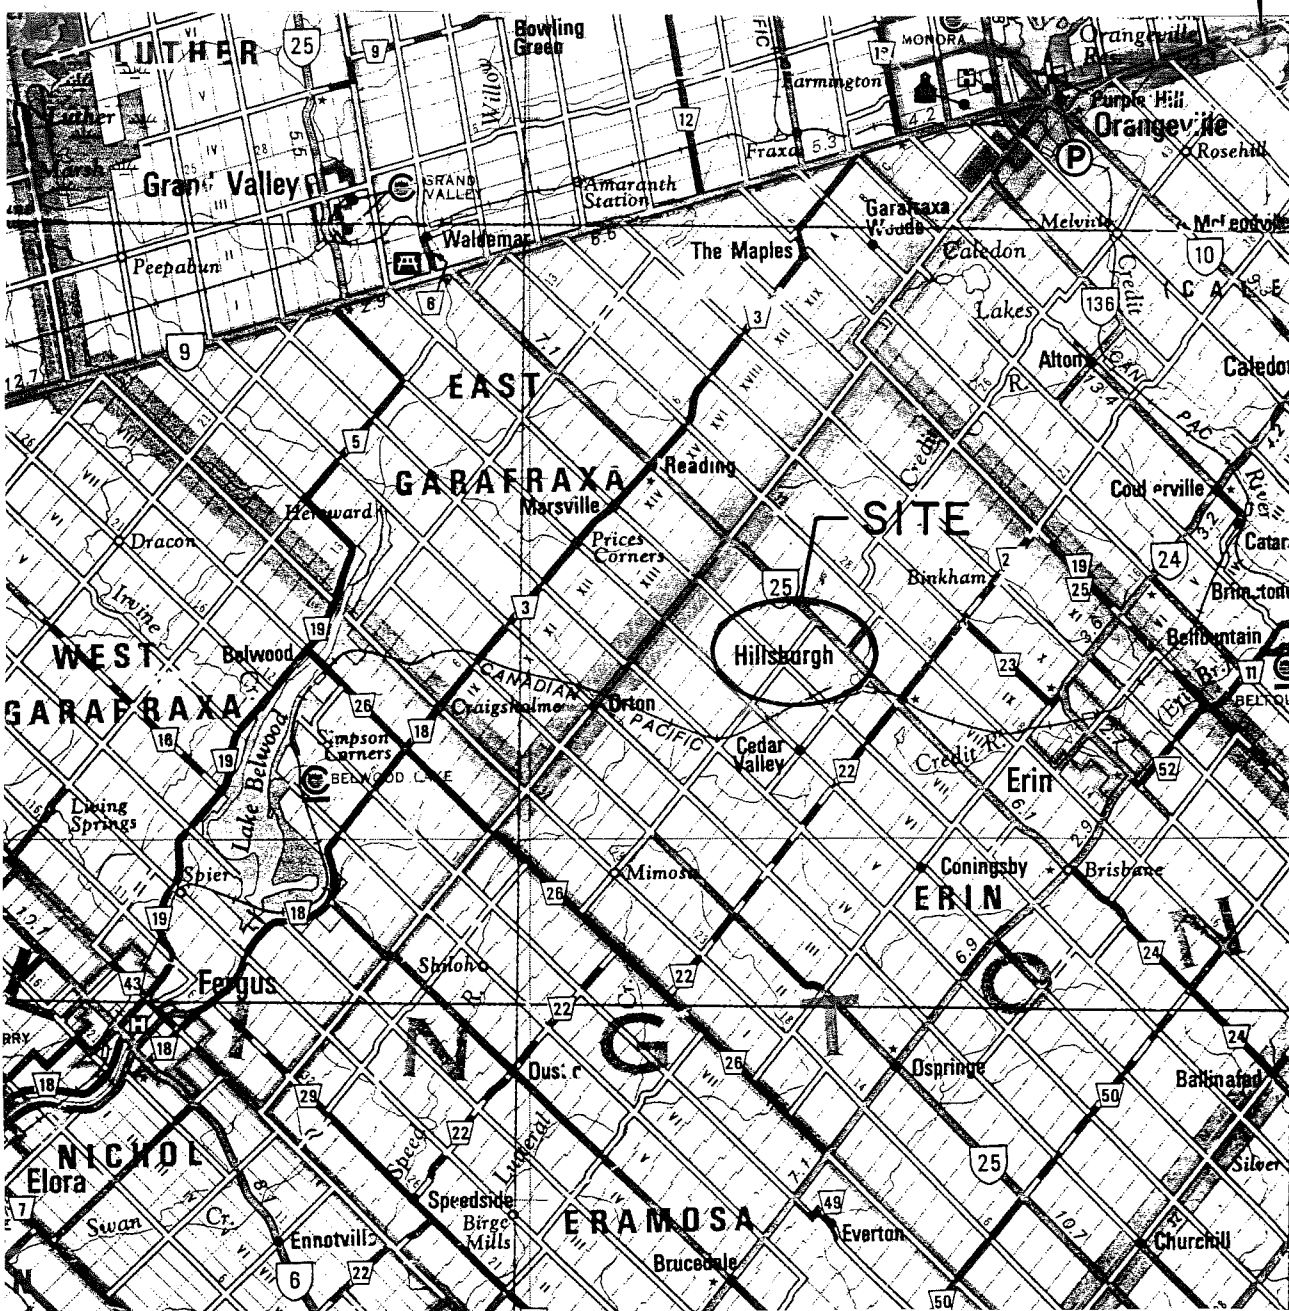

R.J. BURNSIDE & ASSOCIATES LIMITED
 ENGINEERS - PLANNERS - HYDROGEOLOGISTS - ENVIRONMENTAL CONSULTANTS
 15 TOWNLINE, ORANGEVILLE, ONTARIO L9W 3R4
 TELEPHONE: 519-941-5331 FAX: 519-941-8120
 DATE JAN 1990 SCALE N.T.S. JOB No S-134
 REVISED AUG 1999

LOCATION PLAN

FIGURE 1

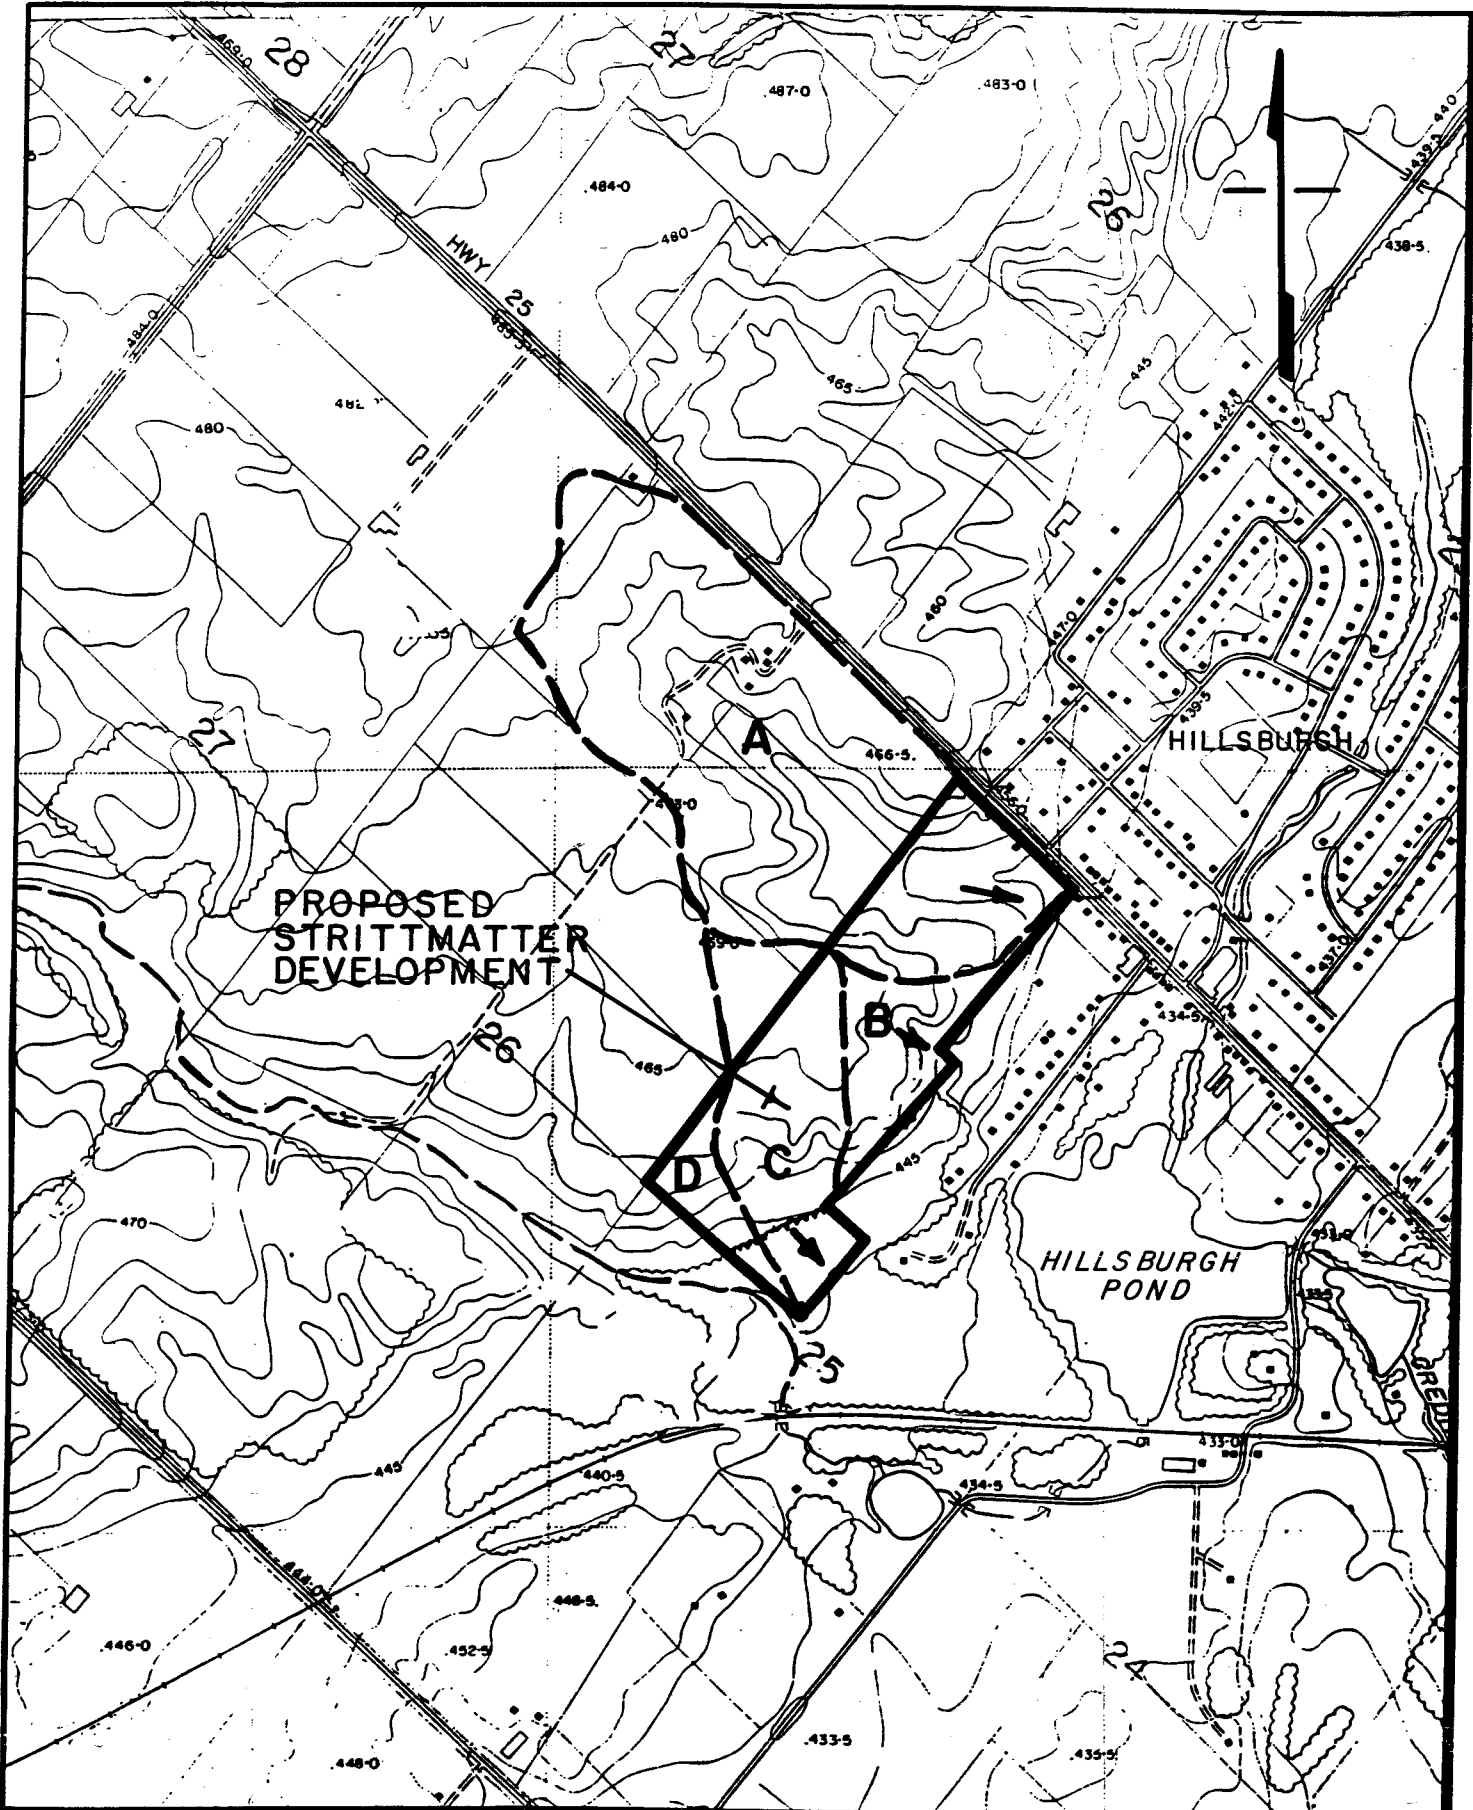

PREPARED BY



R.J. BURNSIDE & ASSOCIATES LTD.
 CONSULTING MUNICIPAL ENGINEERS & PLANNERS

15 TOWNLINE ORANGEVILLE L9W 3R4

DATE JAN 1990 SCALE NTS DRWG NO S-134

LOCATION OF PRE - DEVELOPMENT
 SUB WATERSHED

FIGURE 2

3.0 Hydrology

The Credit Valley Conservation Authority require that the post-development peak flows do not exceed the pre-development levels. This has been used as the design criteria for the detention ponds.

3.1 Pre-development Hydrologic Parameters

The pre-development flows were calculated using the OTTHYMO hydrologic computer model with the NASHYD sub-routine designed for use with rural areas. The characteristics of sub-watersheds A, B, C and D for pre-development conditions are listed in Table 1.

Table 1 Pre-Development Parameters				
Sub-Watershed	Area (ha.)	CN	Slope (%)	Tp (hr.)
A	26.7	58	5.0	0.30
B	3.44	64	8.0	0.08
C	7.32	64	6.0	0.12
D	1.61	64	6.0	0.11

3.2 Post Development Conditions

Following development of the Strittmatter property, drainage area A will be somewhat different than for pre-development conditions. The upstream lands (22.4 hectares), including the McMurchy farm, will continue to drain through the Strittmatter development. However, a separate storage facility is proposed for this drainage area, to be located on the McMurchy lands. This facility will release runoff very slowly into Pond 1 of the Strittmatter development.

Furthermore, approximately 3.3 hectares of drainage from County Road 24 will also be routed through Pond 1 in an effort to reduce peak flows in the County stormsewer. Hydrologic studies completed by Triton Engineering Services Limited in 1998 on the County stormsewer indicated that, while having sufficient capacity in the steep sections, the stormsewer is under surcharge where the gradient is reduced near the Credit River (across from the Hillsburgh arena) for a 5 year storm event. By routing it through Pond 1 on the Strittmatter property, flows are reduced significantly.

To this date, the CVC has been concerned with Pond 1 outletting to the natural outlet, a swale which drains through several backyards, before flowing under an existing house on George Street. The CVC has previously requested, as a condition of Draft Plan approval, that Mr. Strittmatter secure

easements along the swale to the Hillsburgh Pond in order to have access in the event of a flooding or potential flooding problem. Costs to secure the easements were prohibitive and Mr. Strittmatter chose to consider alternative drainage options.

The additional controls now provided by the McMurchy facility , the diversion of County Road drainage and the enlargement of Pond 1 into the area previously occupied by Lot 1 has reduced Mr. Strittmatter's runoff rates to a level which has permitted the routing of Pond 1 away from the natural outlet towards the County Road system without any adverse impacts. In fact, the 5 year flows in the County sewer are still significantly lower than pre-development rates and the 100 year flow at the outlet to the Credit River is lower also.

Routing the County Road drainage through Mr. Strittmatter's pond, as previously discussed, has the added benefit of providing some level of water quality treatment for this otherwise untreated runoff. As the West Credit River is the direct receiver of this road drainage, the water quality treatment aspect of the diversion is considered to be as important as the flow attenuation.


Sub-areas B, C and D were modified slightly to reflect the drainage changes resulting from the proposed road pattern. Sub-areas B and D are left to drain uncontrolled over the rear yards. The revised sub-areas are illustrated in Figure 3. Sub-area characteristics for post development conditions as revised are shown in the schematic in Figure 4.

3.3 Results

The areas and peak flows calculated for predevelopment and post Strittmatter development controlled conditions are summarized in Table 2. Sub-areas C and D drain to a common point at the southeast corner of the property. As a result, the flows from areas C and D are combined for the pre to post-development comparison. Table 2 reflects the combined flows for these two areas as well as the individual peak flows. It is clearly indicated, on this table, that pre to post-development control is met.

Table 2 Summary of Peak Flows (m ³ /s)								
Outlet	Pre-Development				Post Strittmatter Development			
	Area	2 Year	5 Year	100 Year	Area	2 Year	5 Year	100 Year
A	26.7	.637	.806	2.344	30.20	.186	.269	.495
B	3.44	.149	.188	.534	2.69	.102	.128	.373
C	7.32	.296	.374	1.077	8.23	.209	.340	.908
D	1.61	.067	.085	.244	1.10	.050	.123	.362
Combined C & D	8.93	.363	.459	1.322	9.33	.300	.450	1.303

- * Notes:
- i) Results are summarized from original OTTHYMO runs by R. J. Burnside & Associates Limited (1989). Due to changes in drainage areas to Outlet A (1999) for Post Development Conditions (diversion of County Road 24 drainage, additional storage facility on McMurchy property), post development runoff scenarios to Outlet A were re-modelled.
 - ii) A schematic model for drainage to Outlet A and the County Road system is provided in Appendix A with detailed output for 5 year event and 100 year event.

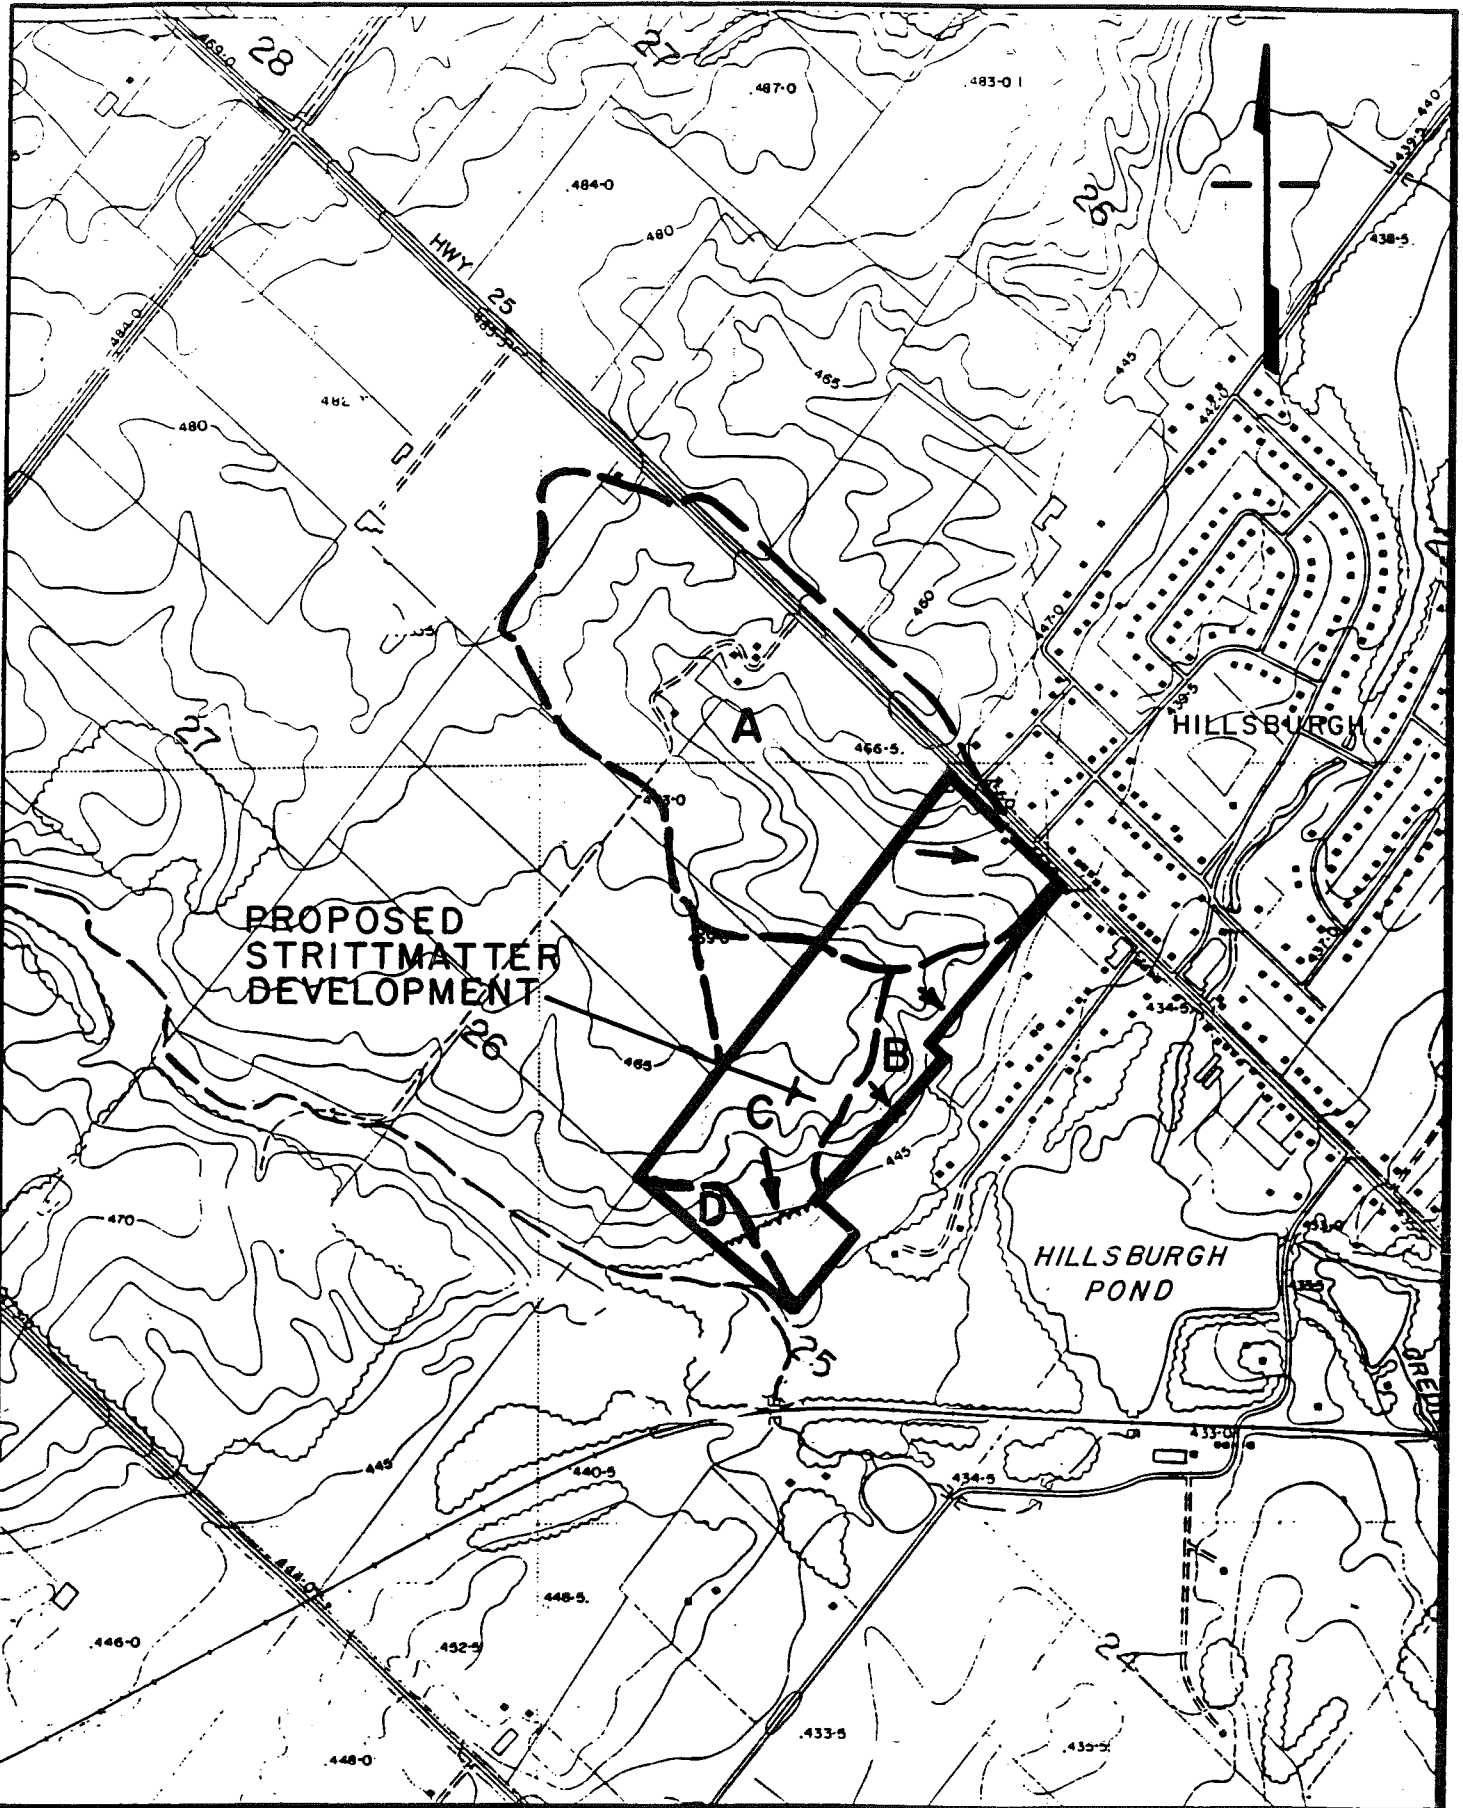

PREPARED BY




R.J. BURNSIDE & ASSOCIATES LTD.
 CONSULTING MUNICIPAL ENGINEERS & PLANNERS
 15 TOWNLINE ORANGEVILLE L9W 3R4
 DATE JAN 1990 SCALE NTS DRWG N°S-134

LOCATION OF POST-DEVELOPMENT
 SUB WATERSHED

FIGURE 3

(REVISED July 1999)

McMURCHY PROPERTY

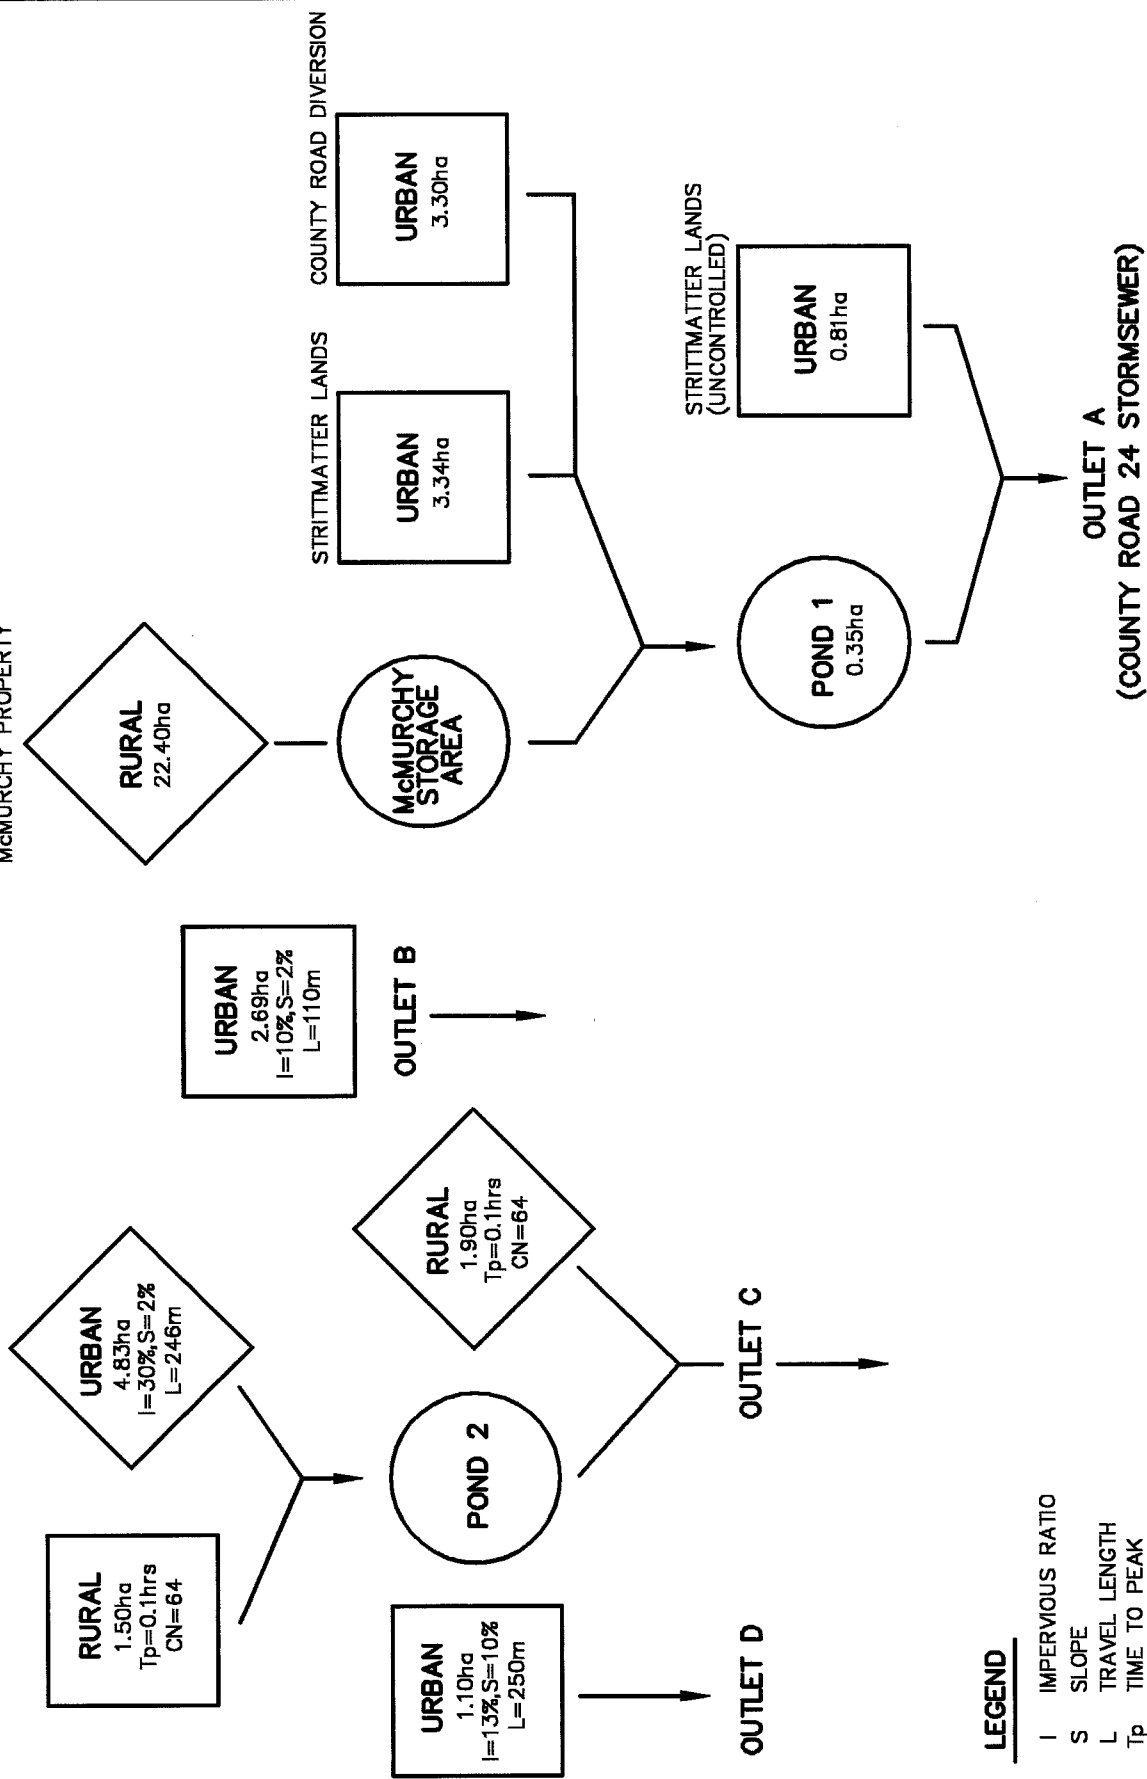

LEGEND

- I IMPERVIOUS RATIO
- S SLOPE
- L TRAVEL LENGTH
- Tp TIME TO PEAK

SCHEMATIC - POST DEVELOPMENT CONDITIONS

FIGURE 4

R.J. BURNSIDE & ASSOCIATES LIMITED
 ENGINEERS - PLANNERS - HYDROGEOLOGISTS - ENVIRONMENTAL CONSULTANTS
 19 TORBLINE, ORANGEVILLE, ONTARIO L9W 5N4
 TELEPHONE: 518-841-5531 FAX: 518-841-8120
 DATE: JAN 1990 SCALE: N.T.S. JOB No: S-134
 REVISED AUG 1998



3.4 Ultimate Development Condition

Consideration was given to the possibility of future development of the McMurchy lands. A hydrologic analysis was conducted to determine if a reasonable sized stormwater management facility could be constructed on McMurchy lands that would allow an appropriate discharge rate during storm events without having adverse effects on the Strittmatter stormwater management system.

For the hydrologic analysis an assumed development scenario was established for the McMurchy lands; this scenario is furthered referred to as the Ultimate Condition. The development of the 22.4 hectare property consisted of the following:

- 10 hectares Open Space (non-developable), and
- 12.4 hectares @ 30% impervious (similar to Strittmatter development)

Under the above conditions the following storage and outflow values were found to adhere to the requirements previously stated:

- 5 year: 2600 m³ controlled to 0.06 m³/s, and
- 100 year: 7300 m³ controlled to 0.16 m³/s.

These figures are rounded from the Summary of Hydrologic Analysis for Ultimate Condition chart provided in Appendix B. The 100 year flood storage could be provided in an area approximately 60m x 60m x 2m deep which is not excessive for a stormwater management pond. Of course, water quality volumes and potentially erosion control storage volumes may be required in addition to flood storage. These storage values are reasonable for the McMurchy development and should merely be used as indications that future expansion of the property, such that the needs of both Strittmatter and McMurchy land owners are satisfied, is possible. The invert of the storm sewer within the Strittmatter system, at the north end of Street 'C', has been deepened to allow maximum flexibility for future development of the McMurchy property.

Appendix B contains SWMHYMO modelling results and a storm sewer design sheet for the Ultimate Condition (post McMurchy development). In addition, tables showing a summary of the peak flows and pond performance under the Ultimate Condition are provided in Appendix B.

4.0 Detention Ponds

4.1 Location

Storage required to control post Strittmatter development runoff rates from sub-area A will be provided by Pond #1. This facility will take advantage of the embankments required for the construction of Upper Canada Drive. Figure 5 shows Pond #1 in detail. The location of Pond #1 is shown on Drawing No. S-405-8/G8 and in detail on Drawing S-405-25/S1.

Storage for outlet C will be provided in Pond #2 located in the southwest portion of the

development immediately north of the treed Open Space area. A drainage easement around the detention area will be granted to the Township for maintenance purposes. Figure 6 shows Pond #2 in detail.



Storage required to control run-off from the McMurchy property will be provided by the temporary pond located on the McMurchy property immediately north of Street 'C'. Figure 7 shows the McMurchy pond in detail.

4.2 Detention Pond Details

Both detention ponds on the Strittmatter property (i.e. Pond #'s 1 and 2) will have maximum side slopes of 3:1 to facilitate maintenance. The pond bottom will be graded at 0.5%. Pond #1 has a low flow channel at a grade of 1.0%. Pond #2 will also incorporate a low flow channel at a grade of 0.5 %.

The temporary pond facility on the McMurchy property will be created by constructing a berm along the north property line of the Strittmatter development at the end of Street 'C'. The berm will allow the McMurchy runoff to pond on their site thereby creating the facility. The release of the stormwater from the McMurchy pond will be facilitated by a Hickenbottom perforated riser which will convey flows in a controlled manner to the Strittmatter storm sewers through a 75mm diameter orifice.

Rainfall Event	Pond #1			Pond #2			McMurchy Pond	
	Outflow, m ³ /s	Depth, m	Volume, m ³	Outflow, m ³ /s	Depth, m	Volume, m ³	Outflow m ³ /s	Volume, m ³
25 mm	0.133	0.46	165	—	—	—	—	—
2 Year	0.165	0.57	300	.209	0.64	105	0.003	780
5 Year	0.233	1.02	660	.267	1.00	268	0.008	1820
100 Year	0.412	1.88	1620	.908	1.76	765	0.013	6120

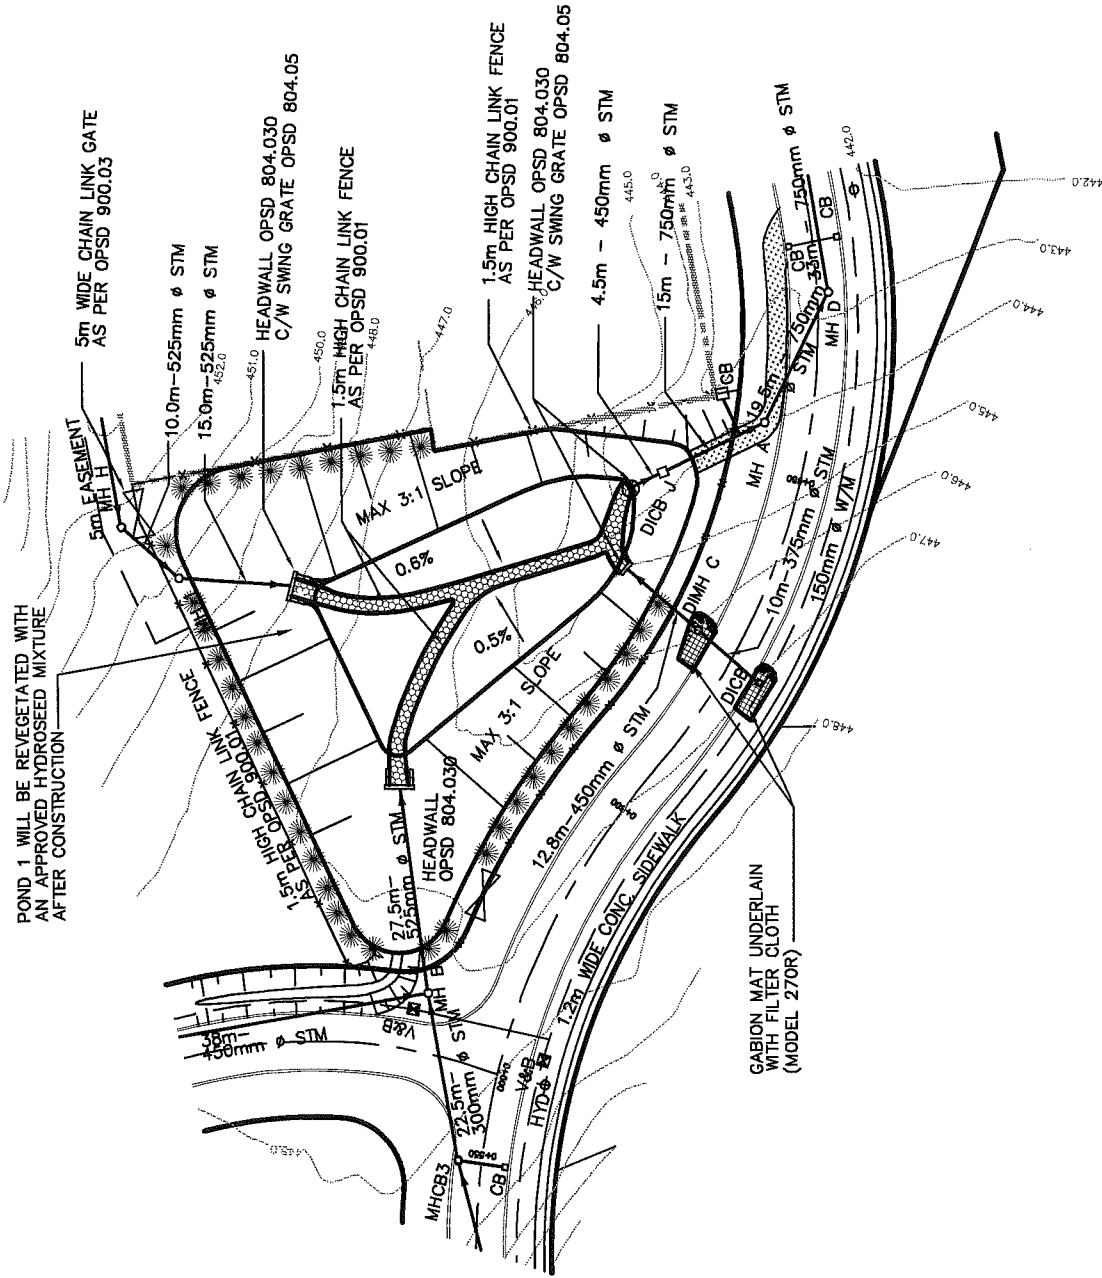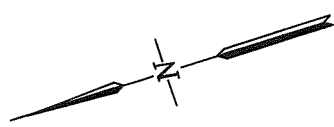


DETAIL OF POND 1

FIGURE 5

R.J. BURNSIDE & ASSOCIATES LIMITED
 ENGINEERS - PLANNERS - HYDROGEOLOGISTS - ENVIRONMENTAL CONSULTANTS
 15 TOWNLINE, ORANGEVILLE, ONTARIO L9W 3R4
 TELEPHONE: 519-941-5331 FAX: 519-941-8120
 DATE: JAN 1990 SCALE: N.T.S. JOB No: S-405
 REVISED: APRIL 2000



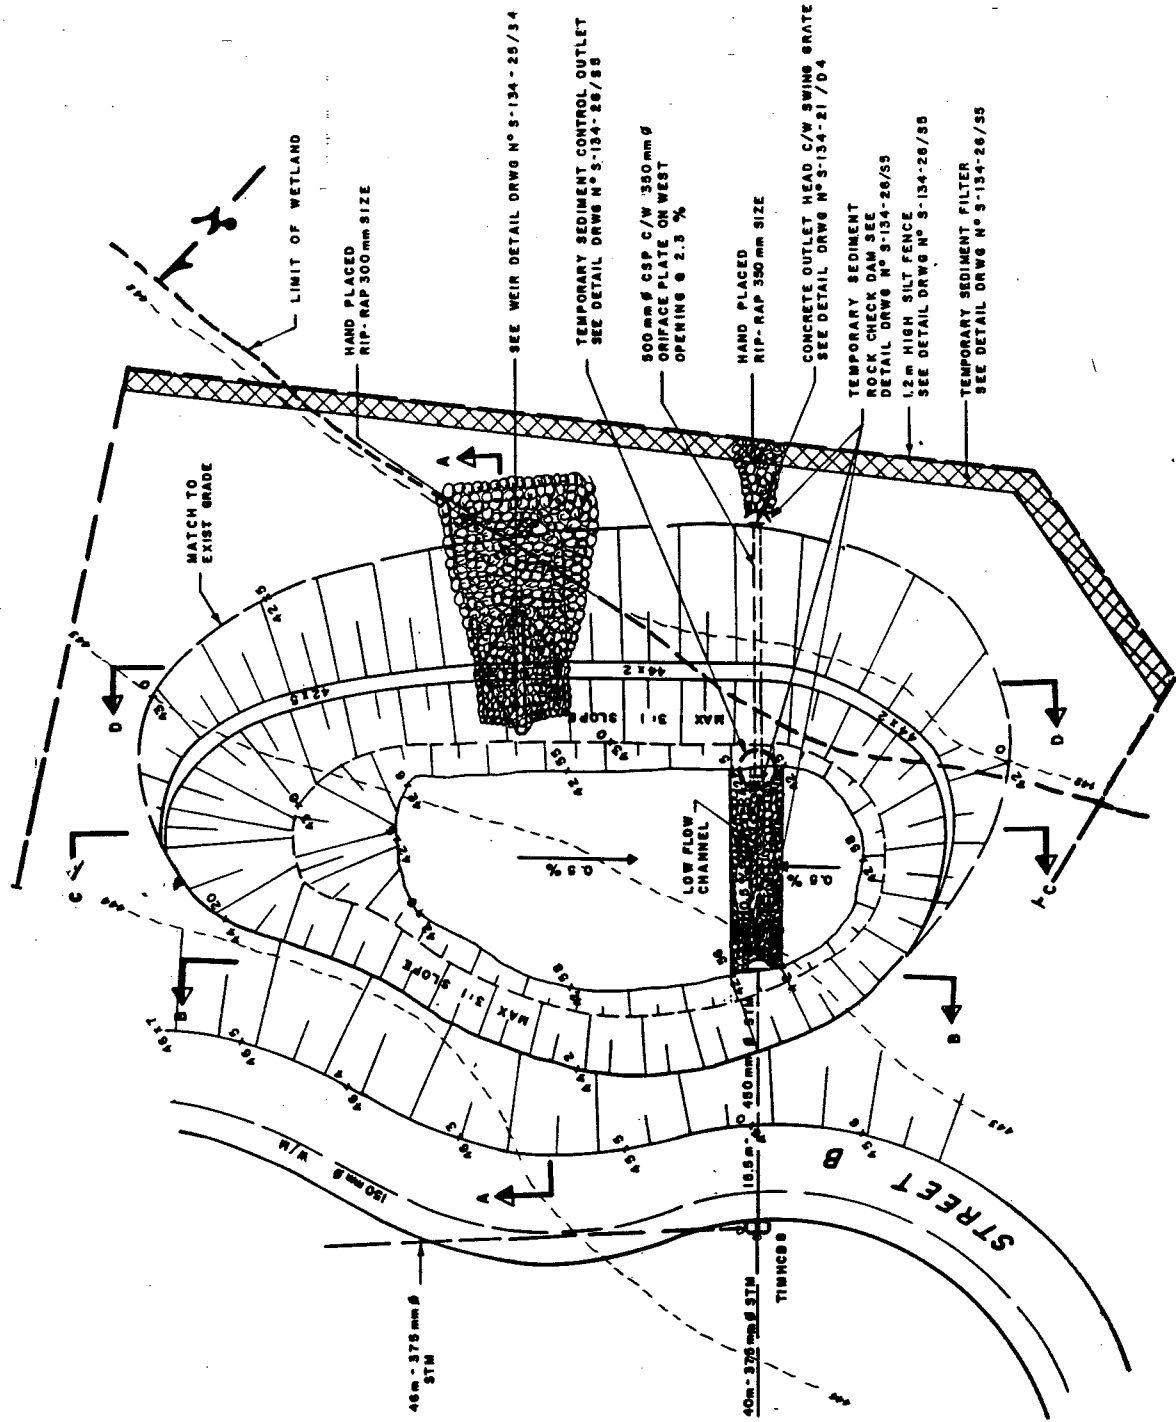


DETAIL OF POND N° 2

FIGURE 6

PREPARED BY
R.J. BURNSIDE & ASSOCIATES LTD.
 CONSULTING MUNICIPAL ENGINEERS & PLANNERS
 15 TOWNLINE ORANGEVILLE L9W 3R4
 DATE JAN 1990 SCALE NTS DRWG N° S-134



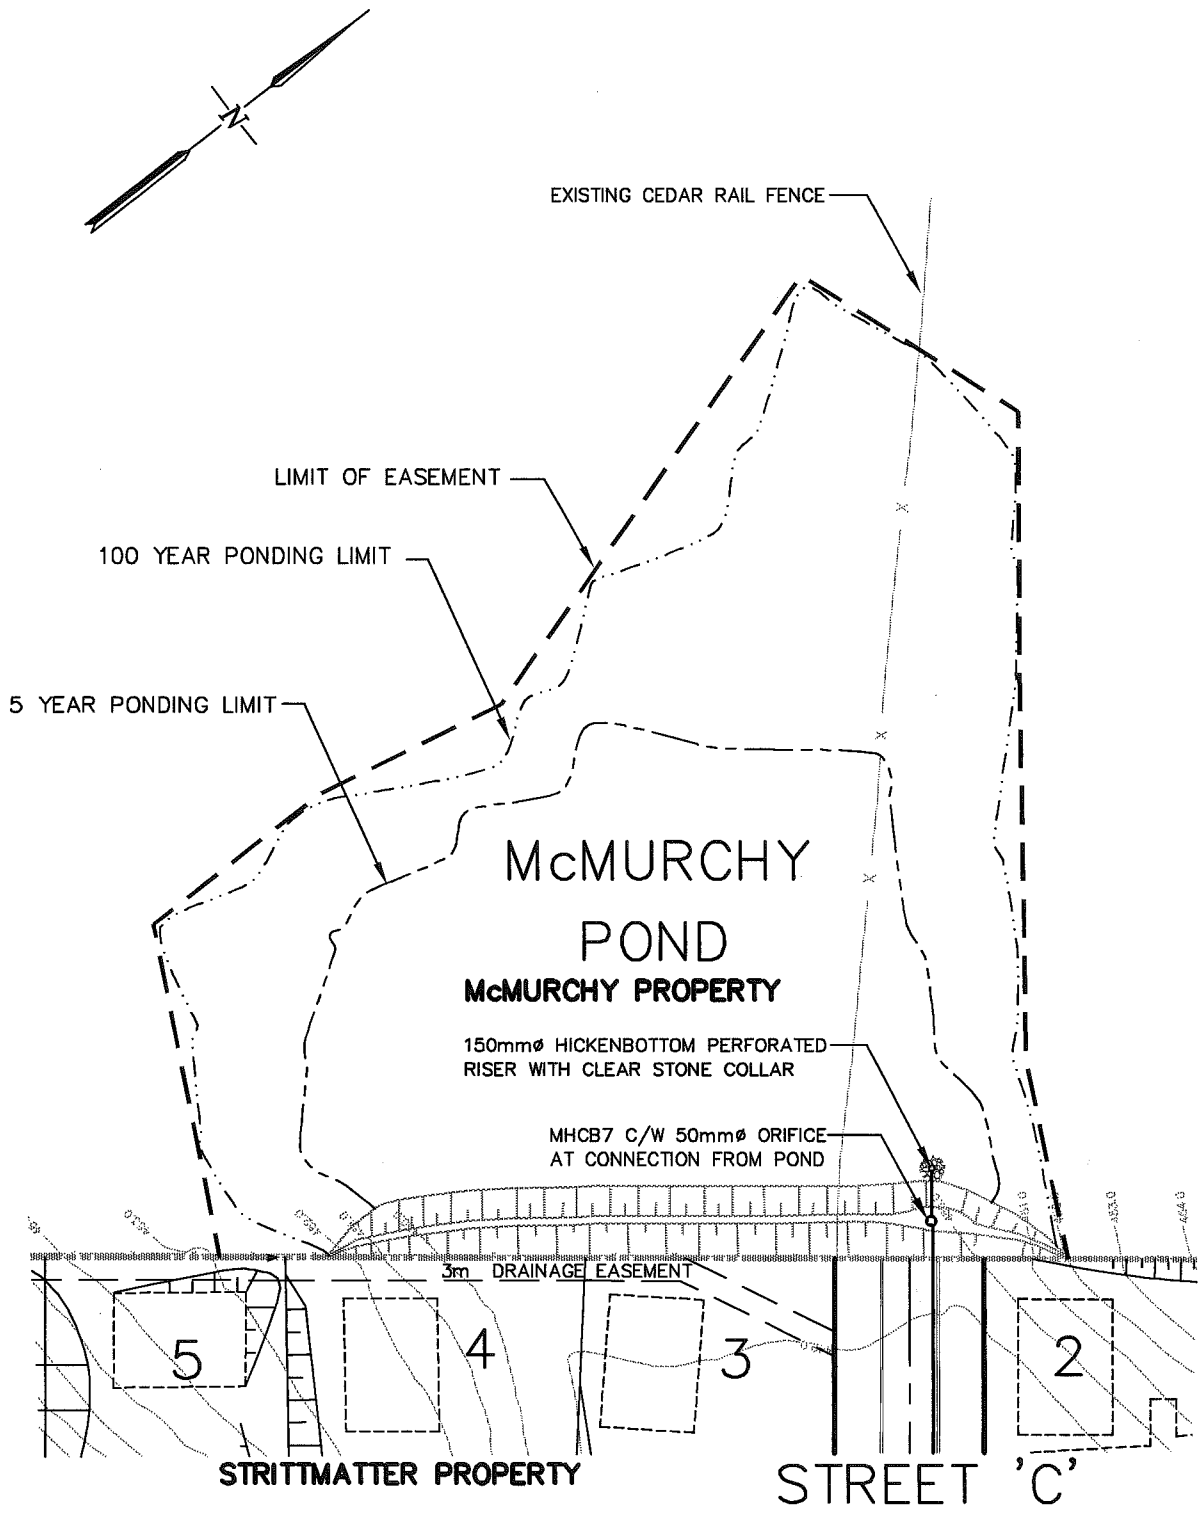

R.J. BURNSIDE & ASSOCIATES LIMITED
 ENGINEERS - PLANNERS - HYDROGEOLOGISTS - ENVIRONMENTAL CONSULTANTS
 15 TOWNLINE, ORANGEVILLE, ONTARIO L9W 3R4
 TELEPHONE: 519-941-5331 FAX: 519-941-8120
 DATE JAN 2000 SCALE N.T.S. JOB No S-405

DETAIL OF McMURCHY POND

FIGURE 7

5.0 Sedimentation And Erosion Control Plan

Sedimentation and erosion control measures are shown on the Sediment Control Plan (Dwg. No. S-405-30/S6). The grading plans indicate that the proposed gradient and length of the slopes are moderate to steep. These, according to the MNR (1987), the site is characterised as moderate to high potential for erodibility.

The site will have measures installed to reduce the impact of sedimentation and erosion on site and downstream, including two sediment basins. One will be constructed for drainage Area A (Pond #1 location) as shown on Drawing S-405-25/S1 and one for drainage Area C (Pond #2 location) as shown on Drawing S-405-27/S3. The McMurchy property will also have a sediment collection area where the McMurchy pond will be located. According MNR criteria the sediment basin will be designed to provide 125 m³/ha of disturbed land. For Area A, a 500 m³ capacity is required for the sediment basin. The outfall for Pond #1 will be controlled by a temporary sediment control structure as detailed in Drawing S-405-29/S5.

For Area C a 600 m³ capacity is required for the sediment basin. The proposed stormwater management area (i.e. Pond #2) will act as a sediment basin during the construction period. Similar to Pond #1, the outfall for the sediment basin at Pond #2 will also be controlled by a temporary sediment control structure as detailed on Drawing S-405-29/S5.

A riser pipe surrounded by clear stone and filter cloth will ensure sediment control during the construction period. The weir for Pond #2 will not be installed until after all other construction on the site is completed and the site is stabilized.

The schedule of construction is a vital component of sedimentation and erosion control. Prior to any site grading or construction, the berm at the McMurchy property line must be constructed. This will control the sediment transport from the McMurchy farm and protect the Strittmatter property from damaging sheet flow. In conjunction with the berm construction, the two sediment basins, Pond #1 and Pond #2 must be constructed to collect sediment from the site.

If either of the sediment basins lose 25% of their total volume during the construction period, the contractor on-site will be responsible for cleaning out the facility.

A silt fence and temporary sediment filters will be installed as per grading plans around the site to provide additional sedimentation and erosion control. Buffer strips and a second line of silt fence have been provided along the south property line. In addition, silt fence will be installed around the entire perimeter of the topsoil and earth stockpiles. After the stripping and removal of topsoil within the road allowance, an interceptor ditch with a minimum depth of 0.6 m will be put in place as shown on the Sediment Control Drawing, S-405-30/S6. Finally, all inlets to the storm sewers will have silt traps placed around them. Details on these measures can be found in Drawing S-405-29/S5. Site inspectors will ensure that all sediment control structures are properly maintained. Any deficiencies are to be reported to the site contractor for immediate repair.

Both ponds will incorporate low flow channels which will be lined with rip-rap (150 to 200 mm) to prevent erosion when the storm sewers are flowing full. Rock check dams are proposed at the inlets and outlets of both ponds. Stockpiling of all topsoil and earth will be on lots 8 to 16 and 20 to 28 inclusive.

All sediment basins will be thoroughly cleaned out and temporary control structures removed before they are commissioned as the new stormwater management ponds.

6.0 Summary

This stormwater management report was originally prepared and submitted in 1989 in support of this development proposal by Mr. Frank Strittmatter. The purpose of the report was to document the design details of the stormwater management plan.

In response to several drainage issues raised by the Credit Valley Conservation and the Town of Erin, we have made some modifications to the drainage system. Mr. Strittmatter's land will no longer drain to the swale outlet which used to accept approximately 26 hectares of drainage (including 22.4 hectares of upstream drainage). An additional stormwater storage area on the McMurchy property has helped to reduce outflows from Pond 1 to a level which can be accommodated in the County storm sewer without adverse effects on that system. In fact, 5 year flows are reduced appreciably and 100 year flows near the outlet at the Credit River are also reduced.

The stormwater management areas provide quantity controls for up to a 100 year storm event for the development.


Sedimentation and erosion controls, including two sediment basins, will be in place to minimize the migration of sediment from the site during the construction period.

Respectfully Submitted:

R. J. Burnside & Associates Limited



Lorena Durrant, BSc. Eng.

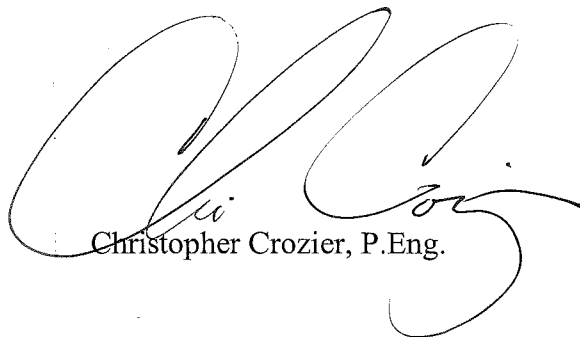

Christopher Crozier, P.Eng.

LD:mm J:\AJOB\RB\S-405\060600report.wpd

APPENDIX A

POST STRITTMATTER DEVELOPMENT
SWMHYMO MODELLING RESULTS

STORM SEWER DESIGN SHEET
POST STRITTMATTER DEVELOPMENT

R.J. BURNSIDE & ASSOCIATES LIMITED
ENGINEERS-HYDROGEOLOGISTS-ENVIRONMENTAL CONSULTANTS

8500 TORBRAM ROAD, SUITE 56, BRAMPTON, ONTARIO L6T5C6
TELEPHONE: 905-793-9239 FAX: 905-793-5018
Township of Erin Rainfall I.D.F. 5 yr. storm
(Standards based on Malton I.D.F. curves)

Q = 2.778 CIA
Q: Peak Flow(l/sec)
C: Runoff coefficient
A : Area(Ha)
i: Rainfall intensity (mm/hr) $I = A/(B+Tc)^c$
Manning's n 0.013

Date : 01-Jun-00
Project : Strittmatter Property
Municipality : Township of Erin
Designer : LD
Checker :

Street Name	Location		AREA A ha	COEF C	Individual 2.78AC	Accumulated 2.78AC	Time of Concentration (mins)	Rainfall Intensity (mm/hr)	Peak Flow (l/s)	Sewer Data					
	From	To								Diameter (mm)	Slope (%)	Length (m)	Capacity (l/s)	Velocity (m/s)	Time of Flow (mins)
Upper Canada Drive	MHCB 5	MHCB 4	0.54	0.4	0.60	0.60	10.00	101.30	61	300	7.85	75.0	283	3.87	0.32
	MHCB 4	MHCB 3	0.53	0.4	0.59	1.19	10.32	99.59	118	300	7.81	64.0	282	3.86	0.28
	MHCB 3	MH B	0.41	0.4	0.46	1.65	10.60	98.18	162	300	8.00	22.5	285	3.91	0.10
Street C	MHCB 7	DCBMH 6	22.4	0.3	18.68	18.68	10.00	(see note 1)	8	450	1.50	39.5	364	2.22	0.30
	DCBMH 6	MH B	1.04	0.4	1.16	1.16	10.30	99.73	123	450	1.50	38.0	364	2.22	0.29
Upper Canada Drive	MH B	headwall					10.69	(see note 3)	285	525	1.00	27.5	449	2.01	0.23
	DICB (RT) DIMH C	headwall					11.70 11.70	(see note 4)	142 283	375 450	1.00 1.00	10.0 12.8	183 297	1.60 1.81	0.10 0.12
Diversion from County Rd. 24 (Triton study)	pond	DICB J	(see note 5)	Refer to R.J. Burnside SWM Report					233	350	0.71	4.5	128	1.29	0.06
	DICB J	MH A		"				233	233	750	0.85	15.0	1071	2.36	0.11
	MH A	MH D		"				233	233	750	0.85	19.5	1071	2.35	0.14
	MH D	MH E		"				233	233	750	0.37	33.0	707	1.55	0.35
	MH E	MH F		"				269	269	750	2.00	22.5	1643	3.60	0.10
	DICB 70	DICB 69	2.4	0.5	3.34	3.34	10.00	101.30	338	525	5.60	78.0	1062	4.75	0.27
New Diversion System	DICB 69	DICB 67	0.25	0.5	0.95	3.68	10.27	99.85	368	525	5.79	73.0	1080	4.83	0.25
	DICB 67	DCB 66	0.68	0.5	0.95	4.63	10.53	98.55	456	525	7.23	28.0	1207	5.40	0.09
New Diversion System	DCB 66	MH G				(No further inflow)			456	525	4.27	21.5	927	4.15	0.09
	MH G	MH H						456	456	525	1.25	53.5	502	2.25	0.40
	MH H	MH I						456	456	525	6.20	10.0	1117	5.00	0.03
	MH I	headwall						456	456	525	1.00	15.0	449	2.01	0.12

- NOTES:
- 1) The peak flow of 8 l/s for the storm sewer from MHCB 7 to DCBMH 6 represents the 5 year routed flow from the undeveloped McMurtry ponding area.
 - 2) The flow from DCBMH 6 to MH B was determined using a combined flow from MHCB 7 to DCBMH 6 (5 yr. SWMHYMO), and DCBMH 6 to MH B using the rational method (5 yr. storm). The 100 yr. storm flow will go directly into the pond via an overland swale
 - 3) The peak flow from MH B to the headwall (in the pond) is the combined flow from Street C and Upper Canada Drive to MH B.
 - 4) The peak flow from DIMH C to pond is the 100 year storm flows from catchment SA4 as well as the carryover flow from the upstream catchments (SA1, SA2, and SA3). This sewer must have the capacity to convey all of the runoff from the 100 year event to the pond (see Catchbasin Design Sheet).
 - 5) 5 year outflow from Strittmatter pond (233 l/s) spills partly through the high flow outlet

Storm Sewers into pond 2 (corrections from page 2 of June 1990 sheet)

Street Name	Location		AREA A ha	COEF C	Individual 2.78AC	Accumulated 2.78AC	Time of Concentration (mins)	Rainfall Intensity (mm/hr)	Peak Flow (l/s)	Sewer Data					
	From	To								Diameter (mm)	Slope (%)	Length (m)	Capacity (l/s)	Velocity (m/s)	Time of Flow (mins)
Leader Court	MHCB 13	MH 12	0.24	0.4	0.27	0.27	10.00	101.30	27	300	6.75	39.0	262	3.59	0.18
	MHCB 11	MHCB 10	0.39	0.4	0.43	0.70	10.34	99.48	70	300	8.15	38.5	288	3.95	0.16
	MHCB 10	MHCB 9	0.97	0.4	1.08	1.78	10.67	97.84	174	300	7.9	75.0	284	3.89	0.32
	MHCB 9	TIMHCB 8	0.63	0.4	0.70	2.48	10.92	96.59	240	375	6.5	54.0	257	3.53	0.26
	MHCB 19	MHCB 18	0.9	0.3	0.75	0.75	10.00	101.30	141	300	3.85	62.0	198	2.71	0.38
Upper Canada Drive	MHCB 18	MHCB 17	0.6	0.3	0.50	0.50	10.38	99.29	242	375	5.5	72.0	429	3.76	0.32
	MHCB 17	MH 16	0.52	0.4	0.58	3.02	10.70	97.67	295	375	4.7	34.5	397	3.48	0.17
	TIMHCB 20	MH 16								525	4.42	27.0	943	4.22	0.11
	MH 16	MH 15								525	8	21.0	1269	5.68	0.06
Easement Lot 19/20	MH 15	MH 14								525	8	26.0	1269	5.68	0.08
	MH 14	TIMHCB 8								525	8	40.0	1269	5.68	0.12
	TIMHCB 8	Pond 2							680	750	1.25	16.5	1299	2.85	0.10

SWMHYMO SCHEMATIC


STRITTMATTER DEVELOPMENT, HILLSBURGH

POST STRITTMATTER DEVELOPMENT

- ROUTE HWY DRAINAGE (3.3ha) THRU STRITTMATTER POND
- REVISED MAY/17/99—ADDED McMURCHY LANDS & BERM
- REVISED MARCH/20/00—MODIFIED MODELLING SUBCATCHMENTS

STRITTMATTER DRAINAGE

COUNTY ROAD 24(BELOW DIVERSION)

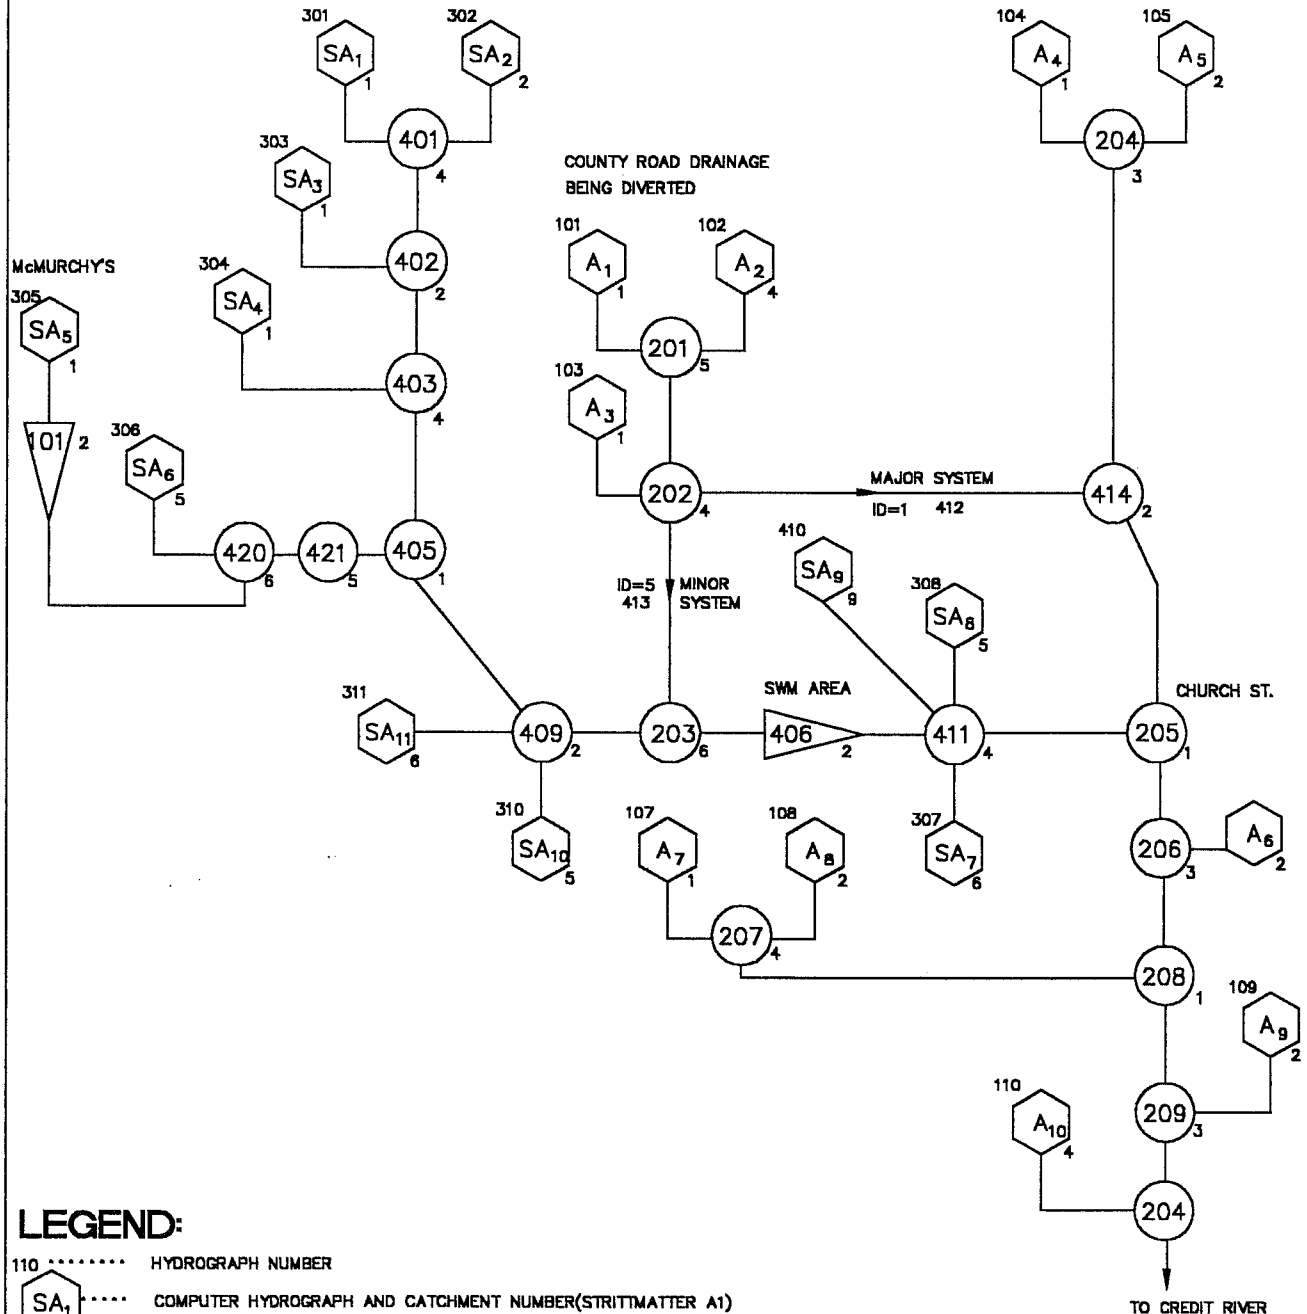

LEGEND:

- 110 HYDROGRAPH NUMBER
- SA₁ COMPUTER HYDROGRAPH AND CATCHMENT NUMBER(STRITTMATTER A1)
- 4..... CELL STORAGE ID (SWMHYMO PROGRAM)
- 207..... ADD HYDROGRAPH (HYDROGRAPH NUMBER INSIDE)
- 4..... CELL STORAGE ID
- 406..... ROUTE RESERVOIR (HYDROGRAPH NUMBER INSIDE)
- 2 ... CELL STORAGE ID



BURNSIDE DEVELOPMENT SERVICES

A DIVISION OF R.J. BURNSIDE AND ASSOCIATES LIMITED
 DEVELOPMENT ENGINEERING & MANAGEMENT,
 STORMWATER MANAGEMENT & COMMUNAL SYSTEMS
 8500 TORBRAM ROAD, SUITE 5A, BRAMPTON, ONTARIO L6T 5C8
 TELEPHONE: 905-793-8238 FAX: 905-793-5018

**Strittmatter Development, Village of Hillsburgh
Town of Erin**

**Summary of Hydrologic Analysis for Post Strittmatter Development Conditions
Drainage Area to County Road 24 Only**

Catchment ID	Drainage Area	5 Year Flows, m ³ /s			100 Year Flows, m ³ /s			Storage Used (m ³)
		Local Runoff	Combined Runoff	Controlled Runoff	Local Runoff	Combined Runoff	Controlled Runoff	
Strittmatter Drainage								
SA1	0.54	0.046	0.046	0.046	0.105	0.105	0.105	-
SA2	0.53	0.045	0.091	0.091	0.103	0.209	0.209	-
SA3	0.41	0.035	0.126	0.126	0.080	0.289	0.289	-
SA4	0.41	0.035	0.161	0.161	0.080	0.369	0.369	-
SA5 *	22.40	0.313	0.313	0.008	1.028	1.028	0.013	6114.00
SA6	1.04	0.063	0.224	0.224	0.166	0.536	0.536	-
SA10	0.36	0.034	0.258	0.258	0.077	0.613	0.613	-
SA11	0.35	0.092	0.350	0.350	0.154	0.767	0.767	-
County Road 24 Drainage Being Diverted (Data from Triton Study (1998))								
A1	2.40	0.312	0.312	0.312	0.604	0.604	0.604	-
A2	0.25	0.033	0.344	0.344	0.064	0.668	0.668	-
A3	0.68	0.089	0.434	0.434	0.173	0.841	0.450	(minor system)
County Road + Strittmatter Drainage		0.78	0.23	-	1.22	0.391	0.41	1620.00
Routed Through Strittmatter SWM Area								
SA7	0.32	0.027	0.027	0.027	0.061	0.061	0.061	-
SA8	0.46	0.038	0.038	0.038	0.087	0.087	0.087	-
SA9	0.08	0.021	0.269	0.269	0.035	0.495	0.495	-
A4	0.09	0.012	0.012	0.012	0.023	0.023	0.023	-
A5	0.28	0.037	0.049	0.049	0.072	0.095	0.095	-
A6	0.31	0.048	0.348	0.348	0.088	0.991	0.991	-
A7	0.24	0.041	0.041	0.041	0.075	0.075	0.075	-
A8	0.30	0.054	0.443	0.443	0.096	1.162	1.162	-
A9	0.32	0.053	0.495	0.495	0.091	1.253	1.253	-
A10	0.21	0.036	0.531	0.531	0.065	1.318	1.318	-
Total	31.98	Total Flows to Credit River			0.531	0.318	0.318	

* SA5 represents the McMurchy Property . Drainage from these lands is controlled on-site in temporary facility.

Stage-Storage-Discharge Relationship for Pond #1 (revised April 2000)
Post Strittmatter Development

Low Flow Outlet :	Conc. Pipe, diameter (m):	0.45
	Orifice, diameter (m):	0.35
	Invert Elevation (m):	442.95
Major Flow Outlet:	Conc. Pipe, diameter (m):	0.2
	Opening Elevation (m):	443.8
Centre of Low Flow Orifice, m		443.13
Centre of Low Flow Pipe, m		443.18
Elevation of Major Flow Pipe, m		443.80

Depth,m	Elevation, m	Low Flow Outlet	Major Flow Outlet	Total Flow, m ³ /s	Total Storage, m ³
0.00	442.95	0.000	0.000	0.000	0.00
0.20	443.15	0.040	0.000	0.040	13.44
0.30	443.25	0.090	0.000	0.090	45.36
0.40	443.35	0.121	0.000	0.121	107.52
0.50	443.45	0.146	0.000	0.146	210.00
0.80	443.75	0.202	0.000	0.202	464.39
1.05	444.00	0.239	0.000	0.239	686.89
1.10	444.05	0.246	0.000	0.246	733.38
1.25	444.20	0.265	0.053	0.318	878.13
1.40	444.35	0.283	0.062	0.345	1032.38
1.60	444.55	0.305	0.072	0.378	1256.39
2.00	444.95	0.345	0.090	0.435	1786.41
2.10	445.05	0.355	0.093	0.448	1939.84
2.20	445.15	0.364	0.097	0.461	2103.02
2.30	445.25	0.373	0.101	0.473	2276.62

file: i:\Lorena\s-405\Pond_newps.wk4

Stage-Discharge Relationship for McMurchy Pond

Use 75mm Orifice as Control

Elev, m	Depth, m	Discharge, m ³ /s	Storage, m ³
450.50	0.00	0.000	0.00
450.75	0.25	0.006	
451.00	0.50	0.008	1850.00
451.25	0.75	0.010	
451.50	1.00	0.012	4775.00
451.75	1.25	0.013	
452.00	1.50	0.014	8690.00
452.25	1.75	0.015	
452.40	1.90	0.582	12670.00

```

SSSSS W W M M H H Y Y M M OOO 999 55555 =====
S W W W MM MM H H Y Y MM MM O O 9 9 5 =====
SSSSS W W W M M M H H H H H Y M M M O O ## 9 9 5 Ver. 3.1
S W W M M H H Y M M O O 9999 5555 Oct. 1997
SSSSS W W M M H H Y M M OOO 9 5 =====
9 9 5 # 3877524
StormWater Management HYdrologic Model 999 5555 =====

```

```

*****
***** SWMHYMO-95w Ver/3.1 *****
***** A single event and continuous hydrologic simulation model *****
***** based on the principles of HYMO and its successors *****
***** OTTHYMO-83 and OTTHYMO-89. *****
***** Distributed by: J.F. Sabourin and Associates Inc. *****
***** Ottawa, Ontario: (613) 727-5199 *****
***** Gatineau, Quebec: (819) 243-6858 *****
***** E-Mail: swmhymo@jfsa.Com *****
*****

```

```

+++++ Licensed user: R.J. Burnside & Associates Ltd. +++++
+++++ Brampton SERIAL#:3877524 +++++
+++++

```

```

*****
***** +++++ PROGRAM ARRAY DIMENSIONS +++++ *****
***** Maximum value for ID numbers : 10 *****
***** Max. number of rainfall points: 5000 *****
***** Max. number of flow points : 5000 *****
*****

```

```

***** D E T A I L E D O U T P U T *****
*****
* DATE: 2000-06-01 TIME: 10:47:50 RUN COUNTER: 001101 *
*****
* Input filename: I:\LORENA\S-405\CORREC~1\MAY00\STRIT5.DAT *
* Output filename: I:\LORENA\S-405\CORREC~1\MAY00\STRIT5.out *
* Summary filename: I:\LORENA\S-405\CORREC~1\MAY00\STRIT5.sum *
* User comments: *
* 1: _____ *
* 2: _____ *
* 3: _____ *
*****

```

```

-----
001:0001-----
*# *****
*# Project Name: [ Strittmatter Development, Hillsburgh] Project Number: [S-405
*# Date : 04-18-2000
*# Modeller : [LD]
*# Company : R. J. Burnside & Associates Ltd.
*# License # : 3877524
*# *****
*# Hydrologic analysis of County Road 24 stormsewer system combined with
*# Strittmatter Development at the north end of the village of Hillsburgh.
*#
*# McMurphy Berm added May '99
*#

```

```
*# 5 year storm event
*#
*# Data from County Rd. 24 Stormsewer Analysis (Triton) used
*# for Road Catchments. Strittmatter Development discharge
*# includes stormwater controls
*#
*# Made modifications to this file to route the road portion or upper canada SA
*# into the pond and let the external property SA8 flow uncontrolled. This fil
*# was run to obtain volume requirements for the pond to store & throttle the
*# 100 year flows of the Strittmatter Development. Lot 1 was made available
*# as pond area so SA10 decreased 0.32 ha and SA11 increased the same amount.
*#
*# File was further modified to let SA9 flow uncontrolled off site
*#
*# File was further modified to collect some of the drainage from SA8 at the
*# south end of Lot 1. SA8 area decreased to 0.46 ha and SA10 area increased
*# to 0.36 ha. Change in response to Triton comments May 19, 2000
*#
```

```
-----
| START | Project dir.: I:\LORENA\S-405\CORREC~1\MAY00\
----- Rainfall dir.: I:\LORENA\S-405\CORREC~1\MAY00\
TZERO = .00 hrs on 0
METOUT= 2 (output = METRIC)
NRUN = 001
NSTORM= 0
-----
```

```
001:0002-----
*READ STORM STORM_FILENAME=["c:\S-405\swmhymo\hazel.stm"]
-----
```

```
| CHICAGO STORM | IDF curve parameters: A=1439.371
| Ptotal= 50.14 mm | B= 13.688
C= .846
used in: INTENSITY = A / (t + B)^C
Duration of storm = 3.00 hrs
Storm time step = 10.00 min
Time to peak ratio = .33
```

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.17	4.466	1.00	98.929	1.83	8.962	2.67	4.283
.33	5.747	1.17	42.990	2.00	7.369	2.83	3.877
.50	8.048	1.33	23.232	2.17	6.247	3.00	3.543
.67	13.224	1.50	15.419	2.33	5.419		
.83	32.890	1.67	11.382	2.50	4.784		

```
001:0003-----
*#
*# Catchment A4 from Triton Study (0.09 hectares, C= 0.5)
*#
```

```
-----
| DESIGN STANDHYD | Area (ha)= .09
| 01:000104 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.05
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	6.00	6.00
Length (m)=	24.49	40.00
Mannings n =	.013	.250

Max.eff.Inten. (mm/hr)=	98.93	20.18	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.64 (ii)	10.27 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.01	.00	.012 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	27.144
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.541

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0004-----

*#
*# Catchment A5 from Triton Study (0.28 hectares, C= 0.5)
*#

| DESIGN STANDHYD | Area (ha)= .28
| 02:000105 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.11	.17	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	6.00	6.00	
Length (m)=	43.20	40.00	
Mannings n =	.013	.250	
Max.eff.Inten. (mm/hr)=	98.93	20.18	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.91 (ii)	10.53 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.03	.01	.037 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	27.145
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.541

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0005-----

*# Add summed hydrographs from Catchments A5 to A4

| ADD HYD (000204) | ID: NHYD AREA QPEAK TPEAK R.V. DWF

 (ha) (cms) (hrs) (mm) (cms)

ID1 01:000104	.09	.012	1.00	27.14	.000
+ID2 02:000105	.28	.037	1.00	27.14	.000
=====					
SUM 03:000204	.37	.049	1.00	27.14	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0006-----

*#
 *# Proposed Strittmatter Development
 *#
 *# Catchment SA1 (Strittmatter A1, 0.54 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.54		
01:000301 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.38	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	60.00	40.00	
Mannings n =	.013	.250	
Max. eff. Inten. (mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.36 (ii)	12.08 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.03	.02	.046 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0007-----

*#
 *# Catchment SA2 (Strittmatter A2, 0.53 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.53		
02:000302 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.37	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	59.44	40.00	
Mannings n =	.013	.250	
Max. eff. Inten. (mm/hr)=	98.93	25.97	

over (min)	10.00	10.00	
Storage Coeff. (min)=	1.35 (ii)	12.07 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.03	.02	.045 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0008-----

*# Add hydrographs from Strittmatter A1 and A2

ADD HYD (000401)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
ID1 01:000301		.54	.046	1.00	20.84	.000
+ID2 02:000302		.53	.045	1.00	20.84	.000
=====						
SUM 04:000401		1.07	.091	1.00	20.84	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0009-----

*#
*# Catchment SA3 (Strittmatter A3, 0.41 hectares)
*#

DESIGN STANDHYD	Area (ha)=	.41		
01:000303 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.12	.29	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	52.28	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.25 (ii)	11.97 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.02	.01	.035 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0010-----

*# Add hydrographs from Strittmatter A3 to Strittmatter (A1+A2)

ADD HYD (000402)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000303		.41	.035	1.00	20.84	.000
+ID2 04:000401		1.07	.091	1.00	20.84	.000
SUM 02:000402		1.48	.126	1.00	20.84	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0011-----

*#
*# Catchment SA4 (Strittmatter A4, 0.41 hectares)
*#

DESIGN STANDHYD	Area (ha)=	Dir. Conn. (%)=
01:000304 DT=10.00	0.41	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.12	.29	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	52.28	40.00	
Mannings n =	.013	.250	
Max. eff. Inten. (mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.25 (ii)	11.97 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.02	.01	.035 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0012-----

*# Add hydrographs from Strittmatter A4 to Strittmatter Upstream Drainage

ADD HYD (000403)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000304		.41	.035	1.00	20.84	.000

```
+ID2 02:000402      1.48      .126      1.00  20.84      .000
=====
SUM 04:000403      1.89      .161      1.00  20.84      .000
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0013-----

```
*#
*# Catchment SA5 (Strittmatter A5, 22.4 hectares of upstream
*# agricultural drainage)
*#
```

```
| DESIGN NASHYD      | Area      (ha)=  22.40  Curve Number  (CN)=58.00
| 01:000305 DT=15.00 | Ia        (mm)=  1.500  # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)=      .750
```

Unit Hyd Qpeak (cms)= 1.141

```
PEAK FLOW          (cms)=  .313 (i)
TIME TO PEAK       (hrs)=  2.000
RUNOFF VOLUME      (mm)=  8.474
TOTAL RAINFALL     (mm)=  50.135
RUNOFF COEFFICIENT =  .169
```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0014-----

```
| ROUTE RESERVOIR   | Requested routing time step = 15.0 min.
| IN>01:(000305)   |
| OUT<02:(000101)  |
-----
===== OUTFLOW STORAGE TABLE =====
OUTFLOW  STORAGE | OUTFLOW  STORAGE
(cms)    (ha.m.) | (cms)    (ha.m.)
.000     .0000E+00 | .014     .8700E+00
.008     .1850E+00 | .016     .1270E+01
.012     .4800E+00 | 2.000    .1300E+01
```

```
ROUTING RESULTS          AREA      QPEAK      TPEAK      R.V.
-----
(ha)      (cms)      (hrs)      (mm)
INFLOW >01: (000305)    22.40     .313      2.000     8.474
OUTFLOW<02: (000101)    22.40     .008      4.500     8.464
OVERFLOW<08: (000150)    .00       .000      .000      .000
```

```
PEAK FLOW REDUCTION [Qout/Qin] (%)= 2.510
TIME SHIFT OF PEAK FLOW (min)= 150.00
MAXIMUM STORAGE USED (ha.m.)=.1818E+00
```

001:0015-----

```
| PRINT HYD        | AREA      (ha)=  22.400
| ID=02 (000101)  | QPEAK     (cms)=  .008 (i)
| DT=10.00 PCYC= 5 | TPEAK     (hrs)=  4.500
-----
VOLUME          (mm)=  8.464
```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

TIME	FLOW	TIME	FLOW	TIME	FLOW	TIME	FLOW	TIME	FLOW
hrs	cms	hrs	cms	hrs	cms	hrs	cms	hrs	cms
.00	.000	87.50	.002	175.00	.001	262.50	.000	350.00	.000
.83	.000	88.33	.002	175.83	.001	263.34	.000	350.83	.000

1.67	.002	89.17	.002	176.67	.001	264.17	.000	351.66	.000
2.50	.006	90.00	.002	177.50	.001	265.00	.000	352.50	.000
3.33	.007	90.83	.002	178.33	.001	265.84	.000	353.33	.000
4.17	.008	91.67	.002	179.17	.001	266.67	.000	354.16	.000
5.00	.008	92.50	.002	180.00	.001	267.50	.000	355.00	.000
5.83	.008	93.33	.002	180.83	.001	268.34	.000	355.83	.000
6.67	.008	94.17	.002	181.67	.001	269.17	.000	356.66	.000
7.50	.008	95.00	.002	182.50	.000	270.00	.000	357.50	.000
8.33	.007	95.83	.002	183.33	.000	270.84	.000	358.33	.000
9.17	.007	96.67	.002	184.17	.000	271.67	.000	359.16	.000
10.00	.007	97.50	.002	185.00	.000	272.50	.000	360.00	.000
10.83	.007	98.33	.002	185.83	.000	273.34	.000	360.83	.000
11.67	.007	99.17	.002	186.67	.000	274.17	.000	361.66	.000
12.50	.007	100.00	.002	187.50	.000	275.00	.000	362.50	.000
13.33	.007	100.83	.002	188.33	.000	275.84	.000	363.33	.000
14.17	.007	101.67	.002	189.17	.000	276.67	.000	364.16	.000
15.00	.007	102.50	.002	190.00	.000	277.50	.000	365.00	.000
15.83	.007	103.33	.002	190.83	.000	278.34	.000	365.83	.000
16.67	.007	104.17	.002	191.67	.000	279.17	.000	366.66	.000
17.50	.006	105.00	.002	192.50	.000	280.00	.000	367.50	.000
18.33	.006	105.83	.002	193.33	.000	280.83	.000	368.33	.000
19.17	.006	106.67	.002	194.17	.000	281.67	.000	369.16	.000
20.00	.006	107.50	.002	195.00	.000	282.50	.000	370.00	.000
20.83	.006	108.33	.002	195.83	.000	283.33	.000	370.83	.000
21.67	.006	109.17	.002	196.67	.000	284.17	.000	371.66	.000
22.50	.006	110.00	.002	197.50	.000	285.00	.000	372.50	.000
23.33	.006	110.83	.002	198.33	.000	285.83	.000	373.33	.000
24.17	.006	111.67	.001	199.17	.000	286.67	.000	374.16	.000
25.00	.006	112.50	.001	200.00	.000	287.50	.000	375.00	.000
25.83	.006	113.33	.001	200.83	.000	288.33	.000	375.83	.000
26.67	.006	114.17	.001	201.67	.000	289.17	.000	376.66	.000
27.50	.006	115.00	.001	202.50	.000	290.00	.000	377.50	.000
28.33	.005	115.83	.001	203.33	.000	290.83	.000	378.33	.000
29.17	.005	116.67	.001	204.17	.000	291.67	.000	379.16	.000
30.00	.005	117.50	.001	205.00	.000	292.50	.000	380.00	.000
30.83	.005	118.33	.001	205.83	.000	293.33	.000	380.83	.000
31.67	.005	119.17	.001	206.67	.000	294.17	.000	381.66	.000
32.50	.005	120.00	.001	207.50	.000	295.00	.000	382.50	.000
33.33	.005	120.83	.001	208.33	.000	295.83	.000	383.33	.000
34.17	.005	121.67	.001	209.17	.000	296.67	.000	384.16	.000
35.00	.005	122.50	.001	210.00	.000	297.50	.000	385.00	.000
35.83	.005	123.33	.001	210.84	.000	298.33	.000	385.83	.000
36.67	.005	124.17	.001	211.67	.000	299.17	.000	386.66	.000
37.50	.005	125.00	.001	212.50	.000	300.00	.000	387.50	.000
38.33	.005	125.83	.001	213.34	.000	300.83	.000	388.33	.000
39.17	.005	126.67	.001	214.17	.000	301.67	.000	389.16	.000
40.00	.005	127.50	.001	215.00	.000	302.50	.000	389.99	.000
40.83	.005	128.33	.001	215.84	.000	303.33	.000	390.83	.000
41.67	.004	129.17	.001	216.67	.000	304.17	.000	391.66	.000
42.50	.004	130.00	.001	217.50	.000	305.00	.000	392.49	.000
43.33	.004	130.83	.001	218.34	.000	305.83	.000	393.33	.000
44.17	.004	131.67	.001	219.17	.000	306.67	.000	394.16	.000
45.00	.004	132.50	.001	220.00	.000	307.50	.000	394.99	.000
45.83	.004	133.33	.001	220.84	.000	308.33	.000	395.83	.000
46.67	.004	134.17	.001	221.67	.000	309.17	.000	396.66	.000
47.50	.004	135.00	.001	222.50	.000	310.00	.000	397.49	.000
48.33	.004	135.83	.001	223.34	.000	310.83	.000	398.33	.000
49.17	.004	136.67	.001	224.17	.000	311.67	.000	399.16	.000
50.00	.004	137.50	.001	225.00	.000	312.50	.000	399.99	.000
50.83	.004	138.33	.001	225.84	.000	313.33	.000	400.83	.000
51.67	.004	139.17	.001	226.67	.000	314.17	.000	401.66	.000
52.50	.004	140.00	.001	227.50	.000	315.00	.000	402.49	.000

53.33	.004	140.83	.001	228.34	.000	315.83	.000	403.33	.000
54.17	.004	141.67	.001	229.17	.000	316.67	.000	404.16	.000
55.00	.004	142.50	.001	230.00	.000	317.50	.000	404.99	.000
55.83	.004	143.33	.001	230.84	.000	318.33	.000	405.83	.000
56.67	.004	144.17	.001	231.67	.000	319.17	.000	406.66	.000
57.50	.003	145.00	.001	232.50	.000	320.00	.000	407.49	.000
58.33	.003	145.83	.001	233.34	.000	320.83	.000	408.33	.000
59.17	.003	146.67	.001	234.17	.000	321.67	.000	409.16	.000
60.00	.003	147.50	.001	235.00	.000	322.50	.000	409.99	.000
60.83	.003	148.33	.001	235.84	.000	323.33	.000	410.83	.000
61.67	.003	149.17	.001	236.67	.000	324.17	.000	411.66	.000
62.50	.003	150.00	.001	237.50	.000	325.00	.000	412.49	.000
63.33	.003	150.83	.001	238.34	.000	325.83	.000	413.33	.000
64.17	.003	151.67	.001	239.17	.000	326.67	.000	414.16	.000
65.00	.003	152.50	.001	240.00	.000	327.50	.000	414.99	.000
65.83	.003	153.33	.001	240.84	.000	328.33	.000	415.83	.000
66.67	.003	154.17	.001	241.67	.000	329.17	.000	416.66	.000
67.50	.003	155.00	.001	242.50	.000	330.00	.000	417.49	.000
68.33	.003	155.83	.001	243.34	.000	330.83	.000	418.33	.000
69.17	.003	156.67	.001	244.17	.000	331.67	.000	419.16	.000
70.00	.003	157.50	.001	245.00	.000	332.50	.000	419.99	.000
70.83	.003	158.33	.001	245.84	.000	333.33	.000	420.83	.000
71.67	.003	159.17	.001	246.67	.000	334.17	.000	421.66	.000
72.50	.003	160.00	.001	247.50	.000	335.00	.000	422.49	.000
73.33	.003	160.83	.001	248.34	.000	335.83	.000	423.33	.000
74.17	.003	161.67	.001	249.17	.000	336.66	.000	424.16	.000
75.00	.003	162.50	.001	250.00	.000	337.50	.000	424.99	.000
75.83	.003	163.33	.001	250.84	.000	338.33	.000	425.83	.000
76.67	.003	164.17	.001	251.67	.000	339.16	.000	426.66	.000
77.50	.003	165.00	.001	252.50	.000	340.00	.000	427.49	.000
78.33	.003	165.83	.001	253.34	.000	340.83	.000	428.33	.000
79.17	.002	166.67	.001	254.17	.000	341.66	.000	429.16	.000
80.00	.002	167.50	.001	255.00	.000	342.50	.000	429.99	.000
80.83	.002	168.33	.001	255.84	.000	343.33	.000	430.83	.000
81.67	.002	169.17	.001	256.67	.000	344.16	.000	431.66	.000
82.50	.002	170.00	.001	257.50	.000	345.00	.000	432.49	.000
83.33	.002	170.83	.001	258.34	.000	345.83	.000	433.33	.000
84.17	.002	171.67	.001	259.17	.000	346.66	.000		
85.00	.002	172.50	.001	260.00	.000	347.50	.000		
85.83	.002	173.33	.001	260.84	.000	348.33	.000		
86.67	.002	174.17	.001	261.67	.000	349.16	.000		

001:0016-----

*#

*# Catchment SA6 (Strittmatter A6, 1.04 hectares)

*#

 | DESIGN STANDHYD | Area (ha)= 1.04
 | 05:000306 DT=10.00 | Total Imp(%)= 20.00 Dir. Conn.(%)= 10.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.21	.83
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	3.00	3.00
Length (m)=	83.27	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	98.93	25.21
over (min)	10.00	10.00
Storage Coeff. (min)=	1.65 (ii)	12.50 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	.17	.09

				TOTALS
PEAK FLOW	(cms)=	.03	.04	.063 (iii)
TIME TO PEAK	(hrs)=	1.00	1.17	1.000
RUNOFF VOLUME	(mm)=	49.34	13.55	17.126
TOTAL RAINFALL	(mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT	=	.98	.27	.342

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0017-----

*# Add hydrographs from Strittmatter A5 (McMurphy Property) to A6

ADD HYD (000420)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 05:000306	1.04	.063	1.00	17.13	.000
	+ID2 02:000101	22.40	.008	4.50	8.46	.000
	SUM 06:000420	23.44	.063	1.00	8.85	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0018-----

*# Add OVERFLOW hydrograph from McMurphy Pond

ADD HYD (000421)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 08:000150	.00	.000	.00	.00	.000 **DRY**
	+ID2 06:000420	23.44	.063	1.00	8.85	.000
	SUM 05:000421	23.44	.063	1.00	8.85	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0019-----

ADD HYD (000405)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 05:000421	23.44	.063	1.00	8.85	.000
	+ID2 04:000403	1.89	.161	1.00	20.84	.000
	SUM 01:000405	25.33	.224	1.00	9.74	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0020-----

*#
*# Catchment SA10 (Strittmatter A10, 0.36 hectares)
*# --- Area Increased May 2000
*#

DESIGN STANDHYD		Area	(ha)=	.36		
05:000310 DT=10.00		Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00	

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.11	.25	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	13.00	13.00	
Length (m)=	48.99	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.77 (ii)	7.68 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.02	.01	.034 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0021-----

*#
 *# Catchment SA11 (Strittmatter All, Pond Surface, 0.12 hecatares)
 *#

DESIGN STANDHYD	Area (ha)=	.35	
06:000311 DT=10.00	Total Imp(%)=	99.00	Dir. Conn.(%)= 99.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.35	.00	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	.10	.10	
Length (m)=	48.30	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	67.48	
over (min)	10.00	20.00	
Storage Coeff. (min)=	3.31 (ii)	23.60 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	.16	.05	
			TOTALS
PEAK FLOW (cms)=	.09	.00	.092 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	43.95	49.281
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.88	.983

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.

(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0022-----
 *# Add hydrograph from Strittmatter A10 and pond (A11) to hydrograph #405
 *#

ADD HYD (000409)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000405		25.33	.224	1.00	9.74	.000
+ID2 05:000310		.36	.034	1.00	20.84	.000
+ID3 06:000311		.35	.092	1.00	49.28	.000
=====						
SUM 02:000409		26.04	.350	1.00	10.43	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0023-----
 *#
 *# Add in Areas A1, A2 and A3 from the County Road
 *# and route total flow through proposed SWM area
 *#
 *#
 *# Catchment A1 from Triton Study (2.4 hectares, C= 0.5)
 *#

DESIGN STANDHYD	Area (ha)=	2.40		
01:000101 DT=10.00	Total Imp(%)=	40.00	Dir. Conn.(%)=	40.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.96	1.44	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	5.00	5.00	
Length (m)=	126.49	40.00	
Mannings n =	.013	.250	
Max.eff.Inten. (mm/hr)=	98.93	20.18	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.82 (ii)	11.99 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.26	.05	.312 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	27.145
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.541

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0024-----
 *#
 *# Catchment A2 from Triton Study (0.25 hectares, C= 0.5)
 *#

```

-----
| DESIGN STANDHYD | Area (ha)= .25
| 04:000102 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
    
```

```

                IMPERVIOUS    PERVIOUS (i)
Surface Area (ha)= .10 .15
Dep. Storage (mm)= .80 1.50
Average Slope (%)= 5.00 5.00
Length (m)= 40.82 40.00
Mannings n = .013 .250

Max.eff.Inten.(mm/hr)= 98.93 20.18
over (min) 10.00 10.00
Storage Coeff. (min)= .92 (ii) 11.10 (ii)
Unit Hyd. Tpeak (min)= 10.00 10.00
Unit Hyd. peak (cms)= .17 .10

                *TOTALS*
PEAK FLOW (cms)= .03 .01 .033 (iii)
TIME TO PEAK (hrs)= 1.00 1.17 1.000
RUNOFF VOLUME (mm)= 49.34 12.35 27.144
TOTAL RAINFALL (mm)= 50.14 50.14 50.135
RUNOFF COEFFICIENT = .98 .25 .541
    
```

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0025-----

*# Add hydrographs from Catchments A1 and A2

```

-----
| ADD HYD (000201) | ID: NHYD    AREA    QPEAK    TPEAK    R.V.    DWF
-----
                (ha)    (cms)    (hrs)    (mm)    (cms)
ID1 01:000101    2.40    .312    1.00    27.14    .000
+ID2 04:000102    .25    .033    1.00    27.14    .000
=====
SUM 05:000201    2.65    .344    1.00    27.14    .000
    
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0026-----

*#
 *# Catchment A3 from Triton Study (0.68 hectares, C= 0.5)
 *#

```

-----
| DESIGN STANDHYD | Area (ha)= .68
| 01:000103 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
    
```

```

                IMPERVIOUS    PERVIOUS (i)
Surface Area (ha)= .27 .41
Dep. Storage (mm)= .80 1.50
Average Slope (%)= 6.00 6.00
Length (m)= 67.33 40.00
Mannings n = .013 .250

Max.eff.Inten.(mm/hr)= 98.93 20.18
over (min) 10.00 10.00
    
```

Storage Coeff. (min)=	1.18 (ii)	10.81 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.07	.01	.089 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	27.145
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.541

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0027-----

*# Add hydrographs from Catchments A3 to hydrograph #201
*# representing total highway flow to be routed through SWM facility
*#

ADD HYD (000202)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 01:000103	.68	.089	1.00	27.14	.000
	+ID2 05:000201	2.65	.344	1.00	27.14	.000
	SUM 04:000202	3.33	.434	1.00	27.14	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0028-----

*#
*# Direct minor system flows to SWM Area, major system stays on County Road
*#

COMPUTE DUALHYD	Average inlet capacities [CINLET] =	.450 (cms)
TotalHyd 04:000202	Number of inlets in system [NINLET] =	1
	Total minor system capacity =	.450 (cms)
	Total major system storage [TMJSTO] =	0.(cu.m.)

	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
TOTAL HYD.	04:000202	3.33	.434	1.000	27.145	.000
MAJOR SYST	01:000412	.00	.000	.000	.000	.000
MINOR SYST	05:000413	3.33	.434	1.000	27.145	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0029-----

*# Add minor highway drainage (hyd #202) to Strittmatter drainage (hyd #409)

ADD HYD (000203)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 05:000413	3.33	.434	1.00	27.14	.000
	+ID2 02:000409	26.04	.350	1.00	10.43	.000

SUM 06:000203 29.37 .784 1.00 12.32 .000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0030

- *# Strittmatter SWM Area
- *# Original Rating Curve (February 1990) revised July 1999 - same storage
- *# Low flow orifice modified Feb. 22, 2000 (from 150mm to 225mm)
- *# Changed Rating Curve (April 2000) with pond redesign
- *#

| ROUTE RESERVOIR | Requested routing time step = 10.0 min.

| IN>06:(000203) |
| OUT<02:(000406) |

===== OUTFLOW STORAGE TABLE =====			
OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
.000	.0000E+00	.246	.7330E-01
.040	.2600E-02	.318	.8780E-01
.090	.4500E-02	.345	.1032E+00
.121	.1070E-01	.378	.1256E+00
.146	.2100E-01	.428	.1786E+00
.202	.4640E-01	.448	.1940E+00
.239	.6870E-01	.467	.2188E+00

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000203)	29.37	.784	1.000	12.323
OUTFLOW<02: (000406)	29.37	.233	1.500	12.323
OVERFLOW<05: (000408)	.00	.000	.000	.000

PEAK FLOW REDUCTION [Qout/Qin] (%) = 29.726
 TIME SHIFT OF PEAK FLOW (min) = 30.00
 MAXIMUM STORAGE USED (ha.m.) = .6597E-01

001:0031

| PRINT HYD | AREA (ha) = 29.370
 | ID=02 (000406) | QPEAK (cms) = .233 (i)
 | DT=10.00 PCYC= 5 | TPEAK (hrs) = 1.500
 |-----| VOLUME (mm) = 12.323

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

TIME hrs	FLOW cms	TIME hrs	FLOW cms	TIME hrs	FLOW cms	TIME hrs	FLOW cms	TIME hrs	FLOW cms
.00	.000	87.50	.002	175.00	.001	262.50	.000	350.00	.000
.83	.106	88.33	.002	175.83	.001	263.34	.000	350.83	.000
1.67	.228	89.17	.002	176.67	.001	264.17	.000	351.66	.000
2.50	.169	90.00	.002	177.50	.001	265.00	.000	352.50	.000
3.33	.088	90.83	.002	178.33	.001	265.84	.000	353.33	.000
4.17	.008	91.67	.002	179.17	.001	266.67	.000	354.16	.000
5.00	.008	92.50	.002	180.00	.001	267.50	.000	355.00	.000
5.83	.008	93.33	.002	180.83	.001	268.34	.000	355.83	.000
6.67	.008	94.17	.002	181.67	.001	269.17	.000	356.66	.000
7.50	.008	95.00	.002	182.50	.000	270.00	.000	357.50	.000
8.33	.007	95.83	.002	183.33	.000	270.84	.000	358.33	.000
9.17	.007	96.67	.002	184.17	.000	271.67	.000	359.16	.000
10.00	.007	97.50	.002	185.00	.000	272.50	.000	360.00	.000
10.83	.007	98.33	.002	185.83	.000	273.34	.000	360.83	.000
11.67	.007	99.17	.002	186.67	.000	274.17	.000	361.66	.000
12.50	.007	100.00	.002	187.50	.000	275.00	.000	362.50	.000

13.33	.007	100.83	.002	188.33	.000	275.84	.000	363.33	.000
14.17	.007	101.67	.002	189.17	.000	276.67	.000	364.16	.000
15.00	.007	102.50	.002	190.00	.000	277.50	.000	365.00	.000
15.83	.007	103.33	.002	190.83	.000	278.34	.000	365.83	.000
16.67	.007	104.17	.002	191.67	.000	279.17	.000	366.66	.000
17.50	.006	105.00	.002	192.50	.000	280.00	.000	367.50	.000
18.33	.006	105.83	.002	193.33	.000	280.83	.000	368.33	.000
19.17	.006	106.67	.002	194.17	.000	281.67	.000	369.16	.000
20.00	.006	107.50	.002	195.00	.000	282.50	.000	370.00	.000
20.83	.006	108.33	.002	195.83	.000	283.33	.000	370.83	.000
21.67	.006	109.17	.002	196.67	.000	284.17	.000	371.66	.000
22.50	.006	110.00	.002	197.50	.000	285.00	.000	372.50	.000
23.33	.006	110.83	.002	198.33	.000	285.83	.000	373.33	.000
24.17	.006	111.67	.001	199.17	.000	286.67	.000	374.16	.000
25.00	.006	112.50	.001	200.00	.000	287.50	.000	375.00	.000
25.83	.006	113.33	.001	200.83	.000	288.33	.000	375.83	.000
26.67	.006	114.17	.001	201.67	.000	289.17	.000	376.66	.000
27.50	.006	115.00	.001	202.50	.000	290.00	.000	377.50	.000
28.33	.005	115.83	.001	203.33	.000	290.83	.000	378.33	.000
29.17	.005	116.67	.001	204.17	.000	291.67	.000	379.16	.000
30.00	.005	117.50	.001	205.00	.000	292.50	.000	380.00	.000
30.83	.005	118.33	.001	205.83	.000	293.33	.000	380.83	.000
31.67	.005	119.17	.001	206.67	.000	294.17	.000	381.66	.000
32.50	.005	120.00	.001	207.50	.000	295.00	.000	382.50	.000
33.33	.005	120.83	.001	208.33	.000	295.83	.000	383.33	.000
34.17	.005	121.67	.001	209.17	.000	296.67	.000	384.16	.000
35.00	.005	122.50	.001	210.00	.000	297.50	.000	385.00	.000
35.83	.005	123.33	.001	210.84	.000	298.33	.000	385.83	.000
36.67	.005	124.17	.001	211.67	.000	299.17	.000	386.66	.000
37.50	.005	125.00	.001	212.50	.000	300.00	.000	387.50	.000
38.33	.005	125.83	.001	213.34	.000	300.83	.000	388.33	.000
39.17	.005	126.67	.001	214.17	.000	301.67	.000	389.16	.000
40.00	.005	127.50	.001	215.00	.000	302.50	.000	389.99	.000
40.83	.005	128.33	.001	215.84	.000	303.33	.000	390.83	.000
41.67	.004	129.17	.001	216.67	.000	304.17	.000	391.66	.000
42.50	.004	130.00	.001	217.50	.000	305.00	.000	392.49	.000
43.33	.004	130.83	.001	218.34	.000	305.83	.000	393.33	.000
44.17	.004	131.67	.001	219.17	.000	306.67	.000	394.16	.000
45.00	.004	132.50	.001	220.00	.000	307.50	.000	394.99	.000
45.83	.004	133.33	.001	220.84	.000	308.33	.000	395.83	.000
46.67	.004	134.17	.001	221.67	.000	309.17	.000	396.66	.000
47.50	.004	135.00	.001	222.50	.000	310.00	.000	397.49	.000
48.33	.004	135.83	.001	223.34	.000	310.83	.000	398.33	.000
49.17	.004	136.67	.001	224.17	.000	311.67	.000	399.16	.000
50.00	.004	137.50	.001	225.00	.000	312.50	.000	399.99	.000
50.83	.004	138.33	.001	225.84	.000	313.33	.000	400.83	.000
51.67	.004	139.17	.001	226.67	.000	314.17	.000	401.66	.000
52.50	.004	140.00	.001	227.50	.000	315.00	.000	402.49	.000
53.33	.004	140.83	.001	228.34	.000	315.83	.000	403.33	.000
54.17	.004	141.67	.001	229.17	.000	316.67	.000	404.16	.000
55.00	.004	142.50	.001	230.00	.000	317.50	.000	404.99	.000
55.83	.004	143.33	.001	230.84	.000	318.33	.000	405.83	.000
56.67	.004	144.17	.001	231.67	.000	319.17	.000	406.66	.000
57.50	.003	145.00	.001	232.50	.000	320.00	.000	407.49	.000
58.33	.003	145.83	.001	233.34	.000	320.83	.000	408.33	.000
59.17	.003	146.67	.001	234.17	.000	321.67	.000	409.16	.000
60.00	.003	147.50	.001	235.00	.000	322.50	.000	409.99	.000
60.83	.003	148.33	.001	235.84	.000	323.33	.000	410.83	.000
61.67	.003	149.17	.001	236.67	.000	324.17	.000	411.66	.000
62.50	.003	150.00	.001	237.50	.000	325.00	.000	412.49	.000
63.33	.003	150.83	.001	238.34	.000	325.83	.000	413.33	.000
64.17	.003	151.67	.001	239.17	.000	326.67	.000	414.16	.000

65.00	.003	152.50	.001	240.00	.000	327.50	.000	414.99	.000
65.83	.003	153.33	.001	240.84	.000	328.33	.000	415.83	.000
66.67	.003	154.17	.001	241.67	.000	329.17	.000	416.66	.000
67.50	.003	155.00	.001	242.50	.000	330.00	.000	417.49	.000
68.33	.003	155.83	.001	243.34	.000	330.83	.000	418.33	.000
69.17	.003	156.67	.001	244.17	.000	331.67	.000	419.16	.000
70.00	.003	157.50	.001	245.00	.000	332.50	.000	419.99	.000
70.83	.003	158.33	.001	245.84	.000	333.33	.000	420.83	.000
71.67	.003	159.17	.001	246.67	.000	334.17	.000	421.66	.000
72.50	.003	160.00	.001	247.50	.000	335.00	.000	422.49	.000
73.33	.003	160.83	.001	248.34	.000	335.83	.000	423.33	.000
74.17	.003	161.67	.001	249.17	.000	336.66	.000	424.16	.000
75.00	.003	162.50	.001	250.00	.000	337.50	.000	424.99	.000
75.83	.003	163.33	.001	250.84	.000	338.33	.000	425.83	.000
76.67	.003	164.17	.001	251.67	.000	339.16	.000	426.66	.000
77.50	.003	165.00	.001	252.50	.000	340.00	.000	427.49	.000
78.33	.003	165.83	.001	253.34	.000	340.83	.000	428.33	.000
79.17	.002	166.67	.001	254.17	.000	341.66	.000	429.16	.000
80.00	.002	167.50	.001	255.00	.000	342.50	.000	429.99	.000
80.83	.002	168.33	.001	255.84	.000	343.33	.000	430.83	.000
81.67	.002	169.17	.001	256.67	.000	344.16	.000	431.66	.000
82.50	.002	170.00	.001	257.50	.000	345.00	.000	432.49	.000
83.33	.002	170.83	.001	258.34	.000	345.83	.000	433.33	.000
84.17	.002	171.67	.001	259.17	.000	346.66	.000		
85.00	.002	172.50	.001	260.00	.000	347.50	.000		
85.83	.002	173.33	.001	260.84	.000	348.33	.000		
86.67	.002	174.17	.001	261.67	.000	349.16	.000		

001:0032-----

*#
 *# Catchment SA7 - Strittmatter road drainage d\s of SWM area - uncontrolled
 *# (Strittmatter A7, 0.32 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.32		
06:000307 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.10	.22
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	2.00	2.00
Length (m)=	46.19	40.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	98.93	25.97
over (min)	10.00	10.00
Storage Coeff. (min)=	1.31 (ii)	13.41 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	.17	.09

TOTALS
 PEAK FLOW (cms)= .02 .01 .027 (iii)
 TIME TO PEAK (hrs)= 1.00 1.17 1.000
 RUNOFF VOLUME (mm)= 49.34 13.71 20.836
 TOTAL RAINFALL (mm)= 50.14 50.14 50.135
 RUNOFF COEFFICIENT = .98 .27 .416

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.

(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0033-----

*#
 *# Catchment SA8 (Strittmatter A8, 0.46 hectares)
 *# NOT ROUTED INTO POND>>>> FLOWS UNCONTROLLED DOWN ROAD
 *# --- Area decreased May 2000
 *#

 | DESIGN STANDHYD | Area (ha)= .46
 | 05:000308 DT=10.00 | Total Imp(%)= 30.00 Dir. Conn.(%)= 20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.14	.32	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	55.38	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.46 (ii)	13.57 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.09	
			TOTALS
PEAK FLOW (cms)=	.03	.01	.038 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0034-----

*#
 *# Catchment SA9 - Strittmatter road drainage d/s of SWM area
 *# NOT ROUTED INTO POND>>>> FLOWS UNCONTROLLED DOWN ROAD
 *# (Strittmatter A9, 0.08 hectares, C= 0.95)
 *#

 | DESIGN STANDHYD | Area (ha)= .08
 | 09:000410 DT=10.00 | Total Imp(%)= 95.00 Dir. Conn.(%)= 95.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.08	.00	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	23.09	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	20.18	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.86 (ii)	14.25 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	

Unit Hyd. peak (cms)=	.17	.09	
			TOTALS
PEAK FLOW (cms)=	.02	.00	.021 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	47.486
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.947

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0035-----
*# Add hydrograph #307 to hyd #410 to SWM area discharge for outflow from
*# Strittmatter development (must be below diversion flow)

ADD HYD (000411)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 02:000406	29.37	.233	1.50	12.32	.000
	+ID2 06:000307	.32	.027	1.00	20.84	.000
	+ID3 05:000308	.46	.038	1.00	20.84	.000
	+ID4 09:000410	.08	.021	1.00	47.49	.000
	=====					
	SUM 04:000411	30.23	.269	1.17	12.64	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0036-----
*#
*# Add major system overflow from diversion to County Road drainage
*# below diversion (Areas A4 and A5)
*#

ADD HYD (000414)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 01:000412	.00	.000	.00	.00	.000 **DRY**
	+ID2 03:000204	.37	.049	1.00	27.14	.000
	=====					
	SUM 02:000414	.37	.049	1.00	27.14	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0037-----
*# Church Street Intersection
*#
*# Add hydrograph from Strittmatter Property (hyd #411)
*# to County Road 24 Drainage at Church Street
*#

ADD HYD (000205)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 02:000414	.37	.049	1.00	27.14	.000
	+ID2 04:000411	30.23	.269	1.17	12.64	.000
	=====					
	SUM 01:000205	30.60	.301	1.00	12.81	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0038-----

*# Catchment A6 from Triton Study (0.31 hectares, C= 0.6)
*#

| DESIGN STANDHYD | Area (ha)= .31
| 02:000106 DT=10.00 | Total Imp(%)= 50.00 Dir. Conn.(%)= 50.00

		IMPERVIOUS	PERVIOUS (i)	
Surface Area	(ha)=	.16	.16	
Dep. Storage	(mm)=	.80	1.50	
Average Slope	(%)=	4.00	4.00	
Length	(m)=	45.46	40.00	
Mannings n	=	.013	.250	
Max.eff.Inten. (mm/hr)=		98.93	20.18	
over (min)		10.00	10.00	
Storage Coeff. (min)=		1.05 (ii)	11.93 (ii)	
Unit Hyd. Tpeak (min)=		10.00	10.00	
Unit Hyd. peak (cms)=		.17	.10	
				TOTALS
PEAK FLOW (cms)=		.04	.01	.048 (iii)
TIME TO PEAK (hrs)=		1.00	1.17	1.000
RUNOFF VOLUME (mm)=		49.34	12.35	30.843
TOTAL RAINFALL (mm)=		50.14	50.14	50.135
RUNOFF COEFFICIENT =		.98	.25	.615

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0039-----

*# Add hydrograph from Catchments A6 to Upstream Hydrograph

ADD HYD (000206)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 01:000205	30.60	.301	1.00	12.81	.000
	+ID2 02:000106	.31	.048	1.00	30.84	.000
	=====	=====	=====	=====	=====	=====
	SUM 03:000206	30.91	.348	1.00	12.99	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0040-----

*#
*# Catchment A7 from Triton Study (0.24 hectares, C= 0.7)
*#

| DESIGN STANDHYD | Area (ha)= .24
| 01:000107 DT=10.00 | Total Imp(%)= 60.00 Dir. Conn.(%)= 60.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	.14	.10

Dep. Storage	(mm)=	.80	1.50
Average Slope	(%)=	2.00	2.00
Length	(m)=	40.00	40.00
Mannings n	=	.013	.250
Max.eff.Inten.(mm/hr)=		98.93	16.78
over (min)		10.00	20.00
Storage Coeff. (min)=		1.20 (ii)	15.62 (ii)
Unit Hyd. Tpeak (min)=		10.00	20.00
Unit Hyd. peak (cms)=		.17	.06

TOTALS

PEAK FLOW	(cms)=	.04	.00	.041 (iii)
TIME TO PEAK	(hrs)=	1.00	1.33	1.000
RUNOFF VOLUME	(mm)=	49.34	12.35	34.542
TOTAL RAINFALL	(mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT	=	.98	.25	.689

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0041-----

*#
*# Catchment A8 from Triton Study (0.30 hectares, C= 0.7)
*#

DESIGN STANDHYD		Area (ha)=	.30		
02:000108 DT=10.00		Total Imp(%)=	60.00	Dir. Conn.(%)=	60.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	.18	.12
Dep. Storage	(mm)=	.80	1.50
Average Slope	(%)=	4.00	4.00
Length	(m)=	44.72	40.00
Mannings n	=	.013	.250
Max.eff.Inten.(mm/hr)=		98.93	20.18
over (min)		10.00	10.00
Storage Coeff. (min)=		1.04 (ii)	11.92 (ii)
Unit Hyd. Tpeak (min)=		10.00	10.00
Unit Hyd. peak (cms)=		.17	.10

TOTALS

PEAK FLOW	(cms)=	.05	.00	.054 (iii)
TIME TO PEAK	(hrs)=	1.00	1.17	1.000
RUNOFF VOLUME	(mm)=	49.34	12.35	34.541
TOTAL RAINFALL	(mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT	=	.98	.25	.689

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0042-----

*# Add hydrographs from Catchments A7 and A8

ADD HYD (000207)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 02:000108		.30	.054	1.00	34.54	.000
+ID2 01:000107		.24	.041	1.00	34.54	.000
=====						
SUM 04:000207		.54	.094	1.00	34.54	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0043-----

*# Add summed hydrographs from Catchments A7+A8 to Upstream Hydrograph

ADD HYD (000208)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 03:000206		30.91	.348	1.00	12.99	.000
+ID2 04:000207		.54	.094	1.00	34.54	.000
=====						
SUM 01:000208		31.45	.443	1.00	13.36	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0044-----

*#
 *# Catchment A9 from Triton Study (0.32 hectares, C= 0.7)
 *#

DESIGN STANDHYD	Area (ha)=	DT=10.00	Total Imp(%)=	Dir. Conn.(%)=
02:000109	.32		60.00	60.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.19	.13	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	.20	.20	
Length (m)=	46.19	40.00	
Mannings n =	.013	.250	
Max.eff.Inten. (mm/hr)=	98.93	13.92	
over (min)	10.00	30.00	
Storage Coeff. (min)=	2.62 (ii)	33.60 (ii)	
Unit Hyd. Tpeak (min)=	10.00	30.00	
Unit Hyd. peak (cms)=	.17	.03	
			TOTALS
PEAK FLOW (cms)=	.05	.00	.053 (iii)
TIME TO PEAK (hrs)=	1.00	1.50	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	34.542
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.689

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0045-----

*# Add hydrograph from Catchments A9 to upstream drainage
 *#
 **# THIS IS THE FLOW AT MH 56 WHICH IS THE LIMITING CONSTRAINT....
 *# 5 year - 0.68 cms
 *# 100 year - 1.29 cms
 *#

ADD HYD (000209)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000208	31.45	.443	1.00	13.36	.000
+ID2	02:000109	.32	.053	1.00	34.54	.000
SUM	03:000209	31.77	.495	1.00	13.57	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0046-----

*#
 *# Catchment A10 from Triton Study (0.21 hectares, C= 0.7)
 *#

DESIGN STANDHYD	Area (ha)=	Total Imp(%)=	Dir. Conn.(%)=
04:000110 DT=10.00	.21	60.00	60.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.13	.08	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	1.00	1.00	
Length (m)=	37.42	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	16.78	
over (min)	10.00	20.00	
Storage Coeff. (min)=	1.42 (ii)	19.17 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	.17	.06	
			TOTALS
PEAK FLOW (cms)=	.03	.00	.036 (iii)
TIME TO PEAK (hrs)=	1.00	1.33	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	34.542
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.689

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0047-----

*# Add hydrograph from Catchment A10 to Upstream Hydrograph
 *# represents total catchment flow to Credit River

ADD HYD (000204)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	03:000209	31.77	.495	1.00	13.57	.000
+ID2	04:000110	.21	.036	1.00	34.54	.000

```

=====
SUM 01:000204      31.98      .531      1.00  13.71      .000

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
001:0048-----
FINISH
-----

```

```

*****
WARNINGS / ERRORS / NOTES
-----

```

- 0003 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0004 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0006 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0007 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0009 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0011 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0016 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0020 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0021 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0023 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0024 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0026 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0032 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0033 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0034 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0038 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0040 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!

Use a smaller DT or a larger area.
0041 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0044 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0046 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
Simulation ended on 2000-06-01 at 10:47:55

=====

```

SSSSS W W M M H H Y Y M M OOO 999 55555 =====
S W W W MM MM H H Y Y MM MM O O 9 9 5 =====
SSSSS W W W M M M H H H H Y M M M O O ## 9 9 5 Ver. 3.1
S W W M M H H Y M M O O 9999 5555 Oct. 1997
SSSSS W W M M H H Y M M OOO 9 5 =====
9 9 5 # 3877524
StormWater Management HYdrologic Model 999 5555 =====

```

```

*****
***** SWMHYMO-95w Ver/3.1 *****
***** A single event and continuous hydrologic simulation model *****
***** based on the principles of HYMO and its successors *****
***** OTTHYMO-83 and OTTHYMO-89. *****
***** Distributed by: J.F. Sabourin and Associates Inc. *****
***** Ottawa, Ontario: (613) 727-5199 *****
***** Gatineau, Quebec: (819) 243-6858 *****
***** E-Mail: swmhymo@jfsa.Com *****
*****

```

```

+++++++ Licensed user: R.J. Burnside & Associates Ltd. ++++++
+++++++ Brampton SERIAL#:3877524 ++++++
+++++++

```

```

*****
***** ++++++ PROGRAM ARRAY DIMENSIONS ++++++ *****
***** Maximum value for ID numbers : 10 *****
***** Max. number of rainfall points: 5000 *****
***** Max. number of flow points : 5000 *****
*****

```

```

***** D E T A I L E D O U T P U T *****
*****
* DATE: 2000-06-01 TIME: 10:48:22 RUN COUNTER: 001104 *
*****
* Input filename: I:\LORENA\S-405\CORREC~1\MAY00\STRIT100.DAT *
* Output filename: I:\LORENA\S-405\CORREC~1\MAY00\STRIT100.out *
* Summary filename: I:\LORENA\S-405\CORREC~1\MAY00\STRIT100.sum *
* User comments: *
* 1: _____ *
* 2: _____ *
* 3: _____ *
*****

```

```

-----
001:0001-----
*#*****
*# Project Name: [ Strittmatter Development, Hillsburgh] Project Number: [S-405
*# Date : 04-18-2000
*# Modeller : [LD]
*# Company : R. J. Burnside & Associates Ltd.
*# License # : 3877524
*#*****
*# Hydrologic analysis of County Road 24 stormsewer system combined with
*# Strittmatter Development at the north end of the village of Hillsburgh.
*#
*# McMurphy Berm added May '99
*#

```

```
*# 100 year storm event
*#
*# Data from County Rd. 24 Stormsewer Analysis (Triton) used
*# for Road Catchments. Strittmatter Development discharge
*# includes stormwater controls
*#
*# Made modifications to this file to route the road portion or upper canada SA
*# into the pond and let the external property SA8 flow uncontrolled. This fil
*# was run to obtain volume requirements for the pond to store & throttle the
*# 100 year flows of the Strittmatter Development. Lot 1 was made available
*# as pond area so SA10 decreased 0.32 ha and SA11 increased the same amount.
*#
*# File was further modified to let SA9 flow uncontrolled off site
*#
*# File was further modified to collect some of the drainage from SA8 at the
*# south end of Lot 1. SA8 area decreased to 0.46 ha and SA10 area increased
*# to 0.36 ha. Change in response to Triton comments May 19, 2000
*#
```

```
-----
| START | Project dir.: I:\LORENA\S-405\CORREC~1\MAY00\
----- Rainfall dir.: I:\LORENA\S-405\CORREC~1\MAY00\
TZERO = .00 hrs on 0
METOUT= 2 (output = METRIC)
NRUN = 001
NSTORM= 0
-----
```

```
001:0002-----
*READ STORM STORM_FILENAME=["c:\S-405\swmhymo\hazel.stm"]
-----
```

```
| CHICAGO STORM | IDF curve parameters: A=3113.230
| Ptotal= 98.95 mm | B= 21.416
C= .857
used in: INTENSITY = A / (t + B)^C
Duration of storm = 3.00 hrs
Storm time step = 10.00 min
Time to peak ratio = .33
```

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.17	9.785	1.00	162.238	1.83	20.114	2.67	9.361
.33	12.748	1.17	85.475	2.00	16.483	2.83	8.425
.50	18.030	1.33	50.208	2.17	13.904	3.00	7.655
.67	29.523	1.50	34.281	2.33	11.990		
.83	67.430	1.67	25.529	2.50	10.521		

```
001:0003-----
*#
*# Catchment A4 from Triton Study (0.09 hectares, C= 0.5)
*#
```

```
-----
| DESIGN STANDHYD | Area (ha)= .09
| 01:000104 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
```

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	.04	.05
Dep. Storage	(mm)=	.80	1.50
Average Slope	(%)=	6.00	6.00
Length	(m)=	24.49	40.00
Mannings n	=	.013	.250

Max.eff.Inten. (mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.53 (ii)	6.89 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.13	
			TOTALS
PEAK FLOW (cms)=	.02	.01	.023 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	39.52	62.969
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.636

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0004-----

*#
*# Catchment A5 from Triton Study (0.28 hectares, C= 0.5)
*#

DESIGN STANDHYD	Area (ha)=	.28		
02:000105 DT=10.00	Total Imp(%)=	40.00	Dir. Conn.(%)=	40.00

		IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=		.11	.17	
Dep. Storage (mm)=		.80	1.50	
Average Slope (%)=		6.00	6.00	
Length (m)=		43.20	40.00	
Mannings n =		.013	.250	
Max.eff.Inten. (mm/hr)=	162.24	56.88		
over (min)	10.00	10.00		
Storage Coeff. (min)=	.74 (ii)	7.10 (ii)		
Unit Hyd. Tpeak (min)=	10.00	10.00		
Unit Hyd. peak (cms)=	.17	.13		
				TOTALS
PEAK FLOW (cms)=	.05	.02		.072 (iii)
TIME TO PEAK (hrs)=	1.00	1.00		1.000
RUNOFF VOLUME (mm)=	98.15	39.52		62.969
TOTAL RAINFALL (mm)=	98.95	98.95		98.950
RUNOFF COEFFICIENT =	.99	.40		.636

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0005-----

*# Add summed hydrographs from Catchments A5 to A4

ADD HYD (000204) ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
	(ha)	(cms)	(hrs)	(mm)	(cms)

ID1 01:000104	.09	.023	1.00	62.97	.000
+ID2 02:000105	.28	.072	1.00	62.97	.000
=====					
SUM 03:000204	.37	.095	1.00	62.97	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0006-----

*#
 *# Proposed Strittmatter Development
 *#
 *# Catchment SA1 (Strittmatter A1, 0.54 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.54		
01:000301 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.38	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	60.00	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.11 (ii)	8.26 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.05	.06	.105 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0007-----

*#
 *# Catchment SA2 (Strittmatter A2, 0.53 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.53		
02:000302 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.37	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	59.44	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	

over (min)	10.00	10.00	
Storage Coeff. (min)=	1.11 (ii)	8.25 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.05	.06	.103 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0008-----

*# Add hydrographs from Strittmatter A1 and A2

ADD HYD (000401)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
-----		(ha)	(cms)	(hrs)	(mm)	(cms)
ID1 01:000301		.54	.105	1.00	53.88	.000
+ID2 02:000302		.53	.103	1.00	53.88	.000
=====						
SUM 04:000401		1.07	.209	1.00	53.88	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0009-----

*#
*# Catchment SA3 (Strittmatter A3, 0.41 hectares)
*#

DESIGN STANDHYD	Area (ha)=	.41		
01:000303 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.12	.29	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	52.28	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.03 (ii)	8.17 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.04	.04	.080 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0010-----

*# Add hydrographs from Strittmatter A3 to Strittmatter (A1+A2)

ADD HYD (000402)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000303	.41	.080	1.00	53.88	.000
+ID2	04:000401	1.07	.209	1.00	53.88	.000
SUM	02:000402	1.48	.289	1.00	53.88	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0011-----

*#
*# Catchment SA4 (Strittmatter A4, 0.41 hectares)
*#

DESIGN STANDHYD	Area (ha)=	Total Imp(%)=	Dir. Conn.(%)=
01:000304 DT=10.00	.41	30.00	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.12	.29	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	52.28	40.00	
Mannings n =	.013	.250	
Max.eff.Inten. (mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.03 (ii)	8.17 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.04	.04	.080 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0012-----

*# Add hydrographs from Strittmatter A4 to Strittmatter Upstream Drainage

ADD HYD (000403)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000304	.41	.080	1.00	53.88	.000

+ID2 02:000402	1.48	.289	1.00	53.88	.000
=====					
SUM 04:000403	1.89	.369	1.00	53.88	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0013-----

*#
*# Catchment SA5 (Strittmatter A5, 22.4 hectares of upstream
*# agricultural drainage)
*#

| DESIGN NASHYD | Area (ha)= 22.40 Curve Number (CN)=58.00
| 01:000305 DT=15.00 | Ia (mm)= 1.500 # of Linear Res.(N)= 3.00

U.H. Tp(hrs)= .750

Unit Hyd Qpeak (cms)= 1.141

PEAK FLOW (cms)= 1.028 (i)
TIME TO PEAK (hrs)= 2.000
RUNOFF VOLUME (mm)= 28.013
TOTAL RAINFALL (mm)= 98.950
RUNOFF COEFFICIENT = .283

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0014-----

| ROUTE RESERVOIR | Requested routing time step = 15.0 min.
| IN>01:(000305) |
OUT<02:(000101)
===== OUTFLOW STORAGE TABLE =====
OUTFLOW STORAGE | OUTFLOW STORAGE
(cms) (ha.m.) | (cms) (ha.m.)
.000 .0000E+00 | .014 .8700E+00
.008 .1850E+00 | .016 .1270E+01
.012 .4800E+00 | 2.000 .1300E+01

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >01: (000305)	22.40	1.028	2.000	28.013
OUTFLOW<02: (000101)	22.40	.013	4.833	28.003
OVERFLOW<08: (000150)	.00	.000	.000	.000

PEAK FLOW REDUCTION [Qout/Qin] (%)= 1.233
TIME SHIFT OF PEAK FLOW (min)= 170.00
MAXIMUM STORAGE USED (ha.m.)=.6114E+00

001:0015-----

| PRINT HYD | AREA (ha)= 22.400
| ID=02 (000101) | QPEAK (cms)= .013 (i)
| DT=10.00 PCYC= 5 | TPEAK (hrs)= 4.833

VOLUME (mm)= 28.003

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

TIME	FLOW	TIME	FLOW	TIME	FLOW	TIME	FLOW	TIME	FLOW
hrs	cms	hrs	cms	hrs	cms	hrs	cms	hrs	cms
.00	.000	110.00	.008	220.00	.002	330.00	.000	439.99	.000
.83	.000	110.83	.008	220.84	.002	330.83	.000	440.83	.000

1.67	.006	111.67	.008	221.67	.002	331.67	.000	441.66	.000
2.50	.011	112.50	.008	222.50	.002	332.50	.000	442.49	.000
3.33	.012	113.33	.008	223.34	.002	333.33	.000	443.33	.000
4.17	.013	114.17	.008	224.17	.002	334.17	.000	444.16	.000
5.00	.013	115.00	.008	225.00	.002	335.00	.000	444.99	.000
5.83	.013	115.83	.008	225.84	.001	335.83	.000	445.82	.000
6.67	.013	116.67	.008	226.67	.001	336.66	.000	446.66	.000
7.50	.013	117.50	.008	227.50	.001	337.50	.000	447.49	.000
8.33	.013	118.33	.008	228.34	.001	338.33	.000	448.32	.000
9.17	.013	119.17	.008	229.17	.001	339.16	.000	449.16	.000
10.00	.013	120.00	.008	230.00	.001	340.00	.000	449.99	.000
10.83	.013	120.83	.008	230.84	.001	340.83	.000	450.82	.000
11.67	.013	121.67	.008	231.67	.001	341.66	.000	451.66	.000
12.50	.013	122.50	.007	232.50	.001	342.50	.000	452.49	.000
13.33	.012	123.33	.007	233.34	.001	343.33	.000	453.32	.000
14.17	.012	124.17	.007	234.17	.001	344.16	.000	454.16	.000
15.00	.012	125.00	.007	235.00	.001	345.00	.000	454.99	.000
15.83	.012	125.83	.007	235.84	.001	345.83	.000	455.82	.000
16.67	.012	126.67	.007	236.67	.001	346.66	.000	456.66	.000
17.50	.012	127.50	.007	237.50	.001	347.50	.000	457.49	.000
18.33	.012	128.33	.007	238.34	.001	348.33	.000	458.32	.000
19.17	.012	129.17	.007	239.17	.001	349.16	.000	459.16	.000
20.00	.012	130.00	.007	240.00	.001	350.00	.000	459.99	.000
20.83	.012	130.83	.007	240.84	.001	350.83	.000	460.82	.000
21.67	.012	131.67	.006	241.67	.001	351.66	.000	461.66	.000
22.50	.012	132.50	.006	242.50	.001	352.50	.000	462.49	.000
23.33	.012	133.33	.006	243.34	.001	353.33	.000	463.32	.000
24.17	.012	134.17	.006	244.17	.001	354.16	.000	464.16	.000
25.00	.012	135.00	.006	245.00	.001	355.00	.000	464.99	.000
25.83	.012	135.83	.006	245.84	.001	355.83	.000	465.82	.000
26.67	.012	136.67	.006	246.67	.001	356.66	.000	466.66	.000
27.50	.012	137.50	.006	247.50	.001	357.50	.000	467.49	.000
28.33	.012	138.33	.006	248.34	.001	358.33	.000	468.32	.000
29.17	.012	139.17	.006	249.17	.001	359.16	.000	469.16	.000
30.00	.012	140.00	.006	250.00	.001	360.00	.000	469.99	.000
30.83	.012	140.83	.006	250.84	.001	360.83	.000	470.82	.000
31.67	.012	141.67	.006	251.67	.001	361.66	.000	471.66	.000
32.50	.012	142.50	.005	252.50	.001	362.50	.000	472.49	.000
33.33	.012	143.33	.005	253.34	.001	363.33	.000	473.32	.000
34.17	.012	144.17	.005	254.17	.001	364.16	.000	474.16	.000
35.00	.012	145.00	.005	255.00	.001	365.00	.000	474.99	.000
35.83	.012	145.83	.005	255.84	.001	365.83	.000	475.82	.000
36.67	.012	146.67	.005	256.67	.001	366.66	.000	476.66	.000
37.50	.012	147.50	.005	257.50	.001	367.50	.000	477.49	.000
38.33	.012	148.33	.005	258.34	.001	368.33	.000	478.32	.000
39.17	.012	149.17	.005	259.17	.001	369.16	.000	479.16	.000
40.00	.012	150.00	.005	260.00	.001	370.00	.000	479.99	.000
40.83	.012	150.83	.005	260.84	.001	370.83	.000	480.82	.000
41.67	.012	151.67	.005	261.67	.001	371.66	.000	481.66	.000
42.50	.012	152.50	.005	262.50	.001	372.50	.000	482.49	.000
43.33	.012	153.33	.005	263.34	.001	373.33	.000	483.32	.000
44.17	.011	154.17	.005	264.17	.001	374.16	.000	484.16	.000
45.00	.011	155.00	.004	265.00	.001	375.00	.000	484.99	.000
45.83	.011	155.83	.004	265.84	.001	375.83	.000	485.82	.000
46.67	.011	156.67	.004	266.67	.001	376.66	.000	486.66	.000
47.50	.011	157.50	.004	267.50	.001	377.50	.000	487.49	.000
48.33	.011	158.33	.004	268.34	.001	378.33	.000	488.32	.000
49.17	.011	159.17	.004	269.17	.001	379.16	.000	489.16	.000
50.00	.011	160.00	.004	270.00	.001	380.00	.000	489.99	.000
50.83	.011	160.83	.004	270.84	.001	380.83	.000	490.82	.000
51.67	.011	161.67	.004	271.67	.001	381.66	.000	491.66	.000
52.50	.011	162.50	.004	272.50	.001	382.50	.000	492.49	.000

53.33	.011	163.33	.004	273.34	.001	383.33	.000	493.32	.000
54.17	.011	164.17	.004	274.17	.001	384.16	.000	494.16	.000
55.00	.011	165.00	.004	275.00	.001	385.00	.000	494.99	.000
55.83	.011	165.83	.004	275.84	.001	385.83	.000	495.82	.000
56.67	.011	166.67	.004	276.67	.001	386.66	.000	496.66	.000
57.50	.011	167.50	.004	277.50	.001	387.50	.000	497.49	.000
58.33	.011	168.33	.004	278.34	.001	388.33	.000	498.32	.000
59.17	.011	169.17	.004	279.17	.001	389.16	.000	499.15	.000
60.00	.011	170.00	.004	280.00	.001	389.99	.000	499.99	.000
60.83	.011	170.83	.004	280.83	.001	390.83	.000	500.82	.000
61.67	.011	171.67	.003	281.67	.001	391.66	.000	501.65	.000
62.50	.010	172.50	.003	282.50	.001	392.49	.000	502.49	.000
63.33	.010	173.33	.003	283.33	.001	393.33	.000	503.32	.000
64.17	.010	174.17	.003	284.17	.001	394.16	.000	504.15	.000
65.00	.010	175.00	.003	285.00	.001	394.99	.000	504.99	.000
65.83	.010	175.83	.003	285.83	.001	395.83	.000	505.82	.000
66.67	.010	176.67	.003	286.67	.001	396.66	.000	506.65	.000
67.50	.010	177.50	.003	287.50	.001	397.49	.000	507.49	.000
68.33	.010	178.33	.003	288.33	.001	398.33	.000	508.32	.000
69.17	.010	179.17	.003	289.17	.001	399.16	.000	509.15	.000
70.00	.010	180.00	.003	290.00	.001	399.99	.000	509.99	.000
70.83	.010	180.83	.003	290.83	.001	400.83	.000	510.82	.000
71.67	.010	181.67	.003	291.67	.001	401.66	.000	511.65	.000
72.50	.010	182.50	.003	292.50	.001	402.49	.000	512.49	.000
73.33	.010	183.33	.003	293.33	.001	403.33	.000	513.32	.000
74.17	.010	184.17	.003	294.17	.001	404.16	.000	514.15	.000
75.00	.010	185.00	.003	295.00	.001	404.99	.000	514.99	.000
75.83	.010	185.83	.003	295.83	.001	405.83	.000	515.82	.000
76.67	.010	186.67	.003	296.67	.000	406.66	.000	516.65	.000
77.50	.010	187.50	.003	297.50	.000	407.49	.000	517.49	.000
78.33	.010	188.33	.003	298.33	.000	408.33	.000	518.32	.000
79.17	.010	189.17	.003	299.17	.000	409.16	.000	519.16	.000
80.00	.010	190.00	.003	300.00	.000	409.99	.000	519.99	.000
80.83	.010	190.83	.003	300.83	.000	410.83	.000	520.82	.000
81.67	.010	191.67	.003	301.67	.000	411.66	.000	521.66	.000
82.50	.010	192.50	.003	302.50	.000	412.49	.000	522.49	.000
83.33	.009	193.33	.002	303.33	.000	413.33	.000	523.32	.000
84.17	.009	194.17	.002	304.17	.000	414.16	.000	524.16	.000
85.00	.009	195.00	.002	305.00	.000	414.99	.000	524.99	.000
85.83	.009	195.83	.002	305.83	.000	415.83	.000	525.82	.000
86.67	.009	196.67	.002	306.67	.000	416.66	.000	526.66	.000
87.50	.009	197.50	.002	307.50	.000	417.49	.000	527.49	.000
88.33	.009	198.33	.002	308.33	.000	418.33	.000	528.32	.000
89.17	.009	199.17	.002	309.17	.000	419.16	.000	529.16	.000
90.00	.009	200.00	.002	310.00	.000	419.99	.000	529.99	.000
90.83	.009	200.83	.002	310.83	.000	420.83	.000	530.82	.000
91.67	.009	201.67	.002	311.67	.000	421.66	.000	531.66	.000
92.50	.009	202.50	.002	312.50	.000	422.49	.000	532.49	.000
93.33	.009	203.33	.002	313.33	.000	423.33	.000	533.32	.000
94.17	.009	204.17	.002	314.17	.000	424.16	.000	534.16	.000
95.00	.009	205.00	.002	315.00	.000	424.99	.000	534.99	.000
95.83	.009	205.83	.002	315.83	.000	425.83	.000	535.82	.000
96.67	.009	206.67	.002	316.67	.000	426.66	.000	536.66	.000
97.50	.009	207.50	.002	317.50	.000	427.49	.000	537.49	.000
98.33	.009	208.33	.002	318.33	.000	428.33	.000	538.32	.000
99.17	.009	209.17	.002	319.17	.000	429.16	.000	539.16	.000
100.00	.009	210.00	.002	320.00	.000	429.99	.000	539.99	.000
100.83	.009	210.84	.002	320.83	.000	430.83	.000	540.82	.000
101.67	.009	211.67	.002	321.67	.000	431.66	.000	541.66	.000
102.50	.009	212.50	.002	322.50	.000	432.49	.000	542.49	.000
103.33	.009	213.34	.002	323.33	.000	433.33	.000	543.32	.000
104.17	.009	214.17	.002	324.17	.000	434.16	.000	544.16	.000

105.00	.009	215.00	.002	325.00	.000	434.99	.000	544.99	.000
105.83	.008	215.84	.002	325.83	.000	435.83	.000	545.82	.000
106.67	.008	216.67	.002	326.67	.000	436.66	.000	546.66	.000
107.50	.008	217.50	.002	327.50	.000	437.49	.000		
108.33	.008	218.34	.002	328.33	.000	438.33	.000		
109.17	.008	219.17	.002	329.17	.000	439.16	.000		

001:0016-----

*#
 *# Catchment SA6 (Strittmatter A6, 1.04 hectares)
 *#

| DESIGN STANDHYD | Area (ha)= 1.04
 | 05:000306 DT=10.00 | Total Imp(%)= 20.00 Dir. Conn.(%)= 10.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.21	.83
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	3.00	3.00
Length (m)=	83.27	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	162.24	69.71
over (min)	10.00	10.00
Storage Coeff. (min)=	1.36 (ii)	8.58 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	.17	.12

TOTALS

PEAK FLOW (cms)=	.05	.12	.166 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.42	47.996
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.485

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0017-----

*# Add hydrographs from Strittmatter A5 (McMurphy Property) to A6

ADD HYD (ID)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 05:000306		1.04	.166	1.00	48.00	.000
+ID2 02:000101		22.40	.013	4.83	28.00	.000
SUM 06:000420		23.44	.167	1.00	28.89	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0018-----

*# Add OVERFLOW hydrograph from McMurphy Pond

ADD HYD (ID)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 08:000150		.00	.000	.00	.00	.000 **DRY**

+ID2 06:000420	23.44	.167	1.00	28.89	.000
=====					
SUM 05:000421	23.44	.167	1.00	28.89	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0019-----

ADD HYD (000405)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 05:000421	23.44	.167	1.00	28.89	.000
	+ID2 04:000403	1.89	.369	1.00	53.88	.000
=====						
	SUM 01:000405	25.33	.536	1.00	30.75	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0020-----

*#
*# Catchment SA10 (Strittmatter A10, 0.36 hectares)
*# --- Area Increased May 2000
*#

DESIGN STANDHYD	Area (ha)=	.36			
05:000310 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00	

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.11	.25	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	13.00	13.00	
Length (m)=	48.99	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.64 (ii)	5.24 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.14	
			TOTALS
PEAK FLOW (cms)=	.03	.04	.077 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0021-----

*#
*# Catchment SA11 (Strittmatter A11, Pond Surface, 0.12 hecatares)
*#

DESIGN STANDHYD	Area (ha)=	.35
-----------------	------------	-----

| 06:000311 DT=10.00 | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.35	.00	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	.10	.10	
Length (m)=	48.30	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	122.01	
over (min)	10.00	20.00	
Storage Coeff. (min)=	2.71 (ii)	18.73 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	.17	.06	
			TOTALS
PEAK FLOW (cms)=	.15	.00	.154 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	98.15	92.53	98.094
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.94	.991

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0022-----

*# Add hydrograph from Strittmatter A10 and pond (A11) to hydrograph #405
*#

ADD HYD (000409)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 01:000405	25.33	.536	1.00	30.75	.000
	+ID2 05:000310	.36	.077	1.00	53.88	.000
	+ID3 06:000311	.35	.154	1.00	98.09	.000
	SUM 02:000409	26.04	.767	1.00	31.98	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0023-----

*#
*# Add in Areas A1, A2 and A3 from the County Road
*# and route total flow through proposed SWM area
*#
*#
*# Catchment A1 from Triton Study (2.4 hectares, C= 0.5)
*#

| DESIGN STANDHYD | Area (ha)= 2.40
| 01:000101 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.96	1.44
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	5.00	5.00
Length (m)=	126.49	40.00

Mannings n	=	.013	.250	
Max.eff.Inten. (mm/hr)=		162.24	56.88	
over (min)		10.00	10.00	
Storage Coeff. (min)=		1.50 (ii)	8.21 (ii)	
Unit Hyd. Tpeak (min)=		10.00	10.00	
Unit Hyd. peak (cms)=		.17	.12	
				TOTALS
PEAK FLOW (cms)=		.43	.17	.604 (iii)
TIME TO PEAK (hrs)=		1.00	1.00	1.000
RUNOFF VOLUME (mm)=		98.15	39.52	62.969
TOTAL RAINFALL (mm)=		98.95	98.95	98.950
RUNOFF COEFFICIENT =		.99	.40	.636

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0024-----

*#
*# Catchment A2 from Triton Study (0.25 hectares, C= 0.5)
*#

DESIGN STANDHYD		Area (ha)=	.25		
04:000102 DT=10.00		Total Imp(%)=	40.00	Dir. Conn.(%)=	40.00

		IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=		.10	.15	
Dep. Storage (mm)=		.80	1.50	
Average Slope (%)=		5.00	5.00	
Length (m)=		40.82	40.00	
Mannings n	=	.013	.250	
Max.eff.Inten. (mm/hr)=		162.24	56.88	
over (min)		10.00	10.00	
Storage Coeff. (min)=		.76 (ii)	7.48 (ii)	
Unit Hyd. Tpeak (min)=		10.00	10.00	
Unit Hyd. peak (cms)=		.17	.13	
				TOTALS
PEAK FLOW (cms)=		.05	.02	.064 (iii)
TIME TO PEAK (hrs)=		1.00	1.00	1.000
RUNOFF VOLUME (mm)=		98.15	39.52	62.969
TOTAL RAINFALL (mm)=		98.95	98.95	98.950
RUNOFF COEFFICIENT =		.99	.40	.636

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0025-----

*# Add hydrographs from Catchments A1 and A2

ADD HYD (000201)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000101		2.40	.604	1.00	62.97	.000
+ID2 04:000102		.25	.064	1.00	62.97	.000
=====						
SUM 05:000201		2.65	.668	1.00	62.97	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0026-----

*#
 *# Catchment A3 from Triton Study (0.68 hectares, C= 0.5)
 *#

DESIGN STANDHYD	Area (ha)=	Dir. Conn.(%)=
01:000103 DT=10.00	Total Imp(%)= 40.00	40.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.27	.41	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	6.00	6.00	
Length (m)=	67.33	40.00	
Mannings n =	.013	.250	
Max.eff.Inten. (mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.97 (ii)	7.33 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.13	
			TOTALS
PEAK FLOW (cms)=	.12	.05	.173 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	39.52	62.969
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.636

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0027-----

*# Add hydrographs from Catchments A3 to hydrograph #201
 *# representing total highway flow to be routed through SWM facility
 *#

ADD HYD (000202)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000103		.68	.173	1.00	62.97	.000
+ID2 05:000201		2.65	.668	1.00	62.97	.000
=====						
SUM 04:000202		3.33	.841	1.00	62.97	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0028-----

*#
 *# Direct minor system flows to SWM Area, major system stays on County Road
 *#

```

-----
| COMPUTE DUALHYD | Average inlet capacities [CINLET] = .450 (cms)
| TotalHyd 04:000202 | Number of inlets in system [NINLET] = 1
-----
Total minor system capacity = .450 (cms)
Total major system storage [TMJSTO] = 0.(cu.m.)
    
```

	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
TOTAL HYD.	04:000202	3.33	.841	1.000	62.969	.000
MAJOR SYST	01:000412	.47	.391	1.000	62.969	.000
MINOR SYST	05:000413	2.86	.450	1.000	62.969	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0029-----
 *# Add minor highway drainage (hyd #202) to Strittmatter drainage (hyd #409)

```

-----
| ADD HYD (000203) | ID: NHYD      AREA      QPEAK    TPEAK    R.V.     DWF
-----
                    (ha)      (cms)    (hrs)    (mm)    (cms)
ID1 05:000413      2.86      .450     1.00    62.97    .000
+ID2 02:000409     26.04     .767     1.00    31.98    .000
-----
SUM 06:000203     28.90     1.217    1.00    35.05    .000
    
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0030-----
 *# Strittmatter SWM Area
 *# Original Rating Curve (February 1990) revised July 1999 - same storage
 *# Low flow orifice modified Feb. 22, 2000 (from 150mm to 225mm)
 *# Changed Rating Curve (April 2000) with pond redesign
 *#

```

-----
| ROUTE RESERVOIR | Requested routing time step = 10.0 min.
| IN>06:(000203) |
| OUT<02:(000406) |
-----
                    ===== OUTFLOW STORAGE TABLE =====
                    OUTFLOW STORAGE | OUTFLOW STORAGE
                    (cms) (ha.m.) | (cms) (ha.m.)
                    .000 .0000E+00 | .246 .7330E-01
                    .040 .2600E-02 | .318 .8780E-01
                    .090 .4500E-02 | .345 .1032E+00
                    .121 .1070E-01 | .378 .1256E+00
                    .146 .2100E-01 | .428 .1786E+00
                    .202 .4640E-01 | .448 .1940E+00
                    .239 .6870E-01 | .467 .2188E+00
    
```

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000203)	28.90	1.217	1.000	35.050
OUTFLOW<02: (000406)	28.90	.412	1.667	35.050
OVERFLOW<05: (000408)	.00	.000	.000	.000

PEAK FLOW REDUCTION [Qout/Qin] (%) = 33.864
 TIME SHIFT OF PEAK FLOW (min) = 40.00
 MAXIMUM STORAGE USED (ha.m.) = .1620E+00

001:0031

```

-----
| PRINT HYD          | AREA      (ha) = 28.904
| ID=02 (000406)    | QPEAK     (cms) = .412 (i)
| DT=10.00 PCYC= 5 | TPEAK     (hrs) = 1.667
-----
|                   | VOLUME    (mm) = 35.050

```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

TIME	FLOW	TIME	FLOW	TIME	FLOW	TIME	FLOW	TIME	FLOW
hrs	cms	hrs	cms	hrs	cms	hrs	cms	hrs	cms
.00	.000	110.00	.008	220.00	.002	330.00	.000	439.99	.000
.83	.153	110.83	.008	220.84	.002	330.83	.000	440.83	.000
1.67	.412	111.67	.008	221.67	.002	331.67	.000	441.66	.000
2.50	.370	112.50	.008	222.50	.002	332.50	.000	442.49	.000
3.33	.226	113.33	.008	223.34	.002	333.33	.000	443.33	.000
4.17	.126	114.17	.008	224.17	.002	334.17	.000	444.16	.000
5.00	.014	115.00	.008	225.00	.002	335.00	.000	444.99	.000
5.83	.013	115.83	.008	225.84	.001	335.83	.000	445.82	.000
6.67	.013	116.67	.008	226.67	.001	336.66	.000	446.66	.000
7.50	.013	117.50	.008	227.50	.001	337.50	.000	447.49	.000
8.33	.013	118.33	.008	228.34	.001	338.33	.000	448.32	.000
9.17	.013	119.17	.008	229.17	.001	339.16	.000	449.16	.000
10.00	.013	120.00	.008	230.00	.001	340.00	.000	449.99	.000
10.83	.013	120.83	.008	230.84	.001	340.83	.000	450.82	.000
11.67	.013	121.67	.008	231.67	.001	341.66	.000	451.66	.000
12.50	.013	122.50	.007	232.50	.001	342.50	.000	452.49	.000
13.33	.012	123.33	.007	233.34	.001	343.33	.000	453.32	.000
14.17	.012	124.17	.007	234.17	.001	344.16	.000	454.16	.000
15.00	.012	125.00	.007	235.00	.001	345.00	.000	454.99	.000
15.83	.012	125.83	.007	235.84	.001	345.83	.000	455.82	.000
16.67	.012	126.67	.007	236.67	.001	346.66	.000	456.66	.000
17.50	.012	127.50	.007	237.50	.001	347.50	.000	457.49	.000
18.33	.012	128.33	.007	238.34	.001	348.33	.000	458.32	.000
19.17	.012	129.17	.007	239.17	.001	349.16	.000	459.16	.000
20.00	.012	130.00	.007	240.00	.001	350.00	.000	459.99	.000
20.83	.012	130.83	.007	240.84	.001	350.83	.000	460.82	.000
21.67	.012	131.67	.006	241.67	.001	351.66	.000	461.66	.000
22.50	.012	132.50	.006	242.50	.001	352.50	.000	462.49	.000
23.33	.012	133.33	.006	243.34	.001	353.33	.000	463.32	.000
24.17	.012	134.17	.006	244.17	.001	354.16	.000	464.16	.000
25.00	.012	135.00	.006	245.00	.001	355.00	.000	464.99	.000
25.83	.012	135.83	.006	245.84	.001	355.83	.000	465.82	.000
26.67	.012	136.67	.006	246.67	.001	356.66	.000	466.66	.000
27.50	.012	137.50	.006	247.50	.001	357.50	.000	467.49	.000
28.33	.012	138.33	.006	248.34	.001	358.33	.000	468.32	.000
29.17	.012	139.17	.006	249.17	.001	359.16	.000	469.16	.000
30.00	.012	140.00	.006	250.00	.001	360.00	.000	469.99	.000
30.83	.012	140.83	.006	250.84	.001	360.83	.000	470.82	.000
31.67	.012	141.67	.006	251.67	.001	361.66	.000	471.66	.000
32.50	.012	142.50	.005	252.50	.001	362.50	.000	472.49	.000
33.33	.012	143.33	.005	253.34	.001	363.33	.000	473.32	.000
34.17	.012	144.17	.005	254.17	.001	364.16	.000	474.16	.000
35.00	.012	145.00	.005	255.00	.001	365.00	.000	474.99	.000
35.83	.012	145.83	.005	255.84	.001	365.83	.000	475.82	.000
36.67	.012	146.67	.005	256.67	.001	366.66	.000	476.66	.000
37.50	.012	147.50	.005	257.50	.001	367.50	.000	477.49	.000
38.33	.012	148.33	.005	258.34	.001	368.33	.000	478.32	.000
39.17	.012	149.17	.005	259.17	.001	369.16	.000	479.16	.000
40.00	.012	150.00	.005	260.00	.001	370.00	.000	479.99	.000
40.83	.012	150.83	.005	260.84	.001	370.83	.000	480.82	.000
41.67	.012	151.67	.005	261.67	.001	371.66	.000	481.66	.000

42.50	.012	152.50	.005	262.50	.001	372.50	.000	482.49	.000
43.33	.012	153.33	.005	263.34	.001	373.33	.000	483.32	.000
44.17	.011	154.17	.005	264.17	.001	374.16	.000	484.16	.000
45.00	.011	155.00	.005	265.00	.001	375.00	.000	484.99	.000
45.83	.011	155.83	.004	265.84	.001	375.83	.000	485.82	.000
46.67	.011	156.67	.004	266.67	.001	376.66	.000	486.66	.000
47.50	.011	157.50	.004	267.50	.001	377.50	.000	487.49	.000
48.33	.011	158.33	.004	268.34	.001	378.33	.000	488.32	.000
49.17	.011	159.17	.004	269.17	.001	379.16	.000	489.16	.000
50.00	.011	160.00	.004	270.00	.001	380.00	.000	489.99	.000
50.83	.011	160.83	.004	270.84	.001	380.83	.000	490.82	.000
51.67	.011	161.67	.004	271.67	.001	381.66	.000	491.66	.000
52.50	.011	162.50	.004	272.50	.001	382.50	.000	492.49	.000
53.33	.011	163.33	.004	273.34	.001	383.33	.000	493.32	.000
54.17	.011	164.17	.004	274.17	.001	384.16	.000	494.16	.000
55.00	.011	165.00	.004	275.00	.001	385.00	.000	494.99	.000
55.83	.011	165.83	.004	275.84	.001	385.83	.000	495.82	.000
56.67	.011	166.67	.004	276.67	.001	386.66	.000	496.66	.000
57.50	.011	167.50	.004	277.50	.001	387.50	.000	497.49	.000
58.33	.011	168.33	.004	278.34	.001	388.33	.000	498.32	.000
59.17	.011	169.17	.004	279.17	.001	389.16	.000	499.15	.000
60.00	.011	170.00	.004	280.00	.001	389.99	.000	499.99	.000
60.83	.011	170.83	.004	280.83	.001	390.83	.000	500.82	.000
61.67	.011	171.67	.003	281.67	.001	391.66	.000	501.65	.000
62.50	.010	172.50	.003	282.50	.001	392.49	.000	502.49	.000
63.33	.010	173.33	.003	283.33	.001	393.33	.000	503.32	.000
64.17	.010	174.17	.003	284.17	.001	394.16	.000	504.15	.000
65.00	.010	175.00	.003	285.00	.001	394.99	.000	504.99	.000
65.83	.010	175.83	.003	285.83	.001	395.83	.000	505.82	.000
66.67	.010	176.67	.003	286.67	.001	396.66	.000	506.65	.000
67.50	.010	177.50	.003	287.50	.001	397.49	.000	507.49	.000
68.33	.010	178.33	.003	288.33	.001	398.33	.000	508.32	.000
69.17	.010	179.17	.003	289.17	.001	399.16	.000	509.15	.000
70.00	.010	180.00	.003	290.00	.001	399.99	.000	509.99	.000
70.83	.010	180.83	.003	290.83	.001	400.83	.000	510.82	.000
71.67	.010	181.67	.003	291.67	.001	401.66	.000	511.65	.000
72.50	.010	182.50	.003	292.50	.001	402.49	.000	512.49	.000
73.33	.010	183.33	.003	293.33	.001	403.33	.000	513.32	.000
74.17	.010	184.17	.003	294.17	.001	404.16	.000	514.15	.000
75.00	.010	185.00	.003	295.00	.001	404.99	.000	514.99	.000
75.83	.010	185.83	.003	295.83	.001	405.83	.000	515.82	.000
76.67	.010	186.67	.003	296.67	.000	406.66	.000	516.65	.000
77.50	.010	187.50	.003	297.50	.000	407.49	.000	517.49	.000
78.33	.010	188.33	.003	298.33	.000	408.33	.000	518.32	.000
79.17	.010	189.17	.003	299.17	.000	409.16	.000	519.16	.000
80.00	.010	190.00	.003	300.00	.000	409.99	.000	519.99	.000
80.83	.010	190.83	.003	300.83	.000	410.83	.000	520.82	.000
81.67	.010	191.67	.003	301.67	.000	411.66	.000	521.66	.000
82.50	.010	192.50	.003	302.50	.000	412.49	.000	522.49	.000
83.33	.009	193.33	.002	303.33	.000	413.33	.000	523.32	.000
84.17	.009	194.17	.002	304.17	.000	414.16	.000	524.16	.000
85.00	.009	195.00	.002	305.00	.000	414.99	.000	524.99	.000
85.83	.009	195.83	.002	305.83	.000	415.83	.000	525.82	.000
86.67	.009	196.67	.002	306.67	.000	416.66	.000	526.66	.000
87.50	.009	197.50	.002	307.50	.000	417.49	.000	527.49	.000
88.33	.009	198.33	.002	308.33	.000	418.33	.000	528.32	.000
89.17	.009	199.17	.002	309.17	.000	419.16	.000	529.16	.000
90.00	.009	200.00	.002	310.00	.000	419.99	.000	529.99	.000
90.83	.009	200.83	.002	310.83	.000	420.83	.000	530.82	.000
91.67	.009	201.67	.002	311.67	.000	421.66	.000	531.66	.000
92.50	.009	202.50	.002	312.50	.000	422.49	.000	532.49	.000
93.33	.009	203.33	.002	313.33	.000	423.33	.000	533.32	.000

94.17	.009	204.17	.002	314.17	.000	424.16	.000	534.16	.000
95.00	.009	205.00	.002	315.00	.000	424.99	.000	534.99	.000
95.83	.009	205.83	.002	315.83	.000	425.83	.000	535.82	.000
96.67	.009	206.67	.002	316.67	.000	426.66	.000	536.66	.000
97.50	.009	207.50	.002	317.50	.000	427.49	.000	537.49	.000
98.33	.009	208.33	.002	318.33	.000	428.33	.000	538.32	.000
99.17	.009	209.17	.002	319.17	.000	429.16	.000	539.16	.000
100.00	.009	210.00	.002	320.00	.000	429.99	.000	539.99	.000
100.83	.009	210.84	.002	320.83	.000	430.83	.000	540.82	.000
101.67	.009	211.67	.002	321.67	.000	431.66	.000	541.66	.000
102.50	.009	212.50	.002	322.50	.000	432.49	.000	542.49	.000
103.33	.009	213.34	.002	323.33	.000	433.33	.000	543.32	.000
104.17	.009	214.17	.002	324.17	.000	434.16	.000	544.16	.000
105.00	.009	215.00	.002	325.00	.000	434.99	.000	544.99	.000
105.83	.008	215.84	.002	325.83	.000	435.83	.000	545.82	.000
106.67	.008	216.67	.002	326.67	.000	436.66	.000	546.66	.000
107.50	.008	217.50	.002	327.50	.000	437.49	.000		
108.33	.008	218.34	.002	328.33	.000	438.33	.000		
109.17	.008	219.17	.002	329.17	.000	439.16	.000		

001:0032-----

*#
 *# Catchment SA7 - Strittmatter road drainage d\s of SWM area - uncontrolled
 *# (Strittmatter A7, 0.32 hectares)
 *#

 | DESIGN STANDHYD | Area (ha)= .32
 | 06:000307 DT=10.00 | Total Imp(%)= 30.00 Dir. Conn.(%)= 20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.10	.22	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	46.19	40.00	
Mannings n =	.013	.250	
Max. eff. Inten. (mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.08 (ii)	9.14 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.03	.03	.061 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0033-----

*#
 *# Catchment SA8 (Strittmatter A8, 0.46 hectares)
 *# NOT ROUTED INTO POND>>>> FLOWS UNCONTROLLED DOWN ROAD
 *# --- Area decreased May 2000

*#

```

-----
| DESIGN STANDHYD | Area (ha)= .46
| 05:000308 DT=10.00 | Total Imp(%)= 30.00 Dir. Conn.(%)= 20.00
-----
    
```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.14	.32	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	55.38	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.20 (ii)	9.27 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.04	.05	.087 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0034-----

*#

```

*# Catchment SA9 - Strittmatter road drainage d/s of SWM area
*# NOT ROUTED INTO POND>>>> FLOWS UNCONTROLLED DOWN ROAD
*# (Strittmatter A9, 0.08 hectares, C= 0.95)
*#
    
```

```

-----
| DESIGN STANDHYD | Area (ha)= .08
| 09:000410 DT=10.00 | Total Imp(%)= 95.00 Dir. Conn.(%)= 95.00
-----
    
```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.08	.00	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	23.09	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.71 (ii)	9.55 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.03	.00	.035 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	98.15	39.49	95.217
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.962

*** WARNING: Storage Coefficient is smaller than DT!

Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0035-----

*# Add hydrograph #307 to hyd #410 to SWM area discharge for outflow from
*# Strittmatter development (must be below diversion flow)

ADD HYD (000411)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 02:000406	28.90	.412	1.67	35.05	.000
	+ID2 06:000307	.32	.061	1.00	53.88	.000
	+ID3 05:000308	.46	.087	1.00	53.88	.000
	+ID4 09:000410	.08	.035	1.00	95.22	.000
=====						
	SUM 04:000411	29.76	.495	1.17	35.71	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0036-----

*#
*# Add major system overflow from diversion to County Road drainage
*# below diversion (Areas A4 and A5)
*#

ADD HYD (000414)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 01:000412	.47	.391	1.00	62.97	.000
	+ID2 03:000204	.37	.095	1.00	62.97	.000
=====						
	SUM 02:000414	.84	.486	1.00	62.97	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0037-----

*# Church Street Intersection
*#
*# Add hydrograph from Strittmatter Property (hyd #411)
*# to County Road 24 Drainage at Church Street
*#

ADD HYD (000205)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 02:000414	.84	.486	1.00	62.97	.000
	+ID2 04:000411	29.76	.495	1.17	35.71	.000
=====						
	SUM 01:000205	30.60	.902	1.00	36.45	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0038-----

*# Catchment A6 from Triton Study (0.31 hectares, C= 0.6)
*#

| DESIGN STANDHYD | Area (ha)= .31
 | 02:000106 DT=10.00 | Total Imp(%)= 50.00 Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.16	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	4.00	4.00	
Length (m)=	45.46	40.00	
Mannings n =	.013	.250	
Max.eff.Inten. (mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.87 (ii)	8.05 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.07	.02	.088 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	39.51	68.833
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.696

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0039-----

*# Add hydrograph from Catchments A6 to Upstream Hydrograph

ADD HYD (000206)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000205	30.60	.902	1.00	36.45	.000
+ID2	02:000106	.31	.088	1.00	68.83	.000
SUM	03:000206	30.91	.991	1.00	36.78	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0040-----

*#

*# Catchment A7 from Triton Study (0.24 hectares, C= 0.7)

*#

| DESIGN STANDHYD | Area (ha)= .24
 | 01:000107 DT=10.00 | Total Imp(%)= 60.00 Dir. Conn.(%)= 60.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.14	.10
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	2.00	2.00
Length (m)=	40.00	40.00
Mannings n =	.013	.250
Max.eff.Inten. (mm/hr)=	162.24	56.88
over (min)	10.00	10.00
Storage Coeff. (min)=	.99 (ii)	9.83 (ii)

Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.06	.01	.075 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	98.15	39.51	74.696
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.755

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0041-----

*#
*# Catchment A8 from Triton Study (0.30 hectares, C= 0.7)
*#

DESIGN STANDHYD	Area (ha)=	.30		
02:000108 DT=10.00	Total Imp(%)=	60.00	Dir. Conn.(%)=	60.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.18	.12
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	4.00	4.00
Length (m)=	44.72	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	162.24	56.88
over (min)	10.00	10.00
Storage Coeff. (min)=	.86 (ii)	8.04 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	.17	.12

			TOTALS
PEAK FLOW (cms)=	.08	.01	.096 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	39.51	74.696
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.755

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0042-----

*# Add hydrographs from Catchments A7 and A8

ADD HYD (000207)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 02:000108	.30	.096	1.00	74.70	.000
	+ID2 01:000107	.24	.075	1.00	74.70	.000

SUM 04:000207 .54 .171 1.00 74.70 .000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0043-----

*# Add summed hydrographs from Catchments A7+A8 to Upstream Hydrograph

ADD HYD (000208)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	03:000206	30.91	.991	1.00	36.78	.000
+ID2	04:000207	.54	.171	1.00	74.70	.000
=====						
SUM	01:000208	31.45	1.162	1.00	37.43	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0044-----

*#
*# Catchment A9 from Triton Study (0.32 hectares, C= 0.7)
*#

DESIGN STANDHYD	Area (ha)=	Total Imp(%)=	Dir. Conn.(%)=
02:000109 DT=10.00	.32	60.00	60.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.19	.13	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	.20	.20	
Length (m)=	46.19	40.00	
Mannings n =	.013	.250	
Max.eff.Inten. (mm/hr)=	162.24	49.00	
over (min)	10.00	20.00	
Storage Coeff. (min)=	2.15 (ii)	20.88 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	.17	.05	
			TOTALS
PEAK FLOW (cms)=	.09	.01	.091 (iii)
TIME TO PEAK (hrs)=	1.00	1.33	1.000
RUNOFF VOLUME (mm)=	98.15	39.52	74.696
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.755

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0045-----

*# Add hydrograph from Catchments A9 to upstream drainage
*#
**# THIS IS THE FLOW AT MH 56 WHICH IS THE LIMITING CONSTRAINT....
*# 5 year - 0.68 cms
*# 100 year - 1.29 cms
*#

ADD HYD (000209)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000208		31.45	1.162	1.00	37.43	.000
+ID2 02:000109		.32	.091	1.00	74.70	.000
=====						
SUM 03:000209		31.77	1.253	1.00	37.80	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0046-----

*#

*# Catchment A10 from Triton Study (0.21 hectares, C= 0.7)

*#

DESIGN STANDHYD	Area (ha)=	Dir. Conn.(%)=
04:000110 DT=10.00	.21	60.00
	Total Imp(%)=	60.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.13	.08	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	1.00	1.00	
Length (m)=	37.42	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.17 (ii)	12.06 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.06	.01	.065 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	98.15	39.51	74.696
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.755

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0047-----

*# Add hydrograph from Catchment A10 to Upstream Hydrograph

*# represents total catchment flow to Credit River

ADD HYD (000204)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 03:000209		31.77	1.253	1.00	37.80	.000
+ID2 04:000110		.21	.065	1.00	74.70	.000
=====						
SUM 01:000204		31.98	1.318	1.00	38.04	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0048-----

FINISH

WARNINGS / ERRORS / NOTES

- 0003 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0004 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0006 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0007 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0009 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0011 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0016 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0020 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0021 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0023 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0024 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0026 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0032 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0033 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0034 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0038 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0040 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0041 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0044 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
- 0046 DESIGN STANDHYD

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
Simulation ended on 2000-06-01 at 10:48:27

=====

APPENDIX B

POST McMURCHY DEVELOPMENT (ULTIMATE CONDITION)
SWMHYMO MODELLING RESULTS

STORM SEWER DESIGN SHEET
ULTIMATE CONDITION (MCMURCHY DEV.)

R.J. BURNSIDE & ASSOCIATES LIMITED
 ENGINEERS-HYDROGEOLOGISTS-ENVIRONMENTAL CONSULTANTS

8500 TORBRAM ROAD, SUITE 56, BRAMPTON, ONTARIO L6T5C6
 TELEPHONE: 905-793-9239 FAX: 905-793-5018
 Township of Erin Rainfall I.D.F. 5 yr. storm
 (Standards based on Malton I.D.F. curves)

Date : 01-Jun-00
 Project : Strittmatter Property
 Municipality : Township of Erin
 Designer : LD
 Checker :
 Q = 2.778 C/A
 C: Peak Flow(l/sec)
 C: Runoff coefficient
 A: Area(Ha)
 I: Rainfall Intensity (mm/hr) I = A/(B+Tc)ⁿ
 Manning's 0.013

A= 820.0
 B= 4.6
 C= 0.780

Street Name	Location		AREA A ha	COEF C	Individual 2.78AC	Accumulated 2.78AC	Time of Concentration (mins)	Rainfall Intensity (mm/hr)	Peak Flow (l/s)	Sewer Data					
	From	To								Diameter (mm)	Slope (%)	Length (m)	Capacity (l/s)	Velocity (m/s)	Time of Flow (mins)
Upper Canada Drive	MHCB 5	MHCB 4	0.54	0.4	0.60	0.60	10.00	101.30	61	300	7.85	75.0	283	3.87	0.32
	MHCB 4	MHCB 3	0.53	0.4	0.59	1.19	10.32	99.59	118	300	7.81	64.0	282	3.86	0.28
	MHCB 3	MH B	0.41	0.4	0.46	1.65	10.60	98.18	162	300	8	22.5	285	3.91	0.10
Street C	MHCB 7	DCBMH 6	22.4	0.3	18.68	18.68	10.00	(see note 1)	59	450	1.5	39.5	364	2.22	0.30
	DCBMH 6	MH B	1.04	0.4	1.16	1.16	10.30	98.73	174	450	1.5	38.0	364	2.22	0.29
Upper Canada Drive	MH B	headwall					10.69	(see note 3)	336	525	1	27.5	449	2.01	0.23
	DICB (RT)	DIMH C					11.70	(see note 4)	142	375	1	10.0	183	1.60	0.10
	DIMH C	headwall					11.80	(see note 4)	283	450	1	12.8	297	1.81	0.12
Diversion from County Rd. 24 (Triton study)	pond	DICB J	(see note 5)	Refer to R.J. Burnside SWM Report					271	375	0.71	4.5	154	1.35	0.06
	DICB J	MH A		"					271	750	0.85	15.0	1071	2.35	0.11
	MH A	MH D		"					271	750	0.85	19.5	1071	2.35	0.14
	MH D	MH E		"					271	750	0.37	33.0	707	1.55	0.35
	MH E	MH F		"					302	750	2	22.5	1643	3.60	0.10
New Diversion System	DICB 70	DICB 69	2.4	0.5	3.34	3.34	10.00	101.30	338	525	5.6	78.0	1062	4.75	0.27
	DICB 69	DICB 67	0.25	0.5	0.35	3.68	10.27	99.85	368	525	5.79	73.0	1080	4.83	0.25
	DICB 67	DCB 66	0.68	0.5	0.95	4.63	10.53	98.55	456	525	7.23	28.0	1207	5.40	0.09
New Diversion System	DCB 66	MH G				(No further inflow)			456	525	4.27	21.5	927	4.15	0.09
	MH G	MH H							456	525	1.25	53.5	502	2.25	0.40
	MH H	MH I							456	525	6.2	10.0	1117	5.00	0.03
	MH I	headwall							456	525	1	15.0	449	2.01	0.12

NOTES:

- 1) The peak flow of 59 l/s for the storm sewer from MHCB 7 to DCBMH 6 represents the 5 year routed flow from the developed McMurchy ponding area.
- 2) The flow from DCBMH 6 to MH B was determined using a combined flow from MHCB 7 to DCBMH 6 (5 yr. SWMHYMO), and DCBMH 6 to MH B using the rational method (5 yr. storm). The sewers on Strittmatter's line will have a 5 year flow restraint.
- 3) The peak flow from MH B to headwall (in the pond) is the combined flow from Street C and Upper Canada Drive to MC B.
- 4) The peak flow from DIMH C to pond is the 100 year storm flows from catchment SA4 as well as the carryover flow from the upstream catchments (SA1, SA2, and SA3). This sewer must have the capacity to convey all of the runoff from the 100 year event to the pond (see Catchbasin Design Sheet).
- 5) 5 year outflow from Strittmatter pond (271 l/s) spills partly through the high flow outlet

Post McMurchy Development (Ultimate Condition)

Summary of Peak Flows									
Outlet	Pre-Development			Post Strittmatter Development			Ultimate Condition		
	2 Year	5 Year	100 Year	2 Year	5 Year	100 Year	2 Year	5 Year	100 Year
A	.637	.806	2.344	.186	.269	.495	.187	.302	.499

Note: I) Changes in the flows from McMurchy's Pond only affect the peak flows at Outlet A.

Ultimate Condition (Post McMurchy Development) Pond Performance					
Rainfall Event	Pond #1			McMurchy Pond	
	Outflow, m ³ /s	Depth, m	Volume, m ³	Outflow m ³ /s	Volume, m ³
25 mm	0.135	0.47	170	0.024	880
2 Year	0.167	0.62	310	0.035	1300
5 Year	0.271	1.04	670	0.058	2600
100 Year	0.434	2.00	1780	0.157	7300

Note: I) Pond 2 is not affected by changes in McMurchy flows so it is not included in the above table.

SWMHYMO SCHEMATIC


STRITTMATTER DEVELOPMENT, HILLSBURGH

ULTIMATE CONDITION (POST McMURCHY DEV.)

- ROUTE HWY DRAINAGE (3.3ha) THRU STRITTMATTER POND
- REVISED MAY/17/99-ADDED McMURCHY LANDS & BERM
- REVISED MARCH/20/00-MODIFIED MODELLING SUBCATCHMENTS

STRITTMATTER DRAINAGE

COUNTY ROAD 24(BELOW DIVERSION)

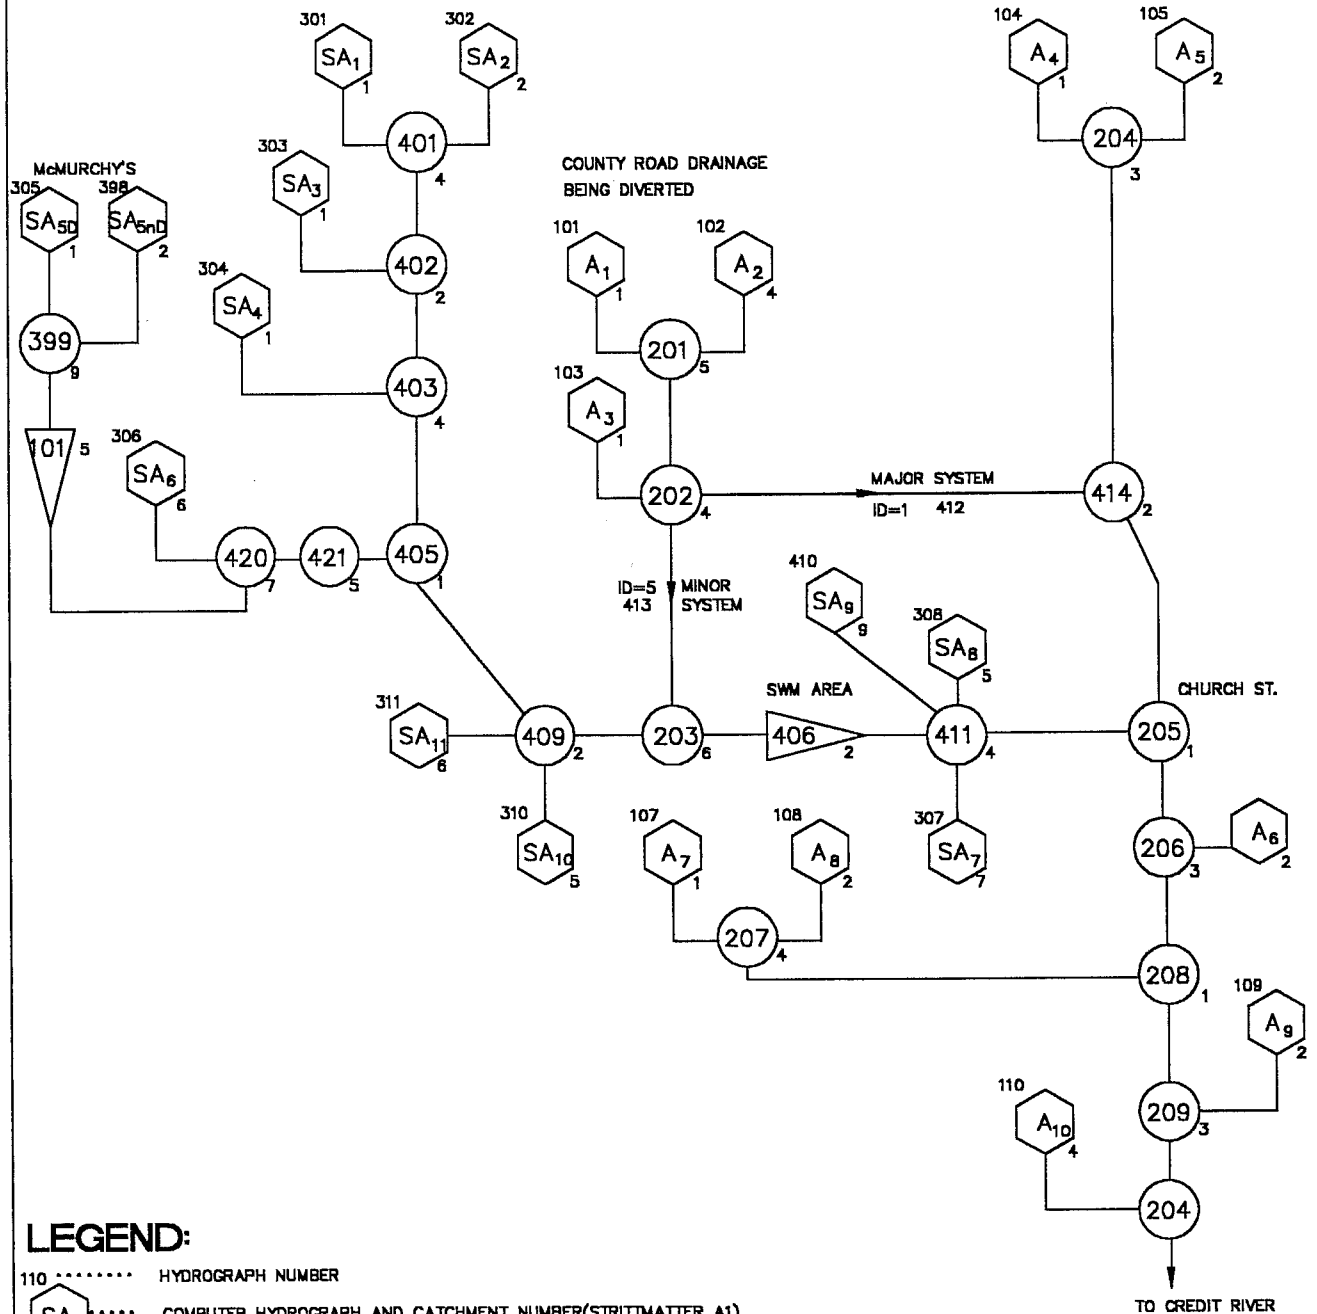

LEGEND:

- 110 HYDROGRAPH NUMBER
- SA₁ COMPUTER HYDROGRAPH AND CATCHMENT NUMBER(STRITTMATTER A1)
- 4..... CELL STORAGE ID (SWMHYMO PROGRAM)
- 207 ADD HYDROGRAPH (HYDROGRAPH NUMBER INSIDE)
- 4..... CELL STORAGE ID
- 406 ROUTE RESERVOIR (HYDROGRAPH NUMBER INSIDE)
- 2 CELL STORAGE ID



BURNSIDE DEVELOPMENT SERVICES

A DIVISION OF R.J. BURNSIDE AND ASSOCIATES LIMITED
 DEVELOPMENT ENGINEERING & MANAGEMENT,
 STORMWATER MANAGEMENT & COMMUNAL SYSTEMS
 8500 TORBRAM ROAD, SUITE 5A, BRAMPTON, ONTARIO L6T 5C8
 TELEPHONE: 905-793-9239 FAX: 905-793-5018

**Strittmatter Development, Village of Hillsburgh
Town of Erin**

**Summary of Hydrologic Analysis for Ultimate Development Conditions
Drainage Area to County Road 24 Only**

Catchment ID	Drainage Area	5 Year Flows, m ³ /s			100 Year Flows, m ³ /s			Storage Used (m ³)
		Local Runoff	Combined Runoff	Controlled Runoff	Local Runoff	Combined Runoff	Controlled Runoff	
Strittmatter Drainage								
SA1	0.54	0.046	0.046	0.046	0.105	0.105	0.105	-
SA2	0.53	0.045	0.091	0.091	0.103	0.209	0.209	-
SA3	0.41	0.035	0.126	0.126	0.080	0.289	0.289	-
SA4	0.41	0.035	0.161	0.161	0.080	0.369	0.369	-
SA5 D*	12.40	0.957	0.957	-	0.744	0.744	0.744	-
SA5 nD**	10.00	0.235	1.068	0.058	2.150	2.511	0.157	7312.00
SA6	1.04	0.063	0.240	0.240	0.166	0.576	0.576	-
SA10	0.36	0.034	0.274	0.274	0.070	0.646	0.646	-
SA11	0.35	0.092	0.366	0.366	0.154	0.801	0.801	-
County Road 24 Drainage Being Diverted (Data from Triton Study (1998))								
A1	2.40	0.312	0.312	0.312	0.604	0.604	0.604	-
A2	0.25	0.033	0.344	0.344	0.064	0.668	0.668	-
A3	0.68	0.089	0.434	0.434	0.173	0.841	0.450	(minor system)
County Road + Strittmatter Drainage		0.80		0.27	1.25		0.43	1784.00
Routed Through Strittmatter SWM Area								
SA7	0.32	0.027	0.027	0.027	0.061	0.061	0.061	-
SA8	0.46	0.038	0.038	0.038	0.087	0.087	0.087	-
SA9	0.08	0.021	0.302	0.302	0.035	0.499	0.499	-
A4	0.09	0.012	0.012	0.012	0.023	0.023	0.023	-
A5	0.28	0.037	0.049	0.049	0.072	0.095	0.095	-
A6	0.31	0.048	0.351	0.351	0.088	1.027	1.027	-
A7	0.24	0.041	0.041	0.041	0.075	0.075	0.075	-
A8	0.30	0.054	0.443	0.443	0.096	1.198	1.198	-
A9	0.32	0.053	0.495	0.495	0.091	1.289	1.289	-
A10	0.21	0.036	0.531	0.531	0.065	1.354	1.354	-
Total	31.98	Total Flows to Credit River		0.531	1.354		1.354	

*SA5 represents the McMurchy Property . Drainage from these lands is controlled on-site in temporary facility.

Stage-Storage-Discharge Relationship for Pond #1 (revised April 2000)
Ultimate Condition -- Post McMurchy

Low Flow Outlet :	Conc. Pipe, diameter (m):	0.45
	Orifice, diameter (m):	0.35
	Invert Elevation (m):	442.95
Major Flow Outlet:	Conc. Pipe, diameter (m):	0.2
	Opening Elevation (m):	443.8
Centre of Low Flow Orifice, m		443.13
Centre of Low Flow Pipe, m		443.18
Elevation of Major Flow Pipe, m		443.80

Depth,m	Elevation, m	Low Flow Outlet	Major Flow Outlet	Total Flow, m ³ /s	Total Storage, m ³
0.00	442.95	0.000	0.000	0.000	0.00
0.25	443.20	0.070	0.000	0.070	26.25
0.30	443.25	0.090	0.000	0.090	45.36
0.40	443.35	0.121	0.000	0.121	107.52
0.50	443.45	0.146	0.000	0.146	210.00
0.80	443.75	0.202	0.000	0.202	464.39
1.05	444.00	0.239	0.037	0.277	686.89
1.10	444.05	0.246	0.042	0.288	733.38
1.25	444.20	0.265	0.053	0.318	878.13
1.40	444.35	0.283	0.062	0.345	1032.38
1.60	444.55	0.305	0.072	0.378	1256.39
2.00	444.95	0.345	0.090	0.435	1786.41
2.10	445.05	0.355	0.093	0.448	1939.84
2.20	445.15	0.364	0.097	0.461	2103.02
2.30	445.25	0.373	0.101	0.473	2276.62

```

SSSSS W W M M H H Y Y M M 000 999 5555 =====
S W W W MM MM H H Y Y MM MM O O 9 9 5 =====
SSSSS W W W M M M H H H H Y M M M O O ## 9 9 5 Ver. 3.1
S W W M M H H Y M M O O 9999 5555 Oct. 1997
SSSSS W W M M H H Y M M 000 9 5 =====
9 9 5 # 3877524
StormWater Management HYdrologic Model 999 5555 =====

```

```

*****
***** SWMHYMO-95w Ver/3.1 *****
***** A single event and continuous hydrologic simulation model *****
***** based on the principles of HYMO and its successors *****
***** OTTHYMO-83 and OTTHYMO-89. *****
***** Distributed by: J.F. Sabourin and Associates Inc. *****
***** Ottawa, Ontario: (613) 727-5199 *****
***** Gatineau, Quebec: (819) 243-6858 *****
***** E-Mail: swmhymo@jfsa.Com *****
*****

```

```

+++++ Licensed user: R.J. Burnside & Associates Ltd. +++++
+++++ Brampton SERIAL#:3877524 +++++
+++++

```

```

*****
***** +++++ PROGRAM ARRAY DIMENSIONS +++++ *****
***** Maximum value for ID numbers : 10 *****
***** Max. number of rainfall points: 5000 *****
***** Max. number of flow points : 5000 *****
*****

```

```

***** D E T A I L E D O U T P U T *****
*****
* DATE: 2000-06-01 TIME: 10:47:02 RUN COUNTER: 001097 *
* Input filename: I:\LORENA\S-405\CORREC~1\MAY00\ULT5.DAT *
* Output filename: I:\LORENA\S-405\CORREC~1\MAY00\ULT5.out *
* Summary filename: I:\LORENA\S-405\CORREC~1\MAY00\ULT5.sum *
* User comments: *
* 1: _____ *
* 2: _____ *
* 3: _____ *
*****

```

```

-----
001:0001-----
*# *****
*# Project Name: [ Strittmatter Development, Hillsburgh] Project Number: [S-405
*# Date : 12-17-1998
*# Modeller : [LD]
*# Company : R. J. Burnside & Associates Ltd.
*# License # : 3877524
*# *****
*# Hydrologic analysis of County Road 24 stormsewer system combined with
*# Strittmatter Development at the north end of the village of Hillsburgh.
*#
*# McMurphy Berm added May '99
*#

```

```
*# 5 year storm event
*#
*# Data from County Rd. 24 Stormsewer Analysis (Triton) used
*# for Road Catchments. Strittmatter Development discharge
*# includes stormwater controls
*#
*# Made modifications to this file to route the road portion or upper canada SA
*# into the pond and let the external property SA8 flow uncontrolled. This fil
*# was run to obtain volume requirements for the pond to store throttle the 100
*# year flows of the ultimate condition. Lot 1 was made available as pond area
*# so SA10 decreased 0.32 ha and SA11 increased the same amount.
*#
*# File was further modified to let SA9 flow uncontrolled off site
*#
*# File was further modified to collect some of the drainage from SA8 at the
*# south end of Lot 1. SA8 area decreased to 0.46 ha and SA10 area increased
*# to 0.36 ha. Change in response to Triton comments May 19, 2000
*#
```

```
-----
| START | Project dir.: I:\LORENA\S-405\CORREC~1\MAY00\
----- Rainfall dir.: I:\LORENA\S-405\CORREC~1\MAY00\
TZERO = .00 hrs on 0
METOUT= 2 (output = METRIC)
NRUN = 001
NSTORM= 0
-----
```

```
001:0002-----
*READ STORM STORM_FILENAME=["c:\S-405\swmhymo\hazel.stm"]
-----
```

```
| CHICAGO STORM | IDF curve parameters: A=1439.371
| Ptotal= 50.14 mm | B= 13.688
C= .846
used in: INTENSITY = A / (t + B)^C

Duration of storm = 3.00 hrs
Storm time step = 10.00 min
Time to peak ratio = .33
```

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.17	4.466	1.00	98.929	1.83	8.962	2.67	4.283
.33	5.747	1.17	42.990	2.00	7.369	2.83	3.877
.50	8.048	1.33	23.232	2.17	6.247	3.00	3.543
.67	13.224	1.50	15.419	2.33	5.419		
.83	32.890	1.67	11.382	2.50	4.784		

```
001:0003-----
*# Catchment A4 from Triton Study (0.09 hectares, C= 0.5)
*#
```

```
-----
| DESIGN STANDHYD | Area (ha)= .09
| 01:000104 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.05
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	6.00	6.00
Length (m)=	24.49	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	98.93	20.18

over (min)	10.00	10.00	
Storage Coeff. (min)=	.64 (ii)	10.27 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.01	.00	.012 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	27.144
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.541

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0004-----

*#
*# Catchment A5 from Triton Study (0.28 hectares, C= 0.5)
*#

DESIGN STANDHYD	Area (ha)=	.28	
02:000105 DT=10.00	Total Imp(%)=	40.00	Dir. Conn.(%)= 40.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=		.11	.17
Dep. Storage (mm)=		.80	1.50
Average Slope (%)=		6.00	6.00
Length (m)=		43.20	40.00
Mannings n =		.013	.250
Max.eff.Inten.(mm/hr)=		98.93	20.18
over (min)		10.00	10.00
Storage Coeff. (min)=		.91 (ii)	10.53 (ii)
Unit Hyd. Tpeak (min)=		10.00	10.00
Unit Hyd. peak (cms)=		.17	.10
			TOTALS
PEAK FLOW (cms)=		.03	.01
TIME TO PEAK (hrs)=		1.00	1.17
RUNOFF VOLUME (mm)=		49.34	12.35
TOTAL RAINFALL (mm)=		50.14	50.14
RUNOFF COEFFICIENT =		.98	.25

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0005-----

*# Add summed hydrographs from Catchments A5 to A4

ADD HYD (000204)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 01:000104	.09	.012	1.00	27.14	.000

+ID2 02:000105	.28	.037	1.00	27.14	.000
=====					
SUM 03:000204	.37	.049	1.00	27.14	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0006-----

*#
 *# Proposed Strittmatter Development
 *#
 *# Catchment SA1 (Strittmatter A1, 0.54 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.54		
01:000301 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.38	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	60.00	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.36 (ii)	12.08 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.03	.02	.046 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0007-----

*#
 *# Catchment SA2 (Strittmatter A2, 0.53 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.53		
02:000302 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.37	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	59.44	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	

Storage Coeff. (min)=	1.35 (ii)	12.07 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.03	.02	.045 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0008-----

*# Add hydrographs from Strittmatter A1 and A2

ADD HYD (000401)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 01:000301	.54	.046	1.00	20.84	.000
	+ID2 02:000302	.53	.045	1.00	20.84	.000
	SUM 04:000401	1.07	.091	1.00	20.84	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0009-----

*#
*# Catchment SA3 (Strittmatter A3, 0.41 hectares)
*#

DESIGN STANDHYD	Area (ha)=	.41		
01:000303 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.12	.29	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	52.28	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.25 (ii)	11.97 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.02	.01	.035 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:

- CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0010-----

*# Add hydrographs from Strittmatter A3 to Strittmatter (A1+A2)

ADD HYD (000402)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000303	.41	.035	1.00	20.84	.000
+ID2	04:000401	1.07	.091	1.00	20.84	.000
SUM	02:000402	1.48	.126	1.00	20.84	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0011-----

*#
 *# Catchment SA4 (Strittmatter A4, 0.41 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.41		
01:000304 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.12	.29	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	52.28	40.00	
Mannings n =	.013	.250	
Max.eff.Inten. (mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.25 (ii)	11.97 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.02	.01	.035 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0012-----

*# Add hydrographs from Strittmatter A4 to Strittmatter Upstream Drainage

ADD HYD (000403)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000304	.41	.035	1.00	20.84	.000
+ID2	02:000402	1.48	.126	1.00	20.84	.000

=====
 SUM 04:000403 1.89 .161 1.00 20.84 .000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

 001:0013-----

```
*#
*# Catchment SA5 (Strittmatter A5, 22.4 hectares of upstream
*# agricultural drainage)
*#
*#
*# Dec.1,1999: This area, known as the McMurphy Property is assumed to be
*# developed for the purpose of sizing a PRELIMINARY stormwater facility.
*#
*# Total Area: 22.4 hectares
*# Assume:      10.0 hectares non-developable
*#              12.4 hectares developable (30% impervious)
*#
*# Note: Although site exhibits extremely high infiltration capacity, average
*# runoff potential is assumed for the purpose of sizing future stormwater
*# facility. It is expected that at-source runoff controls (ie. infiltration
*# facilities)will be implemented to reduce runoff potential for the developme
*#
```

```
-----
| DESIGN NASHYD      | Area (ha)= 10.00    Curve Number (CN)=58.00
| 01:000305 DT=15.00 | Ia (mm)= 1.500    # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= .320
```

```
Unit Hyd Qpeak (cms)= 1.194

PEAK FLOW (cms)= .235 (i)
TIME TO PEAK (hrs)= 1.333
RUNOFF VOLUME (mm)= 8.474
TOTAL RAINFALL (mm)= 50.135
RUNOFF COEFFICIENT = .169
```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

*** WARNING: Time step is too large for value of TP.
 R.V. may be ok. Peak flow could be off.

 001:0014-----

```
-----
| DESIGN STANDHYD   | Area (ha)= 12.40
| 02:000398 DT=15.00 | Total Imp(%)= 30.00    Dir. Conn.(%)= 20.00
-----
```

```

IMPERVIOUS      PERVIOUS (i)
Surface Area (ha)= 3.72      8.68
Dep. Storage (mm)= .80      1.50
Average Slope (%)= 5.00      5.00
Length (m)= 287.52      40.00
Mannings n = .013      .250

Max.eff.Inten.(mm/hr)= 98.93      21.06
                  over (min) 10.00      10.00
Storage Coeff. (min)= 2.98 (ii)    12.98 (ii)
Unit Hyd. Tpeak (min)= 10.00      10.00
Unit Hyd. peak (cms)= .16      .09
```

```

*TOTALS*
PEAK FLOW (cms)= .67      .32      .957 (iii)
TIME TO PEAK (hrs)= 1.00      1.17      1.000
```

RUNOFF VOLUME (mm) = 44.64 9.50 16.526
 TOTAL RAINFALL (mm) = 50.14 50.14 50.135
 RUNOFF COEFFICIENT = .89 .19 .330

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 58.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 001:0015-----

ADD HYD (000399)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000305	10.00	.235	1.33	8.47	.000
+ID2	02:000398	12.40	.957	1.00	16.53	.000
SUM	09:000399	22.40	1.068	1.00	12.93	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

 001:0016-----

ROUTE RESERVOIR	Requested routing time step = 15.0 min.
IN>09:(000399)	
OUT<05:(000101)	
===== OUTFLOW STORAGE TABLE =====	
OUTFLOW (cms)	STORAGE (ha.m.)
.000	.0000E+00
.050	.1850E+00
.080	.4800E+00

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >09: (000399)	22.40	1.068	1.000	12.931
OUTFLOW <05: (000101)	22.40	.058	2.333	12.930
OVERFLOW <08: (000150)	.00	.000	.000	.000

PEAK FLOW REDUCTION [Qout/Qin] (%) = 5.391
 TIME SHIFT OF PEAK FLOW (min) = 80.00
 MAXIMUM STORAGE USED (ha.m.) = .2598E+00

 001:0017-----

PRINT HYD	AREA (ha) = 22.400
ID=05 (000101)	QPEAK (cms) = .058 (i)
DT=10.00 PCYC= 5	TPEAK (hrs) = 2.333
	VOLUME (mm) = 12.930

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

TIME FLOW	TIME FLOW	TIME FLOW	TIME FLOW
hrs cms	hrs cms	hrs cms	hrs cms
.00 .000	19.17 .015	38.33 .002	57.50 .000
.83 .005	20.00 .013	39.17 .002	58.33 .000
1.67 .053	20.83 .012	40.00 .002	59.17 .000
2.50 .058	21.67 .011	40.83 .002	60.00 .000
3.33 .056	22.50 .011	41.67 .002	60.83 .000

4.17	.054	23.33	.010	42.50	.002	61.67	.000	80.83	.000
5.00	.053	24.17	.009	43.33	.001	62.50	.000	81.67	.000
5.83	.051	25.00	.008	44.17	.001	63.33	.000	82.50	.000
6.67	.049	25.83	.008	45.00	.001	64.17	.000	83.33	.000
7.50	.045	26.67	.007	45.83	.001	65.00	.000	84.17	.000
8.33	.042	27.50	.006	46.67	.001	65.83	.000	85.00	.000
9.17	.039	28.33	.006	47.50	.001	66.67	.000	85.83	.000
10.00	.036	29.17	.006	48.33	.001	67.50	.000	86.67	.000
10.83	.033	30.00	.005	49.17	.001	68.33	.000	87.50	.000
11.67	.030	30.83	.005	50.00	.001	69.17	.000	88.33	.000
12.50	.028	31.67	.004	50.83	.001	70.00	.000	89.17	.000
13.33	.026	32.50	.004	51.67	.001	70.83	.000	90.00	.000
14.17	.024	33.33	.004	52.50	.001	71.67	.000	90.83	.000
15.00	.022	34.17	.003	53.33	.001	72.50	.000	91.67	.000
15.83	.020	35.00	.003	54.17	.000	73.33	.000	92.50	.000
16.67	.019	35.83	.003	55.00	.000	74.17	.000	93.33	.000
17.50	.017	36.67	.003	55.83	.000	75.00	.000		
18.33	.016	37.50	.002	56.67	.000	75.83	.000		

001:0018-----

*#
 *# Catchment SA6 (Strittmatter A6, 1.04 hectares)
 *#

| DESIGN STANDHYD | Area (ha)= 1.04
 | 06:000306 DT=10.00 | Total Imp(%)= 20.00 Dir. Conn.(%)= 10.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.21	.83
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	3.00	3.00
Length (m)=	83.27	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	98.93	25.21
over (min)	10.00	10.00
Storage Coeff. (min)=	1.65 (ii)	12.50 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	.17	.09

TOTALS
 PEAK FLOW (cms)= .03 .04 .063 (iii)
 TIME TO PEAK (hrs)= 1.00 1.17 1.000
 RUNOFF VOLUME (mm)= 49.34 13.55 17.126
 TOTAL RAINFALL (mm)= 50.14 50.14 50.135
 RUNOFF COEFFICIENT = .98 .27 .342

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0019-----

*# Add routed hydrograph from Strittmatter A5 (McMurphy Property) to A6

ADD HYD (000420)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 05:000101	22.40	.058	2.33	12.93	.000
	+ID2 06:000306	1.04	.063	1.00	17.13	.000

```
=====
SUM 07:000420    23.44    .080    1.17    13.12    .000
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0020-----

*# Add OVERFLOW hydrograph from McMurchy Pond

```
-----
| ADD HYD (000421) | ID: NHYD    AREA    QPEAK    TPEAK    R.V.    DWF
-----
                    (ha)    (cms)    (hrs)    (mm)    (cms)
ID1 08:000150      .00      .000     .00      .00      .000  **DRY**
+ID2 07:000420     23.44    .080     1.17    13.12    .000
=====
SUM 05:000421     23.44    .080     1.17    13.12    .000
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0021-----

```
-----
| ADD HYD (000405) | ID: NHYD    AREA    QPEAK    TPEAK    R.V.    DWF
-----
                    (ha)    (cms)    (hrs)    (mm)    (cms)
ID1 05:000421     23.44    .080     1.17    13.12    .000
+ID2 04:000403      1.89    .161     1.00    20.84    .000
=====
SUM 01:000405     25.33    .240     1.00    13.69    .000
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0022-----

```
*#
*# Catchment SA10 (Strittmatter A10, 0.36 hectares)
*# --- Area increased May 2000
*#
```

```
-----
| DESIGN STANDHYD | Area (ha)= .36
| 05:000310 DT=10.00 | Total Imp(%)= 30.00 Dir. Conn.(%)= 20.00
-----
```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.11	.25	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	13.00	13.00	
Length (m)=	48.99	40.00	
Mannings n =	.013	.250	
Max. eff. Inten. (mm/hr)=	98.93	25.97	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.77 (ii)	7.68 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.02	.01	.034 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	49.34	13.71	20.836
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:

- CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0023-----

*#
*# Catchment SA11 (Strittmatter A11, Pond Surface, 0.35 hecatares)
*#

| DESIGN STANDHYD | Area (ha)= .35
| 06:000311 DT=10.00 | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00

		IMPERVIOUS	PERVIOUS (i)	
Surface Area	(ha)=	.35	.00	
Dep. Storage	(mm)=	.80	1.50	
Average Slope	(%)=	.10	.10	
Length	(m)=	48.30	40.00	
Mannings n	=	.013	.250	
Max.eff.Inten.(mm/hr)=		98.93	67.48	
over (min)		10.00	20.00	
Storage Coeff. (min)=		3.31 (ii)	23.60 (ii)	
Unit Hyd. Tpeak (min)=		10.00	20.00	
Unit Hyd. peak (cms)=		.16	.05	
				TOTALS
PEAK FLOW	(cms)=	.09	.00	.092 (iii)
TIME TO PEAK	(hrs)=	1.00	1.17	1.000
RUNOFF VOLUME	(mm)=	49.34	43.95	49.281
TOTAL RAINFALL	(mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT	=	.98	.88	.983

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0024-----

*# Add hydrograph from Strittmatter A10 and A11 to hydrograph #405
*#

ADD HYD (000409)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 01:000405	25.33	.240	1.00	13.69	.000
	+ID2 05:000310	.36	.034	1.00	20.84	.000
	+ID3 06:000311	.35	.092	1.00	49.28	.000
	=====					
	SUM 02:000409	26.04	.366	1.00	14.27	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0025-----

*#
*# Add in Areas A1, A2 and A3 from the County Road
*# and route total flow through proposed SWM area
*#

*#
 *# Catchment A1 from Triton Study (2.4 hectares, C= 0.5)
 *#

```
-----
| DESIGN STANDHYD | Area (ha)= 2.40
| 01:000101 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.96	1.44	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	5.00	5.00	
Length (m)=	126.49	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	20.18	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.82 (ii)	11.99 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.26	.05	.312 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	27.145
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.541

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 001:0026-----

*#
 *# Catchment A2 from Triton Study (0.25 hectares, C= 0.5)
 *#

```
-----
| DESIGN STANDHYD | Area (ha)= .25
| 04:000102 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.10	.15	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	5.00	5.00	
Length (m)=	40.82	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	20.18	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.92 (ii)	11.10 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.03	.01	.033 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	27.144
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.541

*** WARNING: Storage Coefficient is smaller than DT!

Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0027-----

*# Add hydrographs from Catchments A1 and A2

ADD HYD (000201)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000101	2.40	.312	1.00	27.14	.000
+ID2	04:000102	.25	.033	1.00	27.14	.000
SUM	05:000201	2.65	.344	1.00	27.14	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0028-----

*#
*# Catchment A3 from Triton Study (0.68 hectares, C= 0.5)
*#

DESIGN STANDHYD	Area (ha)=	PERVIOUS (i)
01:000103 DT=10.00	.68	
	Total Imp(%)= 40.00	Dir. Conn.(%)= 40.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.27	.41	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	6.00	6.00	
Length (m)=	67.33	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	20.18	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.18 (ii)	10.81 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.07	.01	.089 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	27.145
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.541

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0029-----

*# Add hydrographs from Catchments A3 to hydrograph #201
*# representing total highway flow to be routed through SWM facility
*#

```

-----
| ADD HYD (000202) | ID: NHYD      AREA      QPEAK      TPEAK      R.V.      DWF
-----
                        (ha)      (cms)      (hrs)      (mm)      (cms)
      ID1 01:000103      .68      .089      1.00      27.14      .000
+ID2 05:000201      2.65      .344      1.00      27.14      .000
=====
      SUM 04:000202      3.33      .434      1.00      27.14      .000
    
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
001:0030-----
*#
*#   Direct minor system flows to SWM Area, major system stays on County Road
*#
    
```

```

-----
| COMPUTE DUALHYD | Average inlet capacities [CINLET] = .450 (cms)
| TotalHyd 04:000202 | Number of inlets in system [NINLET] = 1
-----
                        Total minor system capacity = .450 (cms)
                        Total major system storage [TMJSTO] = 0.(cu.m.)
    
```

```

      ID: NHYD      AREA      QPEAK      TPEAK      R.V.      DWF
                        (ha)      (cms)      (hrs)      (mm)      (cms)
TOTAL HYD.  04:000202      3.33      .434      1.000      27.145      .000
=====
MAJOR SYST  01:000412      .00      .000      .000      .000      .000
MINOR SYST  05:000413      3.33      .434      1.000      27.145      .000
    
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
001:0031-----
*#   Add minor highway drainage (hyd #202) to Strittmatter drainage (hyd #409)
    
```

```

-----
| ADD HYD (000203) | ID: NHYD      AREA      QPEAK      TPEAK      R.V.      DWF
-----
                        (ha)      (cms)      (hrs)      (mm)      (cms)
      ID1 05:000413      3.33      .434      1.00      27.14      .000
+ID2 02:000409      26.04      .366      1.00      14.27      .000
=====
      SUM 06:000203      29.37      .800      1.00      15.73      .000
    
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
001:0032-----
*#   Strittmatter SWM Area
*#   Original Rating Curve (February 1990) revised July 1999 - same storage
*#
*#   Changed Low Flow Outlet Dec. 1, 1999 (from 150mm to 450mm)
*#   Changed Rating Curve (April 2000) with pond redesign
*#
    
```

```

-----
| ROUTE RESERVOIR | Requested routing time step = 10.0 min.
| IN>06:(000203) |
| OUT<02:(000406) |
=====
      OUTFLOW STORAGE | OUTFLOW STORAGE
      (cms) (ha.m.) | (cms) (ha.m.)
      .000 .0000E+00 | .288 .7330E-01
      .070 .2600E-02 | .318 .8780E-01
      .090 .4500E-02 | .345 .1032E+00
      .121 .1070E-01 | .378 .1256E+00
      .146 .2100E-01 | .428 .1713E+00
    
```

.202 .4640E-01 | .448 .1940E+00
 .277 .6870E-01 | .467 .2188E+00

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000203)	29.37	.800	1.000	15.729
OUTFLOW <02: (000406)	29.37	.271	1.500	15.729
OVERFLOW <05: (000408)	.00	.000	.000	.000

PEAK FLOW REDUCTION [Qout/Qin] (%) = 33.937
 TIME SHIFT OF PEAK FLOW (min) = 30.00
 MAXIMUM STORAGE USED (ha.m.) = .6759E-01

 001:0033-----

 | PRINT HYD | AREA (ha) = 29.370
 | ID=02 (000406) | QPEAK (cms) = .271 (i)
 | DT=10.00 PCYC= 5 | TPEAK (hrs) = 1.500

 | VOLUME (mm) = 15.729

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

TIME hrs	FLOW cms	TIME hrs	FLOW cms	TIME hrs	FLOW cms	TIME hrs	FLOW cms	TIME hrs	FLOW cms
.00	.000	19.17	.015	38.33	.002	57.50	.000	76.67	.000
.83	.103	20.00	.014	39.17	.002	58.33	.000	77.50	.000
1.67	.264	20.83	.013	40.00	.002	59.17	.000	78.33	.000
2.50	.193	21.67	.012	40.83	.002	60.00	.000	79.17	.000
3.33	.144	22.50	.011	41.67	.002	60.83	.000	80.00	.000
4.17	.076	23.33	.010	42.50	.002	61.67	.000	80.83	.000
5.00	.053	24.17	.009	43.33	.001	62.50	.000	81.67	.000
5.83	.051	25.00	.008	44.17	.001	63.33	.000	82.50	.000
6.67	.050	25.83	.008	45.00	.001	64.17	.000	83.33	.000
7.50	.046	26.67	.007	45.83	.001	65.00	.000	84.17	.000
8.33	.042	27.50	.007	46.67	.001	65.83	.000	85.00	.000
9.17	.039	28.33	.006	47.50	.001	66.67	.000	85.83	.000
10.00	.036	29.17	.006	48.33	.001	67.50	.000	86.67	.000
10.83	.033	30.00	.005	49.17	.001	68.33	.000	87.50	.000
11.67	.031	30.83	.005	50.00	.001	69.17	.000	88.33	.000
12.50	.028	31.67	.004	50.83	.001	70.00	.000	89.17	.000
13.33	.026	32.50	.004	51.67	.001	70.83	.000	90.00	.000
14.17	.024	33.33	.004	52.50	.001	71.67	.000	90.83	.000
15.00	.022	34.17	.003	53.33	.001	72.50	.000	91.67	.000
15.83	.020	35.00	.003	54.17	.000	73.33	.000	92.50	.000
16.67	.019	35.83	.003	55.00	.000	74.17	.000	93.33	.000
17.50	.017	36.67	.003	55.83	.000	75.00	.000		
18.33	.016	37.50	.002	56.67	.000	75.83	.000		

 001:0034-----

*#
 *#
 *# Catchment SA7 - Strittmatter road drainage d\s of SWM area - uncontrolled
 *# (Strittmatter A7, 0.32 hectares)
 *#

 | DESIGN STANDHYD | Area (ha) = .32
 | 07:000307 DT=10.00 | Total Imp(%) = 30.00 Dir. Conn.(%) = 20.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha) =	.10	.22
Dep. Storage (mm) =	.80	1.50
Average Slope (%) =	2.00	2.00

Length	(m)=	46.19	40.00	
Mannings n	=	.013	.250	
Max.eff.Inten.(mm/hr)=		98.93	25.97	
over (min)		10.00	10.00	
Storage Coeff. (min)=		1.31 (ii)	13.41 (ii)	
Unit Hyd. Tpeak (min)=		10.00	10.00	
Unit Hyd. peak (cms)=		.17	.09	
				TOTALS
PEAK FLOW (cms)=		.02	.01	.027 (iii)
TIME TO PEAK (hrs)=		1.00	1.17	1.000
RUNOFF VOLUME (mm)=		49.34	13.71	20.836
TOTAL RAINFALL (mm)=		50.14	50.14	50.135
RUNOFF COEFFICIENT =		.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0035-----

*# Catchment SA8 (Strittmatter A8, 0.46 hectares)
*# NOT ROUTED INTO POND>>> FLOWS UNCONTROLLED DOWN ROAD
*# --- Area changed May 2000
*#

DESIGN STANDHYD		Area (ha)=	.46		
05:000308 DT=10.00		Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

		IMPERVIOUS	PERVIOUS (i)	
Surface Area	(ha)=	.14	.32	
Dep. Storage	(mm)=	.80	1.50	
Average Slope	(%)=	2.00	2.00	
Length	(m)=	55.38	40.00	
Mannings n	=	.013	.250	
Max.eff.Inten.(mm/hr)=		98.93	25.97	
over (min)		10.00	10.00	
Storage Coeff. (min)=		1.46 (ii)	13.57 (ii)	
Unit Hyd. Tpeak (min)=		10.00	10.00	
Unit Hyd. peak (cms)=		.17	.09	
				TOTALS
PEAK FLOW (cms)=		.03	.01	.038 (iii)
TIME TO PEAK (hrs)=		1.00	1.17	1.000
RUNOFF VOLUME (mm)=		49.34	13.71	20.836
TOTAL RAINFALL (mm)=		50.14	50.14	50.135
RUNOFF COEFFICIENT =		.98	.27	.416

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0036-----

*#
 *# Catchment SA9 - Strittmatter road drainage d\s of SWM area
 *# NOT ROUTED INTO POND>>>> FLOWS UNCONTROLLED DOWN ROAD
 *# (Strittmatter A9, 0.08 hectares, C= 0.95)
 *#

```
-----
| DESIGN STANDHYD | Area (ha)= .08
| 09:000410 DT=10.00 | Total Imp(%)= 95.00 Dir. Conn.(%)= 95.00
-----
```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.08	.00	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	23.09	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	20.18	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.86 (ii)	14.25 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.09	
			TOTALS
PEAK FLOW (cms)=	.02	.00	.021 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	47.486
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.947

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0037-----
 *# Add SWM area discharge to uncontrolled road drainage (hyd #410)

```
-----
| ADD HYD (000411) | ID: NHYD      AREA      QPEAK      TPEAK      R.V.      DWF
-----
|                   |              (ha)      (cms)      (hrs)      (mm)      (cms)
|                   | ID1 05:000308  .46      .038      1.00      20.84     .000
|                   | +ID2 07:000307  .32      .027      1.00      20.84     .000
|                   | +ID3 02:000406 29.37     .271      1.50      15.73     .000
|                   | +ID4 09:000410  .08      .021      1.00      47.49     .000
|                   |=====
|                   | SUM 04:000411 30.23     .302      1.33      15.94     .000
-----
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0038-----
 *#
 *# Add major system overflow from diversion to County Road drainage
 *# below diversion (Areas A4 and A5)
 *#

```
-----
| ADD HYD (000414) | ID: NHYD      AREA      QPEAK      TPEAK      R.V.      DWF
-----
|                   | ID1 01:000412  .00      .000      .00      .00      .000 **DRY**
|                   | +ID2 03:000204  .37      .049      1.00      27.14     .000
-----
```

=====
 SUM 02:000414 .37 .049 1.00 27.14 .000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

 001:0039-----

*# Church Street Intersection
 *#
 *# Add hydrograph from Strittmatter Property (hyd #411)
 *# to County Road 24 Drainage at Church Street
 *#

ADD HYD (000205)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 02:000414		.37	.049	1.00	27.14	.000
+ID2 04:000411		30.23	.302	1.33	15.94	.000
SUM 01:000205		30.60	.317	1.33	16.08	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

 001:0040-----

*# Catchment A6 from Triton Study (0.31 hectares, C= 0.6)
 *#

DESIGN STANDHYD	Area (ha)=	PERVIOUS (i)
02:000106 DT=10.00	.31	
	Total Imp(%)= 50.00	Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.16	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	4.00	4.00	
Length (m)=	45.46	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	20.18	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.05 (ii)	11.93 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.04	.01	.048 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	30.843
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.615

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 001:0041-----

*# Add hydrograph from Catchments A6 to Upstream Hydrograph

ADD HYD (000206)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
------------------	----------	------	-------	-------	------	-----

	(ha)	(cms)	(hrs)	(mm)	(cms)
ID1 01:000205	30.60	.317	1.33	16.08	.000
+ID2 02:000106	.31	.048	1.00	30.84	.000
SUM 03:000206	30.91	.348	1.00	16.23	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0042-----

*#

*# Catchment A7 from Triton Study (0.24 hectares, C= 0.7)

*#

DESIGN STANDHYD	Area (ha)=	Total Imp(%)=	Dir. Conn.(%)=
01:000107 DT=10.00	.24	60.00	60.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.14	.10	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	40.00	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	98.93	16.78	
over (min)	10.00	20.00	
Storage Coeff. (min)=	1.20 (ii)	15.62 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	.17	.06	
			TOTALS
PEAK FLOW (cms)=	.04	.00	.041 (iii)
TIME TO PEAK (hrs)=	1.00	1.33	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	34.542
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.689

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0043-----

*#

*# Catchment A8 from Triton Study (0.30 hectares, C= 0.7)

*#

DESIGN STANDHYD	Area (ha)=	Total Imp(%)=	Dir. Conn.(%)=
02:000108 DT=10.00	.30	60.00	60.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.18	.12
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	4.00	4.00
Length (m)=	44.72	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	98.93	20.18
over (min)	10.00	10.00

Storage Coeff. (min)=	1.04 (ii)	11.92 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.10	
			TOTALS
PEAK FLOW (cms)=	.05	.00	.054 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	49.34	12.35	34.541
TOTAL RAINFALL (mm)=	50.14	50.14	50.135
RUNOFF COEFFICIENT =	.98	.25	.689

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0044-----

*# Add hydrographs from Catchments A7 and A8

ADD HYD (000207)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 02:000108	.30	.054	1.00	34.54	.000
	+ID2 01:000107	.24	.041	1.00	34.54	.000
=====						
	SUM 04:000207	.54	.094	1.00	34.54	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0045-----

*# Add summed hydrographs from Catchments A7+A8 to Upstream Hydrograph

ADD HYD (000208)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 03:000206	30.91	.348	1.00	16.23	.000
	+ID2 04:000207	.54	.094	1.00	34.54	.000
=====						
	SUM 01:000208	31.45	.443	1.00	16.54	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0046-----

*#

*# Catchment A9 from Triton Study (0.32 hectares, C= 0.7)

*#

DESIGN STANDHYD	Area (ha)=	.32		
02:000109 DT=10.00	Total Imp(%)=	60.00	Dir. Conn.(%)=	60.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.19	.13
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	.20	.20
Length (m)=	46.19	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	98.93	13.92
over (min)	10.00	30.00

```

Storage Coeff. (min)=      2.62 (ii)  33.60 (ii)
Unit Hyd. Tpeak (min)=    10.00      30.00
Unit Hyd. peak (cms)=     .17        .03
                                     *TOTALS*
PEAK FLOW (cms)=          .05        .00      .053 (iii)
TIME TO PEAK (hrs)=       1.00        1.50      1.000
RUNOFF VOLUME (mm)=      49.34       12.35     34.542
TOTAL RAINFALL (mm)=     50.14       50.14     50.135
RUNOFF COEFFICIENT =     .98         .25      .689
    
```

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0047-----

```

*# Add hydrograph from Catchments A9 to upstream drainage
*#
*# THIS IS THE FLOW AT MH 56 WHICH IS THE LIMITING CONSTRAINT....
*# 5 year - 0.68 cms
*# 100 year - 1.29 cms
*#
    
```

ADD HYD (000209)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000208	31.45	.443	1.00	16.54	.000
+ID2	02:000109	.32	.053	1.00	34.54	.000
SUM	03:000209	31.77	.495	1.00	16.72	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0048-----

```

*#
*# Catchment A10 from Triton Study (0.21 hectares, C= 0.7)
*#
    
```

DESIGN STANDHYD	Area (ha)=	Total Imp(%)=	Dir. Conn.(%)=
04:000110 DT=10.00	.21	60.00	60.00

```

                                     IMPERVIOUS    PERVIOUS (i)
Surface Area (ha)=                   .13          .08
Dep. Storage (mm)=                   .80          1.50
Average Slope (%)=                   1.00          1.00
Length (m)=                          37.42         40.00
Mannings n =                         .013          .250

Max.eff.Inten.(mm/hr)=                98.93         16.78
over (min)                            10.00         20.00
Storage Coeff. (min)=                 1.42 (ii)     19.17 (ii)
Unit Hyd. Tpeak (min)=                10.00         20.00
Unit Hyd. peak (cms)=                 .17           .06
                                     *TOTALS*
PEAK FLOW (cms)=                      .03           .00      .036 (iii)
TIME TO PEAK (hrs)=                   1.00          1.33      1.000
RUNOFF VOLUME (mm)=                   49.34         12.35     34.542
TOTAL RAINFALL (mm)=                   50.14         50.14     50.135
    
```

RUNOFF COEFFICIENT = .98 .25 .689

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0049

*# Add hydrograph from Catchment A10 to Upstream Hydrograph
*# represents total catchment flow to Credit River

Table with 7 columns: ADD HYD (000204), ID, AREA (ha), QPEAK (cms), TPEAK (hrs), R.V. (mm), DWF (cms). Rows include ID1 03:000209, +ID2 04:000110, and SUM 01:000204.

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0050

FINISH

WARNINGS / ERRORS / NOTES

- 0003 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0004 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0006 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0007 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0009 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0011 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0013 DESIGN NASHYD
*** WARNING: Time step is too large for value of TP.
R.V. may be ok. Peak flow could be off.
0014 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0018 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0022 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0023 DESIGN STANDHYD

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0025 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0026 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0028 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0034 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0035 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0036 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0040 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0042 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0043 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0046 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

0048 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

Simulation ended on 2000-06-01 at 10:47:07

=====

```

SSSSS W W M M H H Y Y M M OOO 999 55555 =====
S W W W MM MM H H Y Y MM MM O O 9 9 5 =====
SSSSS W W W M M M H H H H Y M M M O O ## 9 9 5 Ver. 3.1
S W W M M H H Y M M O O 9999 5555 Oct. 1997
SSSSS W W M M H H Y M M OOO 9 5 =====
9 9 5 # 3877524
StormWater Management Hydrologic Model 999 5555 =====

```

```

*****
***** SWMHYMO-95w Ver/3.1 *****
***** A single event and continuous hydrologic simulation model *****
***** based on the principles of HYMO and its successors *****
***** OTTHYMO-83 and OTTHYMO-89. *****
***** Distributed by: J.F. Sabourin and Associates Inc. *****
***** Ottawa, Ontario: (613) 727-5199 *****
***** Gatineau, Quebec: (819) 243-6858 *****
***** E-Mail: swmhymo@jfsa.Com *****
*****

```

```

+++++ Licensed user: R.J. Burnside & Associates Ltd. +++++
+++++ Brampton SERIAL#:3877524 +++++
+++++

```

```

*****
***** +++++ PROGRAM ARRAY DIMENSIONS +++++ *****
***** Maximum value for ID numbers : 10 *****
***** Max. number of rainfall points: 5000 *****
***** Max. number of flow points : 5000 *****
*****

```

```

***** D E T A I L E D O U T P U T *****
*****
* DATE: 2000-06-01 TIME: 10:47:39 RUN COUNTER: 001100 *
*****
* Input filename: I:\LORENA\S-405\CORREC~1\MAY00\ULT100.DAT *
* Output filename: I:\LORENA\S-405\CORREC~1\MAY00\ULT100.out *
* Summary filename: I:\LORENA\S-405\CORREC~1\MAY00\ULT100.sum *
* User comments: *
* 1: _____ *
* 2: _____ *
* 3: _____ *
*****

```

```

-----
001:0001-----
*# *****
*# Project Name: [ Strittmatter Development, Hillsburgh] Project Number: [S-405
*# Date : 12-17-1998
*# Modeller : [LD]
*# Company : R. J. Burnside & Associates Ltd.
*# License # : 3877524
*# *****
*# Hydrologic analysis of County Road 24 stormsewer system combined with
*# Strittmatter Development at the north end of the village of Hillsburgh.
*#
*# McMurphy Berm added May '99
*#

```

```
*# 100 year storm event
*#
*# Data from County Rd. 24 Stormsewer Analysis (Triton) used
*# for Road Catchments. Strittmatter Development discharge
*# includes stormwater controls
*#
*# Made modifications to this file to route the road portion or upper canada SA
*# into the pond and let the external property SA8 flow uncontrolled. This fil
*# was run to obtain volume requirements for the pond to store throttle the 100
*# year flows of the ultimate condition. Lot 1 was made available as pond area
*# so SA10 decreased 0.32 ha and SA11 increased the same amount.
*#
*# File was further modified to let SA9 flow uncontrolled off site
*#
*# File was further modified to collect some of the drainage from SA8 at the
*# south end of Lot 1. SA8 area decreased to 0.46 ha and SA10 area increased
*# to 0.36 ha. Change in response to Triton comments May 19, 2000
*#
```

```
-----
| START          | Project dir.: I:\LORENA\S-405\CORREC~1\MAY00\
----- Rainfall dir.: I:\LORENA\S-405\CORREC~1\MAY00\
  TZERO =   .00 hrs on      0
  METOUT=   2 (output = METRIC)
  NRUN  =  001
  NSTORM=   0
-----
```

```
001:0002-----
*READ STORM          STORM_FILENAME=["c:\S-405\swmhymo\hazel.stm"]
-----
```

```
| CHICAGO STORM | IDF curve parameters: A=3113.230
| Ptotal= 98.95 mm | B= 21.416
|                   | C= .857
used in: INTENSITY = A / (t + B)^C

Duration of storm = 3.00 hrs
Storm time step   = 10.00 min
Time to peak ratio = .33
```

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.17	9.785	1.00	162.238	1.83	20.114	2.67	9.361
.33	12.748	1.17	85.475	2.00	16.483	2.83	8.425
.50	18.030	1.33	50.208	2.17	13.904	3.00	7.655
.67	29.523	1.50	34.281	2.33	11.990		
.83	67.430	1.67	25.529	2.50	10.521		

```
001:0003-----
*# Catchment A4 from Triton Study (0.09 hectares, C= 0.5)
*#
```

```
-----
| DESIGN STANDHYD | Area (ha)= .09
| 01:000104 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.05
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	6.00	6.00
Length (m)=	24.49	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	162.24	56.88

over (min)	10.00	10.00	
Storage Coeff. (min)=	.53 (ii)	6.89 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.13	
			TOTALS
PEAK FLOW (cms)=	.02	.01	.023 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	39.52	62.969
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.636

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0004-----

*#
*# Catchment A5 from Triton Study (0.28 hectares, C= 0.5)
*#

DESIGN STANDHYD	Area (ha)=	.28		
02:000105 DT=10.00	Total Imp(%)=	40.00	Dir. Conn.(%)=	40.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.11	.17	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	6.00	6.00	
Length (m)=	43.20	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.74 (ii)	7.10 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.13	
			TOTALS
PEAK FLOW (cms)=	.05	.02	.072 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	39.52	62.969
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.636

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0005-----

*# Add summed hydrographs from Catchments A5 to A4

ADD HYD (000204) ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
	(ha)	(cms)	(hrs)	(mm)	(cms)
ID1 01:000104	.09	.023	1.00	62.97	.000

+ID2 02:000105	.28	.072	1.00	62.97	.000
=====					
SUM 03:000204	.37	.095	1.00	62.97	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0006-----

*#
 *# Proposed Strittmatter Development
 *#
 *# Catchment SA1 (Strittmatter A1, 0.54 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.54		
01:000301 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.38	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	60.00	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.11 (ii)	8.26 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.05	.06	.105 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0007-----

*#
 *# Catchment SA2 (Strittmatter A2, 0.53 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	.53		
02:000302 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.37	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	59.44	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	

Storage Coeff. (min)=	1.11 (ii)	8.25 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.05	.06	.103 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0008-----

*# Add hydrographs from Strittmatter A1 and A2

ADD HYD (000401)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 01:000301	.54	.105	1.00	53.88	.000
	+ID2 02:000302	.53	.103	1.00	53.88	.000
	SUM 04:000401	1.07	.209	1.00	53.88	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0009-----

*#
*# Catchment SA3 (Strittmatter A3, 0.41 hectares)
*#

DESIGN STANDHYD	Area (ha)=	.41		
01:000303 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.12	.29	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	52.28	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.03 (ii)	8.17 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.04	.04	.080 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:

- CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0010-----

*# Add hydrographs from Strittmatter A3 to Strittmatter (A1+A2)

ADD HYD (000402)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000303		.41	.080	1.00	53.88	.000
+ID2 04:000401		1.07	.209	1.00	53.88	.000
SUM 02:000402		1.48	.289	1.00	53.88	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0011-----

*#
 *# Catchment SA4 (Strittmatter A4, 0.41 hectares)
 *#

DESIGN STANDHYD	Area (ha)=	Total Imp(%)=	Dir. Conn.(%)=
01:000304 DT=10.00	.41	30.00	20.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.12	.29	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	52.28	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.03 (ii)	8.17 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.04	.04	.080 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0012-----

*# Add hydrographs from Strittmatter A4 to Strittmatter Upstream Drainage

ADD HYD (000403)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000304		.41	.080	1.00	53.88	.000
+ID2 02:000402		1.48	.289	1.00	53.88	.000

=====
 SUM 04:000403 1.89 .369 1.00 53.88 .000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

 001:0013-----

```
*#
*# Catchment SA5 (Strittmatter A5, 22.4 hectares of upstream
*# agricultural drainage)
*#
*#
*# Dec.1,1999: This area, known as the McMurchy Property is assumed to be
*# developed for the purpose of sizing a PRELIMINARY stormwater facility.
*#
*# Total Area: 22.4 hectares
*# Assume:      10.0 hectares non-developable
*#              12.4 hectares developable (30% impervious)
*#
*# Note: Although site exhibits extremely high infiltration capacity, average
*# runoff potential is assumed for the purpose of sizing future stormwater
*# facility. It is expected that at-source runoff controls (ie. infiltration
*# facilities)will be implemented to reduce runoff potential for the developme
*#
```

```
-----
| DESIGN NASHYD      | Area (ha)= 10.00 Curve Number (CN)=58.00
| 01:000305 DT=15.00 | Ia (mm)= 1.500 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= .320
```

```
Unit Hyd Qpeak (cms)= 1.194

PEAK FLOW (cms)= .744 (i)
TIME TO PEAK (hrs)= 1.333
RUNOFF VOLUME (mm)= 28.013
TOTAL RAINFALL (mm)= 98.950
RUNOFF COEFFICIENT = .283
```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

*** WARNING: Time step is too large for value of TP.
 R.V. may be ok. Peak flow could be off.

 001:0014-----

```
-----
| DESIGN STANDHYD   | Area (ha)= 12.40
| 02:000398 DT=15.00 | Total Imp(%)= 30.00 Dir. Conn.(%)= 20.00
-----
```

```

IMPERVIOUS      PERVIOUS (i)
Surface Area (ha)= 3.72      8.68
Dep. Storage (mm)= .80      1.50
Average Slope (%)= 5.00      5.00
Length (m)= 287.52      40.00
Mannings n = .013      .250

Max.eff.Inten.(mm/hr)= 162.24      59.89
                  over (min) 10.00      10.00
Storage Coeff. (min)= 2.45 (ii)      9.03 (ii)
Unit Hyd. Tpeak (min)= 10.00      10.00
Unit Hyd. peak (cms)= .17      .11
```

```
*TOTALS*
PEAK FLOW (cms)= 1.11      1.05      2.150 (iii)
TIME TO PEAK (hrs)= 1.00      1.17      1.000
```

RUNOFF VOLUME (mm)= 87.84 30.72 42.142
 TOTAL RAINFALL (mm)= 98.95 98.95 98.950
 RUNOFF COEFFICIENT = .89 .31 .426

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 58.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0015-----

ADD HYD (000399)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000305	10.00	.744	1.33	28.01	.000
+ID2	02:000398	12.40	2.150	1.00	42.14	.000
SUM 09:000399		22.40	2.511	1.00	35.83	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0016-----

ROUTE RESERVOIR	Requested routing time step = 15.0 min.
IN>09:(000399)	
OUT<05:(000101)	
===== OUTFLOW STORAGE TABLE =====	
OUTFLOW (cms)	STORAGE (ha.m.)
.000	.0000E+00
.050	.1850E+00
.080	.4800E+00

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >09: (000399)	22.40	2.511	1.000	35.835
OUTFLOW<05: (000101)	22.40	.157	2.333	35.833
OVERFLOW<08: (000150)	.00	.000	.000	.000

PEAK FLOW REDUCTION [Qout/Qin] (%) = 6.249
 TIME SHIFT OF PEAK FLOW (min) = 80.00
 MAXIMUM STORAGE USED (ha.m.) = .7312E+00

001:0017-----

PRINT HYD	AREA (ha) = 22.400
ID=05 (000101)	QPEAK (cms) = .157 (i)
DT=10.00 PCYC= 5	TPEAK (hrs) = 2.333
	VOLUME (mm) = 35.833

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

TIME FLOW	TIME FLOW	TIME FLOW	TIME FLOW	TIME FLOW	TIME FLOW
hrs cms	hrs cms	hrs cms	hrs cms	hrs cms	hrs cms
.00 .000	22.50 .046	45.00 .005	67.50 .001	90.00 .000	
.83 .015	23.33 .042	45.83 .005	68.33 .001	90.83 .000	
1.67 .114	24.17 .039	46.67 .004	69.17 .000	91.67 .000	
2.50 .157	25.00 .036	47.50 .004	70.00 .000	92.50 .000	
3.33 .145	25.83 .033	48.33 .004	70.83 .000	93.33 .000	

4.17	.133	26.67	.030	49.17	.003	71.67	.000	94.17	.000
5.00	.121	27.50	.028	50.00	.003	72.50	.000	95.00	.000
5.83	.110	28.33	.026	50.83	.003	73.33	.000	95.83	.000
6.67	.101	29.17	.024	51.67	.003	74.17	.000	96.67	.000
7.50	.092	30.00	.022	52.50	.002	75.00	.000	97.50	.000
8.33	.084	30.83	.020	53.33	.002	75.83	.000	98.33	.000
9.17	.079	31.67	.019	54.17	.002	76.67	.000	99.17	.000
10.00	.076	32.50	.017	55.00	.002	77.50	.000	100.00	.000
10.83	.074	33.33	.016	55.83	.002	78.33	.000	100.83	.000
11.67	.072	34.17	.015	56.67	.002	79.17	.000	101.67	.000
12.50	.070	35.00	.014	57.50	.002	80.00	.000	102.50	.000
13.33	.068	35.83	.012	58.33	.001	80.83	.000	103.33	.000
14.17	.066	36.67	.012	59.17	.001	81.67	.000	104.17	.000
15.00	.064	37.50	.011	60.00	.001	82.50	.000	105.00	.000
15.83	.062	38.33	.010	60.83	.001	83.33	.000	105.83	.000
16.67	.060	39.17	.009	61.67	.001	84.17	.000	106.67	.000
17.50	.058	40.00	.008	62.50	.001	85.00	.000	107.50	.000
18.33	.056	40.83	.008	63.33	.001	85.83	.000	108.33	.000
19.17	.055	41.67	.007	64.17	.001	86.67	.000		
20.00	.053	42.50	.007	65.00	.001	87.50	.000		
20.83	.051	43.33	.006	65.83	.001	88.33	.000		
21.67	.050	44.17	.006	66.67	.001	89.17	.000		

001:0018-----

*#
 *# Catchment SA6 (Strittmatter A6, 1.04 hectares)
 *#

 | DESIGN STANDHYD | Area (ha)= 1.04
 | 06:000306 DT=10.00 | Total Imp(%)= 20.00 Dir. Conn.(%)= 10.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.21	.83	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	3.00	3.00	
Length (m)=	83.27	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	69.71	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.36 (ii)	8.58 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.05	.12	.166 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.42	47.996
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.485

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0019-----

*# Add routed hydrograph from Strittmatter A5 (McMurphy Property) to A6

ADD HYD (000420)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	05:000101	22.40	.157	2.33	35.83	.000
+ID2	06:000306	1.04	.166	1.00	48.00	.000
=====						
SUM	07:000420	23.44	.207	1.00	36.37	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0020-----

*# Add OVERFLOW hydrograph from McMurchy Pond

ADD HYD (000421)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	08:000150	.00	.000	.00	.00	.000 **DRY**
+ID2	07:000420	23.44	.207	1.00	36.37	.000
=====						
SUM	05:000421	23.44	.207	1.00	36.37	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0021-----

ADD HYD (000405)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	05:000421	23.44	.207	1.00	36.37	.000
+ID2	04:000403	1.89	.369	1.00	53.88	.000
=====						
SUM	01:000405	25.33	.576	1.00	37.68	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0022-----

*#
 *# Catchment SA10 (Strittmatter A10, 0.36 hectares)
 *# --- Area increased May 2000
 *#

DESIGN STANDHYD	Area (ha)=	.36			
05:000310 DT=10.00	Total Imp(%)=	30.00	Dir. Conn.(%)=	20.00	

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.11	.25	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	13.00	13.00	
Length (m)=	48.99	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.64 (ii)	5.24 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.14	
			TOTALS
PEAK FLOW (cms)=	.03	.04	.077 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0023-----

*#
*# Catchment SA11 (Strittmatter A11, Pond Surface, 0.35 hecatares)
*#

| DESIGN STANDHYD | Area (ha)= .35
| 06:000311 DT=10.00 | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.35	.00	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	.10	.10	
Length (m)=	48.30	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	122.01	
over (min)	10.00	20.00	
Storage Coeff. (min)=	2.71 (ii)	18.73 (ii)	
Unit Hyd. Tpeak (min)=	10.00	20.00	
Unit Hyd. peak (cms)=	.17	.06	
			TOTALS
PEAK FLOW (cms)=	.15	.00	.154 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	98.15	92.53	98.094
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.94	.991

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0024-----

*# Add hydrograph from Strittmatter A10 and A11 to hydrograph #405
*#

ADD HYD (000409)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 01:000405	25.33	.576	1.00	37.68	.000
	+ID2 05:000310	.36	.077	1.00	53.88	.000
	+ID3 06:000311	.35	.154	1.00	98.09	.000
	SUM 02:000409	26.04	.807	1.00	38.72	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0025-----


```
*#
*# Add in Areas A1, A2 and A3 from the County Road
*# and route total flow through proposed SWM area
*#
*#
*# Catchment A1 from Triton Study (2.4 hectares, C= 0.5)
*#
```

```
-----
| DESIGN STANDHYD | Area (ha)= 2.40
| 01:000101 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.96	1.44	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	5.00	5.00	
Length (m)=	126.49	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.50 (ii)	8.21 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.43	.17	.604 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	39.52	62.969
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.636

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0026-----

```
*#
*# Catchment A2 from Triton Study (0.25 hectares, C= 0.5)
*#
```

```
-----
| DESIGN STANDHYD | Area (ha)= .25
| 04:000102 DT=10.00 | Total Imp(%)= 40.00 Dir. Conn.(%)= 40.00
-----
```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.10	.15	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	5.00	5.00	
Length (m)=	40.82	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.76 (ii)	7.48 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.13	
			TOTALS
PEAK FLOW (cms)=	.05	.02	.064 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000

RUNOFF VOLUME (mm)= 98.15 39.52 62.969
 TOTAL RAINFALL (mm)= 98.95 98.95 98.950
 RUNOFF COEFFICIENT = .99 .40 .636

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 001:0027-----

*# Add hydrographs from Catchments A1 and A2

ADD HYD (000201)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000101		2.40	.604	1.00	62.97	.000
+ID2 04:000102		.25	.064	1.00	62.97	.000
SUM 05:000201		2.65	.668	1.00	62.97	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

 001:0028-----

*#

*# Catchment A3 from Triton Study (0.68 hectares, C= 0.5)

*#

DESIGN STANDHYD	Area (ha)=	Dir. Conn. (%)=
01:000103 DT=10.00	.68	40.00
	Total Imp(%)=	40.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.27	.41
Dep. Storage (mm)=	.80	1.50
Average Slope (%)=	6.00	6.00
Length (m)=	67.33	40.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	162.24	56.88
over (min)	10.00	10.00
Storage Coeff. (min)=	.97 (ii)	7.33 (ii)
Unit Hyd. Tpeak (min)=	10.00	10.00
Unit Hyd. peak (cms)=	.17	.13

TOTALS

PEAK FLOW (cms)=	.12	.05	.173 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	39.52	62.969
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.636

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0029-----

*# Add hydrographs from Catchments A3 to hydrograph #201
 *# representing total highway flow to be routed through SWM facility
 *#

ADD HYD (000202)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 01:000103	.68	.173	1.00	62.97	.000
	+ID2 05:000201	2.65	.668	1.00	62.97	.000
=====						
	SUM 04:000202	3.33	.841	1.00	62.97	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0030-----

*#
 *# Direct minor system flows to SWM Area, major system stays on County Road
 *#

COMPUTE DUALHYD	Average inlet capacities [CINLET]	=	.450	(cms)
TotalHyd 04:000202	Number of inlets in system [NINLET]	=	1	
	Total minor system capacity	=	.450	(cms)
	Total major system storage [TMJSTO]	=	0.	(cu.m.)

	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
TOTAL HYD.	04:000202	3.33	.841	1.000	62.969	.000
=====						
MAJOR SYST	01:000412	.47	.391	1.000	62.969	.000
MINOR SYST	05:000413	2.86	.450	1.000	62.969	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0031-----

*# Add minor highway drainage (hyd #202) to Strittmatter drainage (hyd #409)

ADD HYD (000203)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 05:000413	2.86	.450	1.00	62.97	.000
	+ID2 02:000409	26.04	.807	1.00	38.72	.000
=====						
	SUM 06:000203	28.90	1.257	1.00	41.12	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0032-----

*# Strittmatter SWM Area
 *# Original Rating Curve (February 1990) revised July 1999 - same storage
 *#
 *# Changed Low Flow Outlet Dec. 1, 1999 (from 150mm to 450mm)
 *# Changed Rating Curve (April 2000) with pond redesign
 *#

ROUTE RESERVOIR	Requested routing time step = 10.0 min.			
IN>06:(000203)				
OUT<02:(000406)				
=====				
	OUTFLOW	STORAGE	OUTFLOW	STORAGE
	(cms)	(ha.m.)	(cms)	(ha.m.)
	.000	.0000E+00	.288	.7330E-01

.070	.2600E-02		.318	.8780E-01
.090	.4500E-02		.345	.1032E+00
.121	.1070E-01		.378	.1256E+00
.146	.2100E-01		.428	.1713E+00
.202	.4640E-01		.448	.1940E+00
.277	.6870E-01		.467	.2188E+00

ROUTING RESULTS	AREA	QPEAK	TPEAK	R.V.
-----	(ha)	(cms)	(hrs)	(mm)
INFLOW >06: (000203)	28.90	1.257	1.000	41.118
OUTFLOW <02: (000406)	28.90	.435	1.833	41.118
OVERFLOW <05: (000408)	.00	.000	.000	.000

PEAK FLOW REDUCTION [Qout/Qin] (%) = 34.587
 TIME SHIFT OF PEAK FLOW (min) = 50.00
 MAXIMUM STORAGE USED (ha.m.) = .1794E+00

001:0033-----

PRINT HYD	AREA	(ha) =	28.904
ID=02 (000406)	QPEAK	(cms) =	.435 (i)
DT=10.00 PCYC= 5	TPEAK	(hrs) =	1.833
-----	VOLUME	(mm) =	41.118

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

TIME	FLOW	TIME	FLOW	TIME	FLOW	TIME	FLOW	TIME	FLOW
hrs	cms	hrs	cms	hrs	cms	hrs	cms	hrs	cms
.00	.000	22.50	.046	45.00	.005	67.50	.001	90.00	.000
.83	.154	23.33	.043	45.83	.005	68.33	.001	90.83	.000
1.67	.433	24.17	.039	46.67	.004	69.17	.000	91.67	.000
2.50	.421	25.00	.036	47.50	.004	70.00	.000	92.50	.000
3.33	.370	25.83	.033	48.33	.004	70.83	.000	93.33	.000
4.17	.268	26.67	.031	49.17	.003	71.67	.000	94.17	.000
5.00	.185	27.50	.028	50.00	.003	72.50	.000	95.00	.000
5.83	.151	28.33	.026	50.83	.003	73.33	.000	95.83	.000
6.67	.127	29.17	.024	51.67	.003	74.17	.000	96.67	.000
7.50	.104	30.00	.022	52.50	.002	75.00	.000	97.50	.000
8.33	.091	30.83	.021	53.33	.002	75.83	.000	98.33	.000
9.17	.080	31.67	.019	54.17	.002	76.67	.000	99.17	.000
10.00	.077	32.50	.017	55.00	.002	77.50	.000	100.00	.000
10.83	.075	33.33	.016	55.83	.002	78.33	.000	100.83	.000
11.67	.073	34.17	.015	56.67	.002	79.17	.000	101.67	.000
12.50	.070	35.00	.014	57.50	.002	80.00	.000	102.50	.000
13.33	.068	35.83	.013	58.33	.001	80.83	.000	103.33	.000
14.17	.066	36.67	.012	59.17	.001	81.67	.000	104.17	.000
15.00	.064	37.50	.011	60.00	.001	82.50	.000	105.00	.000
15.83	.062	38.33	.010	60.83	.001	83.33	.000	105.83	.000
16.67	.060	39.17	.009	61.67	.001	84.17	.000	106.67	.000
17.50	.058	40.00	.008	62.50	.001	85.00	.000	107.50	.000
18.33	.057	40.83	.008	63.33	.001	85.83	.000	108.33	.000
19.17	.055	41.67	.007	64.17	.001	86.67	.000		
20.00	.053	42.50	.007	65.00	.001	87.50	.000		
20.83	.052	43.33	.006	65.83	.001	88.33	.000		
21.67	.050	44.17	.006	66.67	.001	89.17	.000		

001:0034-----

*#
 *#
 *# Catchment SA7 - Strittmatter road drainage d\s of SWM area - uncontrolled
 *# (Strittmatter A7, 0.32 hectares)
 *#

```

-----
| DESIGN STANDHYD | Area (ha)= .32
| 07:000307 DT=10.00 | Total Imp(%)= 30.00 Dir. Conn.(%)= 20.00
-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.10	.22	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	46.19	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.08 (ii)	9.14 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.03	.03	.061 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
001:0035-----

```

```

*# Catchment SA8 (Strittmatter A8, 0.46 hectares)
*# NOT ROUTED INTO POND>>>> FLOWS UNCONTROLLED DOWN ROAD
*# --- Area changed May 2000
*#

```

```

-----
| DESIGN STANDHYD | Area (ha)= .46
| 05:000308 DT=10.00 | Total Imp(%)= 30.00 Dir. Conn.(%)= 20.00
-----

```

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.14	.32	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	55.38	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	71.61	
over (min)	10.00	10.00	
Storage Coeff. (min)=	1.20 (ii)	9.27 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.04	.05	.087 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	42.82	53.883
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.43	.545

*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0036-----

*#
 *# Catchment SA9 - Strittmatter road drainage d\s of SWM area
 *# NOT ROUTED INTO POND>>>> FLOWS UNCONTROLLED DOWN ROAD
 *# (Strittmatter A9, 0.08 hectares, C= 0.95)
 *#

| DESIGN STANDHYD | Area (ha)= .08
 | 09:000410 DT=10.00 | Total Imp(%)= 95.00 Dir. Conn.(%)= 95.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.08	.00	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	23.09	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.71 (ii)	9.55 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.03	.00	.035 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	98.15	39.49	95.217
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.962

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0037-----

*# Add SWM area discharge to uncontrolled road drainage (hyd #410)

ADD HYD (000411)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 05:000308	.46	.087	1.00	53.88	.000
	+ID2 07:000307	.32	.061	1.00	53.88	.000
	+ID3 02:000406	28.90	.435	1.83	41.12	.000
	+ID4 09:000410	.08	.035	1.00	95.22	.000
	SUM 04:000411	29.76	.499	1.17	41.60	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0038-----

*#

*# Add major system overflow from diversion to County Road drainage
 *# below diversion (Areas A4 and A5)
 *#

ADD HYD (000414)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	01:000412	.47	.391	1.00	62.97	.000
+ID2	03:000204	.37	.095	1.00	62.97	.000
=====						
SUM	02:000414	.84	.486	1.00	62.97	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0039-----

*# Church Street Intersection
 *#
 *# Add hydrograph from Strittmatter Property (hyd #411)
 *# to County Road 24 Drainage at Church Street
 *#

ADD HYD (000205)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	02:000414	.84	.486	1.00	62.97	.000
+ID2	04:000411	29.76	.499	1.17	41.60	.000
=====						
SUM	01:000205	30.60	.938	1.00	42.18	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0040-----

*# Catchment A6 from Triton Study (0.31 hectares, C= 0.6)
 *#

DESIGN STANDHYD	Area (ha)=	PERVIOUS (i)
02:000106 DT=10.00	.31	
	Total Imp(%)= 50.00	Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.16	.16	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	4.00	4.00	
Length (m)=	45.46	40.00	
Mannings n =	.013	.250	
Max.eff.Inten.(mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.87 (ii)	8.05 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.12	
			TOTALS
PEAK FLOW (cms)=	.07	.02	.088 (iii)
TIME TO PEAK (hrs)=	1.00	1.00	1.000
RUNOFF VOLUME (mm)=	98.15	39.51	68.833
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.696

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL

THAN THE STORAGE COEFFICIENT.
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 001:0041-----

*# Add hydrograph from Catchments A6 to Upstream Hydrograph

ADD HYD (000206)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:000205		30.60	.938	1.00	42.18	.000
+ID2 02:000106		.31	.088	1.00	68.83	.000
SUM 03:000206		30.91	1.027	1.00	42.45	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

 001:0042-----

*#
 *# Catchment A7 from Triton Study (0.24 hectares, C= 0.7)
 *#

DESIGN STANDHYD	Area (ha)=	Dir. Conn.(%)=
01:000107 DT=10.00	.24	60.00

	IMPERVIOUS	PERVIOUS (i)	
Surface Area (ha)=	.14	.10	
Dep. Storage (mm)=	.80	1.50	
Average Slope (%)=	2.00	2.00	
Length (m)=	40.00	40.00	
Mannings n =	.013	.250	
Max.eff.Inten. (mm/hr)=	162.24	56.88	
over (min)	10.00	10.00	
Storage Coeff. (min)=	.99 (ii)	9.83 (ii)	
Unit Hyd. Tpeak (min)=	10.00	10.00	
Unit Hyd. peak (cms)=	.17	.11	
			TOTALS
PEAK FLOW (cms)=	.06	.01	.075 (iii)
TIME TO PEAK (hrs)=	1.00	1.17	1.000
RUNOFF VOLUME (mm)=	98.15	39.51	74.696
TOTAL RAINFALL (mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT =	.99	.40	.755

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 001:0043-----

*#
 *# Catchment A8 from Triton Study (0.30 hectares, C= 0.7)
 *#

DESIGN STANDHYD	Area (ha)=	Dir. Conn.(%)=
02:000108 DT=10.00	.30	60.00

IMPERVIOUS PERVIOUS (i)

Surface Area (ha)= .18 .12
 Dep. Storage (mm)= .80 1.50
 Average Slope (%)= 4.00 4.00
 Length (m)= 44.72 40.00
 Mannings n = .013 .250

Max.eff.Inten.(mm/hr)= 162.24 56.88
 over (min) 10.00 10.00
 Storage Coeff. (min)= .86 (ii) 8.04 (ii)
 Unit Hyd. Tpeak (min)= 10.00 10.00
 Unit Hyd. peak (cms)= .17 .12

PEAK FLOW (cms)= .08 .01 *TOTALS*
 TIME TO PEAK (hrs)= 1.00 1.00 .096 (iii)
 RUNOFF VOLUME (mm)= 98.15 39.51 1.000
 TOTAL RAINFALL (mm)= 98.95 98.95 74.696
 RUNOFF COEFFICIENT = .99 .40 98.950
 .755

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0044-----

*# Add hydrographs from Catchments A7 and A8

ADD HYD (000207)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 02:000108		.30	.096	1.00	74.70	.000
+ID2 01:000107		.24	.075	1.00	74.70	.000
=====						
SUM 04:000207		.54	.171	1.00	74.70	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0045-----

*# Add summed hydrographs from Catchments A7+A8 to Upstream Hydrograph

ADD HYD (000208)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 03:000206		30.91	1.027	1.00	42.45	.000
+ID2 04:000207		.54	.171	1.00	74.70	.000
=====						
SUM 01:000208		31.45	1.198	1.00	43.00	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0046-----

*#
 *# Catchment A9 from Triton Study (0.32 hectares, C= 0.7)
 *#

DESIGN STANDHYD	Area (ha)=	Total Imp(%)=	Dir. Conn.(%)=
02:000109 DT=10.00	.32	60.00	60.00

IMPERVIOUS PERVIOUS (i)

Surface Area	(ha)=	.19	.13	
Dep. Storage	(mm)=	.80	1.50	
Average Slope	(%)=	.20	.20	
Length	(m)=	46.19	40.00	
Mannings n	=	.013	.250	
Max.eff.Inten. (mm/hr)=		162.24	49.00	
over (min)		10.00	20.00	
Storage Coeff. (min)=		2.15 (ii)	20.88 (ii)	
Unit Hyd. Tpeak (min)=		10.00	20.00	
Unit Hyd. peak (cms)=		.17	.05	
				TOTALS
PEAK FLOW	(cms)=	.09	.01	.091 (iii)
TIME TO PEAK	(hrs)=	1.00	1.33	1.000
RUNOFF VOLUME	(mm)=	98.15	39.52	74.696
TOTAL RAINFALL	(mm)=	98.95	98.95	98.950
RUNOFF COEFFICIENT	=	.99	.40	.755

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0047-----

```
*# Add hydrograph from Catchments A9 to upstream drainage
*#
*# THIS IS THE FLOW AT MH 56 WHICH IS THE LIMITING CONSTRAINT....
*# 5 year - 0.68 cms
*# 100 year - 1.29 cms
*#
```

ADD HYD (000209)						
ID	ID	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
ID1	01:000208	31.45	1.198	1.00	43.00	.000
+ID2	02:000109	.32	.091	1.00	74.70	.000
=====						
SUM	03:000209	31.77	1.289	1.00	43.32	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0048-----

```
*#
*# Catchment A10 from Triton Study (0.21 hectares, C= 0.7)
*#
```

DESIGN STANDHYD			
Area	(ha)=		
Total Imp(%)=	Dir. Conn.(%)=		
04:000110 DT=10.00	60.00	60.00	60.00
		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	.13	.08
Dep. Storage	(mm)=	.80	1.50
Average Slope	(%)=	1.00	1.00
Length	(m)=	37.42	40.00
Mannings n	=	.013	.250

Max.eff.Inten. (mm/hr)=		162.24	56.88
over (min)		10.00	10.00

```

Storage Coeff. (min)=      1.17 (ii)   12.06 (ii)
Unit Hyd. Tpeak (min)=    10.00      10.00
Unit Hyd. peak (cms)=     .17        .10

PEAK FLOW (cms)=          .06         .01
TIME TO PEAK (hrs)=       1.00        1.17
RUNOFF VOLUME (mm)=       98.15      39.51
TOTAL RAINFALL (mm)=      98.95      98.95
RUNOFF COEFFICIENT =      .99         .40
    
```

```

*TOTALS*
          .065 (iii)
          1.000
          74.696
          98.950
          .755
    
```

*** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 64.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 001:0049-----

*# Add hydrograph from Catchment A10 to Upstream Hydrograph
 *# represents total catchment flow to Credit River

ADD HYD (000204)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 03:000209		31.77	1.289	1.00	43.32	.000
+ID2 04:000110		.21	.065	1.00	74.70	.000
=====						
SUM 01:000204		31.98	1.354	1.00	43.53	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

 001:0050-----

FINISH

 WARNINGS / ERRORS / NOTES



- 0003 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0004 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0006 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0007 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0009 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0011 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!
 Use a smaller DT or a larger area.
- 0013 DESIGN NASHYD
 *** WARNING: Time step is too large for value of TP.
 R.V. may be ok. Peak flow could be off.
- 0014 DESIGN STANDHYD
 *** WARNING: Storage Coefficient is smaller than DT!

Use a smaller DT or a larger area.
0018 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0022 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0023 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0025 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0026 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0028 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0034 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0035 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0036 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0040 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0042 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0043 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0046 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.
0048 DESIGN STANDHYD
*** WARNING: Storage Coefficient is smaller than DT!
Use a smaller DT or a larger area.

Simulation ended on 2000-06-01 at 10:47:44

DRAWINGS

DRAWINGS

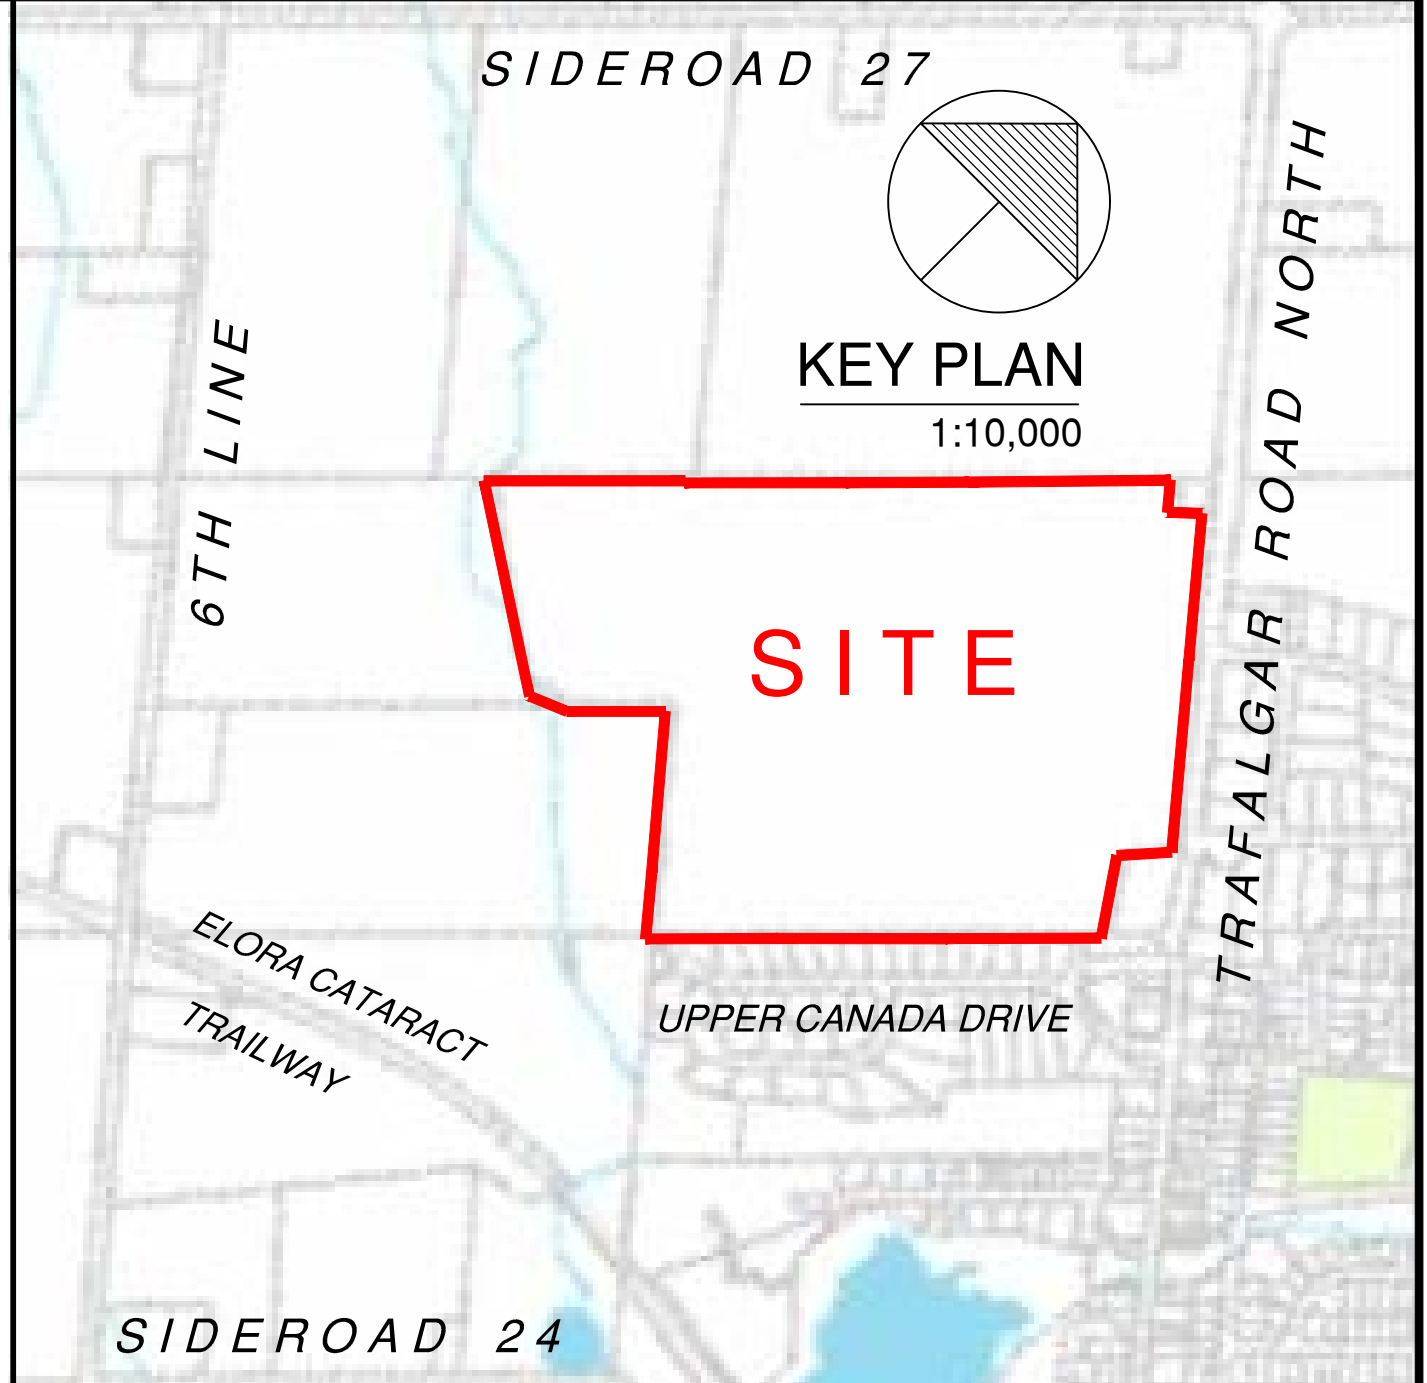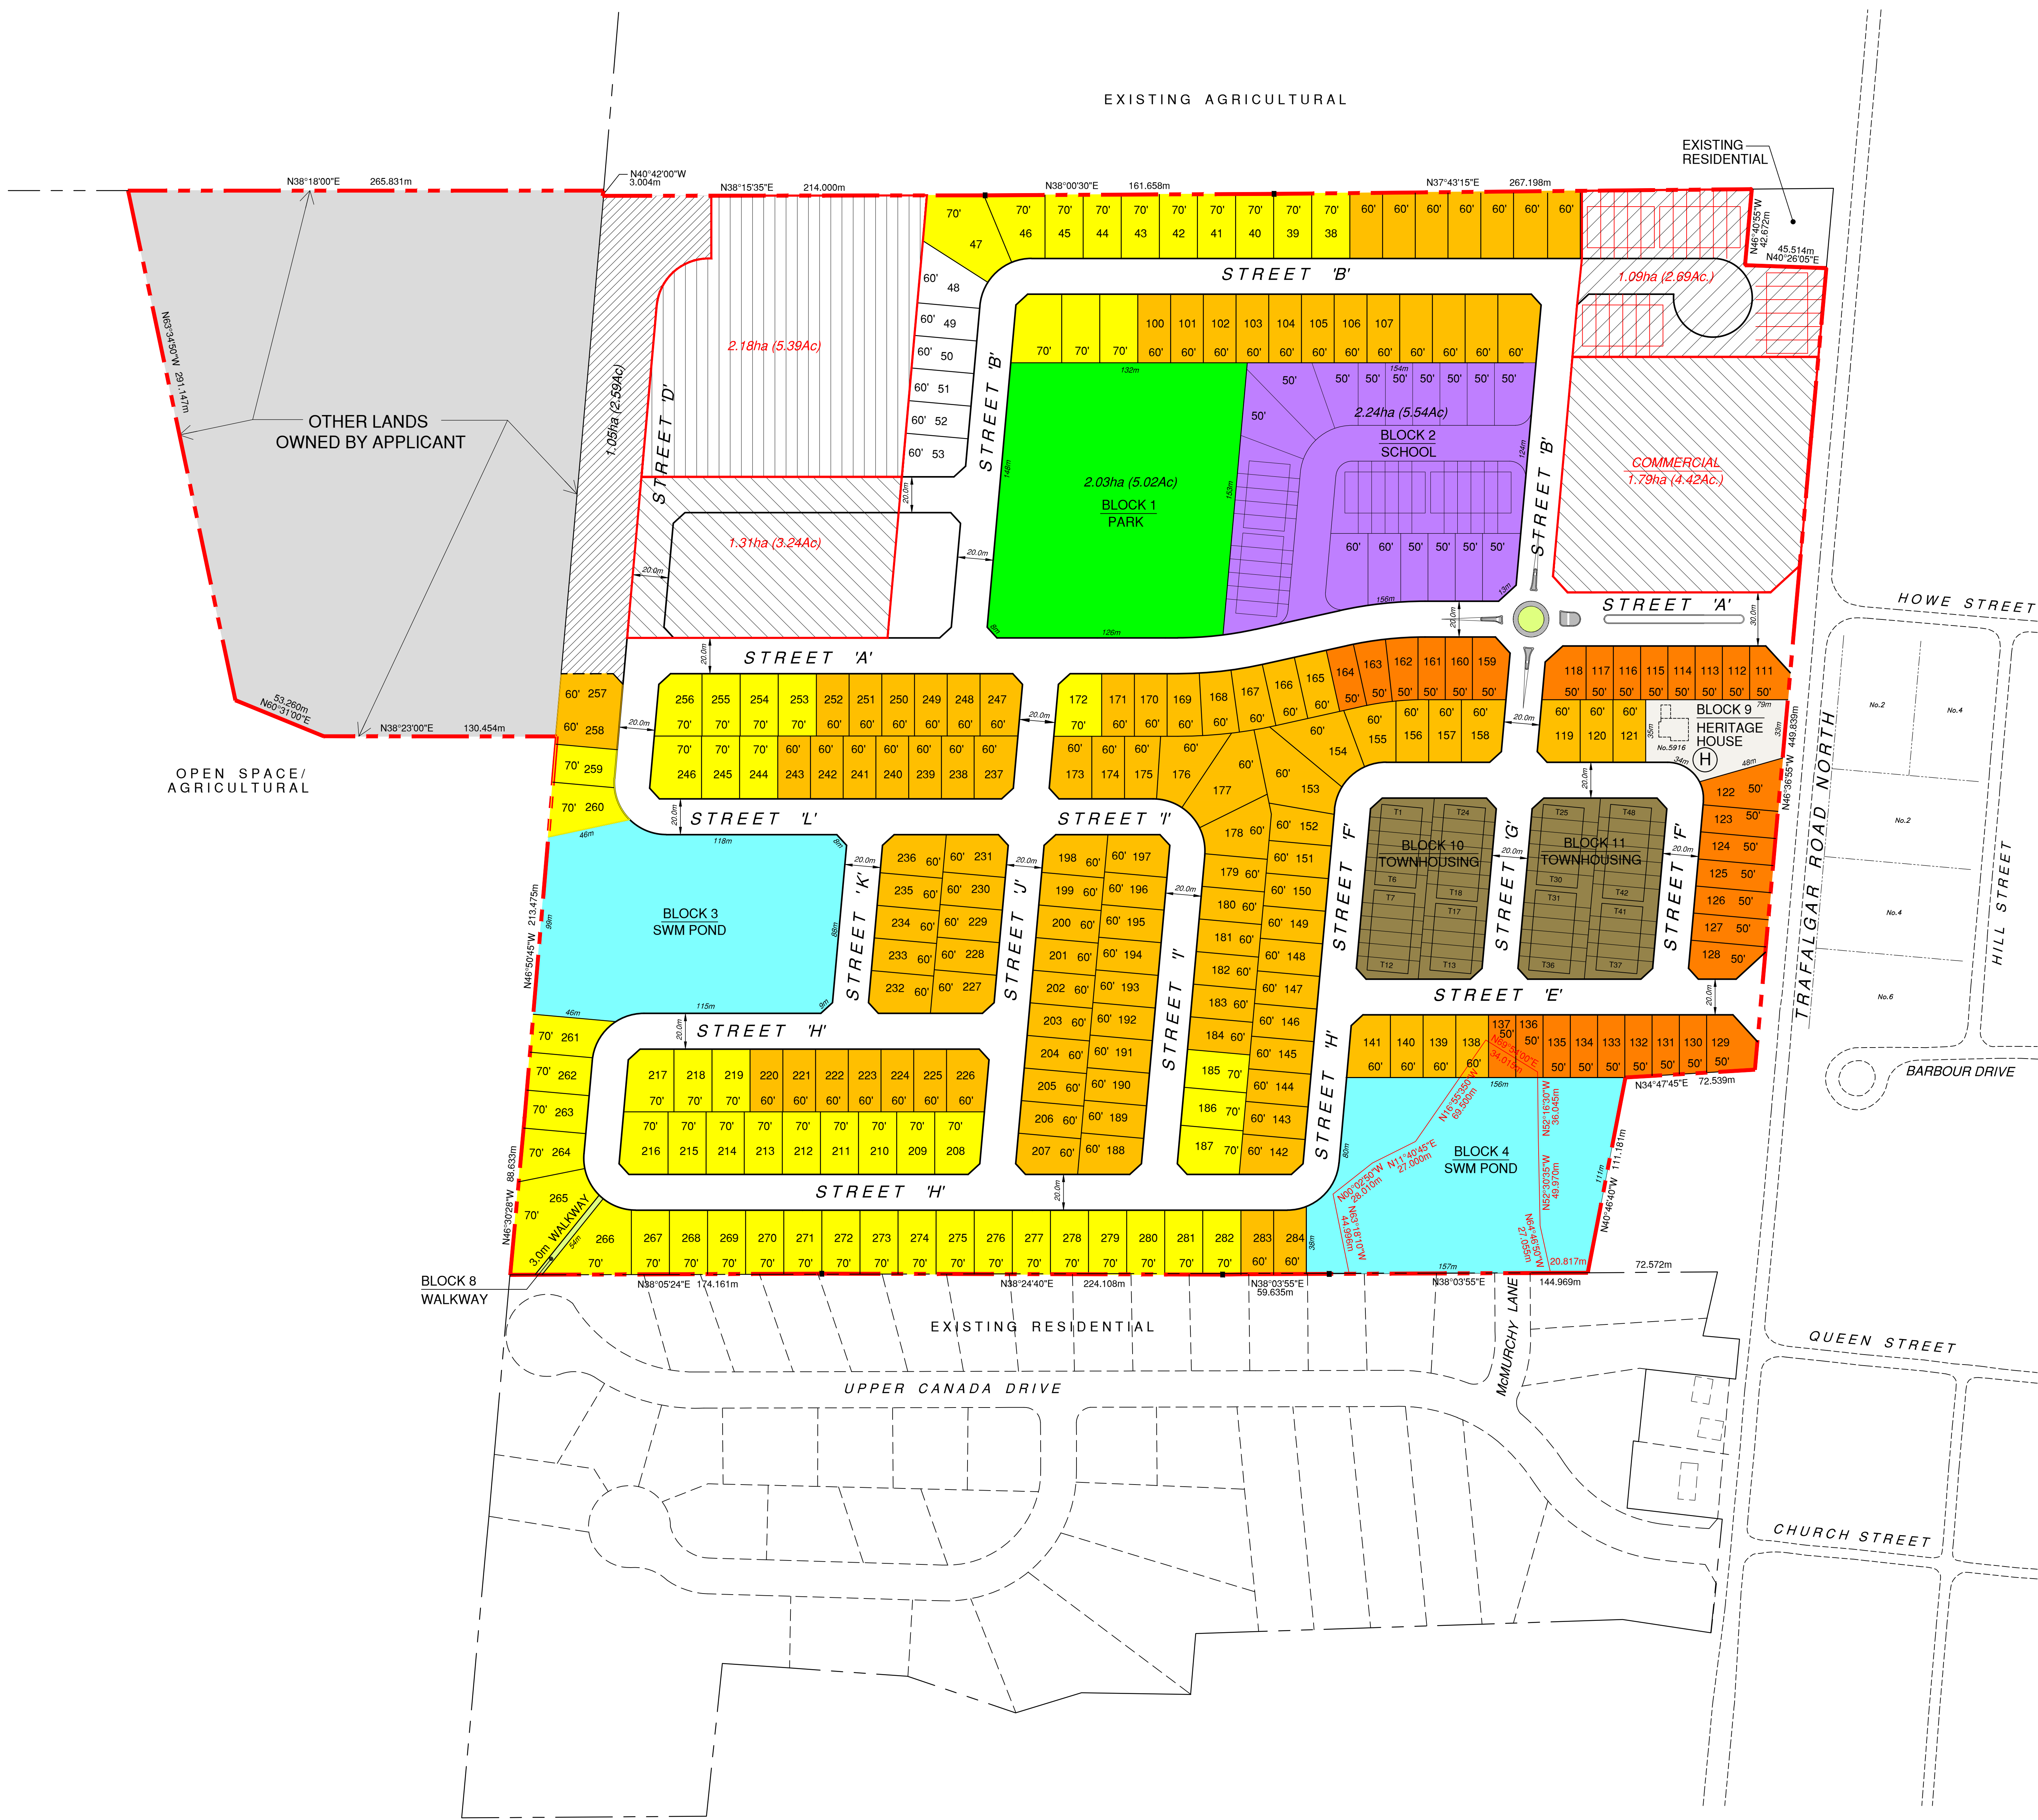

LOT SCHEDULE					
DESCRIPTION	TYPE	MINIMUM FRONTAGE	MINIMUM DEPTH	NUMBER OF LOTS	NUMBER OF UNITS
SINGLE DETACHED	50'	15.2m (50.0')	35.0m (114.8')	51	51
SINGLE DETACHED	60'	18.3m (60.0')	35.0m (114.8')	137	137
SINGLE DETACHED	70'	21.3m (70.0')	35.0m (114.8')	96	96
TOWNHOUSE	T	7.5m (24.6')	35.0m (114.8')	-	48
TOTAL				284	332

LAND USE	BLOCK / LOT	AREA
RESIDENTIAL	LOTS 1-284	20.79 ha. (51.38 Ac.)
PARK	BLOCK 1	2.03 ha. (5.01 Ac.)
SCHOOL	BLOCK 2	2.23 ha. (5.51 Ac.)
SWM POND	BLOCKS 3-4	3.41 ha. (8.43 Ac.)
RESIDENTIAL RESERVE	BLOCK 5	0.22 ha. (0.55 Ac.)
VISTA	STREETS 6-7	0.16 ha. (0.40 Ac.)
ROADS	STREETS A-L	9.79 ha. (24.18 Ac.)
WALKWAY	BLOCK 8	0.01 ha. (0.02 Ac.)
HERITAGE HOUSE	BLOCK 9	0.30 ha. (0.74 Ac.)
TOWNHOUSING	BLOCKS 10-11	1.46 ha. (3.61 Ac.)
TOTAL		40.40 ha. (99.83 Ac.)

NOTE:
 1. R.O.W. RADII AT INTERSECTIONS:
 17.0m TO 17.0m = 5.0m
 17.0m TO 20.0m = 14.0m
 20.0m TO 20.0m = 5.0m
 20.0m TO 23.0m = 10.0m
 23.0m TO 23.0m = 10.0m
 23.0m TO 28.0m = 15.0m (DAYLIGHT TRIANGLE)
 28.0m TO 36.0m = 15.0m (DAYLIGHT TRIANGLE)
 2. MINIMUM RADII AT CENTRELINES:
 17.0m R.O.W. R = 14.0m
 20.0m R.O.W. R = 74.0m
 23.0m R.O.W. R = 145.0m

NO.	DESCRIPTION	DATE	BY	REVISIONS
1	DIMENSIONS ADDED TO STREETS AND BLOCKS.	04.02.2022	D.K.H.	
2	BEARINGS AND DISTANCES ADDED AS PER BSR&D LAND SURVEYORS PLAN REF. No. 21-14-619-00, DATED JAN., 7th 2022	07.01.2022	D.K.H.	

ADDITIONAL INFORMATION
 AS REQUIRED UNDER SECTION 51(17) OF THE PLANNING ACT (R.S.O. 1990 C.P. 13)
 A) AS SHOWN ON DRAFT PLAN. G) AS SHOWN ON DRAFT AND KEY PLANS.
 B) AS SHOWN ON DRAFT AND KEY PLAN. H) MUNICIPAL SERVICES TO BE PROVIDED.
 C) AS SHOWN ON KEY PLANS. I) SOIL IS CLAYEY SILT.
 D) AS SHOWN IN LAND USE SCHEDULE. J) AS SHOWN ON DRAFT PLAN.
 E) AS SHOWN ON DRAFT PLAN. K) MUNICIPAL SERVICES TO BE PROVIDED.
 F) AS SHOWN ON DRAFT PLAN. L) NONE.

OWNER'S AUTHORIZATION:
 THE UNDERSIGNED, BEING THE OWNER OF THE SUBJECT LANDS HEREBY AUTHORIZE CANDEVCON LIMITED TO ACT ON OUR BEHALF AS AGENTS AND TO PREPARE AND SUBMIT A DRAFT PLAN OF SUBDIVISION FOR APPROVAL.

DATE _____ HILLSBURGH HEIGHTS INC.
(BRIARWOOD DEVELOPMENTS GROUP)


SURVEYOR'S CERTIFICATE:
 I HEREBY CERTIFY THAT THE BOUNDARIES OF THE LAND TO BE SUBDIVIDED AND THEIR RELATIONSHIP TO THE ADJOINING PROPERTIES ARE CORRECTLY SHOWN ON THIS PLAN

DATE _____ RAYMOND J. SIBTHORP
 ONTARIO LAND SURVEYORS
 BLACK, SHOEMAKER, ROBINSON & DONALDSON LTD.
 457 WOODLAWN ROAD WEST, UNIT 101, GUELPH ONTARIO
 TEL: (519) 822-1220 www.rjbarnes.com

DRAFT PLAN OF SUBDIVISION
 5916 TRAFALGAR ROAD NORTH
 (PLAN 61R-9590)
 PART OF LOT 26, CONCESSION 7
 TOWN OF ERIN
 COUNTY OF WELLINGTON


CANDEVCON LIMITED
 CONSULTING ENGINEERS AND PLANNERS

TEL: (905) 794-0600 FAX: (905) 794-0611
 SCALE: 1:1500 DWG. No. PL-1
 DATE: NOV., 12th 2021 PROJECT No. W21081

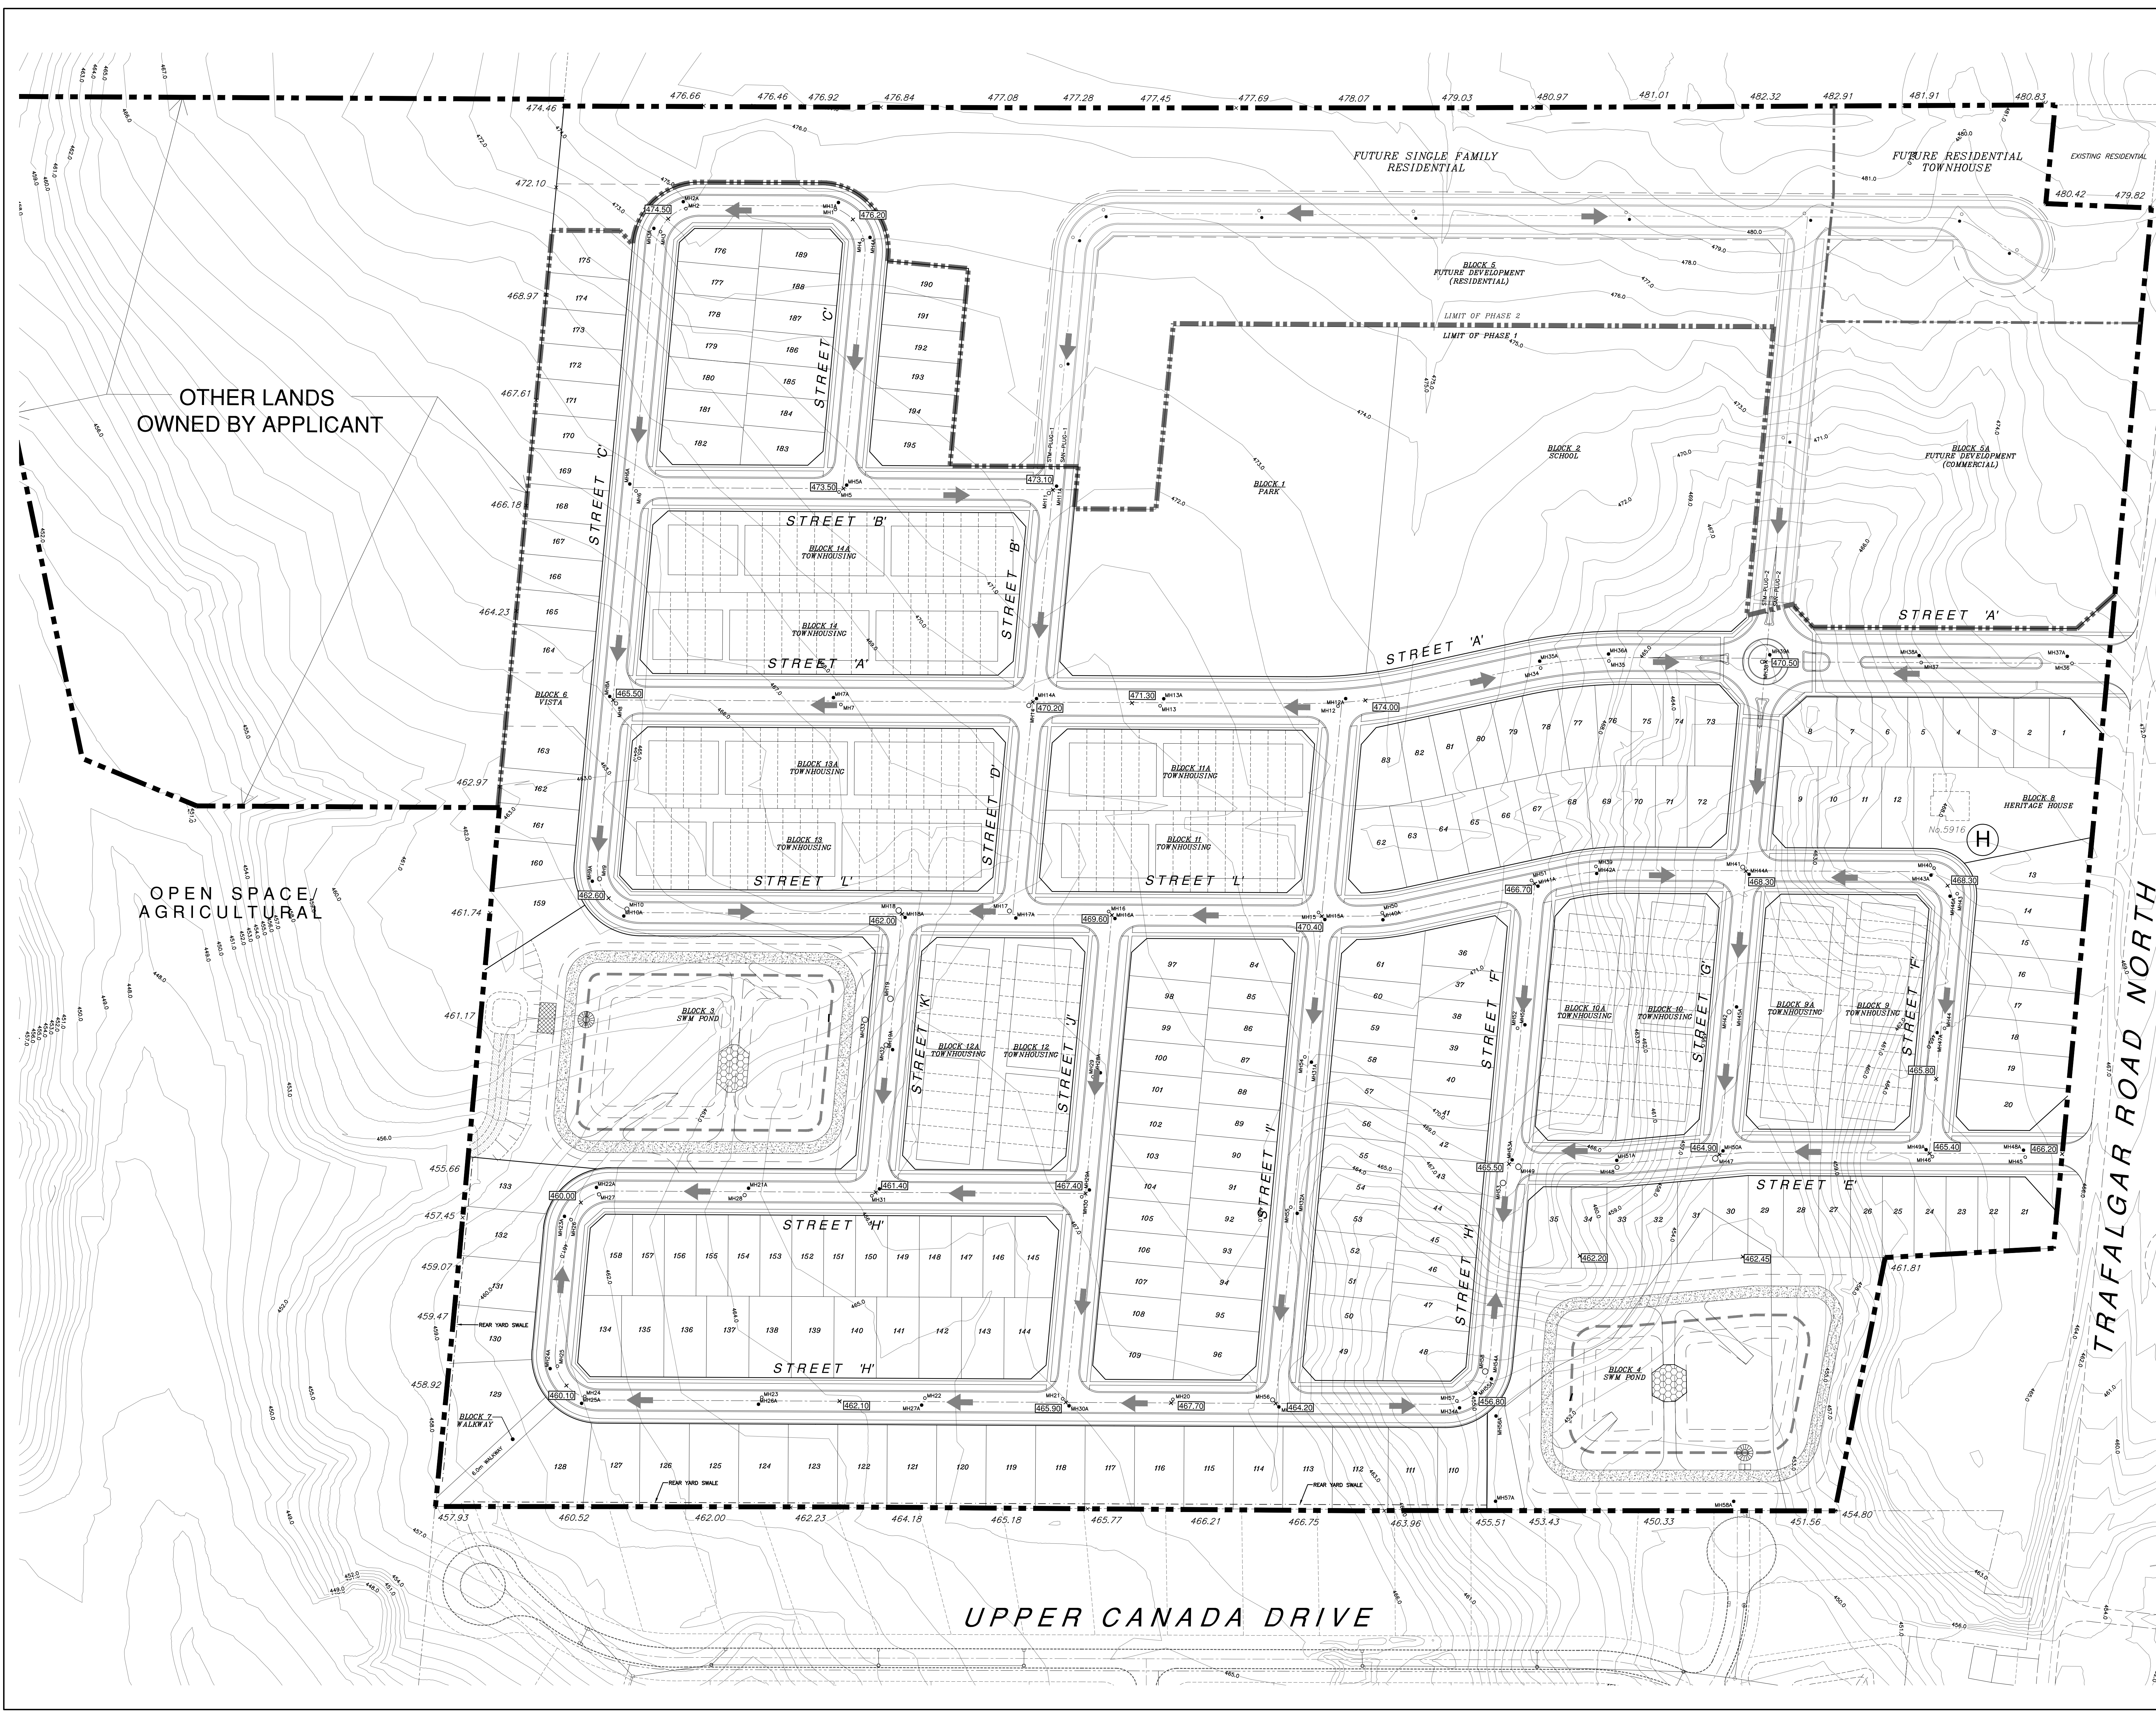

OTHER LANDS OWNED BY APPLICANT

OPEN SPACE/ AGRICULTURAL

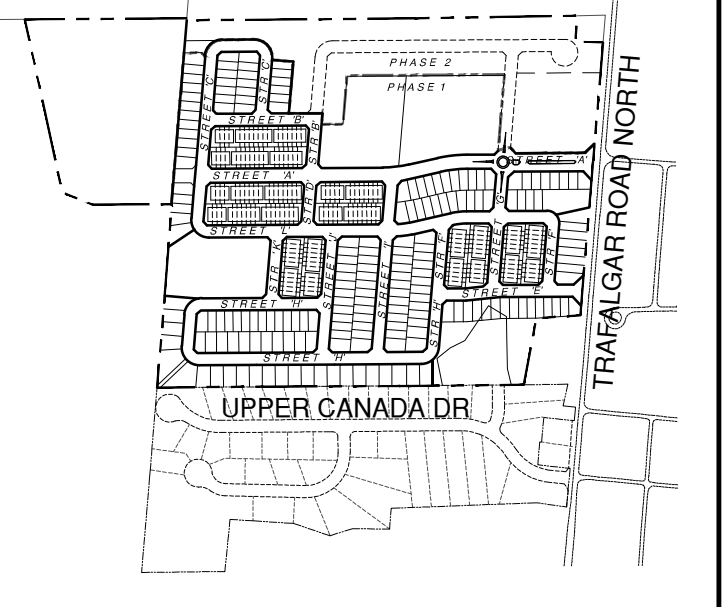


KEY PLAN

- LEGEND:**
- LIMIT OF SUBDIVISION
 - PHASING LIMIT
 - - - - - EXISTING PROPERTY LINE
 - 481.80 PROPOSED ELEVATIONS
 - 455.51 EXISTING ELEVATIONS
 - - - - - INFILTRATION TRENCH
 - - - - - REAR YARD SWALE
 - ➔ OVERLAND FLOW ROUTE

- REFERENCE DRAWINGS:**
1. REFER TO DRAFT PLAN (PL-1) PREPARED BY CANDEVCON LIMITED FOR SUBDIVISION LAYOUT.
 2. REFER TO DRAWING PS-1 FOR INFORMATION ON STORM, SANITARY & FDC

NO.	DESCRIPTION	DATE	BY

304 CANDEVCON LIMITED
CONSULTING ENGINEERS AND PLANNERS
TEL (905) 794-0600 FAX (905) 794-0611


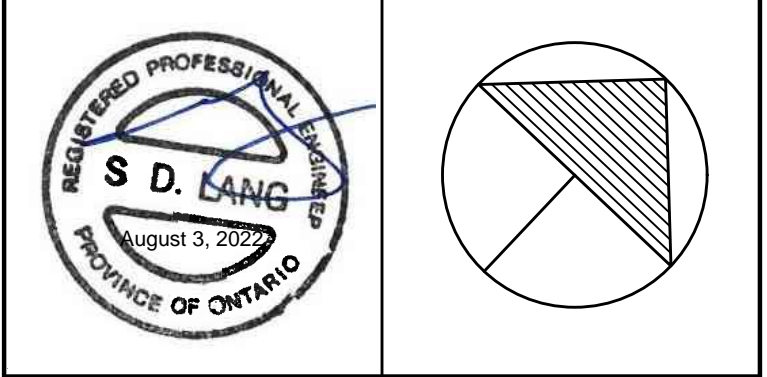


HILLSBURGH HEIGHTS INC.
RESIDENTIAL SUBDIVISION
5616 TRAFALGAR ROAD NORTH
PART 1 OF PLAN 61R-9590
PART OF LOT 26, CONCESSION 7
HILLSBURGH URBAN AREA
TOWN OF ERIN

PRELIMINARY GRADING PLAN

DRAWN BY: E.A.M	PROJECT No. W21081
CHECKED BY: S.L	DRAWING No.
SCALE: 1:1000	GR-1
DATE: OCT 1st, 2021	

J:\DC\2021 WEST - FINE\W21081-HILLSBURGH-HIGHWAYS\W21081-GR-1-PRELIM GRADING.dwg, 2022-08-04 10:38:51 AM

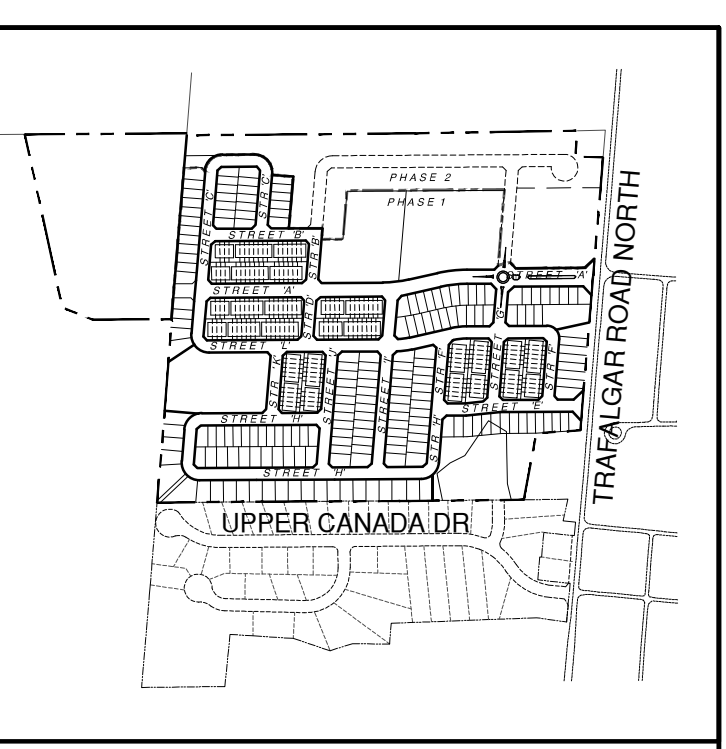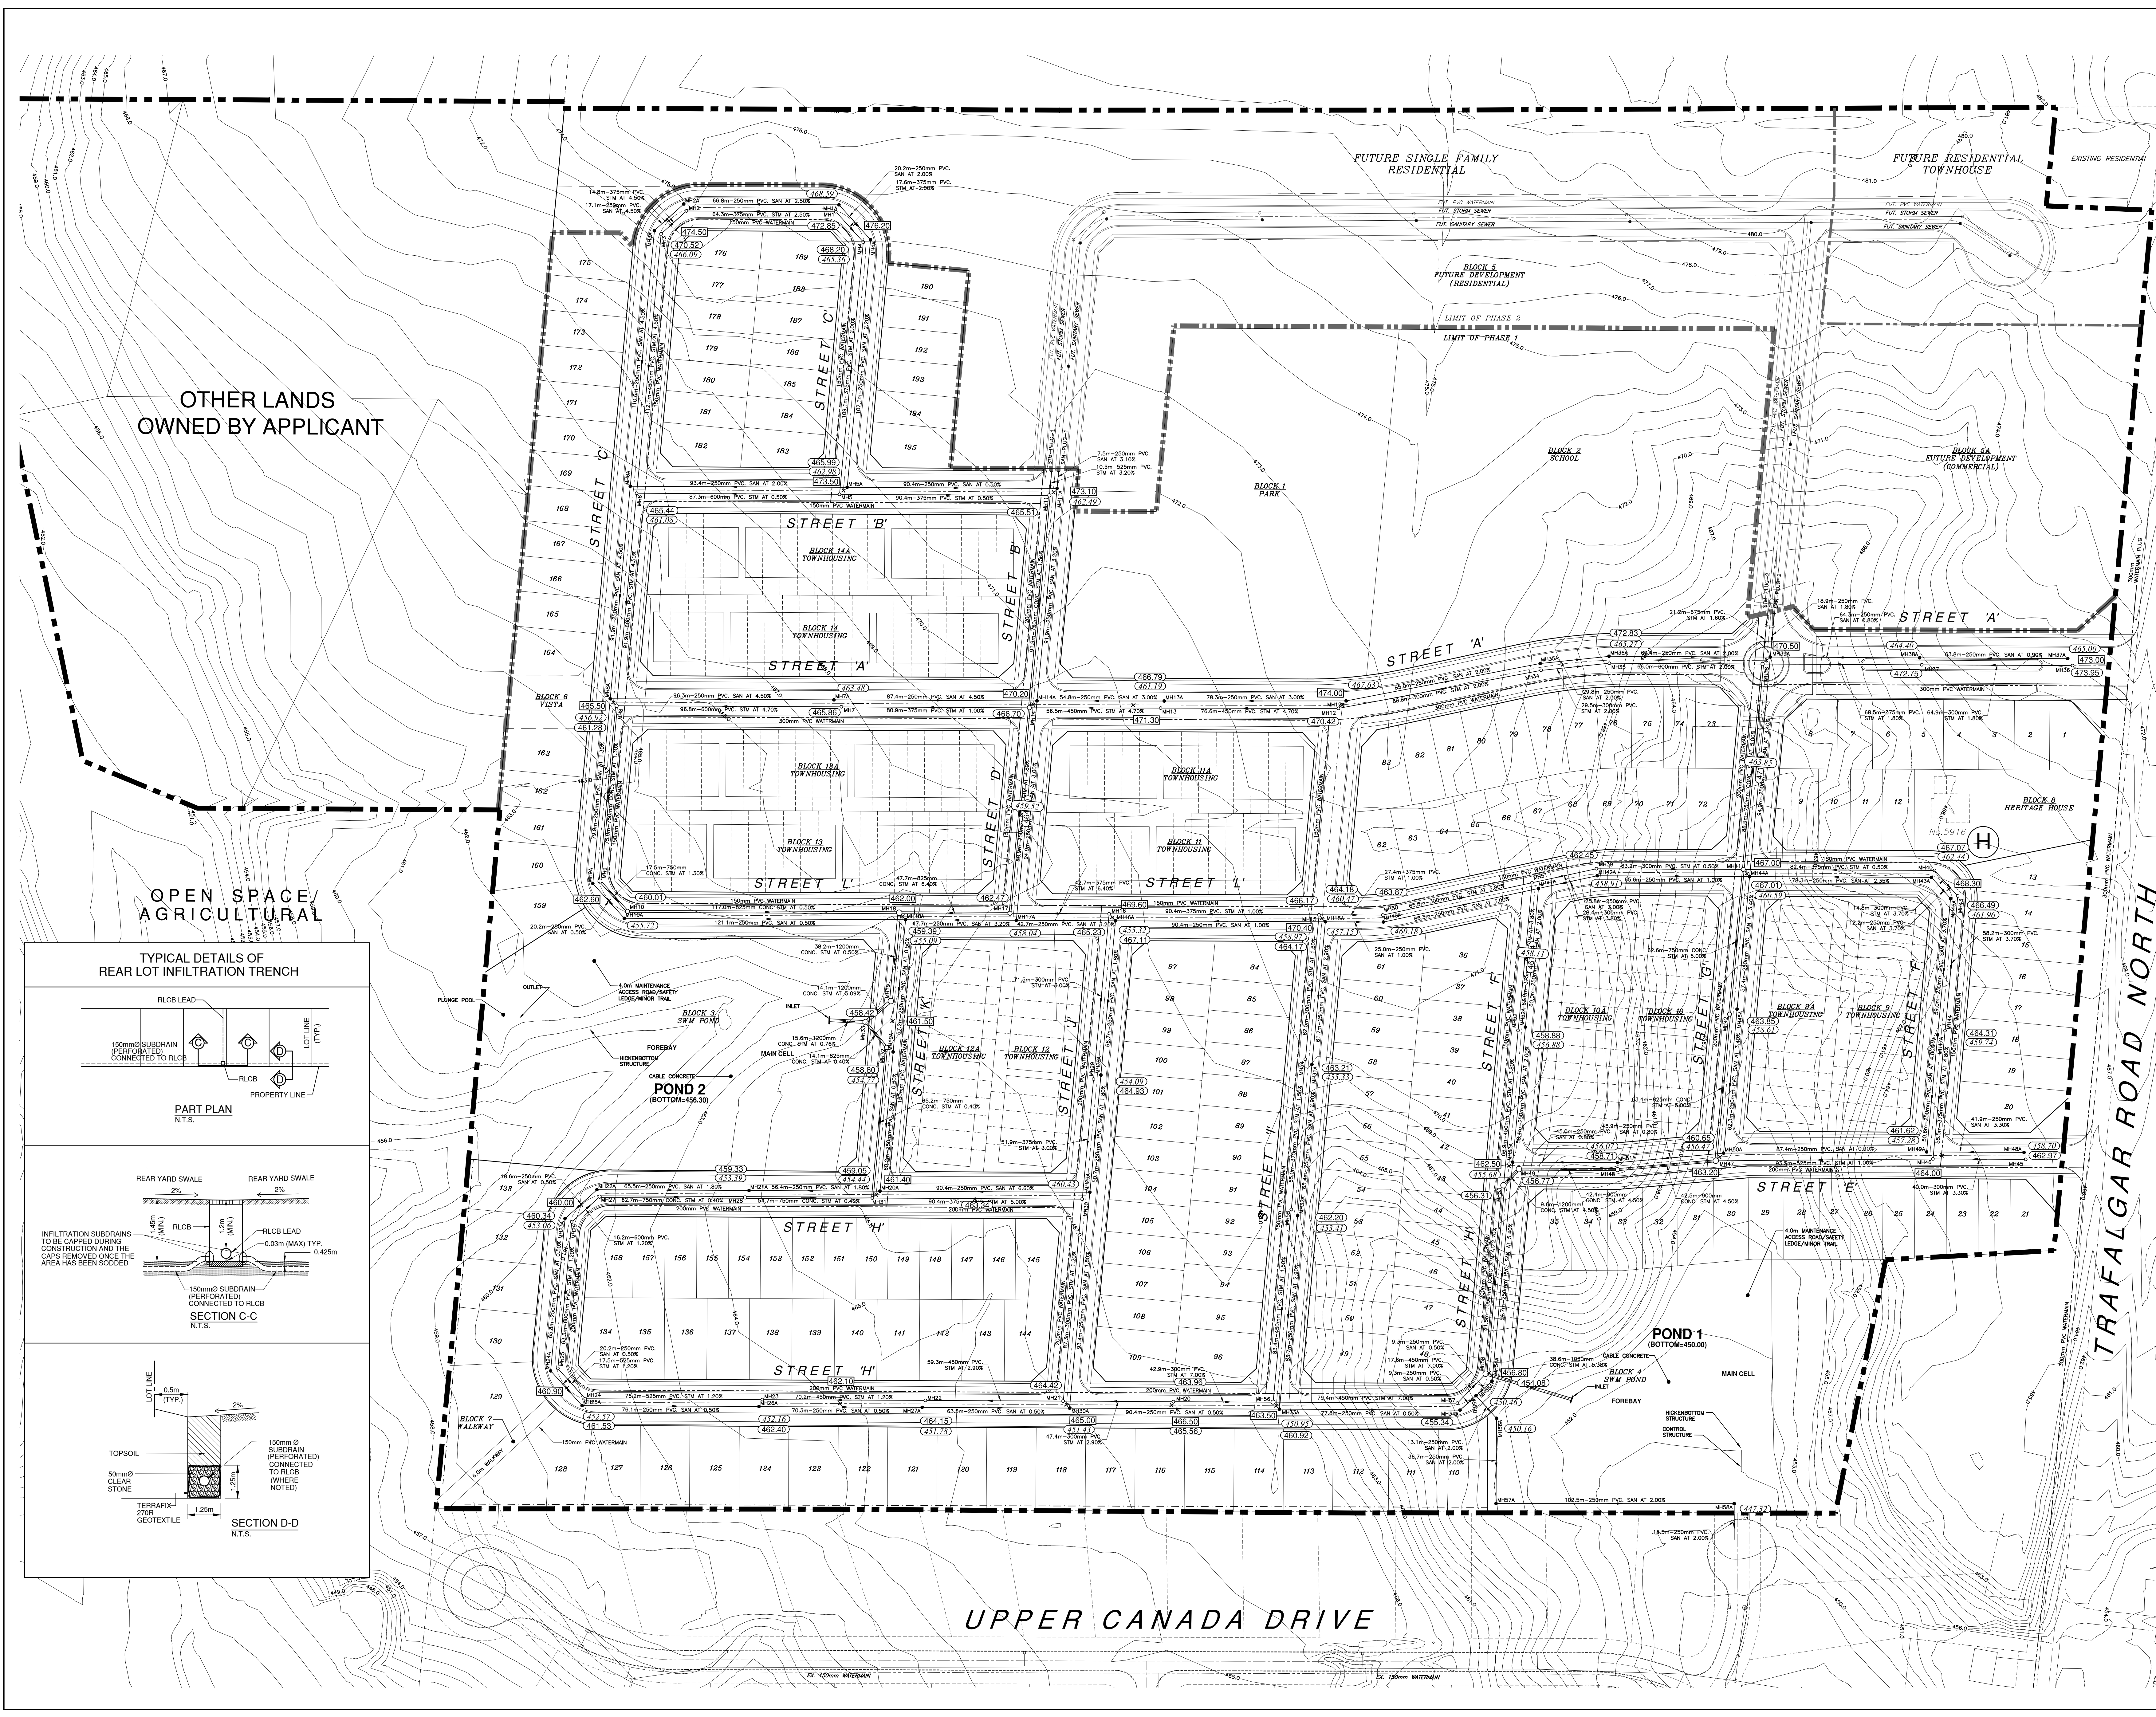


- KEY PLAN**
- LEGEND:**
- LIMIT OF SUBDIVISION
 - PHASING LIMIT
 - EXISTING PROPERTY LINE
 - PROPOSED STORM SEWER
 - EXISTING STORM SEWER
 - PROPOSED SAN SEWER
 - EXISTING SAN SEWER
 - WATERMAIN
 - EXISTING WATERMAIN
 - INFILTRATION TRENCH
 - x 455.51 EXIST. GRADE
 - 481.80 PROPOSED ROAD GRADE
 - 476.65 PROPOSED SAN SEWER OBVERT
 - 456.80 PROPOSED STORM SEWER OBVERT

- REFERENCE DRAWINGS:**
- REFER TO DRAFT PLAN (PL-1) PREPARED BY CANDEVCON LIMITED FOR SUBDIVISION LAYOUT
 - REFER TO DRAWINGS ST-1 FOR INFORMATION ON STORM DRAINAGE
 - REFER TO DRAWINGS SA-1 FOR INFORMATION ON SANITARY DRAINAGE
 - REFER TO DWG EXT-ST1 FOR EXTERNAL STORM DRAINAGE AREA PLAN

NO.	DESCRIPTION	DATE	BY
1	SECOND SUBMISSION	2022-07-29	SL

REVISIONS

CDI CANDEVCON LIMITED
CONSULTING ENGINEERS AND PLANNERS
TEL: (905) 794-8600 FAX: (905) 794-0611

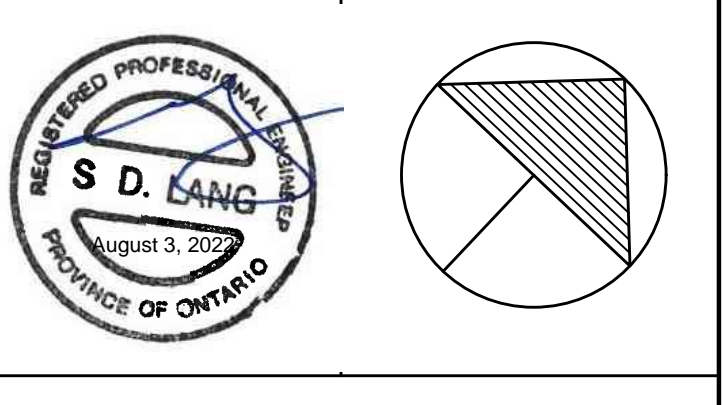


HILLSBURGH HEIGHTS INC.
RESIDENTIAL SUBDIVISION
5616 TRAFALGAR ROAD NORTH
PART 1 OF PLAN 61R-9590
PART OF LOT 26, CONCESSION 7
HILLSBURGH URBAN AREA
TOWN OF ERIN

PRELIMINARY SERVICING PLAN

DRAWN BY:	E.A.M	PROJECT No.:	W21081
CHECKED BY:	S.L	DRAWING No.:	
SCALE:	1:1000		
DATE:	OCT 1st, 2021		

PS-1


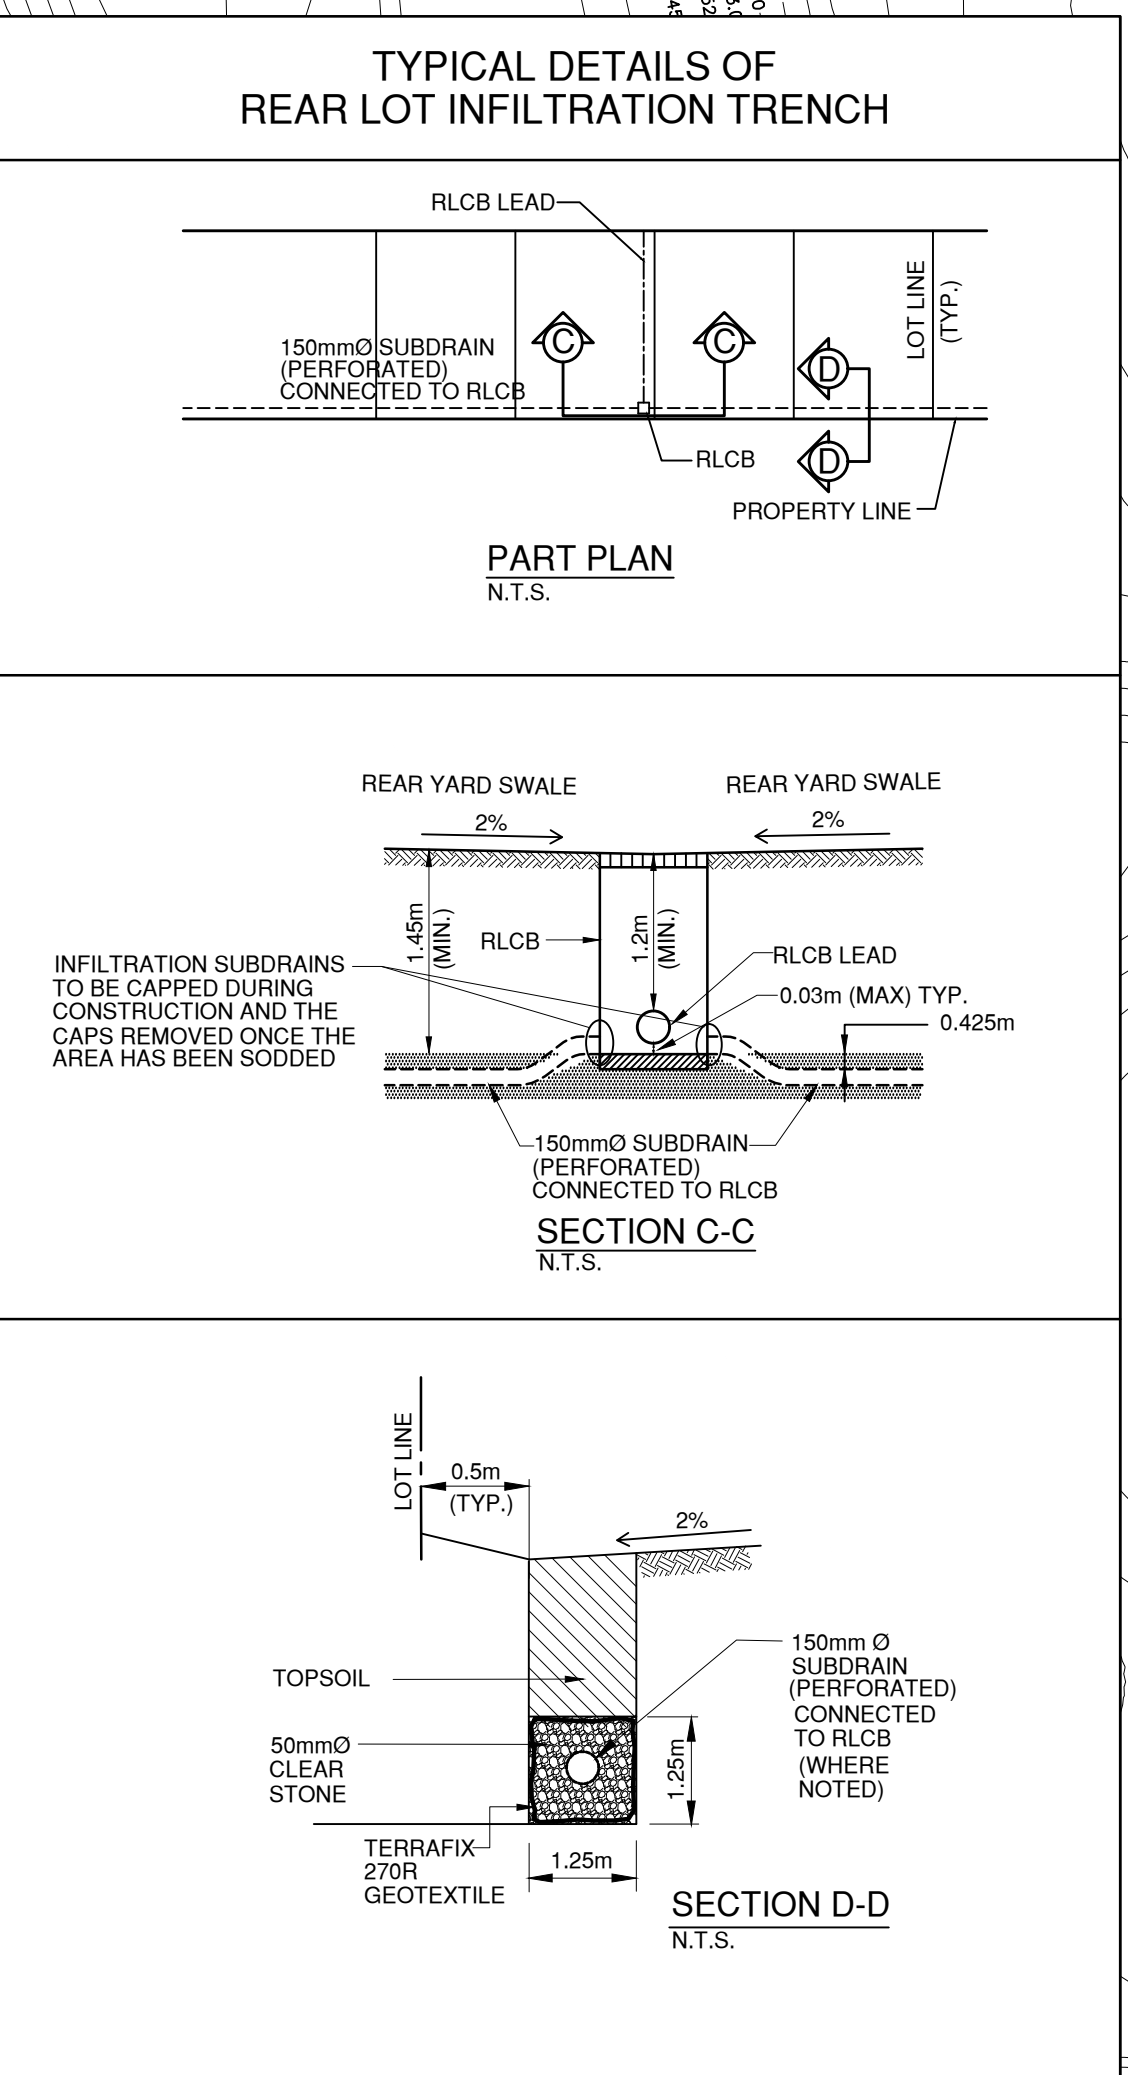


OTHER LANDS OWNED BY APPLICANT

OPEN SPACE / AGRICULTURAL

TRAFFALGAR ROAD NORTH

UPPER CANADA DRIVE

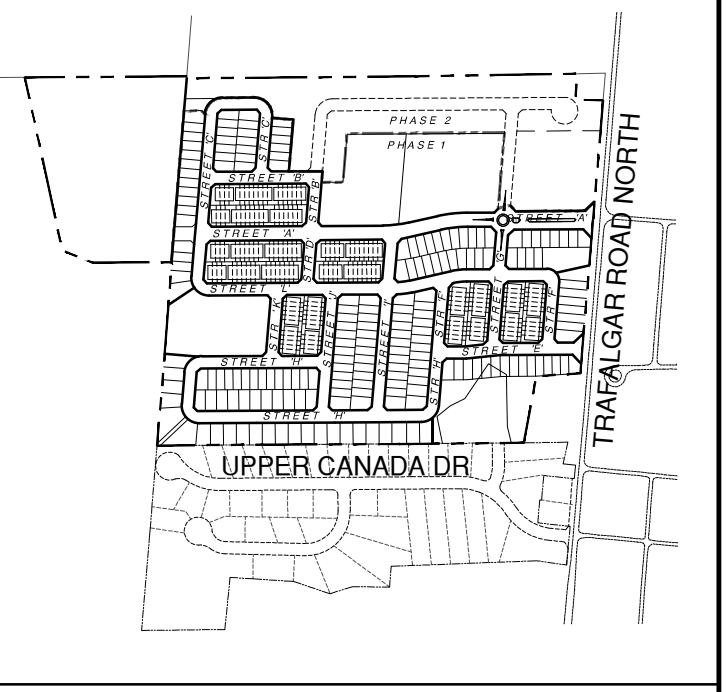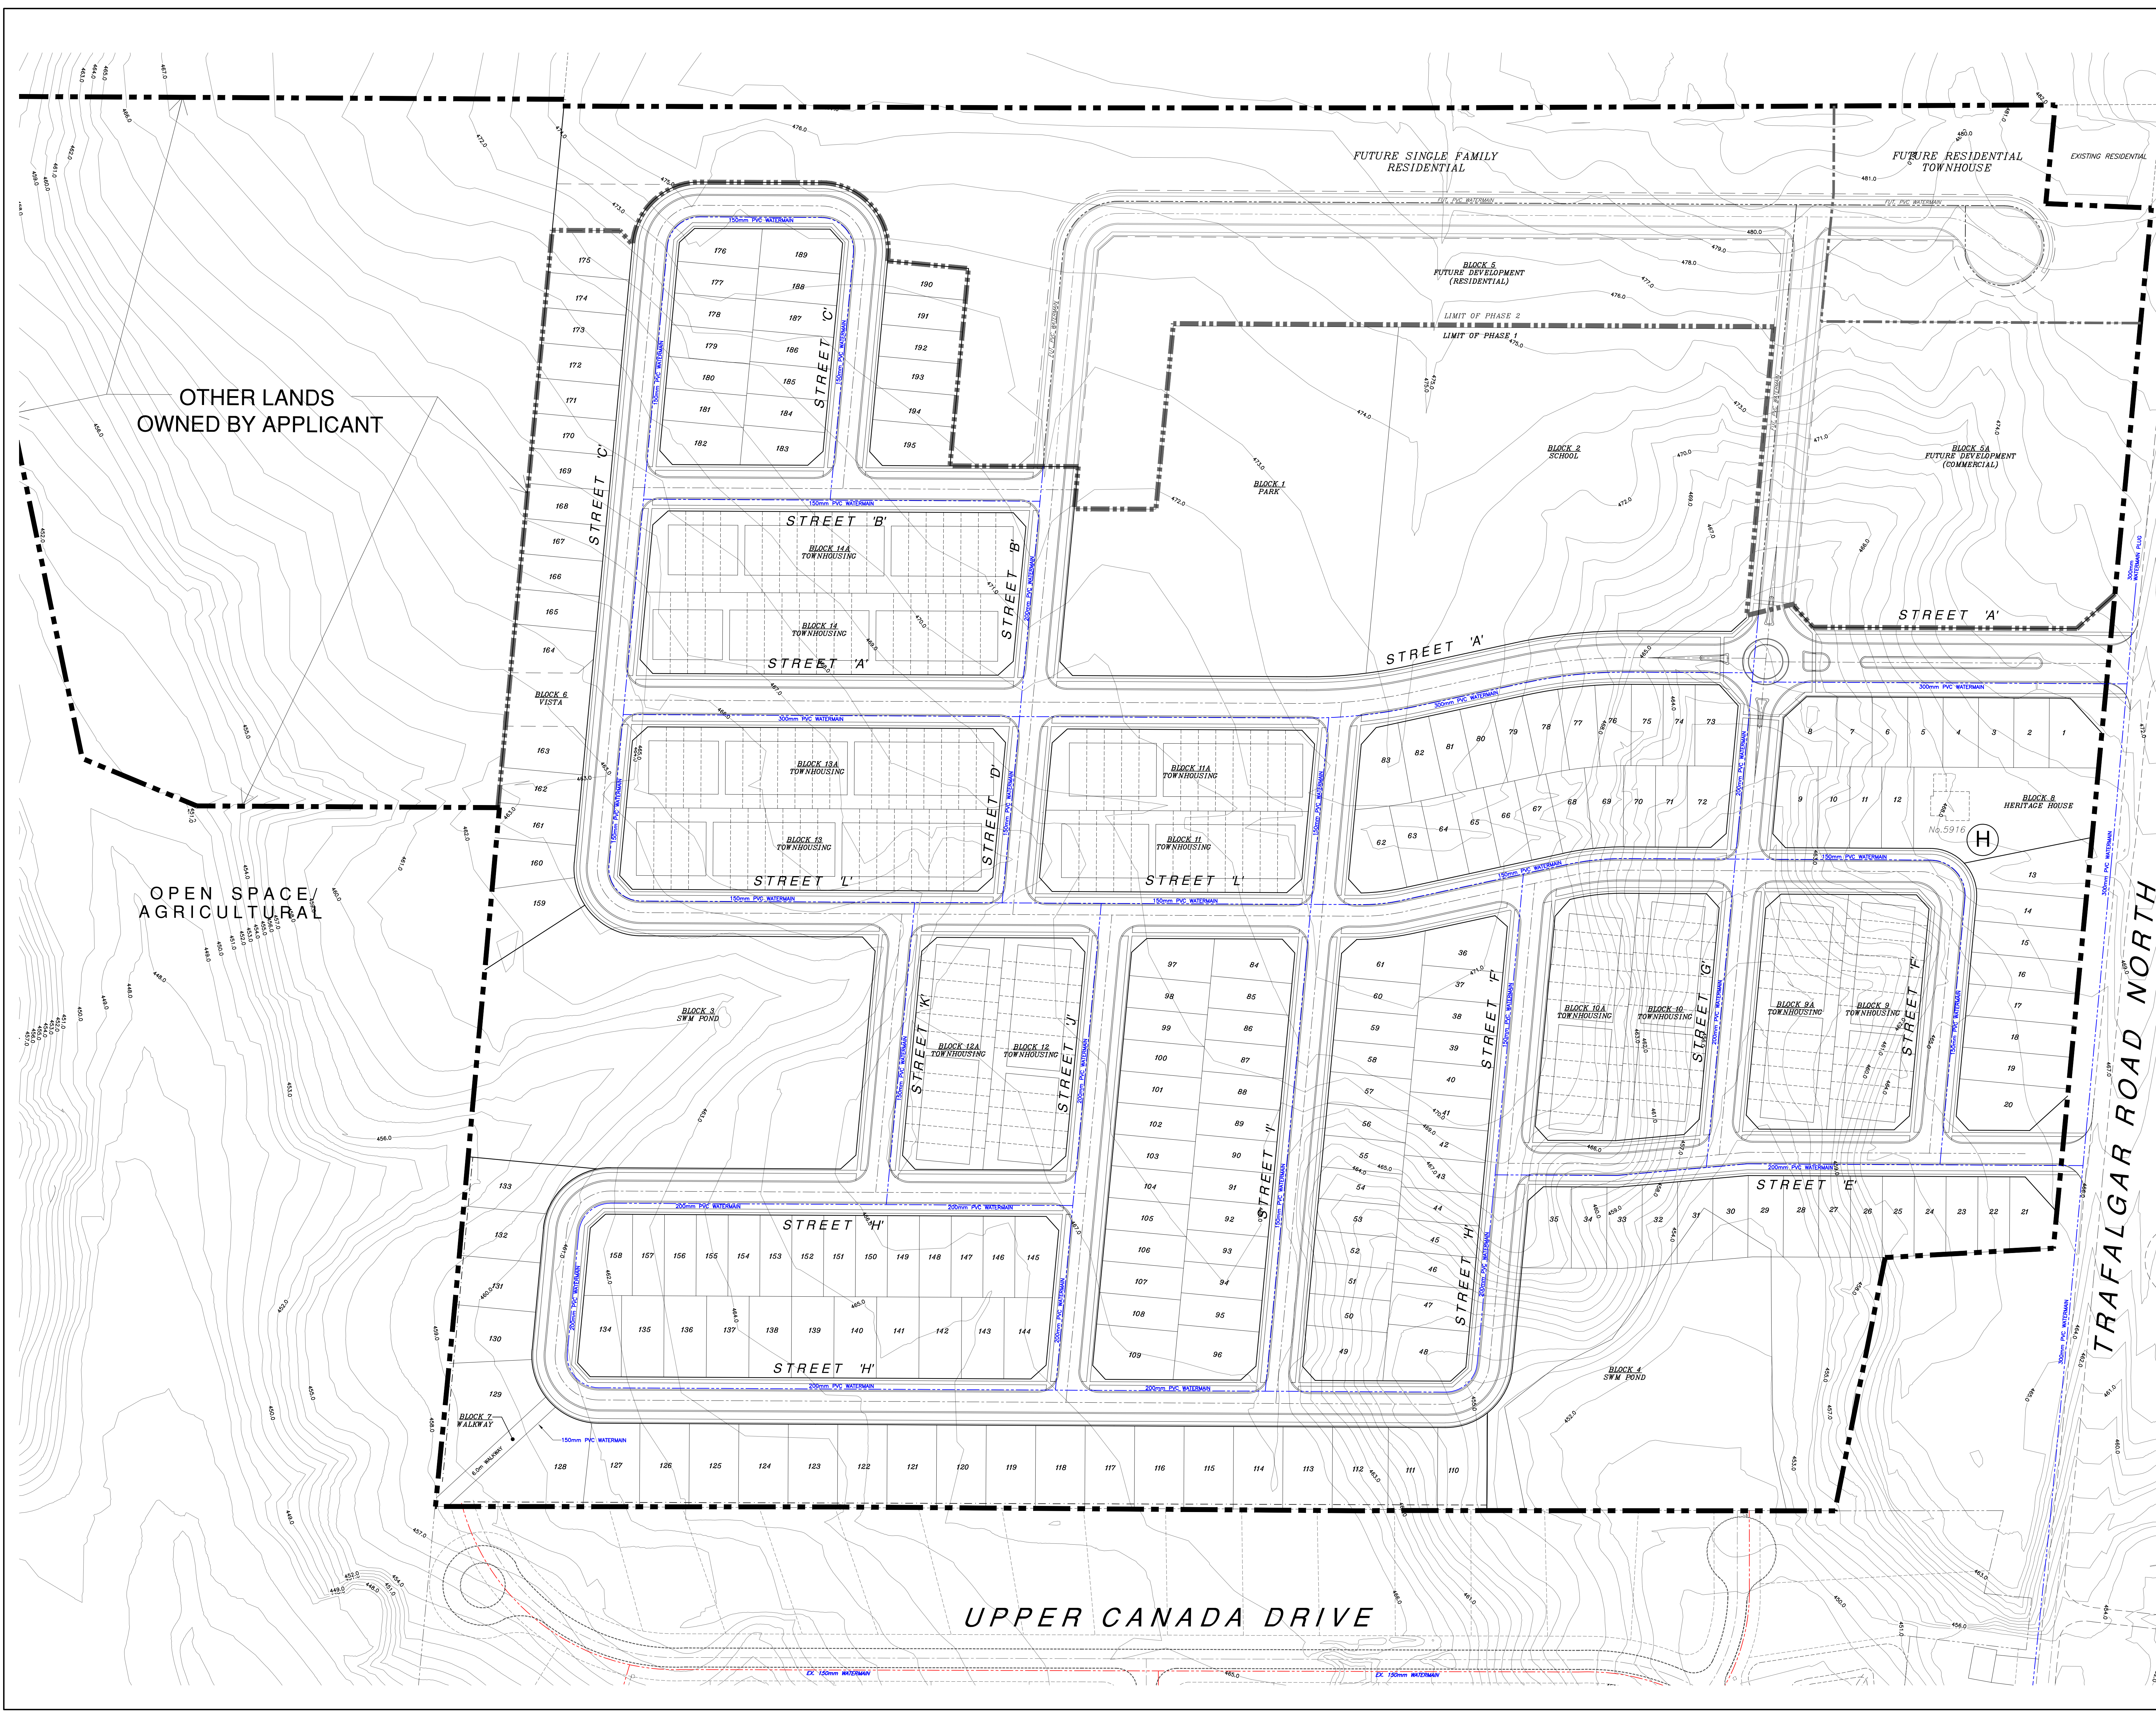


KEY PLAN

- LEGEND:**
- LIMIT OF SUBDIVISION
 - PHASING LIMIT
 - - - - - EXISTING PROPERTY LINE
 - PROPOSED WATERMAIN
 - - - - - FUTURE WATERMAIN
 - EXISTING WATERMAIN

- REFERENCE DRAWINGS:**
1. REFER TO DRAFT PLAN (PL-1) PREPARED BY CANDEVCON LIMITED FOR SUBDIVISION LAYOUT
 2. REFER TO DRAWING PS-1 FOR INFORMATION ON STORM & SANITARY

NO.	DESCRIPTION	DATE	BY



CANDEVCON LIMITED
CONSULTING ENGINEERS AND PLANNERS
TEL: (905) 794-0600 FAX: (905) 794-0611

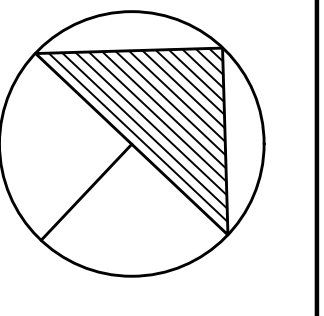

HILLSBURGH HEIGHTS INC.
RESIDENTIAL SUBDIVISION
5616 TRAFALGAR ROAD NORTH
PART 1 OF PLAN 61R-9590
PART OF LOT 26, CONCESSION 7
HILLSBURGH URBAN AREA
TOWN OF ERIN

WATER DISTRIBUTION PLAN

DRAWN BY: E.A.M	PROJECT No. W21081
CHECKED BY: S.L	DRAWING No.
SCALE: 1:1000	WM-1
DATE: OCT 1st, 2021	

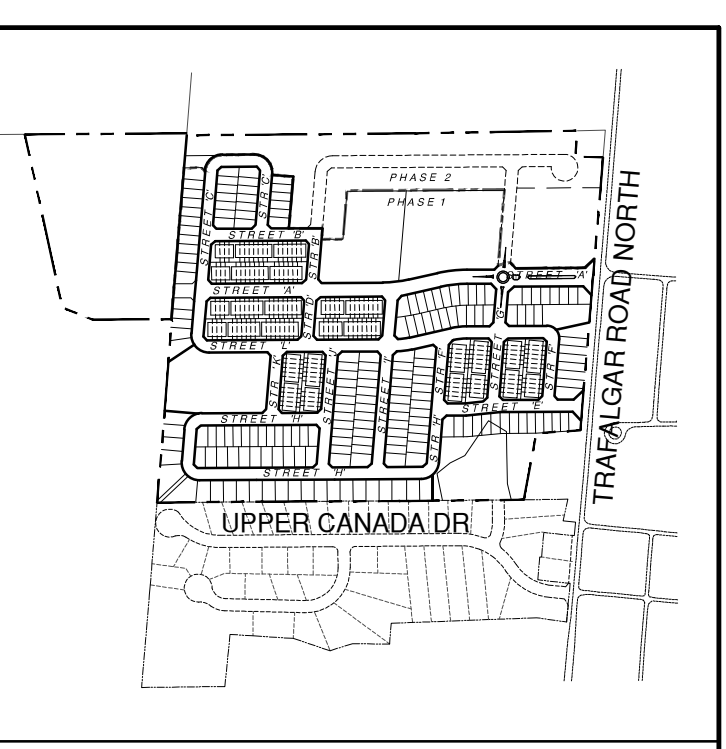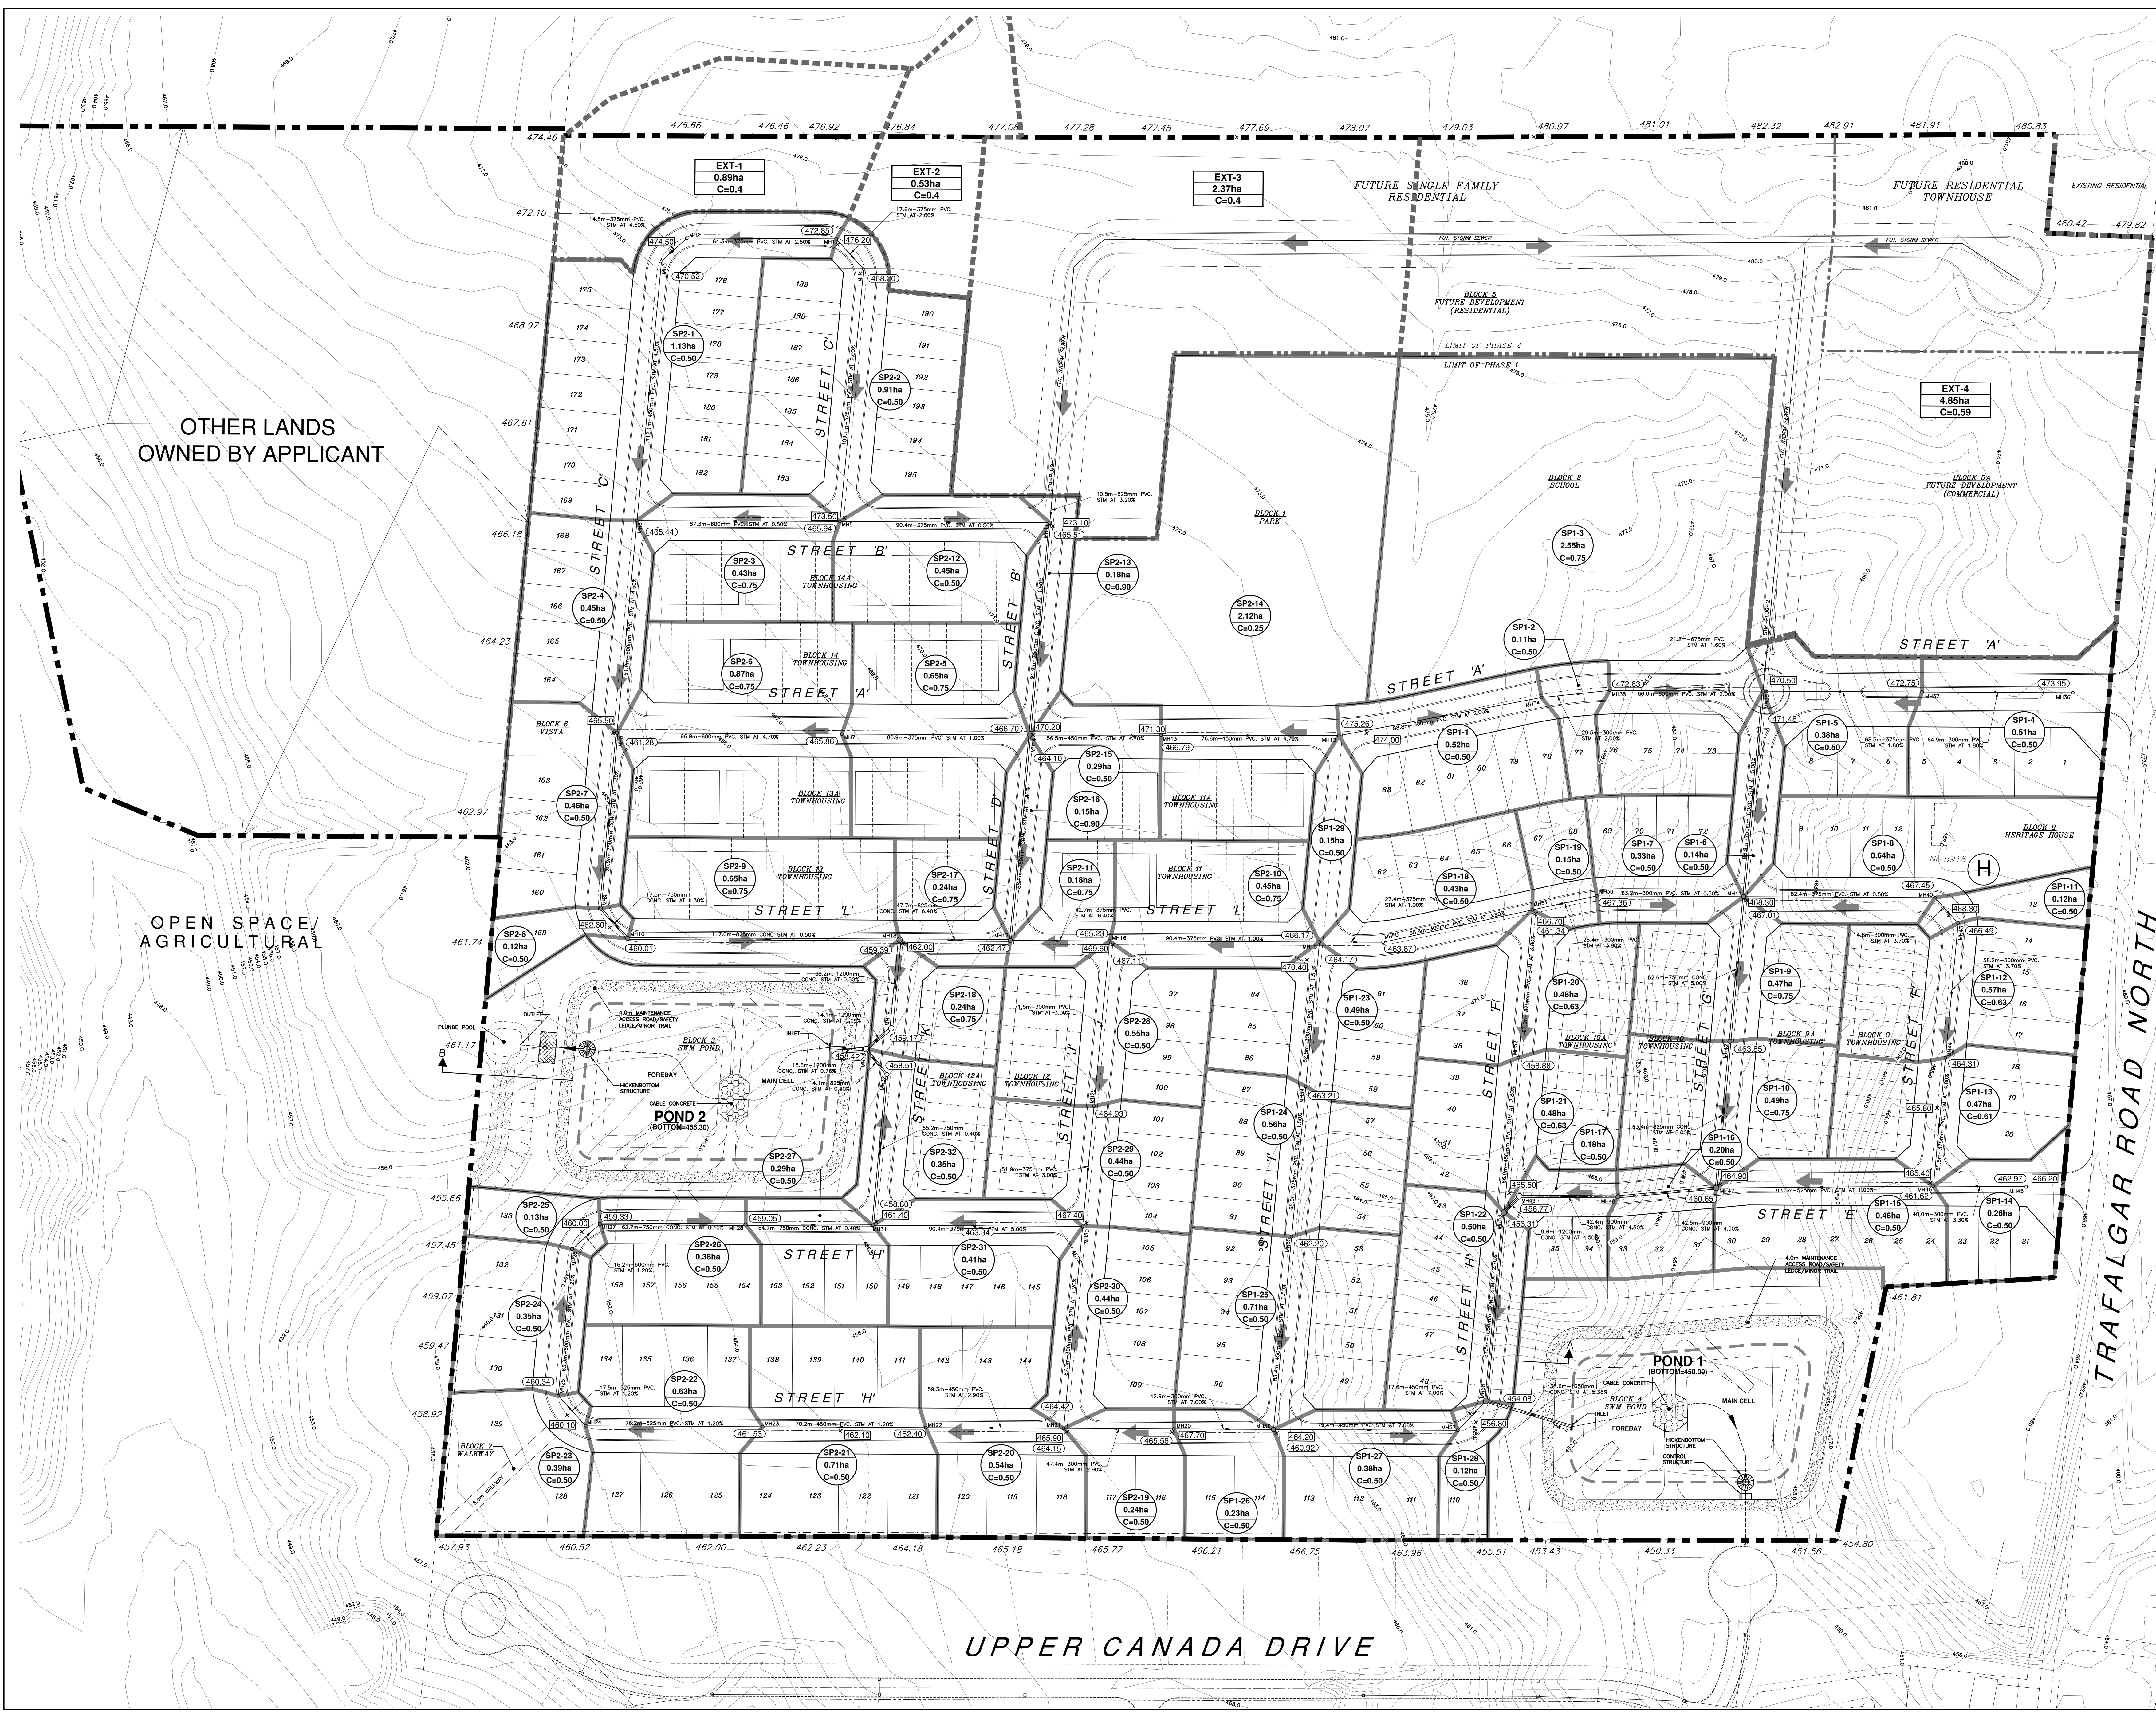


- KEY PLAN**
- LEGEND:**
- LIMIT OF SUBDIVISION
 - PHASING LIMIT
 - - - EXISTING PROPERTY LINE
 - PROPOSED STORM SEWER
 - EXISTING STORM SEWER
 - 455.51 PROPOSED ELEVATIONS
 - 456.80 FUTURE ELEVATIONS
 - STORM DRAINAGE AREA BOUNDARY
 - - - EXTERNAL STORM DRAINAGE AREA BOUNDARY
 - - - INFILTRATION TRENCH
 - OVERLAND FLOW ROUTE
 - SP1-1 DENOTES DRAINAGE NODE
 - 0.65ha DENOTES AREA IN HECTARES
 - C=0.50 DENOTES DRAINAGE COEFFICIENT
 - EXT-1 DENOTES EXTERNAL DRAINAGE NODE
 - 0.10ha DENOTES AREA IN HECTARES

- REFERENCE DRAWINGS:**
1. REFER TO DRAFT PLAN (PL-1) PREPARED BY CANDEVCON LIMITED FOR SUBDIVISION LAYOUT.
 2. REFER TO DRAWING PS-1 FOR INFORMATION ON STORM, SANITARY & FDC.
 3. REFER TO DRAWING EXT-ST1 FOR INFORMATION ON EXTERNAL STORM DRAINAGE AREAS.

NO.	DESCRIPTION	DATE	BY

REVISIONS

304 CANDEVCON LIMITED
CONSULTING ENGINEERS AND PLANNERS
TEL: (905) 794-8600 FAX: (905) 794-0611

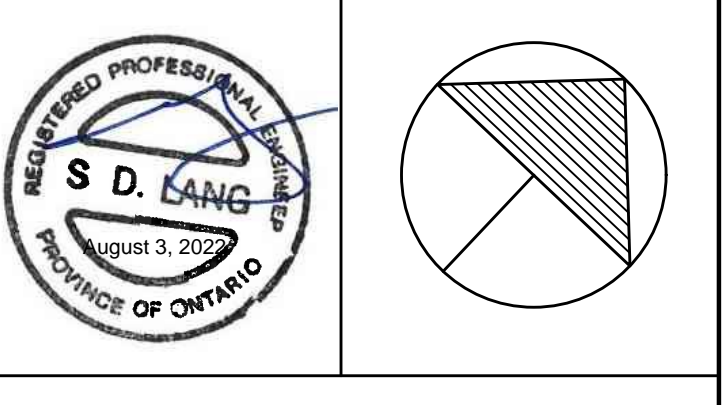

HILLSBURGH HEIGHTS INC.
RESIDENTIAL SUBDIVISION
5616 TRAFFALGAR ROAD NORTH
PART 1 OF PLAN 61R-9590
PART OF LOT 26, CONCESSION 7
HILLSBURGH URBAN AREA
TOWN OF ERIN


STORM DRAINAGE PLAN

SHEET TITLE:

DRAWN BY: E.A.M. PROJECT No. W21081
CHECKED BY: S.L. DRAWING No. ST-1
SCALE: 1:1000
DATE: OCT 1st, 2021

J:\DCD-2021 WEST - FINEWORK\HILLSBURGH-HIGHWOOD-HOMES\PS-1\ST-1 STORM DRAINAGE AREA PLAN.dwg, 2022-08-04 10:31:15 AM

J:\DCD\2021 WEST - FINE\W2101HILLSBURGH-HIGHWOOD-HOMES\PS-1 SANITARY DRAINAGE AREA PLAN.DWG, 2022-08-04 10:38:11 AM

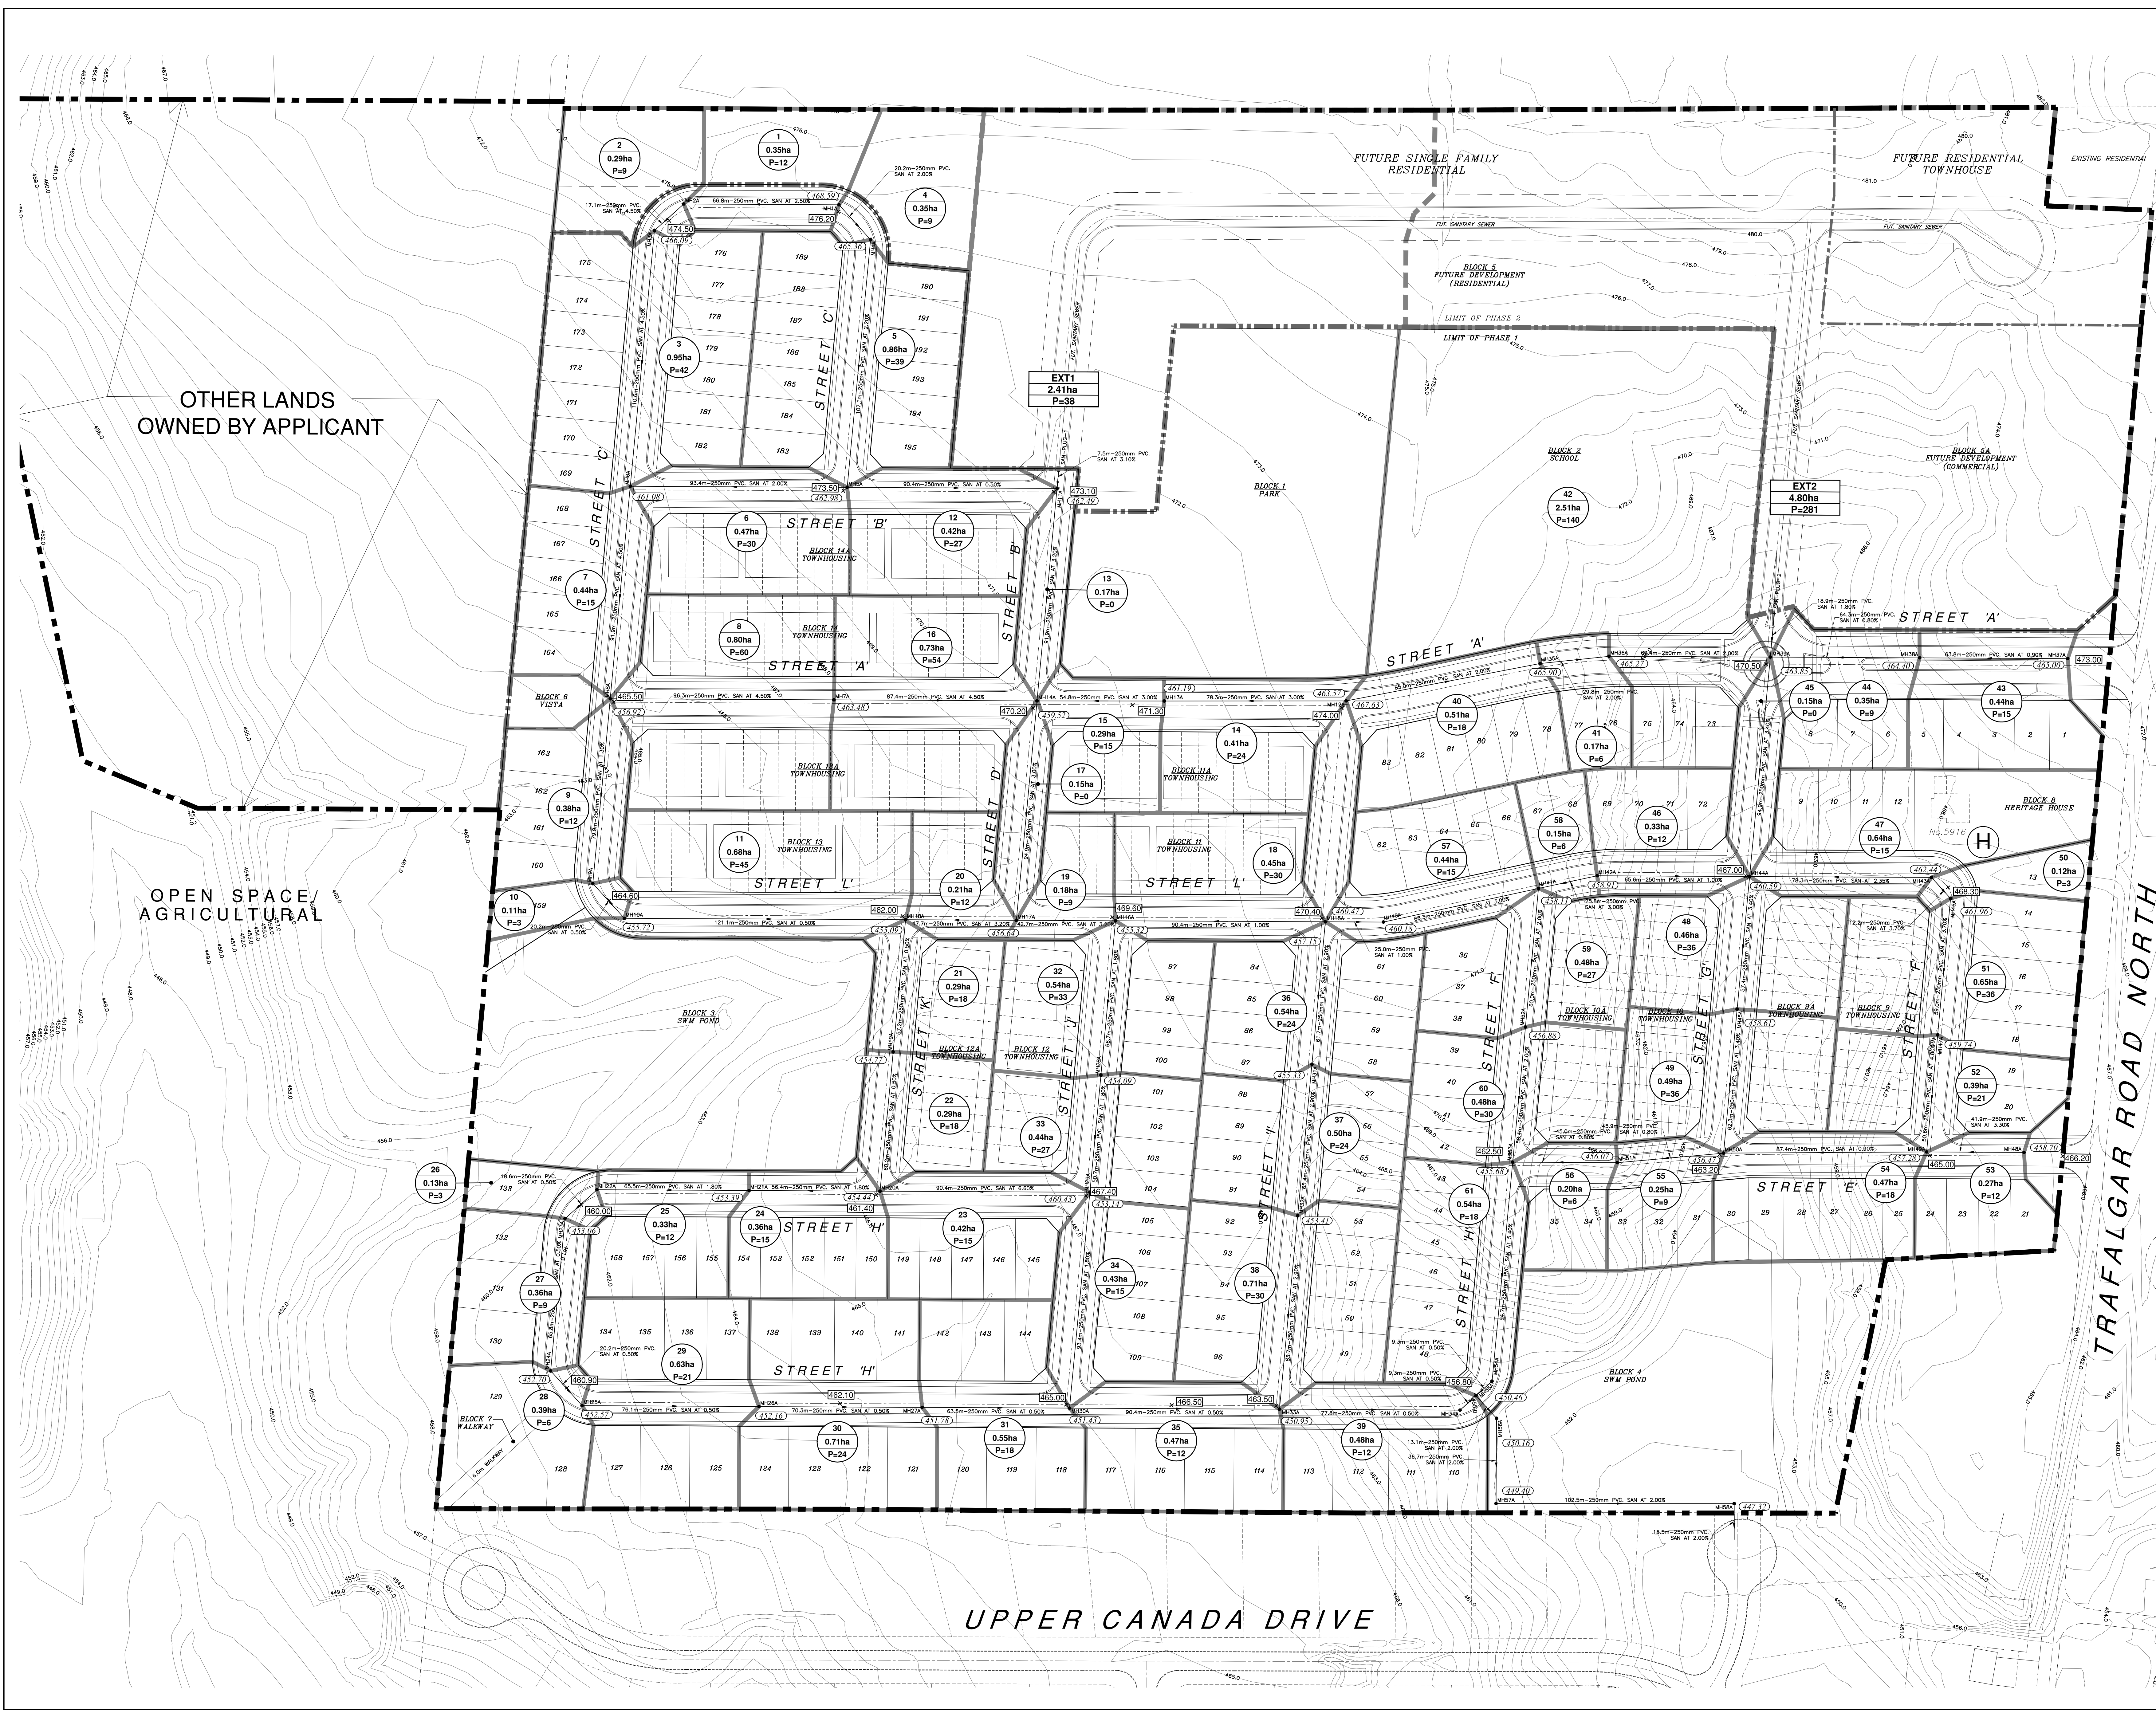


OTHER LANDS OWNED BY APPLICANT

OPEN SPACE/ AGRICULTURAL

UPPER CANADA DRIVE

TRAFALGAR ROAD NORTH

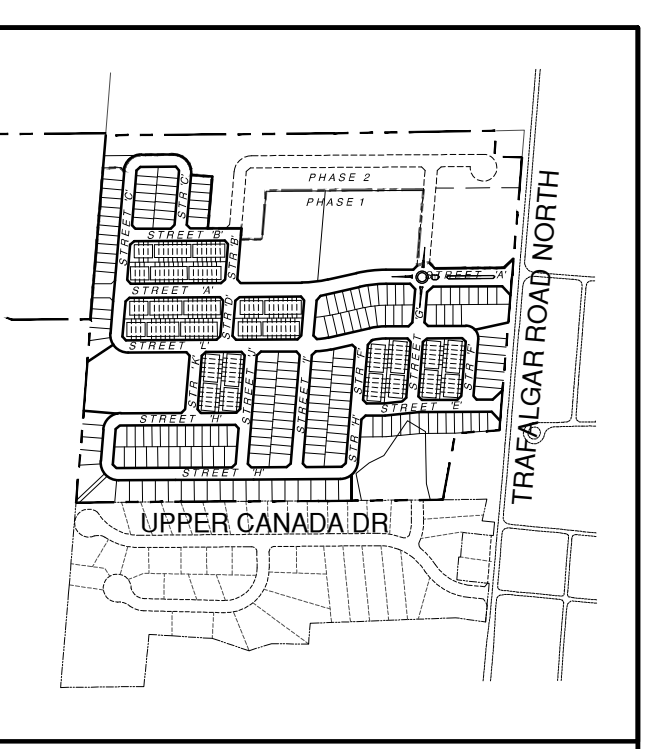

KEY PLAN

- LEGEND:**
- LIMIT OF SUBDIVISION
 - PHASING LIMIT
 - PROPOSED SAN SEWER
 - EXISTING SAN SEWER
 - PROPOSED ROAD GRADE
 - PROPOSED SAN SEWER INVERT
 - SANITARY DRAINAGE AREA BOUNDARY
 - EXTERNAL SANITARY DRAINAGE AREA BOUNDARY
 - 1 DENOTES AREA NUMBER
 - 0.56ha DENOTES AREA IN HECTARES
 - P=22 DENOTES EQUIVALENT POPULATION

- REFERENCE DRAWINGS:**
1. REFER TO DRAFT PLAN (PL-1) PREPARED BY CANDEVCON LIMITED FOR SUBDIVISION LAYOUT
 2. REFER TO DRAWING PS-1 FOR INFORMATION ON STORM & SANITARY.

NO.	DESCRIPTION	DATE	BY


CANDEVCON LIMITED
CONSULTING ENGINEERS AND PLANNERS
TEL. (905) 794-0800 FAX (905) 794-0611




HILLSBURGH HEIGHTS INC.
RESIDENTIAL SUBDIVISION
5616 TRAFALGAR ROAD NORTH
PART 1 OF PLAN 61R-9590
PART OF LOT 26, CONCESSION 7
HILLSBURGH URBAN AREA
TOWN OF ERIN

SANITARY DRAINAGE PLAN


DRAWN BY:	E.A.M	PROJECT No.:	W21081
CHECKED BY:	S.L	DRAWING No.:	
SCALE:	1:1000	SA-1	
DATE:	OCT 1st, 2021		

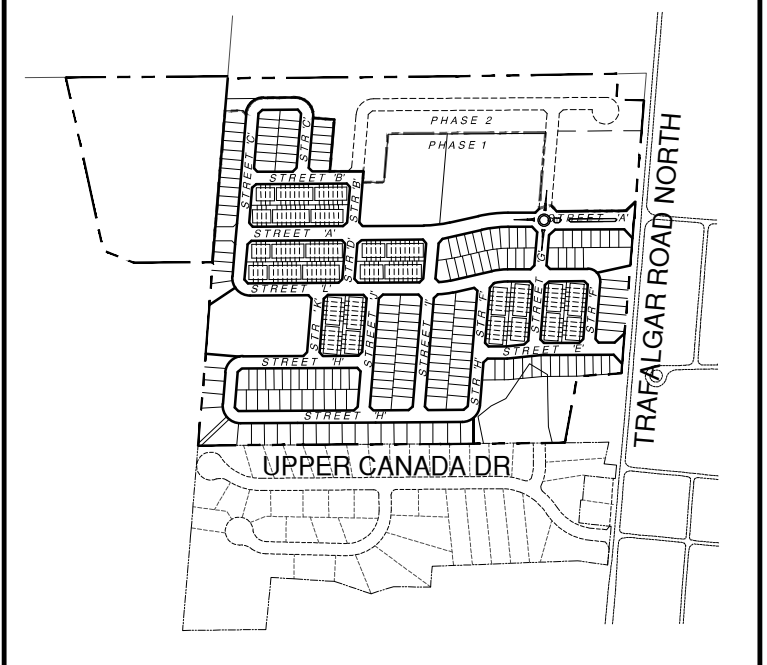


KEY PLAN

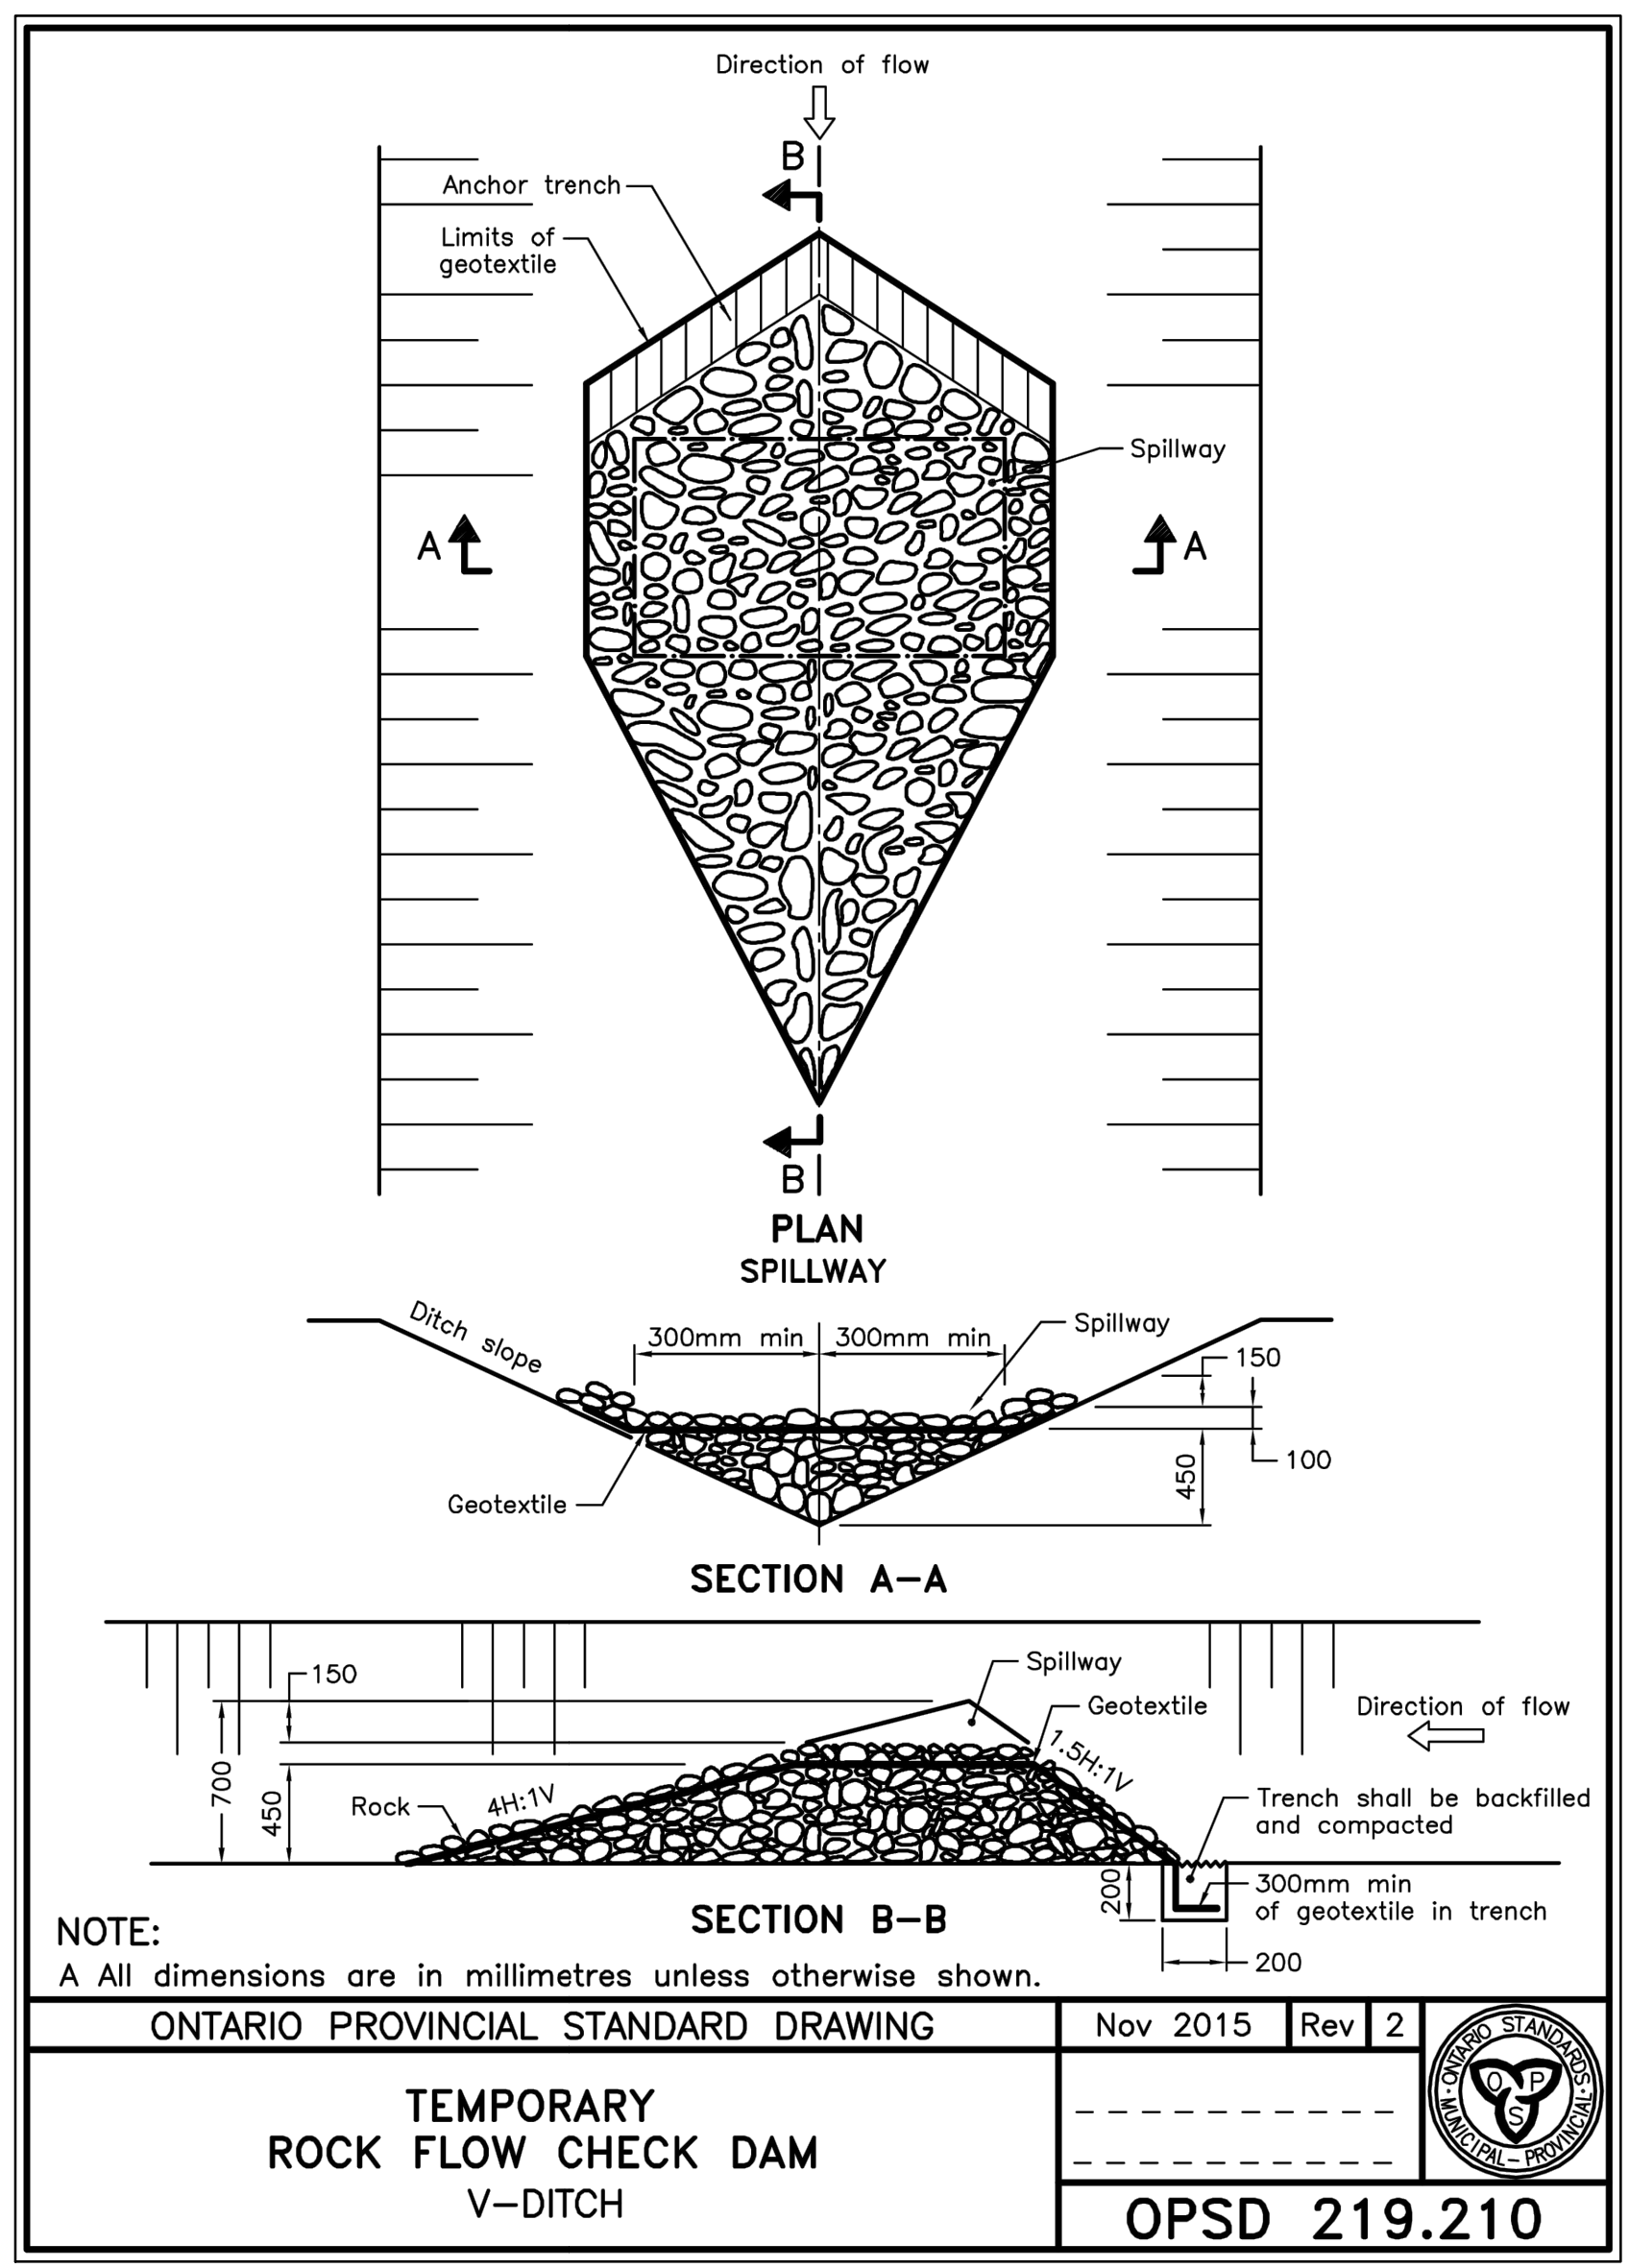

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2015 Rev 2
TEMPORARY ROCK FLOW CHECK DAM V-DITCH
 OPSD 219.210

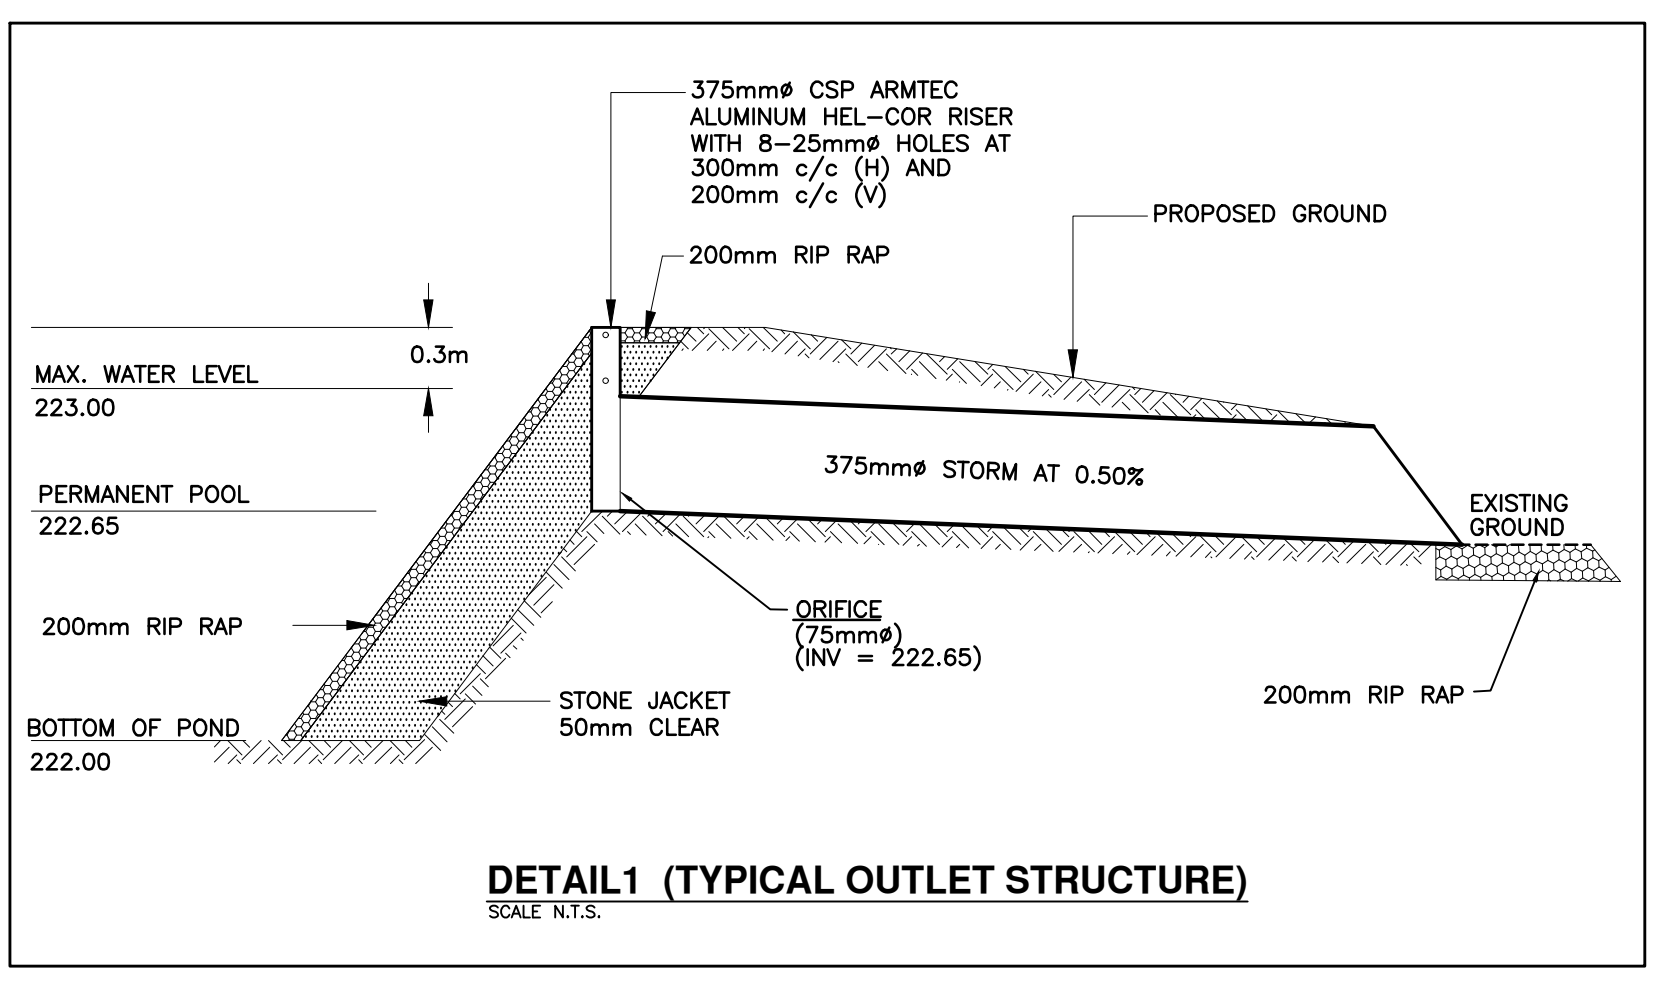


DETAIL 1 (TYPICAL OUTLET STRUCTURE)
 SCALE: N.T.S.

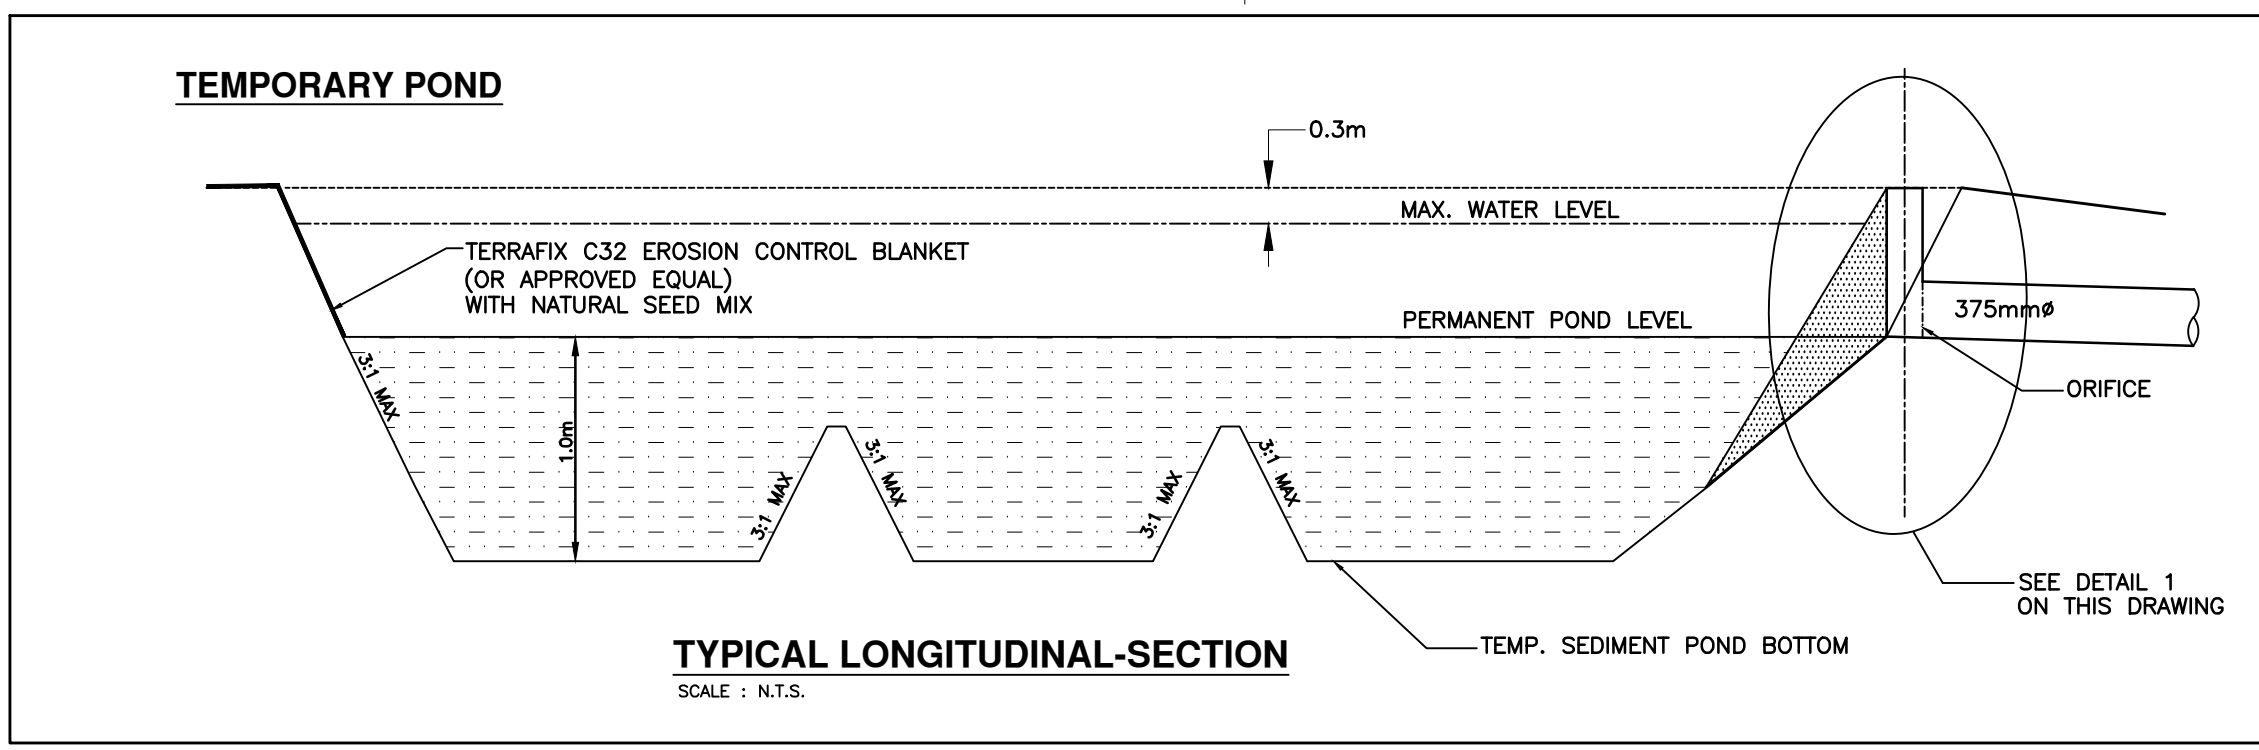

TYPICAL LONGITUDINAL-SECTION
 SCALE: 1: N.T.S.


POND No./NAME	DRAINAGE AREA (Ha.)	PERMANENT POOL DEPTH (m)	ACTIVE STORAGE DEPTH (m)	PERMANENT POOL VOLUME REQUIRED (m ³)	ACTIVE STORAGE REQUIRED (m ³)
1	12.9	1.0	0.59	2580	1600
2	6.0	1.0	0.63	1200	750
3	4.7	1.0	0.62	940	590
4	13	1.0	0.60	2600	1625

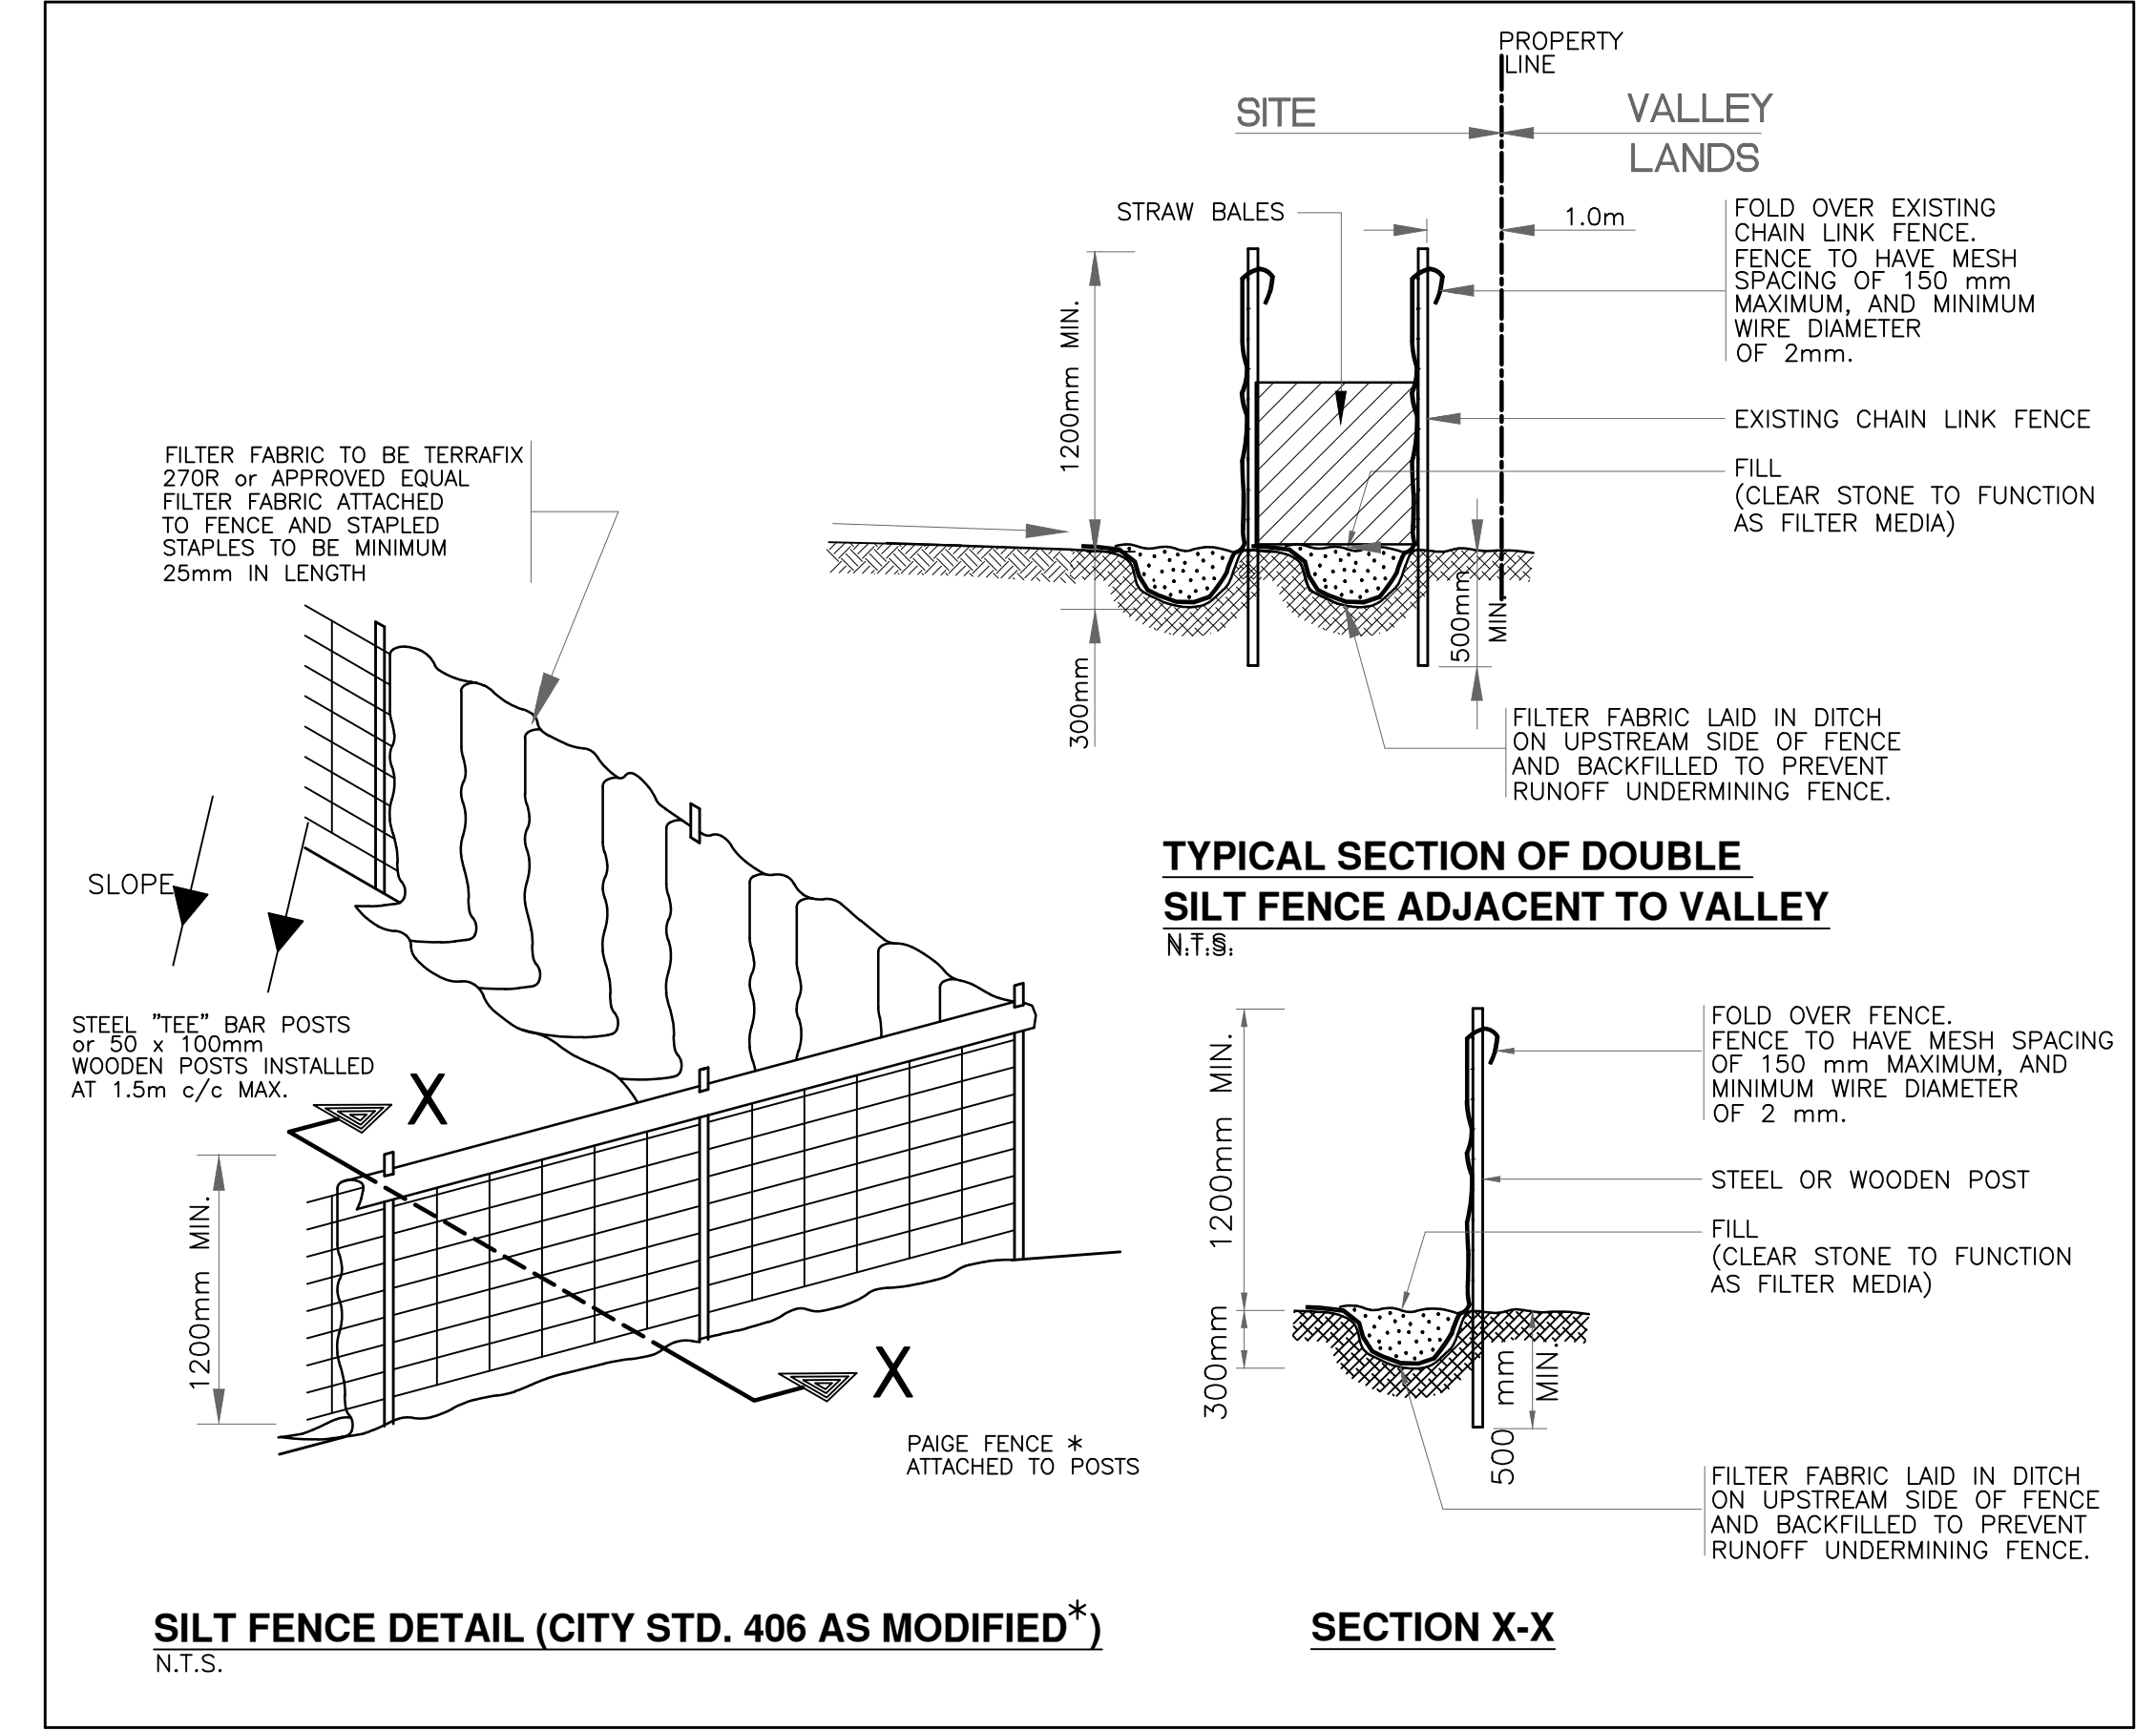


SILT FENCE DETAIL (CITY STD. 406 AS MODIFIED*)
 N.T.S.

TYPICAL SECTION OF DOUBLE SILT FENCE ADJACENT TO VALLEY
 N.T.S.

SECTION X-X
 N.T.S.

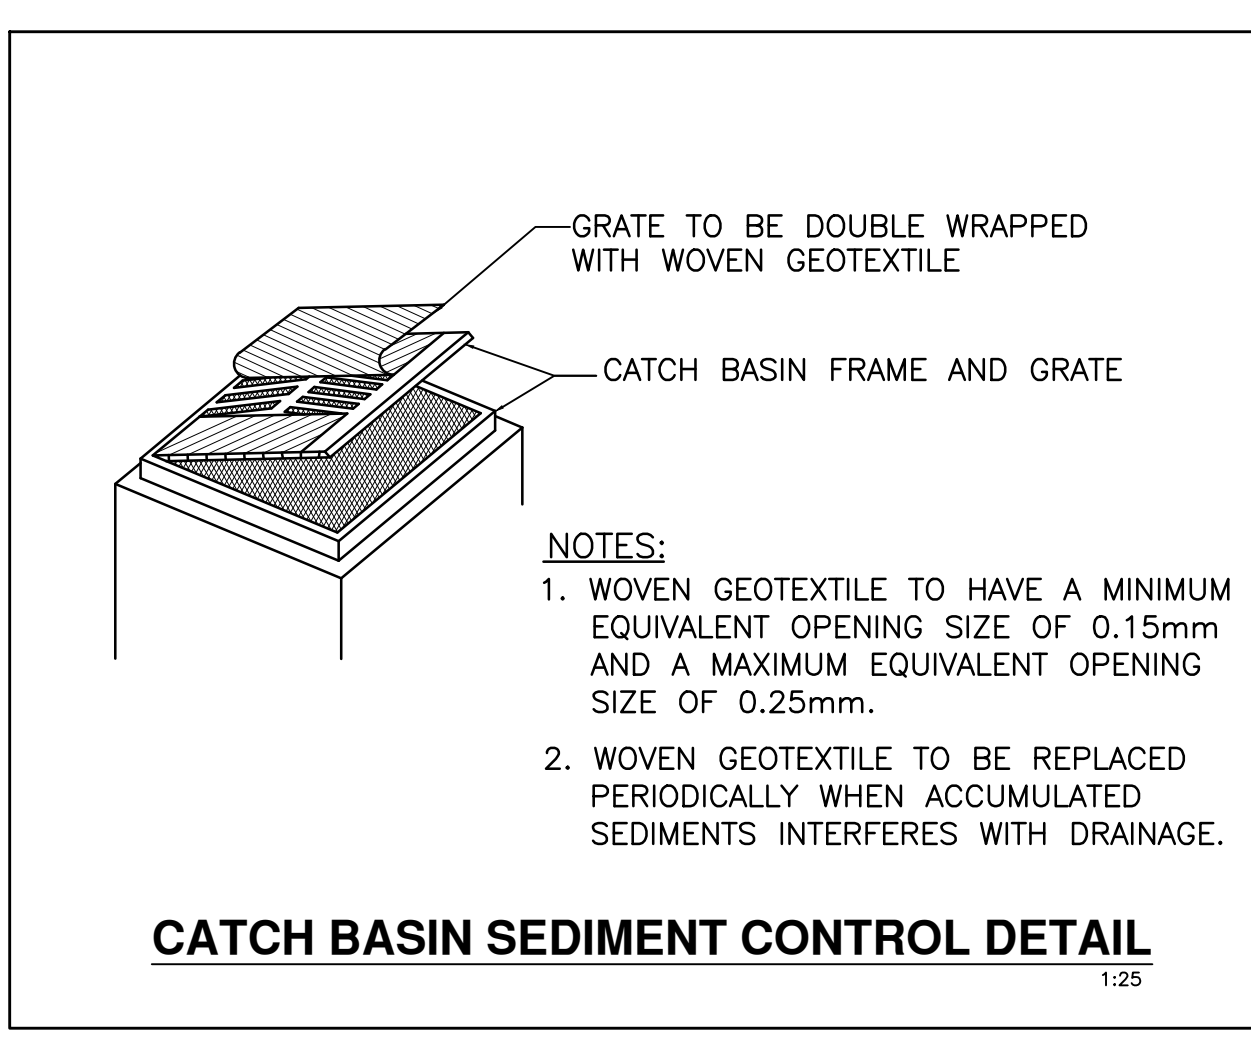

CATCH BASIN SEDIMENT CONTROL DETAIL
 1:25

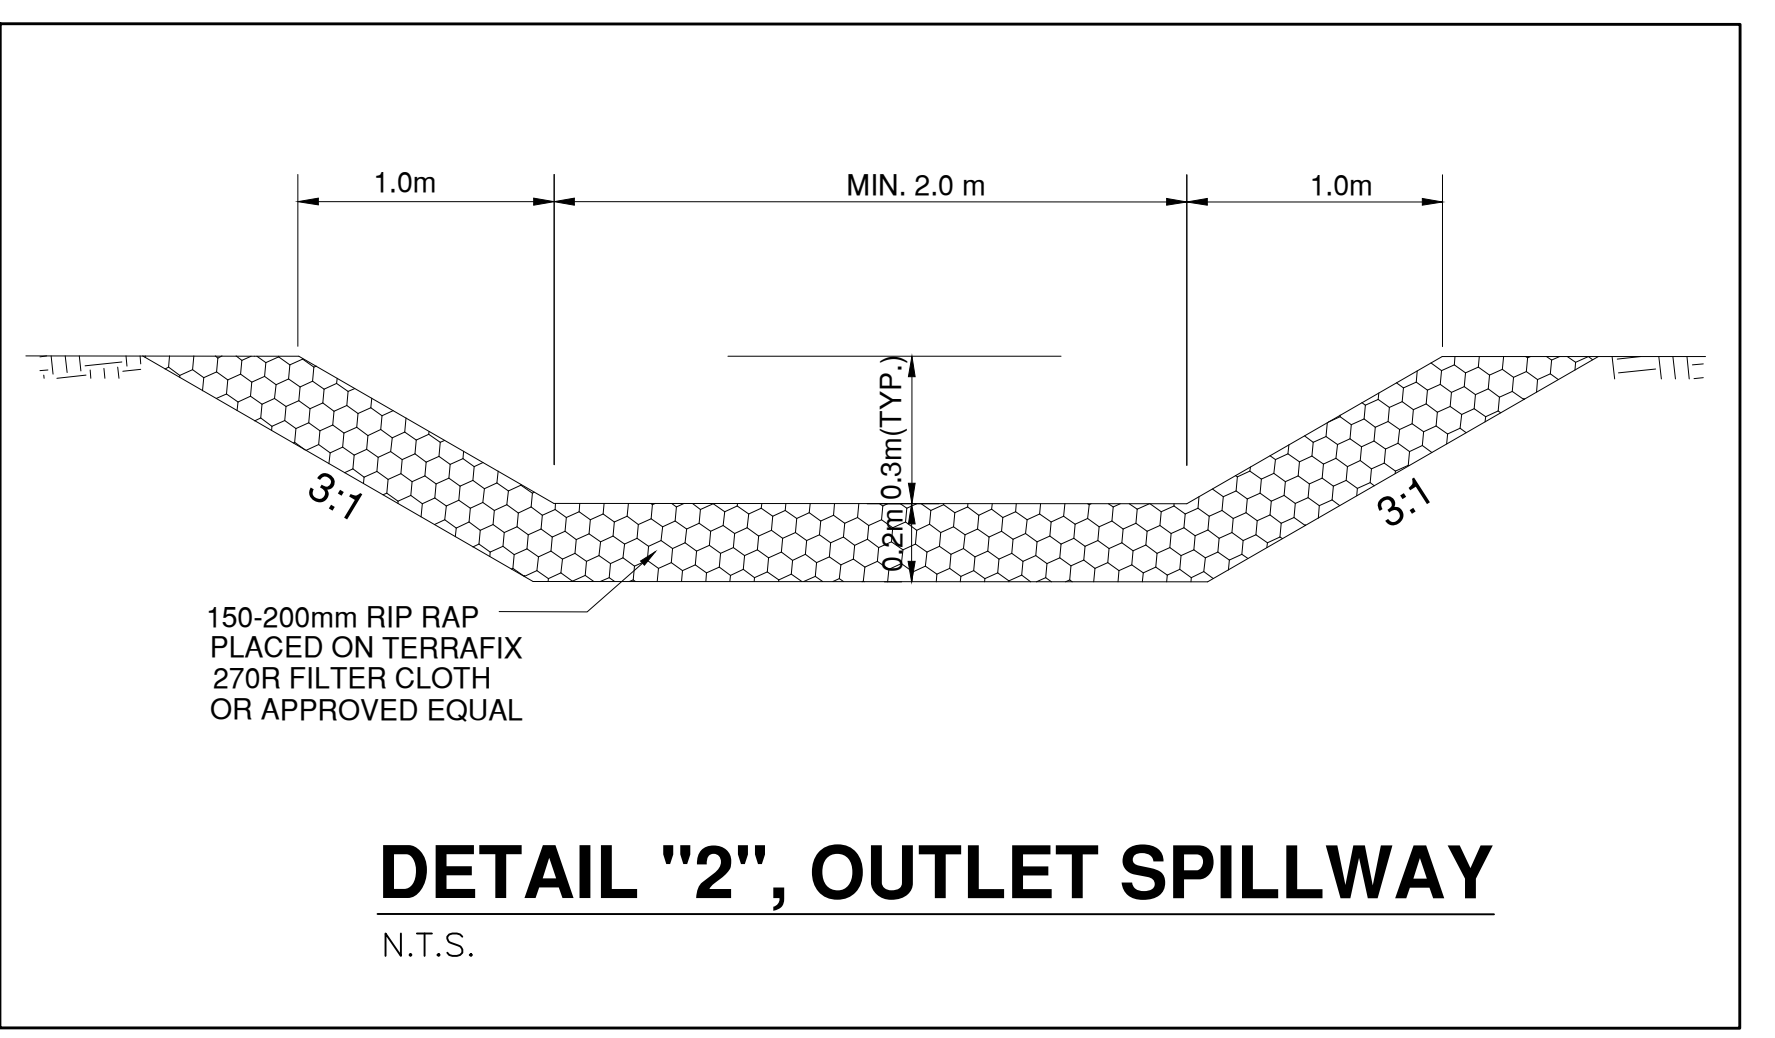


DETAIL "2", OUTLET SPILLWAY
 N.T.S.

REFERENCE DRAWINGS:
 1. REFER TO DRAFT PLAN (PL-1) PREPARED BY CANDEVCON LIMITED FOR SUBDIVISION LAYOUT.
 2. REFER TO DRAWING PS-1 FOR INFORMATION ON STORM, SANITARY & FDC

NO.	DESCRIPTION	DATE	BY
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			

CANDEVCON LIMITED
 CONSULTING ENGINEERS AND PLANNERS
 TEL: (905) 794-0800 FAX: (905) 794-0811


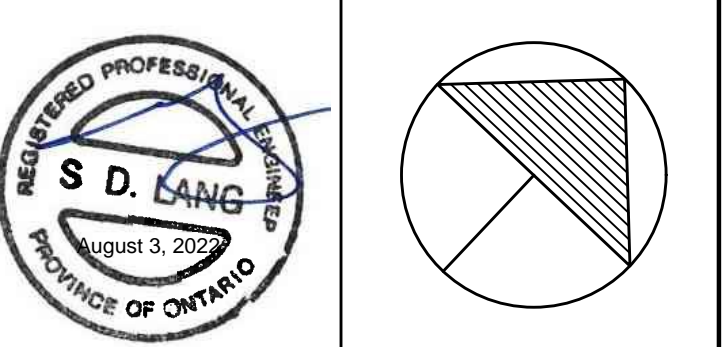


HILLSBURGH HEIGHTS INC.
 RESIDENTIAL SUBDIVISION
 5616 TRAFALGAR ROAD NORTH
 PART 1 OF PLAN 61R-9590
 PART OF LOT 26, CONCESSION 7
 HILLSBURGH URBAN AREA
 TOWN OF ERIN

EROSION & SEDIMENT CONTROL DETAILS

DRAWN BY: E.A.M	PROJECT No. W21081
CHECKED BY: S.L	DRAWING No. ESC-1A
SCALE: 1:1000	DATE: OCT 1st, 2021

J:\DCD\2021 WEST - Hillsburgh-Hillside-Hillside-ESC - Erosion Sediment Control and Details.dwg, 2022-08-04 10:27:22 AM

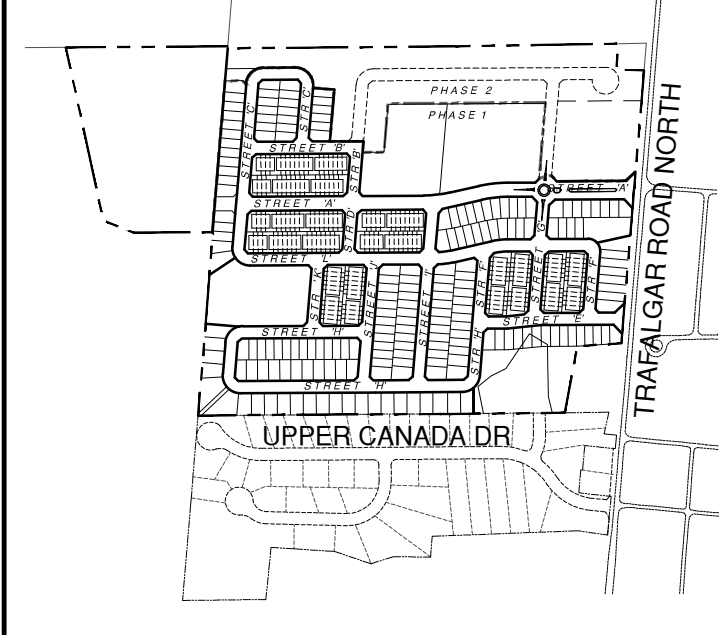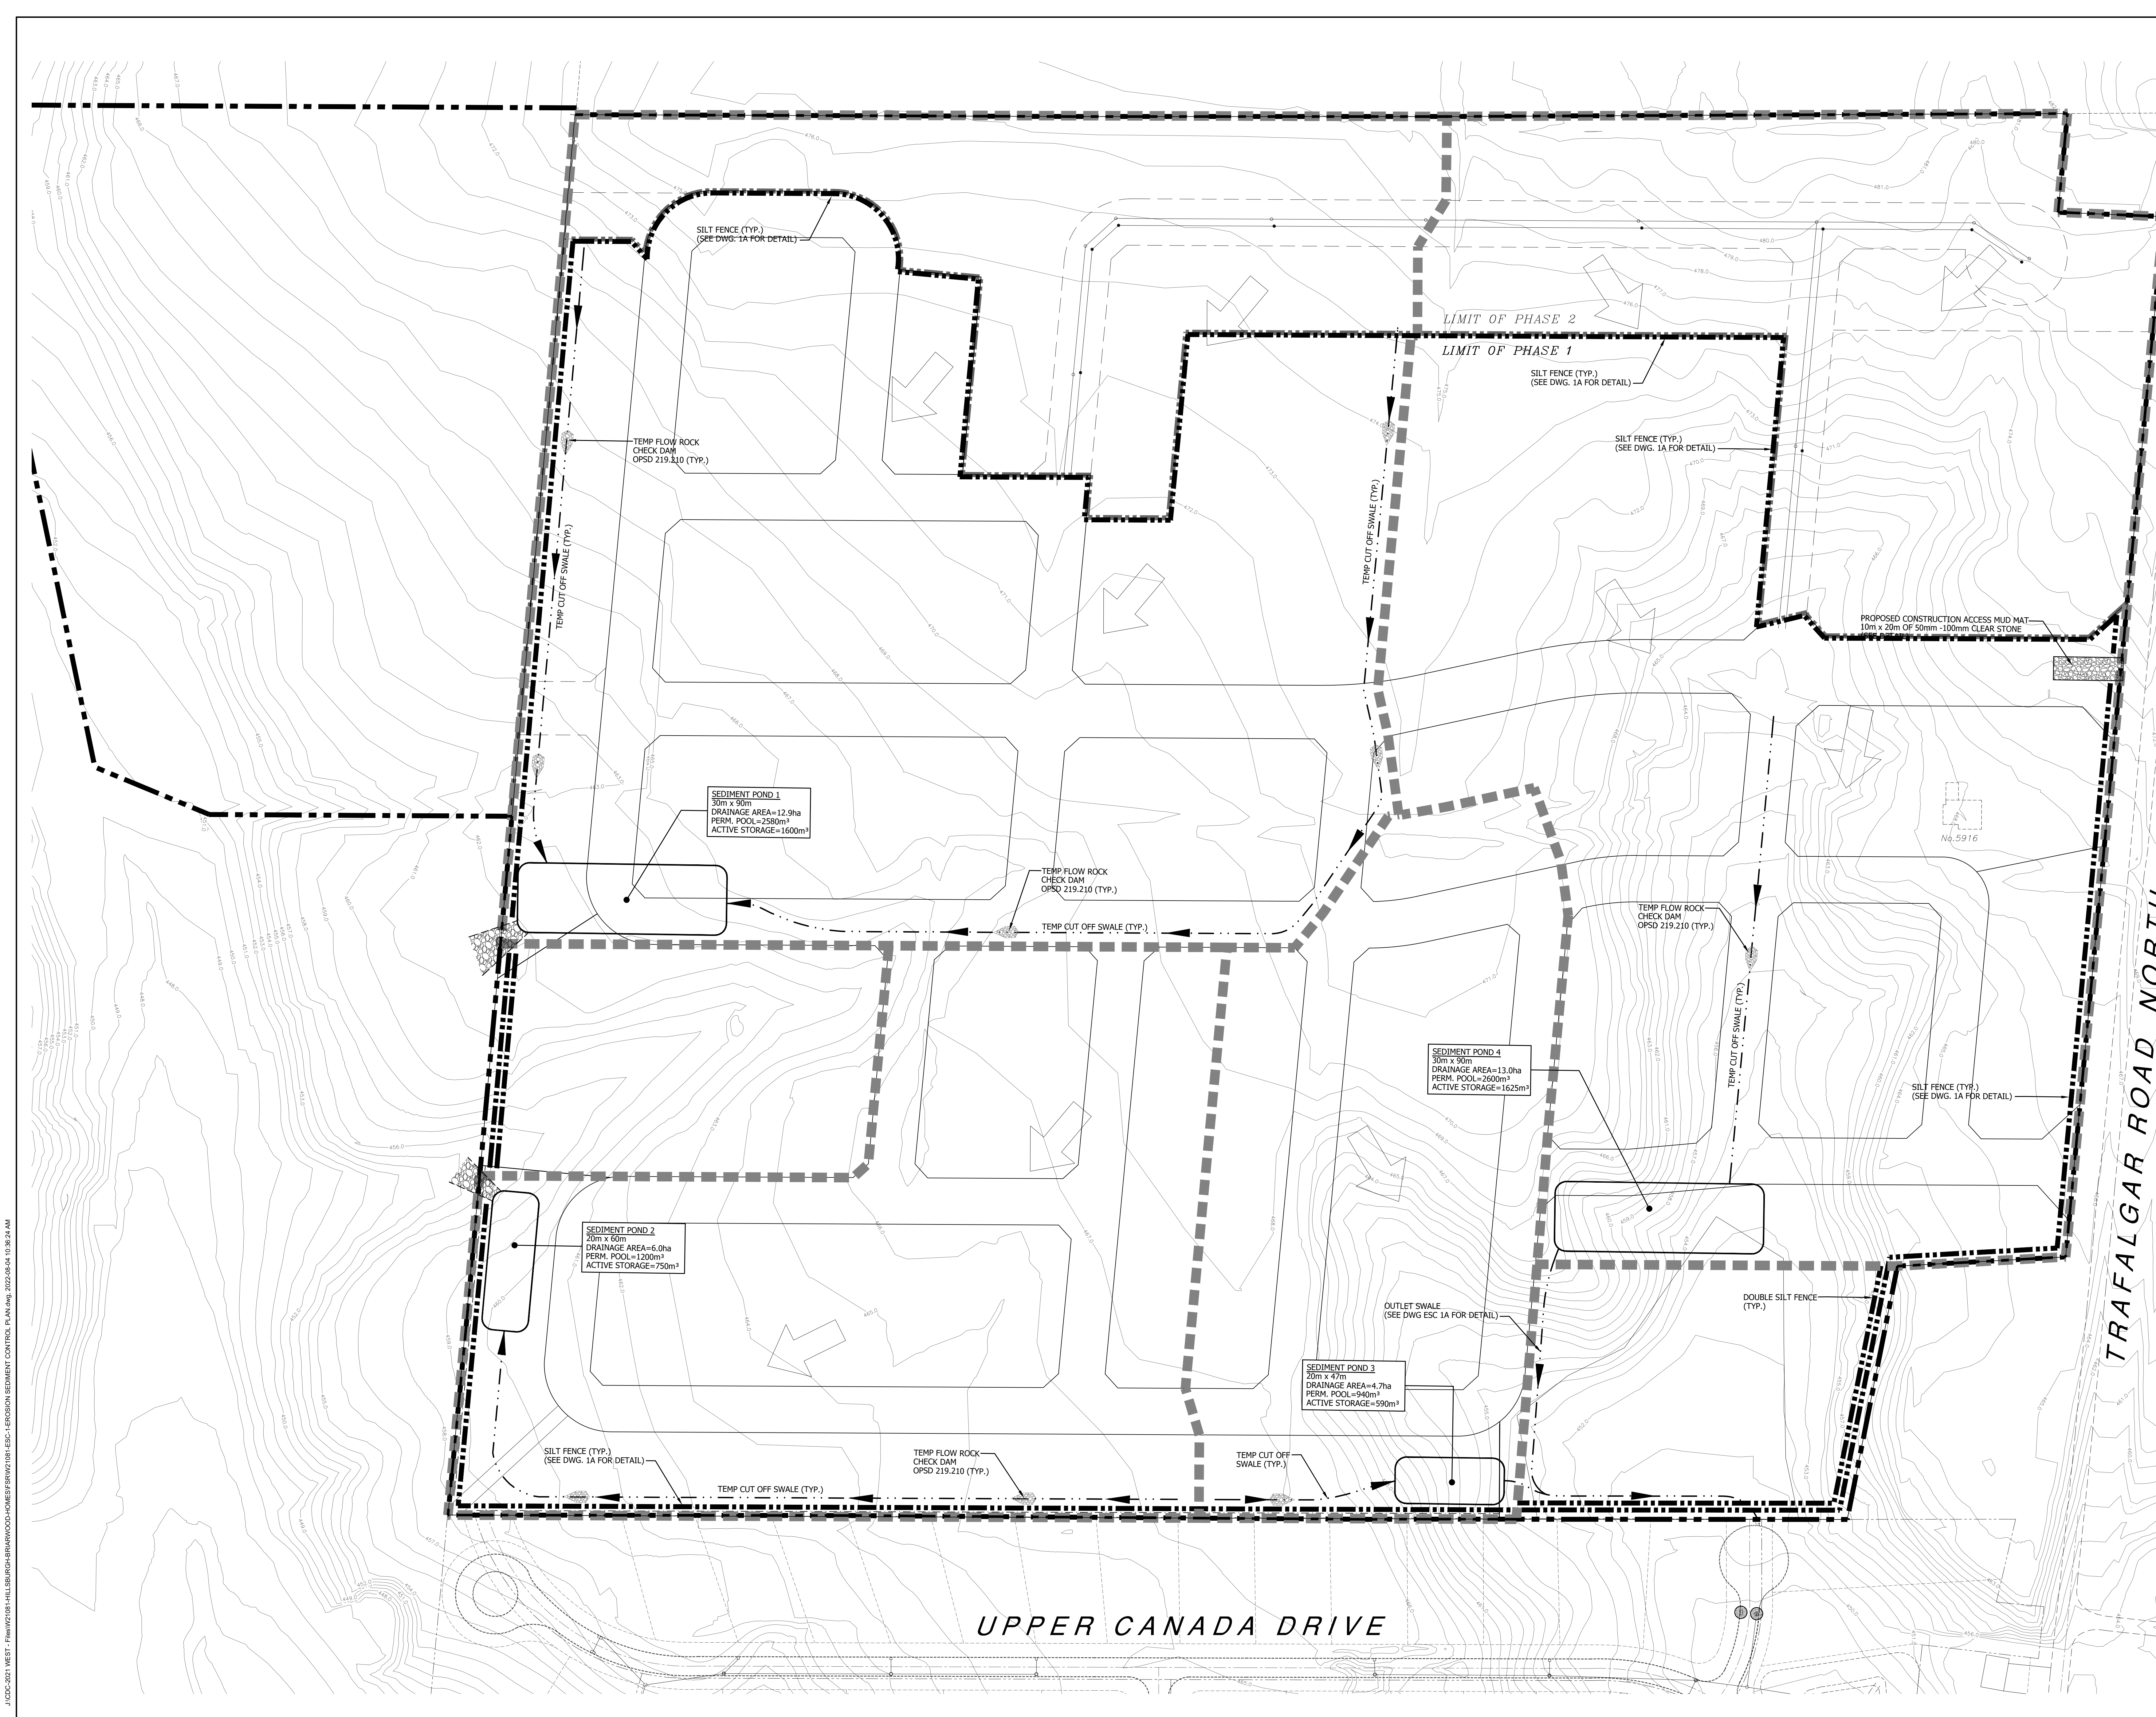

KEY PLAN

LEGEND:


- EX.MH1 ○ EXISTING STORM MAINTENANCE HOLE
- EX.MH1A ● EXISTING SANITARY MAINTENANCE HOLE
- SUBDIVISION BOUNDARY
- SILT FENCE
- DOUBLE SILT FENCE
- CUT-OFF SWALE
- DRAINAGE AREA BOUNDARY
- CONSTRUCTION ACCESS MUD MAT (10m WIDE c/w THE THICKNESS OF 300mm OF 50mm TO 100mm CLEAR STONE)
- CATCHBASIN SEDIMENT CONTROL PROTECTION
- FLOW ARROW

REFERENCE DRAWINGS:

1. REFER TO DRAFT PLAN (PL-1) PREPARED BY CANDEVCON LIMITED FOR SUBDIVISION LAYOUT.
2. REFER TO DRAWING PS-1 FOR INFORMATION ON STORM, SANITARY & FDC

NO.	DESCRIPTION	DATE	BY

304 CANDEVCON LIMITED
CONSULTING ENGINEERS AND PLANNERS
TEL: (905) 794-0800 FAX: (905) 794-0811

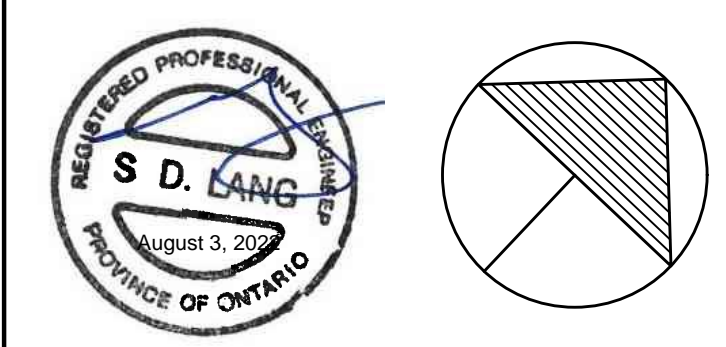

HILLSBURGH HEIGHTS INC.
RESIDENTIAL SUBDIVISION
5616 TRAFALGAR ROAD NORTH
PART 1 OF PLAN 61R-9590
PART OF LOT 26, CONCESSION 7
HILLSBURGH URBAN AREA
TOWN OF ERIN

EROSION & SEDIMENT CONTROL PLAN

DRAWN BY: E.A.M	PROJECT No. W21081
CHECKED BY: S.L	DRAWING No. ESC-1
SCALE: 1:1000	DATE: OCT 1st, 2021

J:\DC\2021 WEST - FINE\W21081-HILLSBURGH-HIGHWAYWOOD-HOUSES\EROSION-SEDIMENT CONTROL PLAN.dwg, 2022-08-04 10:38:24 AM

