

SAMPLE SITE PLAN

PROPERTY LINES (NOT NECESSARILY LOCATION OF FENCE - CONFIRM ON SURVEY)

PROVIDE THE FOLLOWING DIMENSIONS

HOUSE SETBACKS TO PROPERTY LINES

A. _____

B. _____

EDGE OF DECK OR STAIRS TO SIDE PROPERTY LINES

C. _____

D. _____

EDGE OF DECK OR STAIRS TO REAR PROPERTY LINE

E. _____

HEIGHT OF DECK ABOVE FINISHED GRADE

F. _____

YOUR STREET NAME

* USE SURVEY TO SHOW SETBACKS (PROVIDED WITH HOUSE PURCHASE) OR SKETCH DRAWN TO SCALE

* THE SETBACKS FROM THE EDGE OF THE DECK OR EDGE OF STAIRS (WHERE APPLICABLE) ARE SET OUT BY THE TOWN

* CONSERVATION AUTHORITY APPROVAL MAY BE REQUIRED
DEPENDING ON YOUR ADDRESS

* CONSIDER CONTACTING SOMEONE IN THE PLANNING OFFICE FOR YOUR ZONING AND
SETBACK REQUIREMENTS BEFORE APPLYING FOR A BUILDING PERMIT

Site plan measurements and scale to be in metric.

Deck Permit Specifications

Joist Span	Pier Size				Beam Size				Joist Size	
	Pier Spacing				Pier Spacing					
	6'	8'	10'	12'	6'	8'	10'	12'		
6'	8" dia.	10" dia.	10" dia.	12" dia.	2/2"x 6"	2/2"x 6"	2/2"x 8"	2/2"x 10"	**2 x 6	
8'	10" dia.	10" dia.	12" dia.	12" dia.	2/2"x 6"	2/2"x 6"	2/2"x 8"	2/2"x 10"	**2 x 6	
10'	10" dia.	12" dia.	12" dia.	<u>*12" dia.</u>	2/2"x 6"	2/2"x 8"	2/2"x 10"	2/2"x 12"	2 x 8	
12'	10" dia.	12" dia.	<u>*12" dia.</u>	<u>*12" dia.</u>	2/2"x 6"	2/2"x 8"	2/2"x 10"	2/2"x 12"	2 x 10	

Wood Deck (2500 PSF)

***NOTE:** Piers with these spacing and joist spans might require bell-out at the bottom or footing.

****NOTE:** All joist sizes shall be a minimum 2"x 8" with joists spaced not more than 16" on centre where the deck is more than 2'- 0" above adjacent grade.

BEAM SIZING TABLE

SUPPORTED JOIST LENGTH (mm)	LIVE LOAD 1.9 kPa			LIVE LOAD 2.5 kPa			LIVE LOAD 3.0 kPa		
	PIER SPACING (mm)			PIER SPACING (mm)			PIER SPACING (mm)		
	2000	3000	4000	2000	3000	4000	2000	3000	4000
1500	2/38x140	2/38x184	3/38x255	2/38x140	3/38x184	3/38x255	3/38x140	2/38x255	2/38x286
2000	2/38x140	3/38x184	3/38x255	2/38x184	3/38x255	3/38x286	2/38x184	2/38x255	3/38x286
2500	2/38x184	2/38x255	3/38x286	2/38x184	3/38x255	3/38x286	2/38x184	3/38x255	4/38x286
3000	2/38x184	2/38x255	3/38x286	2/38x184	3/38x255	4/38x286	2/38x184	3/38x255	4/38x286
3500	2/38x184	3/38x255	3/38x286	2/38x184	3/38x255	4/38x286	3/38x184	3/38x255	N/A
4000	2/38x184	3/38x255	4/38x286	2/38x184	3/38x286	N/A	3/38x184	3/38x286	N/A

JOIST SIZING TABLE

JOIST SPAN (mm)	LIVE LOAD 1.9 kPa			LIVE LOAD 2.5 kPa			LIVE LOAD 3.0 kPa		
	JOIST SPACING (mm)			JOIST SPACING (mm)			JOIST SPACING (mm)		
	300	400	600	300	400	600	300	400	600
2000	38x140	38x140	38x140	38x140	38x140	38x140	38x140	38x140	38x140
2500	38x140	38x140	38x184	38x140	38x184	38x184	38x140	38x184	38x184
3000	38x140	38x184	38x184	38x184	38x184	38x255	38x184	38x184	38x255
3500	38x184	38x184	38x255	38x184	38x255	38x255	38x255	38x255	38x255
4000	38x255	38x255	38x286	38x255	38x286	38x286	38x255	38x255	38x286

FOOTING SIZES


SOIL BEARING CAPACITIES (kPa)	
SOIL TYPE	BEARING PRESSURE (kPa)
SOFT CLAY	40
LOOSE SAND OR GRAVEL	50
FIRM CLAY	75
DENSE COMPACT SILT	100
STIFF CLAY	150
DENSE COMPACT SAND OR GRAVEL	150
TILL	200
CLAY SHALE	300
SOUND ROCK	500

PIER SIZES

DIAMETER (mm)	M ²
200	0.03
250	0.05
300	0.08
350	0.10
400	0.15
500	0.20
600	0.30

POST SIZING TABLE

POST SIZE (mm)	MAXIMUM HEIGHT (M)	MAX. SUPPORTED DECK AREA (M ²)		
		LIVE LOAD (kPa)	1.9	2.5
84x84	1.0	10.86	8.71	7.48
	1.5	5.93	4.76	4.04
	2.0	3.15	2.55	2.17
140x140	2.0	15.61	10.98	9.45
	2.5	9.32	7.48	6.48
	3.0	6.35	5.10	4.38
	3.5	4.41	3.54	3.04

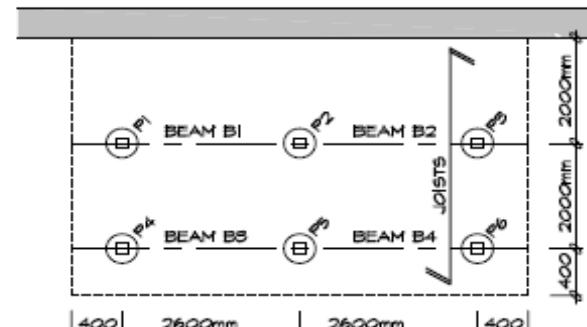PLAN EXAMPLE	PIERS	SUPPORTED DECK AREA	
	P1	2 x 1.7 = 3.4m ²	
	P2	2 x 2.6 = 5.2m ²	
	P3	2 x 1.7 = 3.4m ²	
	P4	1.4 x 1.7 = 2.4m ²	
	P5	1.4 x 2.6 = 3.6m ²	
	P6	1.4 x 1.7 = 2.4m ²	
	BEAMS	SUPPORTED JOIST LENGTH	
	B1	2000mm	
	B2	2000mm	
	B3	1400mm	
	B4	1400mm	
	BEAM SPAN =	2600mm	
	JOIST SPAN =	2000mm	


PIER SIZE (M²) = SUPPORTED DECK AREA (M²) x MIN. 1.9 (kPa) LIVE LOAD
 SOIL BEARING CAPACITY (kPa)

GENERAL NOTES

- A MINIMUM LIVE LOAD OF 1.9 (kPa) SHALL BE APPLIED IN ALL LOCATIONS.
- THE PRESCRIBED SNOW LOAD FOR 225 SELECTED ONTARIO LOCATIONS IS INDICATED IN COLUMN 12 OF TABLE I-2 IN SUPPLEMENTARY GUIDELINE SB-1 OF THE ONTARIO BUILDING CODE. THE SNOW LOAD SHALL BE APPLIED AS THE MINIMUM LIVE LOAD WHERE IT IS GREATER THAN 1.9 (kPa).
- A SITE PLAN OR SURVEY IS REQUIRED SHOWING ALL LOT LINES & DIMENSIONS, SIZE & LOCATION OF ALL EXISTING BUILDINGS & DECKS.
- LUMBER NO. 2 SPF OR BETTER WOOD POSTS MIN. 84x84 (SOLID). USE CORROSION RESISTANT SPIRAL NAILS OR SCREWS.
- A DECK IS NOT PERMITTED TO BE SUPPORTED ON BRICK VENEER.
- CANTILEVERED JOISTS AND BEAMS ARE LIMITED TO 1/6 THE MEMBERS LENGTH.
- CONCRETE PIERS SHALL BEAR ON UNDISTURBED SOIL. THE BEARING CAPACITY OF THE SOIL SHALL BE DETERMINED PRIOR TO CONSTRUCTION.
- MAXIMUM HEIGHT REFERS TO THE HEIGHT OF THE POST FROM THE TOP OF THE PIER TO THE DECK SURFACE.
- BEAMS WITH MORE THAN 2 MEMBERS MUST BE SUPPORTED BY 140x140 POSTS.
- THE ALLOWABLE SOIL BEARING PRESSURE SHALL BE REDUCED BY 50% WHILE THE WATER IS AT OR NEAR THE BOTTOM OF THE FOOTING EXCAVATION.
- CONTACT YOUR LOCAL BUILDING DEPARTMENT FOR FURTHER INFORMATION ABOUT LOCAL SOIL BEARING CAPACITIES.
- JOISTS SPANNING MORE THAN 2100mm ARE TO HAVE BRIDGING AT LEAST EVERY 2100mm O.C.


SAMPLE FLOOR PLAN

(EXAMPLE ONLY, REFER ALSO TO THE ONTARIO
BUILDING CODE AND STANDARD DETAILS)

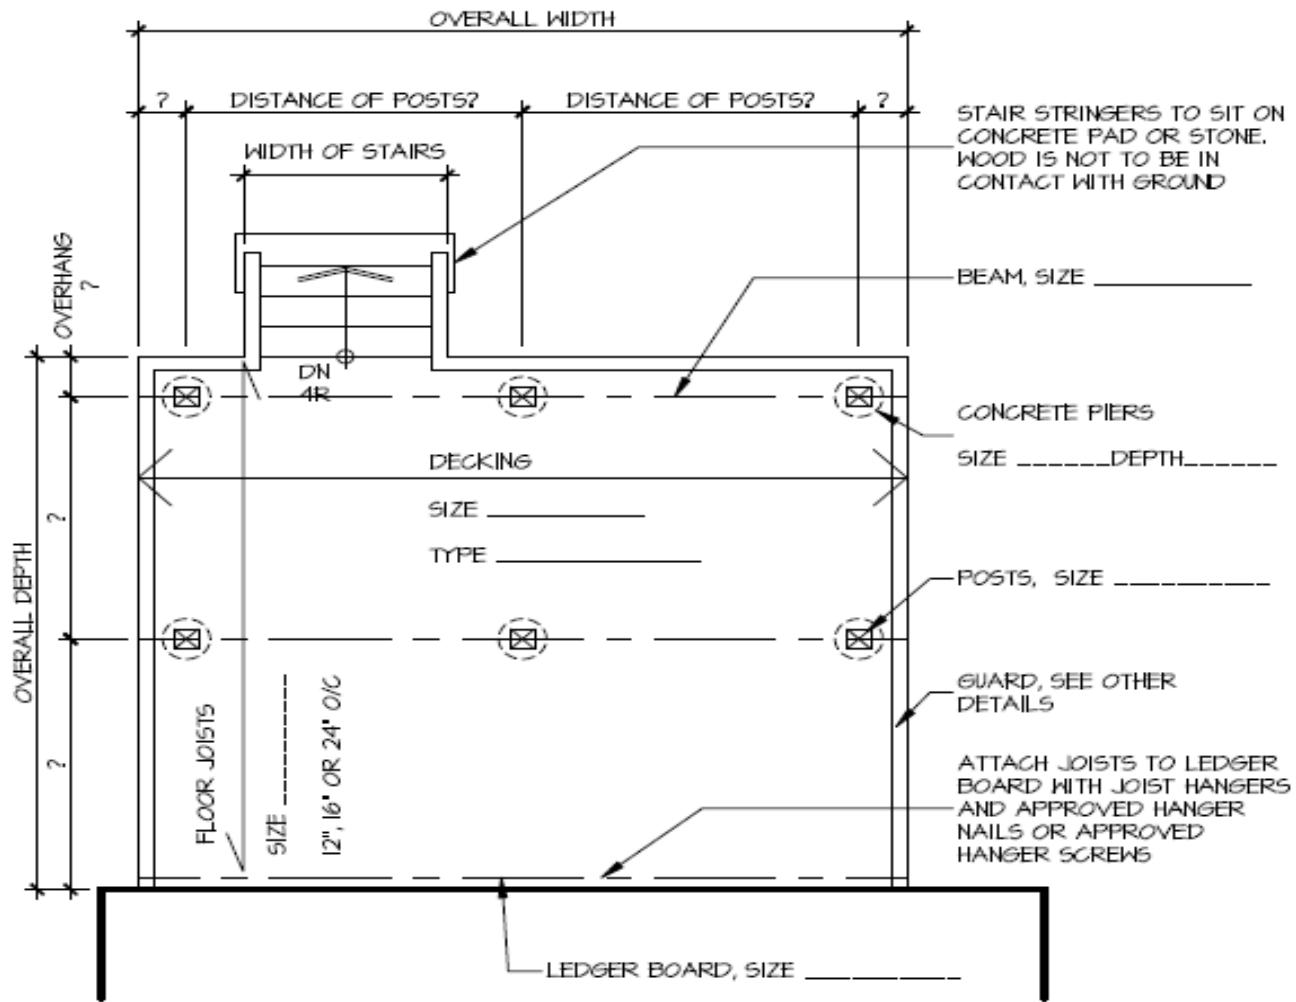


- * LEDGER BOARD TO BE ATTACHED TO HOUSE WITH MIN. 1/2" CONNECTORS AT MAX. 32" CENTRES
- * PROVIDE TYPE OF MATERIAL USED FOR STRUCTURE
- * PROVIDE TYPE OF MATERIAL USED FOR DECKINGS
- * PROVIDE TYPE OF MATERIAL USED FOR GUARD
- * GUARD REQUIRED AT ANY PORTION OF DECK THAT IS 24" ABOVE GRADE OR MORE


***LAG BOLT TO MASONRY VENEER IS NOT
CONSIDERD A STRUCTURAL CONNECTION**

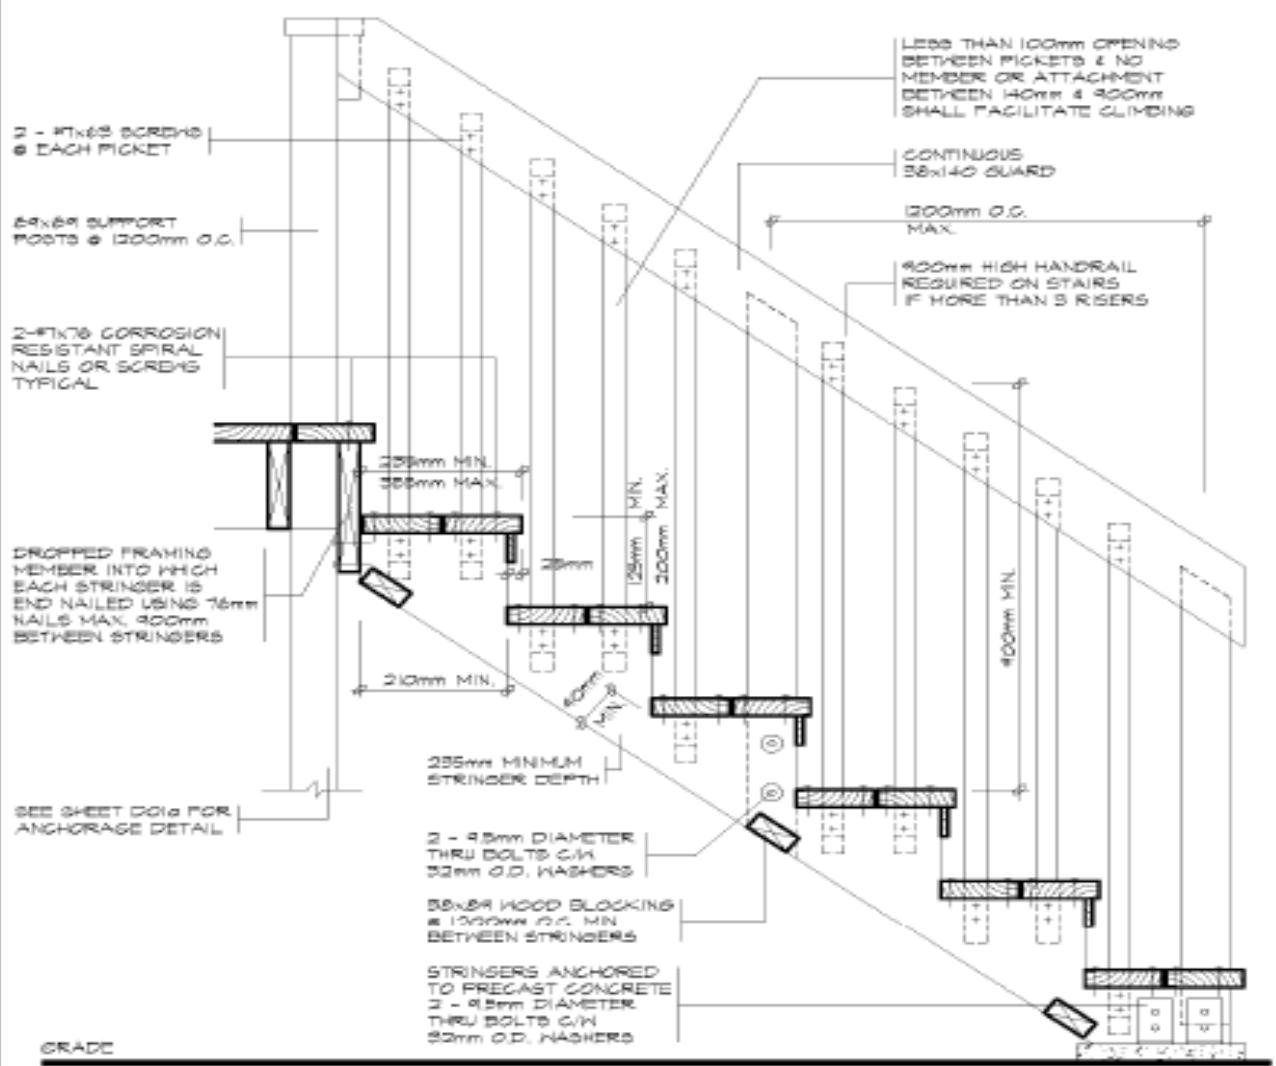

SECTION 'B'

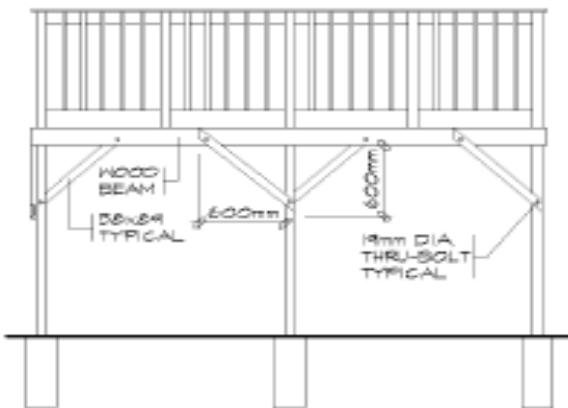

BRACING PARALLEL TO BEAM

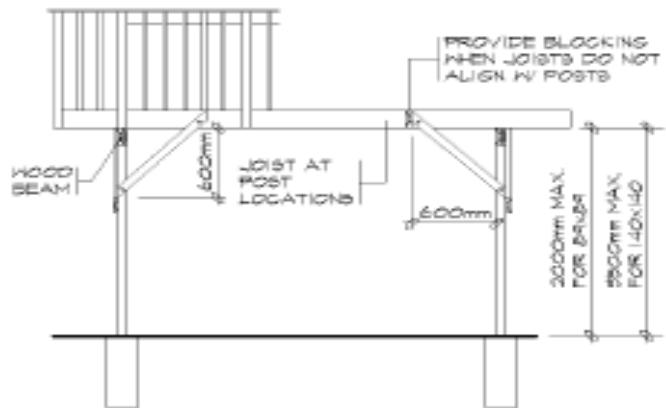

BRACING PERPENDICULAR TO BEAM

FREE STANDING DECKS GREATER THAN 600mm ABOVE GRADE SHALL RESIST LATERAL LOADING & MOVEMENT. ALL POSTS MUST BE BRACED WHERE THE SUPPORTED AREA EXCEEDS THOSE LISTED IN THE TABLE ON DOD4

SAMPLE SECTION

(EXAMPLE ONLY, REFER ALSO TO THE ONTARIO
BUILDING CODE AND
STANDARD DETAILS)

